



10. 2007 - 1:04pm smorgan  
 07/18/07 22:00:00 (from files received on 07/18/07)  
 07/19/07 22:00:00 (from files received on 07/19/07)  
 07/19/07 22:00:00 (from files received on 07/19/07)  
 07/19/07 22:00:00 (from files received on 07/19/07)  
 07/19/07 22:00:00 (from files received on 07/19/07)  
 07/19/07 22:00:00 (from files received on 07/19/07)  
 07/19/07 22:00:00 (from files received on 07/19/07)  
 07/19/07 22:00:00 (from files received on 07/19/07)  
 07/19/07 22:00:00 (from files received on 07/19/07)  
 07/19/07 22:00:00 (from files received on 07/19/07)

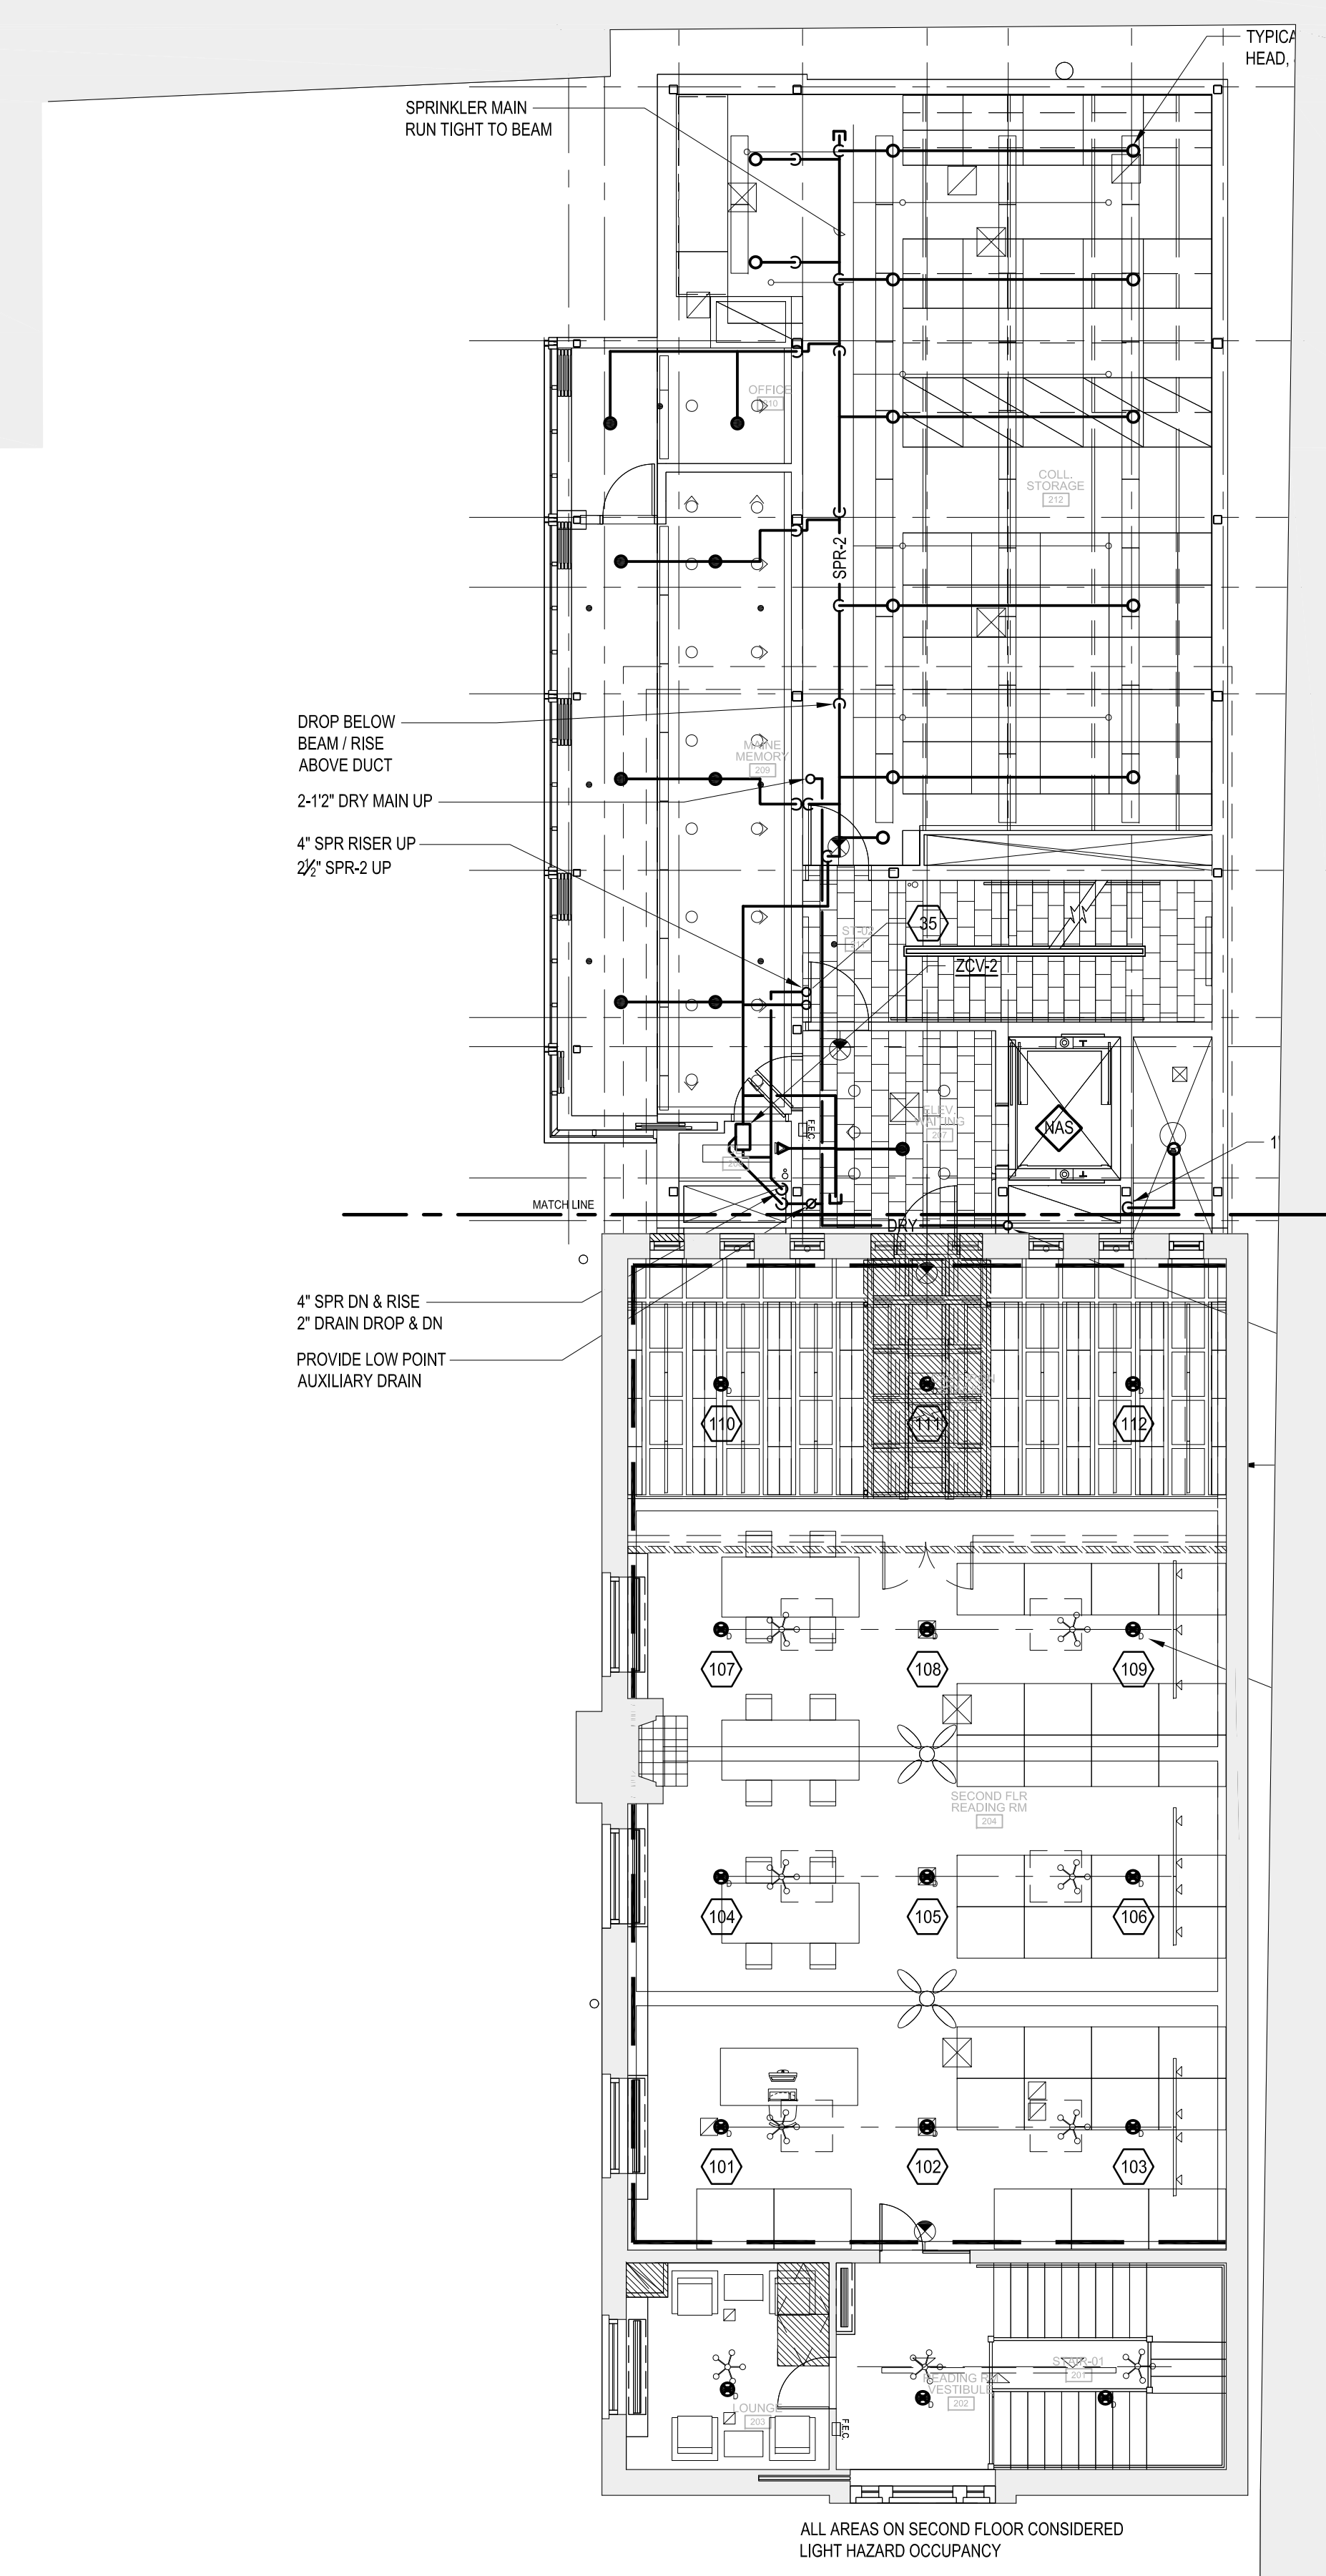

**1 Second Floor**  
 Scale: 1/8" = 1'-0"

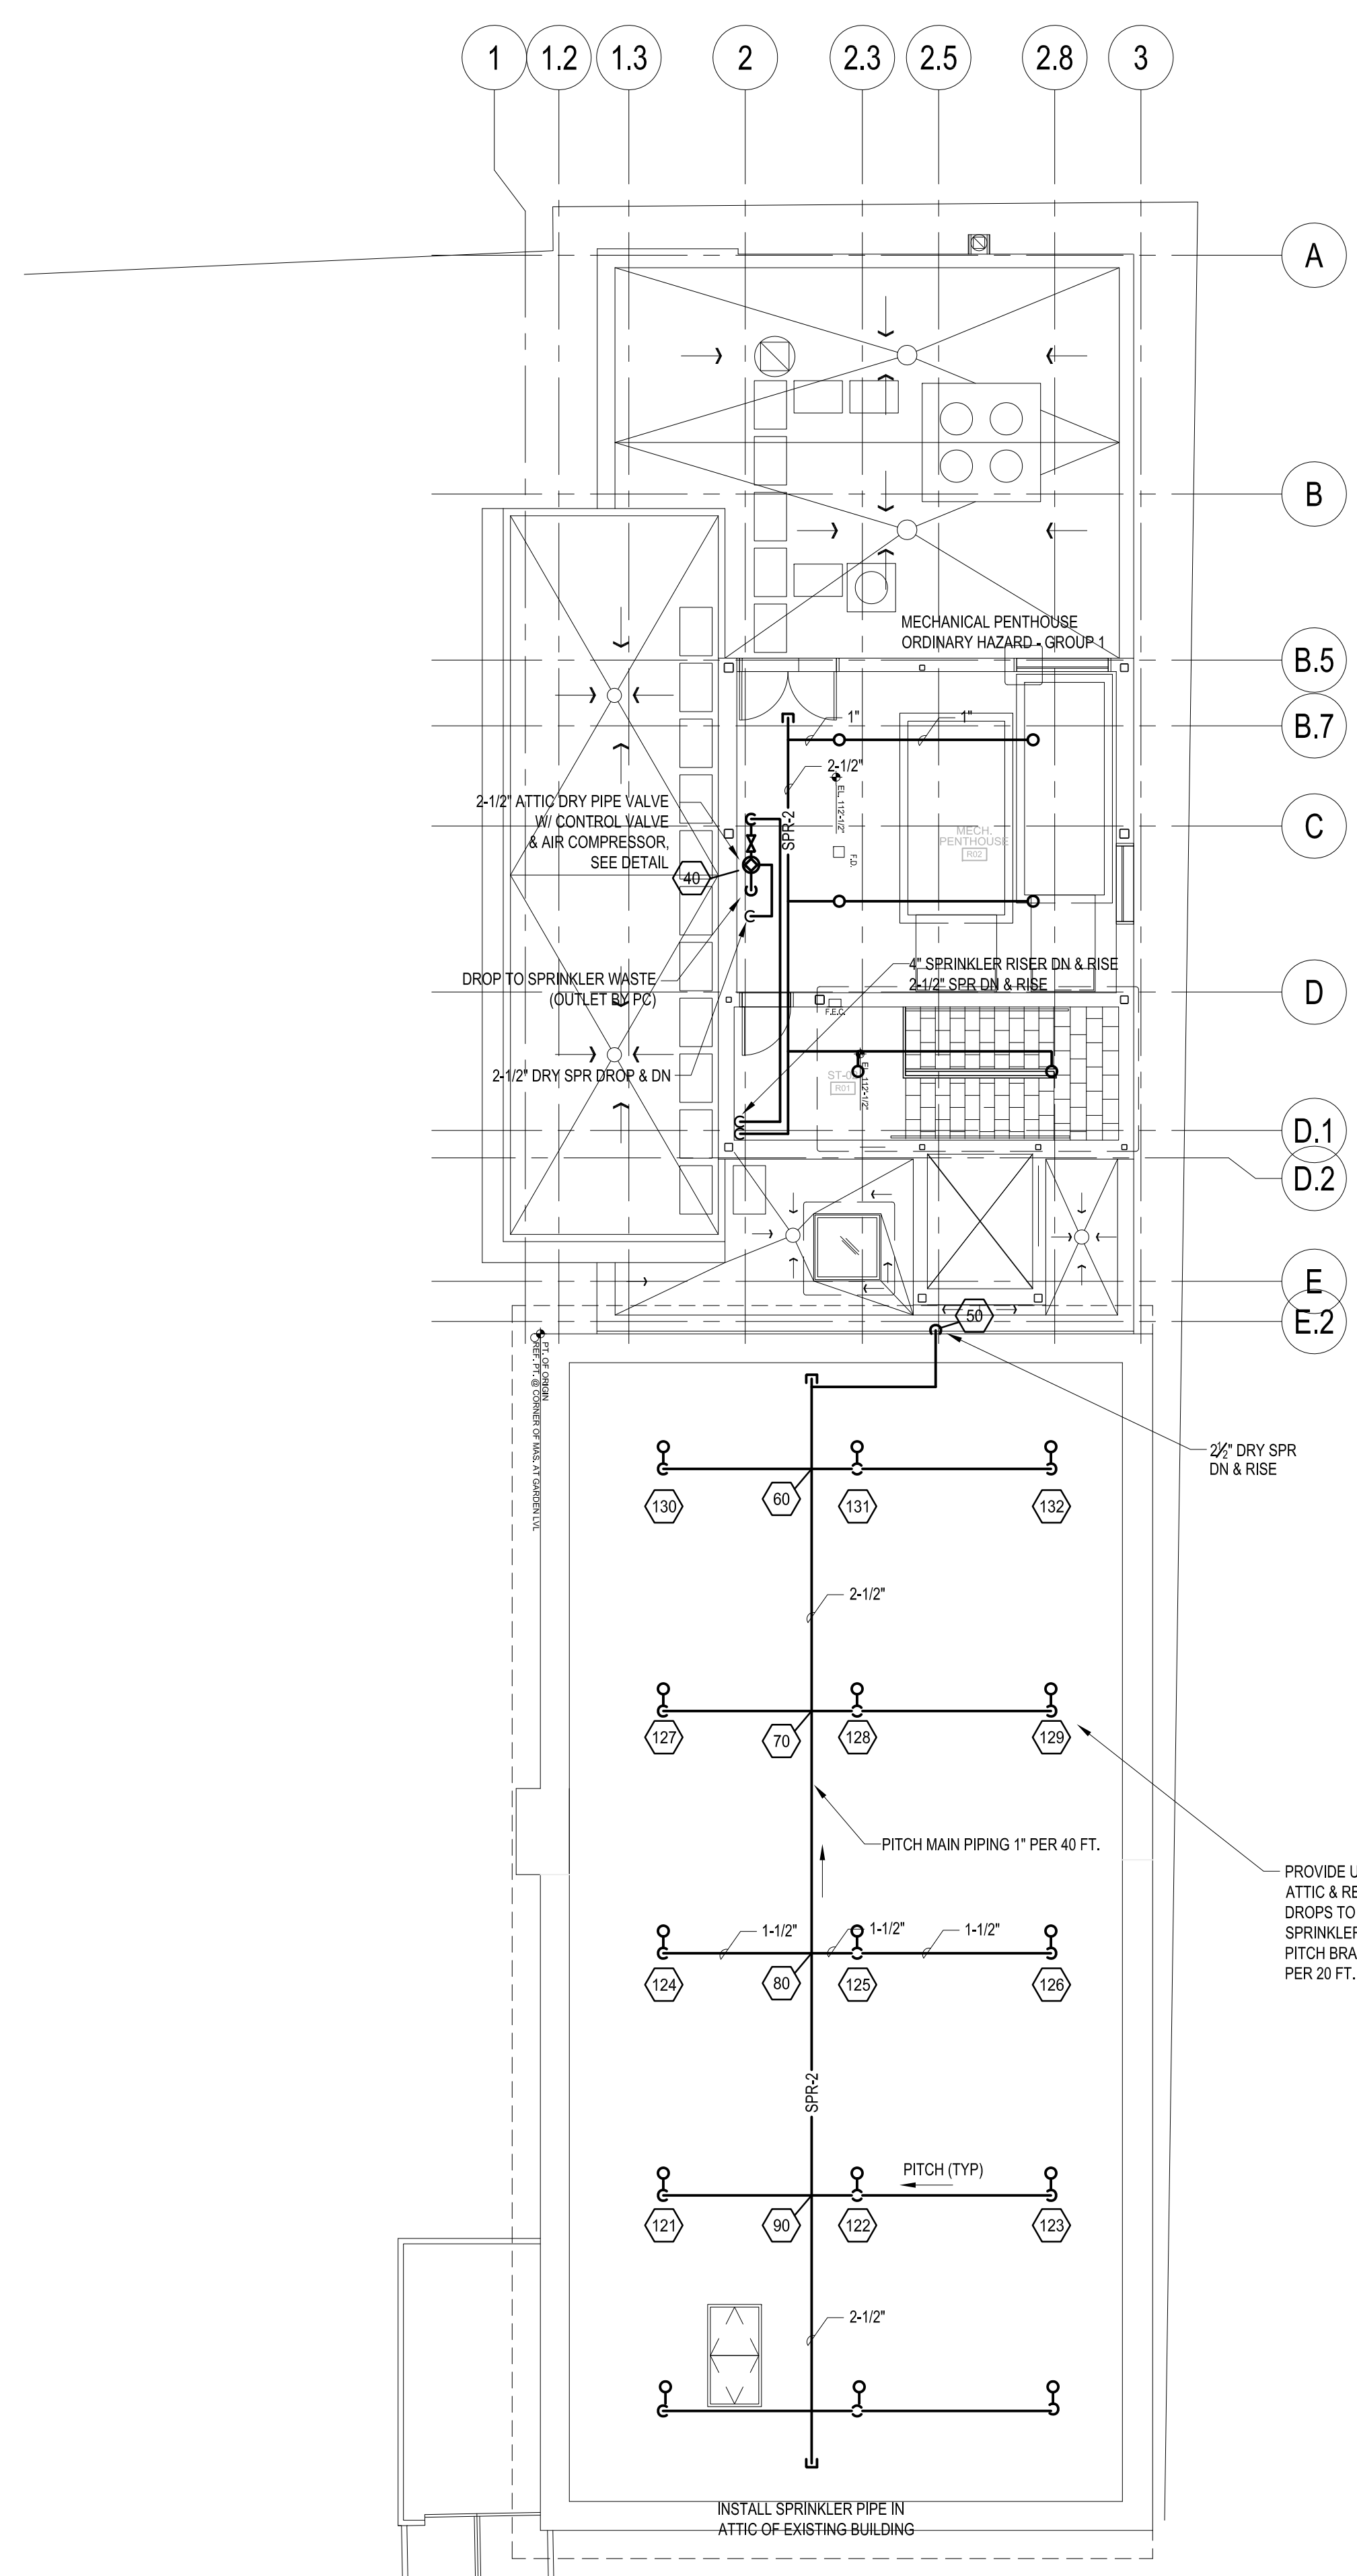

**1 Penthouse/Attic**  
 Scale: 1/8" = 1'-0"

NO FL. ATTIC  
 AREA OCCUPANCY  
 SQ. FT. OVER 1650 SQ. FT. (DRY SYSTEM)  
 4 @ 60 PSI AT CONNECTION CONGRESS STREET.  
 35 STREAM ALLOWANCE  
 7 PENDENT SPRINKLERS HANG ABOVE IN ATTIC SPACE

ALL AREAS ON SECOND FLOOR CONSIDERED LIGHT HAZARD OCCUPANCY

PROVIDE UPRIGHT HEADS IN ATTIC & RETURN BENDS AT DROPS TO DRY PENDENT SPRINKLERS; SEE DETAIL. PITCH BRANCH PIPING 1" PER 20 FT.

**CONSULTANTS**  
**SCHWARTZ / SILVER ARCHITECTS INC.**  
 52 Temple Place  
 Boston, MA 02111-1306  
 Telephone 617-542-6650  
 Facsimile 617-951-0779

**PROJECT**  
 MAINE HISTORICAL SOCIETY  
 489 CONGRESS ST.  
 PORTLAND, MAINE

DATE	REVISIONS	DESCRIPTION
05/01/07	60% CD SET	
07/02/07	100% CD REVIEW SET	
07/16/07	100% CD SET	

DATE	REVISIONS	DESCRIPTION
07/16/07	MAKS Drawn By	
07/16/07	SCA Reviewed By	
07/16/07	RDW Approved By	

**DRAWING NUMBER**  
 SECOND FLOOR PLAN / PENTHOUSE  
 Scale: 1/8" = 1'-0"

**FP1.03**  
 Sheet 4 of 4