

CROSS SECTION

- REFERENCE NOTES
- 1. BOLTING RECOMMENDATIONS---ALL HIGH STRENGTH BOLTS SHALL BE INSTALLED WITH HEAVY HEX NUTS AND ARE TO BE STALLED USING TORQUE TIGHT METHOD SPECIFIED IN THE SPECIFICATION. PUBLISHED TIGHTENING SPECIFICATIONS FOR ASTH A325 BOLTS, PUBLISHED TIGHTENING SPECIFICATIONS FOR A307 BOLTS, AND PUBLISHED TIGHTENING SPECIFICATIONS FOR A508 GR. C. D. OR D8 IN WELDED SUBSTITUTION WILL VOID THE DESIGN WARRANTY.
 - 2. BOLT AND NUT SPECIFICATIONS --- ALL BOLTS AND NUTS SHALL BE HIGH STRENGTH AND SHALL BE INSTALLED PER THE SPECIFICATIONS AND ASTM A325 OR SAE J429 FOR BOLTS, AND 200 FOR NUTS. ALL BOLTS AND NUTS SHALL BE SPECIFICATIONS AND ASTM A325, ASTM A193, OR ASTM A508 GR. C. D. OR D8 IN WELDED SUBSTITUTION WILL VOID THE DESIGN WARRANTY.
 - 3. ALL ELEVATION DIMENSIONS ARE TAKEN FROM BOTTOM OF FRAME COLUMN BASE PLATE. BASE OF COLUMN IS AT ELEVATION 100'-0".
 - 4. NECESSARY BRACING SHALL BE INTRODUCED WHEREVER NECESSARY TO MAINTAIN CARE OF ALL LOADS IMPOSED UPON THE STRUCTURE DURING THE ERECTION PROCESS.
 - 5. ALL DIMENSIONS ARE IN INCHES UNLESS OTHERWISE MARKED.
 - 6. ALL DRAWINGS ARE NOT TO SCALE.
 - 7. NOTE 'A' REFER TO GENERAL DETAILS AND SECTIONS FROM ROOF SHEET OVERHANG AND SPLICE LAP DIMENSIONS.
 - 8. FLANGE BRACES ARE REQUIRED ONLY ON ONE SIDE OF FRAME, EXCEPT THOSE FLANGE BRACES SHOWN WITH 'A' (2)1FB... ARE REQUIRED ON BOTH SIDES OF THE FRAME.
 - 9. EAVE HEIGHT DIMENSION IS NOT ALWAYS TO THE TOP OF EAVE SHEET BUT TO THE TOP OF THERMAL BLOCK SITUATIONS. DIMENSION MAY BE TO TOP OF GIRT SPACE OF THE PURLIN. REFER TO THE EAVE DETAILS FOR MORE INFORMATION.

SPLICE NO.	SIZE	DEPTH
A	10 - 3/4 X 2	2'-0"
B	12 - 3/4 X 1 1/2	2'-0"
C	12 - 3/4 X 1 1/2	2'-0"
D	10 - 3/4 X 1 1/2	1'-8"
E	12 - 3/4 X 1 1/2	1'-8"
F	10 - 3/4 X 2 1/2	1'-10"
G	4 - 1/2 X 2	8"
H	4 - 1/2 X 2	8"
I	4 - 1/2 X 2	8"

REVISIONS


NO.	DESCRIPTION
1	
2	
3	
4	

CHIEF BUILDINGS
 2007 RFB
 GRAND ISLAND, ME 04849-2073

BRADCO SUPPLY / BRADCO-WICKES LUMBER
 PORTLAND, ME
 RFM 178X200X16'-10 1:12 25' BAYS

DRANN CD 7-DEC-05
 CHECK ORDER NO. C51
 C084705
 (57)

FRAME: C084705(40)

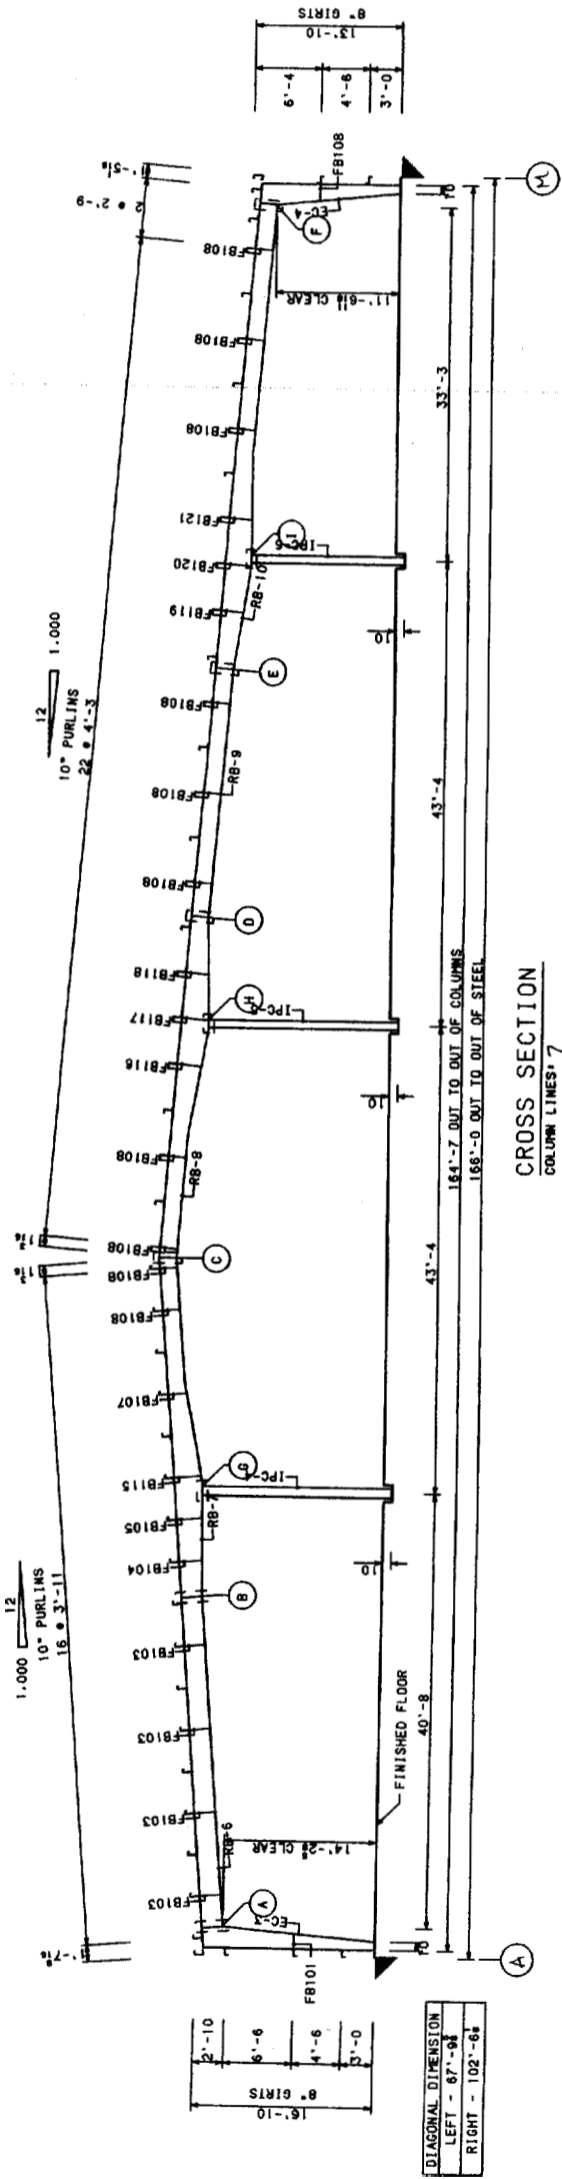

- REFERENCE NOTES
- BOLTING RECOMMENDATIONS--ALL HIGH STRENGTH BOLTS ARE A-325 WITH HEAVY HEX NUTS AND ARE TO BE INSTALLED USING THE SNUG TIGHT METHOD SPECIFIED IN THE SPECIFICATION FOR STRUCTURAL JOINTS USING HIGH STRENGTH BOLTS AND NUTS, DATED JUNE 30, 2004. SNUG TIGHT SHALL BE DEFINED AS THE FULL EFFORT OF AN IRON WORKER USING AN ORDINARY SPOD WRENCH TO BRING THE PLIES INTO FIRM CONTACT.
 - BOLT AND NUT SPECIFICATIONS -- ALL BOLTS AND NUTS SPECIFIED THROUGHOUT THESE DRAWINGS WILL BE HIGH STRENGTH BOLTS AND NUTS CONFORMING TO ASTM A325 OR SAE J429 GRADE 5 BOLT SPECIFICATIONS. IN SUBSTITUTION OF MILD STEEL BOLTS WILL NOT BE ALLOWED AND ANY FIELD SUBSTITUTION WILL VOID THE DESIGN WARRANTY.
 - ALL ELEVATION DIMENSIONS ARE TAKEN FROM BOTTOM OF FRAME COLUMN BASE PLATE. BASE OF COLUMN IS AT ELEVATION 100'-0".
 - TEMPORARY BRACING SHALL BE INTRODUCED WHEREVER NECESSARY TO SHARE OF ALL LOADS IMPOSED UPON THE STRUCTURE DURING THE ERECTION PROCESS.
 - ALL DIMENSIONS ARE IN INCHES UNLESS OTHERWISE MARKED.
 - ALL DRAWINGS ARE NOT TO SCALE.
 - NOTE 1. REFER TO GENERAL DETAILS AND SECTIONS FOR ROD END OVERHANG AND SPLICE LAP DIMENSIONS.
 - FLANGE BRACES ARE REQUIRED ONLY ON ONE SIDE OF FRAME, EXCEPT THOSE FLANGE BRACES THAT ARE PROVIDED WITH A (2)FB... ARE REQUIRED ON BOTH SIDES OF THE FRAME.
 - EAVE HEIGHT DIMENSION IS NOT ALWAYS TO THE TOP OF THE EAVE STUD. DUE TO THERMAL BLOCK SITUATIONS, ENGINEER DIMENSION AND TOP GIRT SPACE DIMENSION MAY BE DIFFERENT. REFER TO THE TOP OF THE PURLINS. REFER TO THE EAVE DETAILS FOR MORE INFORMATION.

SPLICE NO	SIZE	DEPTH
A	10 - 3 X 21	2'-0
B	12 - 3 X 13	2'-0
C	12 - 3 X 13	1'-8
D	10 - 3 X 13	1'-8
E	10 - 3 X 13	1'-8
F	8 - 1 X 31	1'-8
G	4 - 2 X 2	10"
H	4 - 2 X 2	8"
I	4 - 2 X 2	6"

REVISIONS


NOTWITHSTANDING THE ADJACENT SEAL, NEITHER THE ENGINEER NAMED NOR CHIEF BUILDING IS RECORDING AS THE ENGINEER OF RECORD. THE ENGINEER NAMED AND CHIEF BUILDING IS LIMITED RESPONSIBILITY IS LIMITED TO THE PRE-ENGINEERING OF THE COMPONENTS DESIGNED BY CHIEF BUILDING.

UNUSO DESIGN
 BRADCO SUPPLY / BRADCO-WICKES LUMBER
 PORTLAND, ME
 RFM 178X200X16'-10 1:12 25' BAYS

CHIEF BUILDING
 P.O. BOX 2074
 GRAND ISLAND, ME 04842-2074

DRAWN CD 7-DEC-05
 CHECK CD 7-DEC-05
 ORDER NO. C084705
 CSZ

FRAME: C084705-02

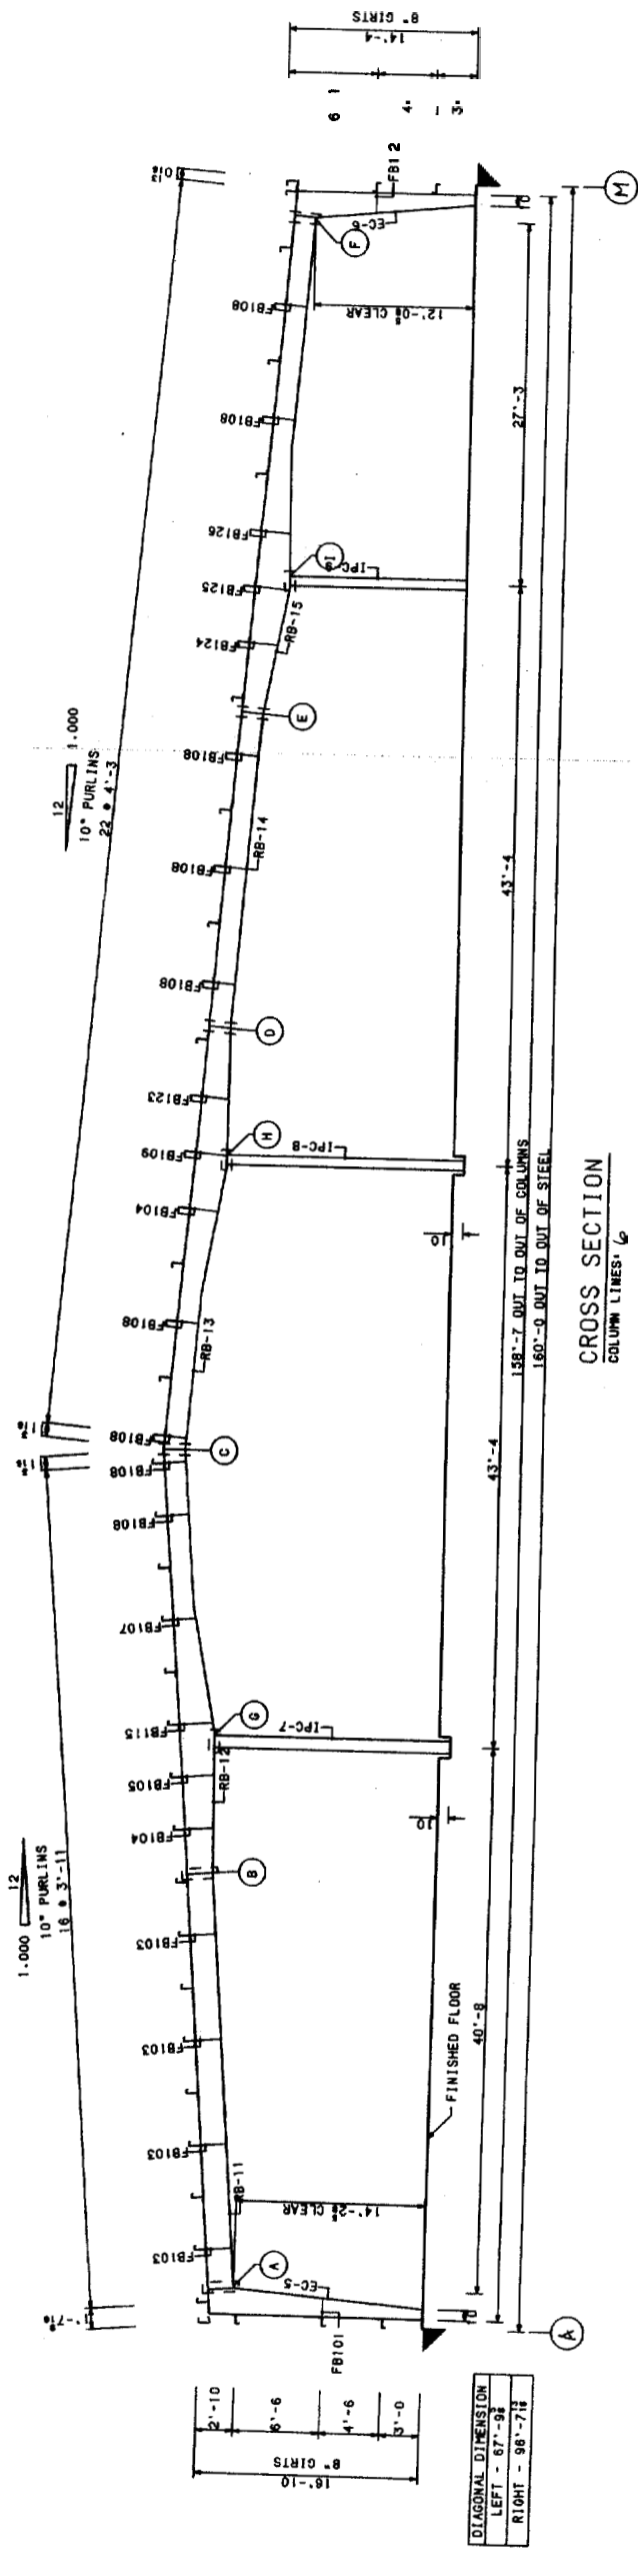

1. REFERENCE NOTES
 1. ALL DIMENSIONS ARE IN INCHES UNLESS OTHERWISE MARKED.
 2. ALL DIMENSIONS ARE NOT TO SCALE.
 3. NOTE REFER TO GENERAL DETAILS AND SECTIONS DIMENSIONS.
 4. FLANGE BRACES ARE REQUIRED ONLY ON ONE SIDE OF FRAME EXCEPT THOSE FLANGE BRACES THAT ARE STAGES OF THE FRAME.
 5. EAVE HEIGHT DIMENSION IS NOT ALWAYS TO THE TOP OF THE PLATE DUE TO THERMAL BLOCK SITUATIONS. EAVE HEIGHT DIMENSION TO THE INTERSECTION OF THE PURLINS. REFER TO THE EAVE DETAILS FOR MORE INFORMATION.
 6. TEMPORARY BRACING SHALL BE INTRODUCED WHEREVER NECESSARY TO TAKE CARE OF ALL LOADS APPLIED UPON E STRUCTURE DURING THE ERECTION PROCESS.
2. ALL DIMENSIONS ARE IN INCHES UNLESS OTHERWISE MARKED.
 3. NOTE REFER TO GENERAL DETAILS AND SECTIONS DIMENSIONS.
 4. FLANGE BRACES ARE REQUIRED ONLY ON ONE SIDE OF FRAME EXCEPT THOSE FLANGE BRACES THAT ARE STAGES OF THE FRAME.
 5. EAVE HEIGHT DIMENSION IS NOT ALWAYS TO THE TOP OF THE PLATE DUE TO THERMAL BLOCK SITUATIONS. EAVE HEIGHT DIMENSION TO THE INTERSECTION OF THE PURLINS. REFER TO THE EAVE DETAILS FOR MORE INFORMATION.
3. EAVE HEIGHT DIMENSION IS NOT ALWAYS TO THE TOP OF THE PLATE DUE TO THERMAL BLOCK SITUATIONS. EAVE HEIGHT DIMENSION TO THE INTERSECTION OF THE PURLINS. REFER TO THE EAVE DETAILS FOR MORE INFORMATION.
4. TEMPORARY BRACING SHALL BE INTRODUCED WHEREVER NECESSARY TO TAKE CARE OF ALL LOADS APPLIED UPON E STRUCTURE DURING THE ERECTION PROCESS.

SPLICE BOLT TABLE		
SPLICE	NO	DEPTH
A	10 - 3 X 21	2'-0"
B	12 - 3 X 13	2'-0"
C	12 - 3 X 13	1'-8"
D	10 - 3 X 11	1'-8"
E	10 - 3 X 13	1'-8"
F	B - 1 X 31	1'-8"
G	4 - 2 X 2	10"
H	4 - 2 X 2	8"
I	4 - 2 X 2	8"

REVISIONS


NOTWITHSTANDING THE ADJACENT SEAL, NEITHER THE ENGINEER NAMED, NOR CHIEF BUILDINGS IS RESPONSIBLE FOR THE DESIGN OF THE BUILDING. THE ENGINEER NAMED AND CHIEF BUILDINGS IS LIMITED TO THE STRUCTURAL PERFORMANCE OF THE PRE-ENGINEERED COMPONENTS DESIGNED BY CHIEF BUILDINGS.

CHIEF BUILDINGS
 3000 JEFFERSON
 BRADCO SUPPLY / BRADCO-WICKES LUMBER
 PORTLAND, ME
 RFM 178X200X16'-10 1:12 25' BAYS

DRANN	CHECK
CD	

FRAME 008-1705-03

04/27/09

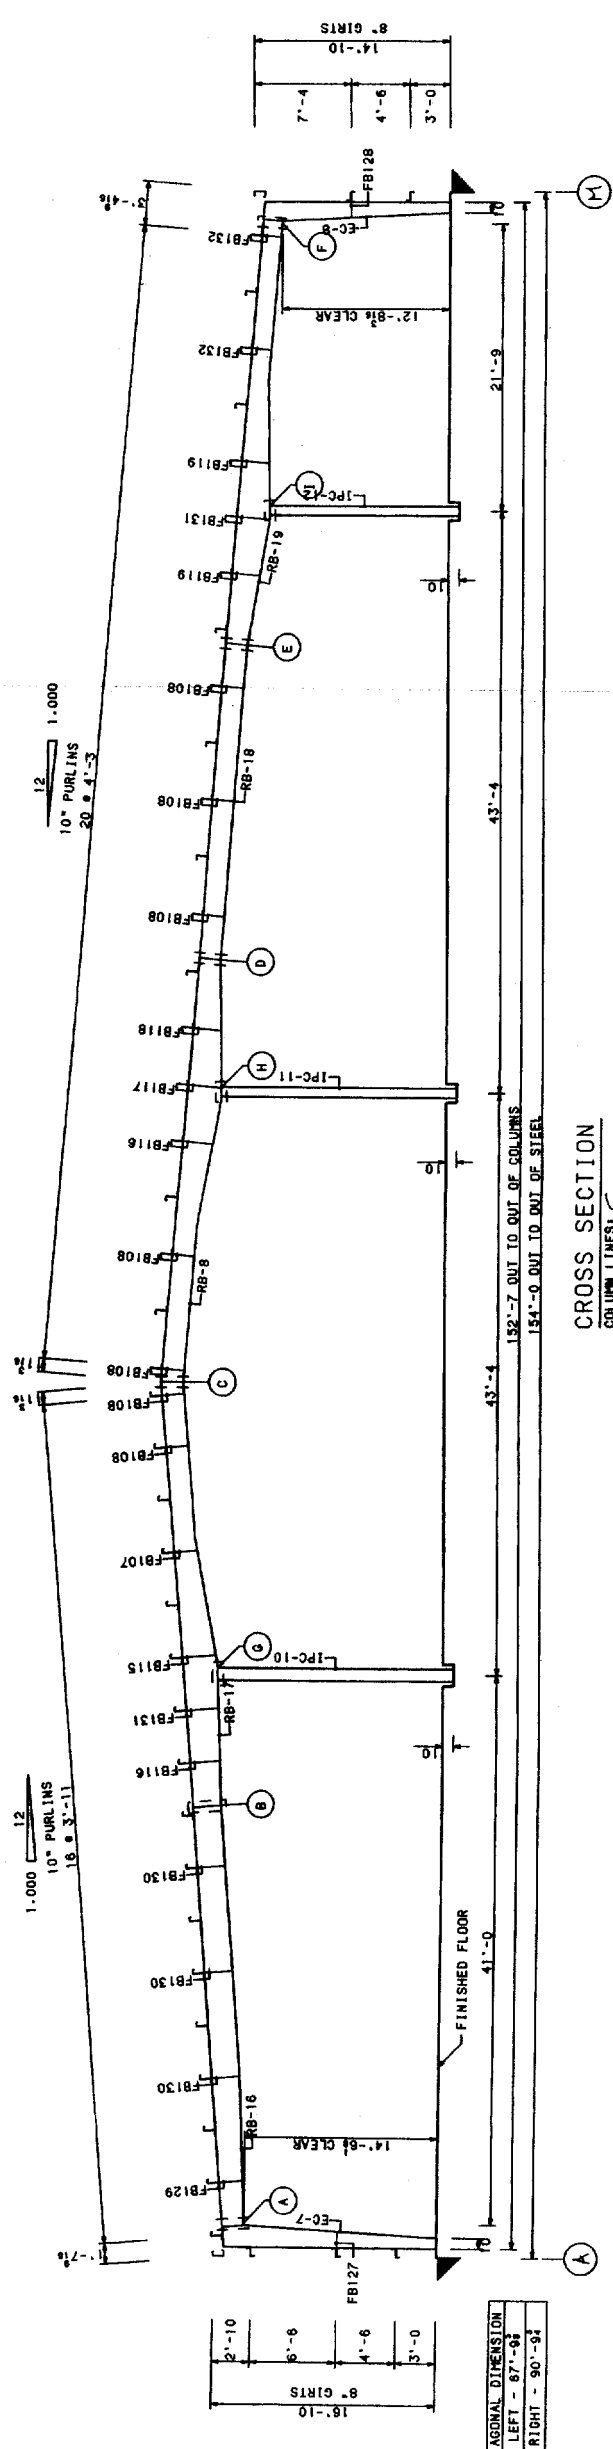

CROSS SECTION
COLUMN LINES 5

- REFERENCE NOTES
- BOLTING RECOMMENDATIONS---ALL HIGH STRENGTH BOLTS SHALL BE INSTALLED WITH HEX NUTS AND ARE TO BE INSTALLED WITH THE SAME STRENGTH AS THE BOLTS. THE SPECIFICATION FOR STRUCTURAL JOINTS LISTED IN ASTM A325 BOLTS, PUBLISHED BY AISC, DATED JUNE 30, 2004, SHALL BE USED UNLESS OTHERWISE NOTED. FULL EFFORT OF ALL BOW NUTS IS TO BE MAINTAINED. SPUD WRENCH TO BRING THE PILES INTO FIRM CONTACT.
 - BOLT AND NUT SPECIFICATIONS --- ALL BOLTS AND NUTS SHALL BE HIGH STRENGTH UNLESS OTHERWISE NOTED. ALL BOLTS AND NUTS SHALL BE FURNISHED TO ASTM A325 OR SAE J429 GRADE 5, BOLT SPECIFICATIONS AND ASTM A325, ASTM A194 GRADE 2 OR 2H, OR ASTM A583 GRADE C, D, OR DH NUT SPECIFICATIONS. SUBSTITUTION OF MILD STEEL BOLTS SHALL BE PERMITTED ONLY IN FIELD SUBSTITUTION WILL VOID THE DESIGN WARRANTY.
 - ALL ELEVATION DIMENSIONS ARE TAKEN FROM BOTTOM OF FRAME COLUMN BASE PLATE. BASE OF COLUMN IS AT ELEVATION 100'-0".
 - TEMPORARY BRACING SHALL BE INTRODUCED WHEREVER NECESSARY TO TAKE CARE OF ALL LOADS IMPOSED UPON THE STRUCTURE DURING THE ERECTION PHASE.

- ALL DIMENSIONS ARE IN INCHES UNLESS OTHERWISE MARKED.
- ALL DRAWINGS ARE NOT TO SCALE.
- NOTE 1 * REFER TO GENERAL DETAILS AND SECTIONS FOR ROOF SHEET OVERHANG AND SPLICE LAP DIMENSIONS.
- FLANGE BRACES ARE REQUIRED ONLY ON ONE SIDE OF THE EAVE STRUT. EXCEPT THOSE FLANGE BRACES THAT ARE PRECEDED WITH A (2)FB... ARE REQUIRED ON BOTH SIDES OF THE FRAME.
- EAVE HEIGHT DIMENSION IS NOT ALWAYS TO THE TOP OF THE EAVE STRUT. DUE TO THERMAL BLOCK SITUATIONS, EAVE HEIGHT DIMENSION AND TOP GIRT SPACE DIMENSION MAY BE TO THE INTERSECTION OF THE TOP DIMENSION. REFER TO THE EAVE DETAILS FOR MORE INFORMATION.

SPLICE BOLT TABLE		
SPLICE	NO	DEPTH
A	6 - 1/2 X 3/4	1'-8"
B	14 - 1/2 X 1/2	2'-2"
C	12 - 1/2 X 1/2	1'-8"
D	10 - 1/2 X 1/2	1'-8"
E	10 - 1/2 X 1/2	1'-8"
F	6 - 1/2 X 1/2	1'-8"
G	4 - 1/2 X 2	10"
H	4 - 1/2 X 2	8"
I	4 - 1/2 X 2	8"

REVISIONS

NOTWITHSTANDING THE ADJACENT SEAL, NEITHER THE ENGINEER IS MADE NOR CHIEF BUILDINGS IS ACTING AS THE ENGINEER OF RECORD. THE ENGINEER NAMED AND CHIEF BUILDINGS LIMITED RESPECTS ITS LIABILITY LIMITED TO THE STRUCTURAL PERFORMANCE OF THE PRE-ENGINEERED COMPONENTS DESIGNED BY CHIEF BUILDINGS.


CROSS SECTION
BRADCO SUPPLY / BRADCO-WICKES LUMBER
PORTLAND, ME
RFM 178X200X16'-10 1:12 25' BAYS

CHIEF BUILDINGS
P.O. BOX 2078
PORTLAND, ME 04102-2078

DRAWN	CHECK	ORDER NO.
CD		C084705
7-DEC-05		

CSA

FRAME C084705A04

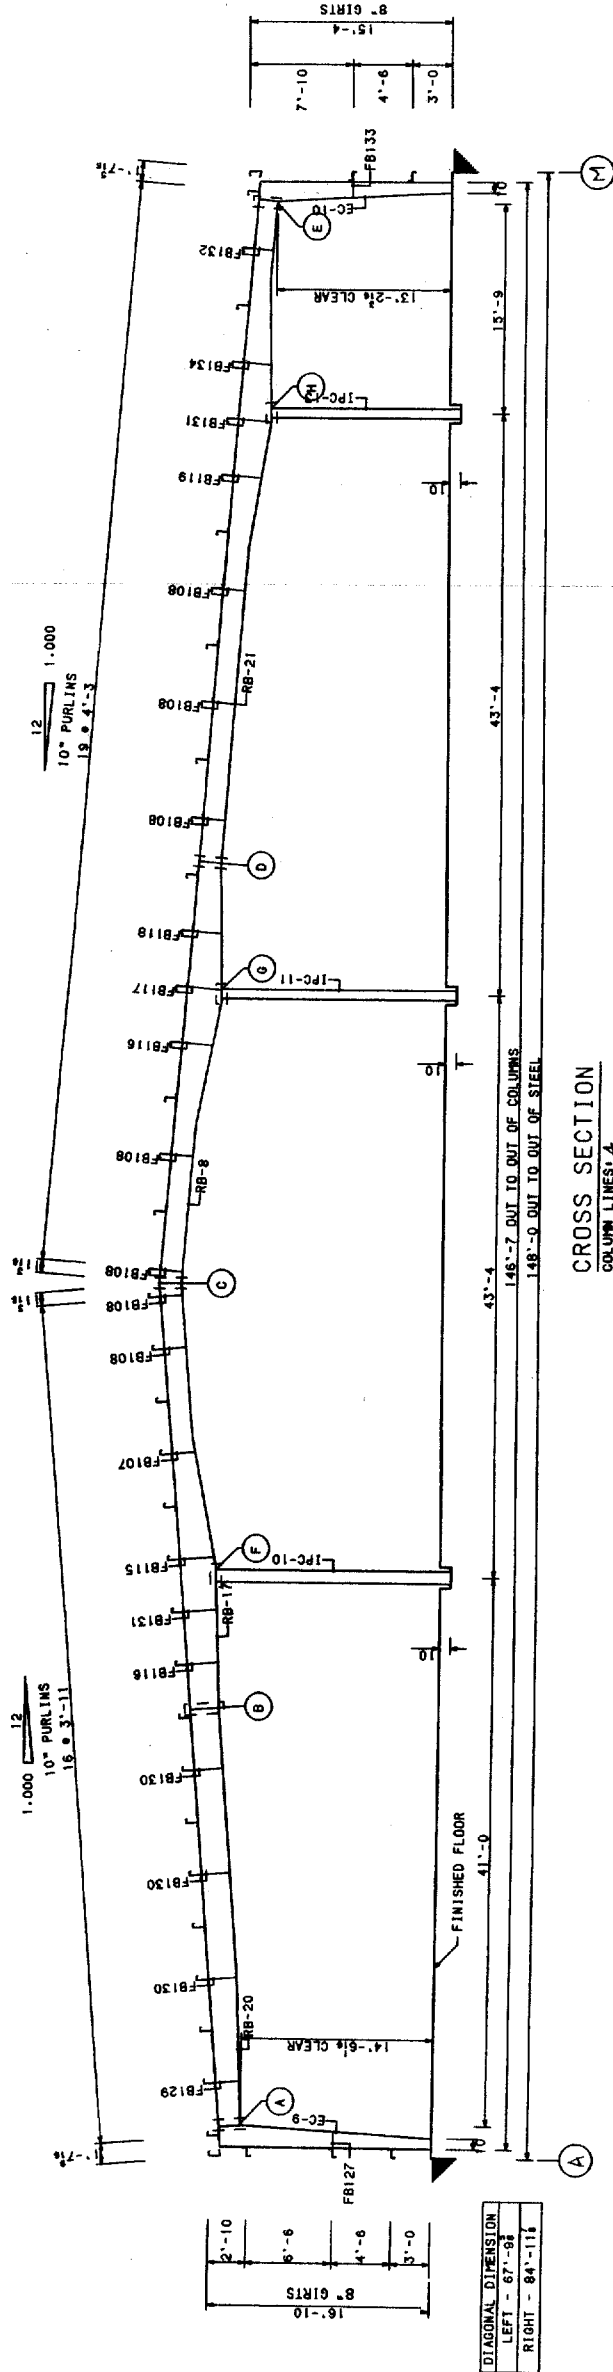

CROSS SECTION
COLUMN LINES 4

- REFERENCE NOTES
- BOLTING RECOMMENDATIONS--ALL HIGH STRENGTH BOLTS ARE A-325 WITH HEAVY HEX NUTS AND ARE TO BE INSTALLED USING THE SNUG TIGHT METHOD SPECIFIED IN THE SPECIFICATION FOR STRUCTURAL JOINTS USING HIGH STRENGTH BOLTS AND NUTS, DATED JUNE 20, 2004. SNUG TIGHT SHALL BE ACHIEVED WITH A FEW IMPACTS OF AN IMPACT WRENCH OR A SPUD WRENCH TO BRING THE PLIES INTO FIRM CONTACT.
 - BOLT AND NUT SPECIFICATIONS --- ALL BOLTS AND NUTS SPECIFIED THROUGHOUT THESE DRAWINGS WILL BE HIGH STRENGTH BOLTS AND NUTS CONFORMING TO ASTM A325 OR SAE J429 GRADE 5 BOLT OR 2 OR 2 1/2 OR ASTM A325, ASTM A325, ASTM A325 OR 2 OR 2 1/2 OR ASTM A325, ASTM A325. ALL BOLTS WILL NOT BE ALLOWED AND ANY FIELD SUBSTITUTION WILL VOID THE DESIGN WARRANTY.
 - ALL ELEVATION DIMENSIONS ARE TAKEN FROM BOTTOM OF FRAME COLUMN BASE PLATE. BASE OF COLUMN IS AT ELEVATION 100'-0".
 - TEMPORARY BRACING SHALL BE INTRODUCED WHEREVER NECESSARY TO MAINTAIN THE STRUCTURE UNDER ALL LOADS IMPOSED UPON THE STRUCTURE DURING THE ERECTION PROCESS.

SPLICE NO	SIZE	DEPTH
A	8 - 1 X 3/4	11'-8"
B	14 - 1 X 1 1/2	2'-2"
C	12 - 1 X 1 1/2	1'-8"
D	10 - 1 X 1 1/2	1'-8"
E	6 - 1 1/2 X 4	1'-6"
F	4 - 1 X 2	10"
G	4 - 1 X 2	8"
H	4 - 1 X 2	8"

REVISIONS


NOTWITHSTANDING THE ADJACENT SEAL, NEITHER THE ENGINEER NAMED NOR CHIEF BUILDINGS IS ACTING AS THE ENGINEER OF RECORD FOR THE BUILDING NAMED RESPONSIBILITY IS LIMITED TO THE STRUCTURAL PERFORMANCE OF THE PRE-ENGINEERED COMPONENTS DESIGNED BY CHIEF BUILDINGS.

CROSS SECTION
BRADCO SUPPLY / BRADCO-WICKES LUMBER
PORTLAND, ME
RFM 178X200X16'-10 1:12 25' BAYS

CHIEF BUILDINGS
P.O. BOX 2075
ORLAND ME, ME 04552-2075

DRAWN	CHECK	ORDER NO.
CD		C084705
7-DEC-03		

CS5

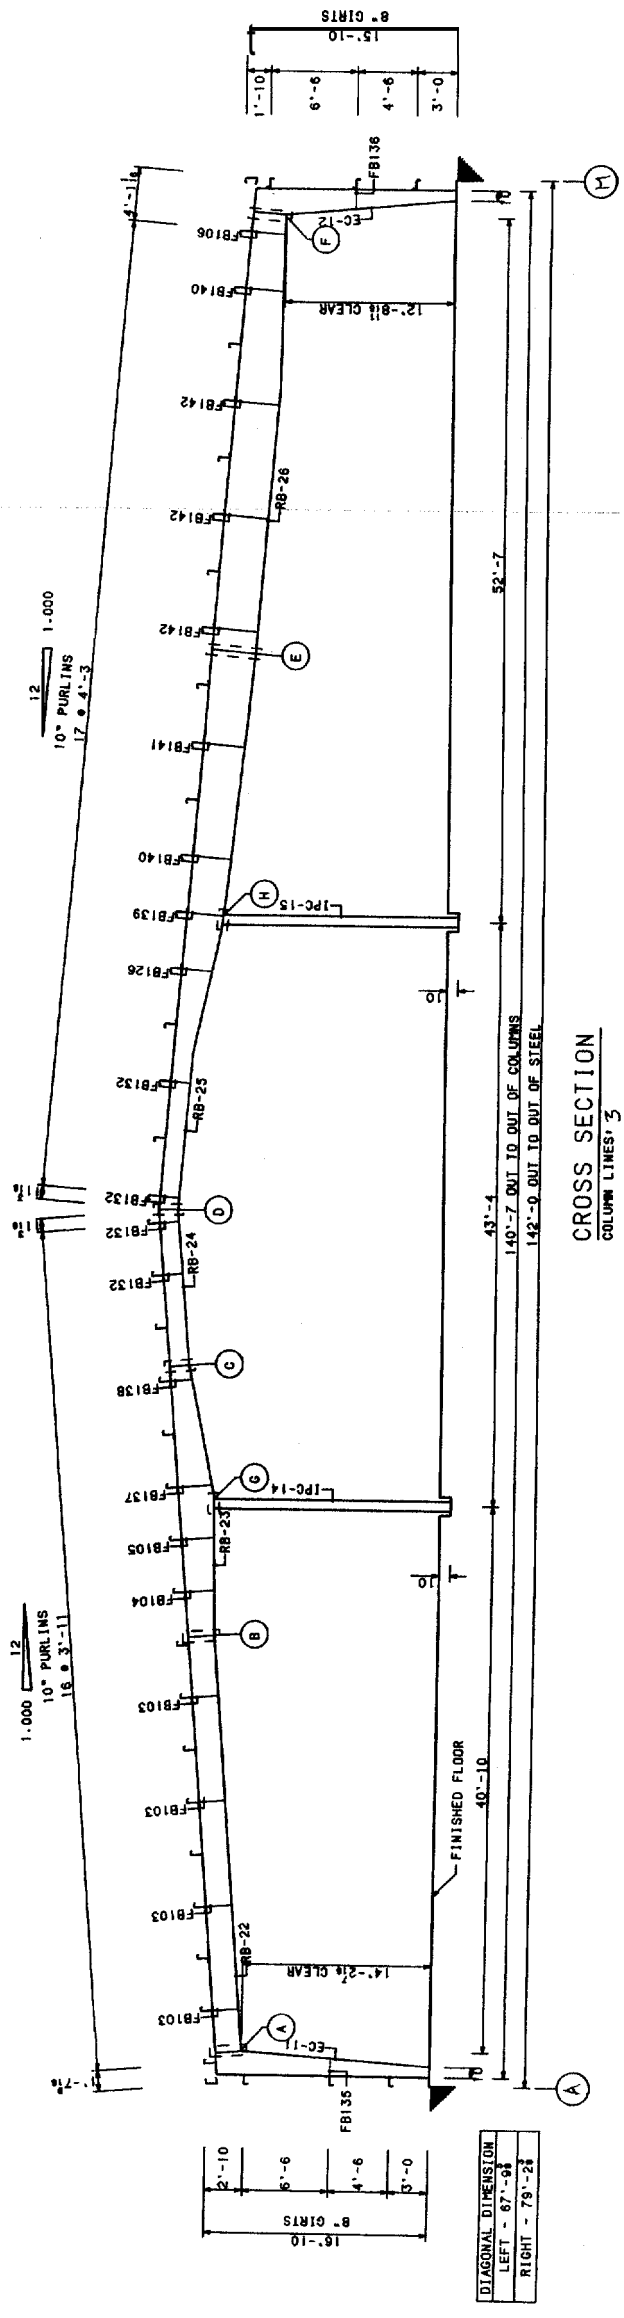

BRADCO SUPPLY / BRADCO-WICKES LUMBER
 PORTLAND, ME
 RFM 178X200X16'-10 1:12 25' BAYS

DRAWN CD
 CHECK CD
 7-DEC-05

ORDER NO. C56
 C084705

CHIEF
 BUILDINGS
 P.O. BOX 3078
 BRAND ISLAND, ME 05805-2078

NOTWITHSTANDING THE ADJACENT SEAL NEAR THE JOINTS, CHIEF BUILDINGS IS NOT RESPONSIBLE FOR THE PERFORMANCE OF THE STRUCTURE REFERRED TO BY THIS DRAWING. THE PERFORMANCE OF THE STRUCTURE REFERRED TO BY THIS DRAWING IS LIMITED TO THE PERFORMANCE OF THE COMPONENTS DESIGNED BY CHIEF BUILDINGS.

REVISIONS


NO.	DATE	DESCRIPTION
1		
2		
3		
4		

SPLICE BOLT TABLE

SPLICE	NO.	SIZE	DEPTH
A	10	3 X 2 1/2	2'-0
B	12	8 X 1 1/2	2'-0
C	8	8 X 1 1/2	1'-6
D	8	8 X 1 1/2	1'-6
E	14	3 X 2 1/2	3'-4
F	10	3 X 2 1/2	2'-6
G	4	3 X 2	3'-4

- REFERENCE NOTES
- BOLTING RECOMMENDATIONS--ALL HIGH STRENGTH BOLTS ARE A-325 WITH HEAVY HEX NUTS AND ARE TO BE INSTALLED USING THE SING TIGHT METHOD SPECIFIED IN THE SPECIFICATION FOR STRUCTURAL JOINTS USING HIGH STRENGTH BOLTS, PUBLISHED BY AISC, DATED JUNE 3, 2003. THE FOLLOWING INFORMATION IS OBTAINED WITH A FEW IMPACTS OF AN IMPACT WRENCH AN ORDINARY SPUD WRENCH TO BRING THE PLIES INTO FIRM CONTACT.
 - BOLT AND NUT SPECIFICATIONS -- ALL BOLTS AND NUTS SPECIFIED THROUGHOUT THESE DRAWINGS WILL BE HIGH STRENGTH BOLTS AND NUTS CONFORMING TO ASTM A325 OR SAE J429 GRADE 5 BOLT OR 2024-T3 ALUMINUM SUBSTITUTION. D. OR DR NUT SPECIFICATIONS WILL NOT BE ALLOWED AND ANY FIELD SUBSTITUTION WILL VOID THE DESIGN WARRANTY.
 - ALL ELEVATION DIMENSIONS ARE TAKEN FROM BOTTOM OF FRAME COLUMN BASE PLATE. BASE OF COLUMN IS AT ELEVATION 100'-0".
 - TEMPORARY BRACING SHALL BE INTRODUCED WHEREVER NECESSARY TO MAINTAIN THE STRUCTURE DURING THE ERECTION PROCESS.
 - ALL DIMENSIONS ARE IN INCHES UNLESS OTHERWISE MARKED.
 - ALL DRAWINGS ARE NOT TO SCALE.
 - NOTE 1 - REFER TO GENERAL DETAILS AND SECTIONS FOR ROOF SHEET OVERHANG AND SPLICE LAP DIMENSIONS.
 - FLANGE BRACES ARE REQUIRED ONLY ON ONE SIDE OF FRAME, EXCEPT THOSE FLANGE BRACES THAT ARE PRECEDED WITH A (2)FB... ARE REQUIRED ON BOTH SIDES OF THE FRAME.
 - EAVE HEIGHT DIMENSION IS NOT ALWAYS TO THE TOP OF THE EAVE STRUT. DUE TO THERMAL BLOCK SITUATIONS, EAVE HEIGHT DIMENSION AND TOP GIRL SPACE DIMENSION MAY BE DIFFERENT. REFER TO THE TOP OF THE PURLINS. REFER TO THE EAVE DETAILS FOR MORE INFORMATION.

FRAME-008-178X200

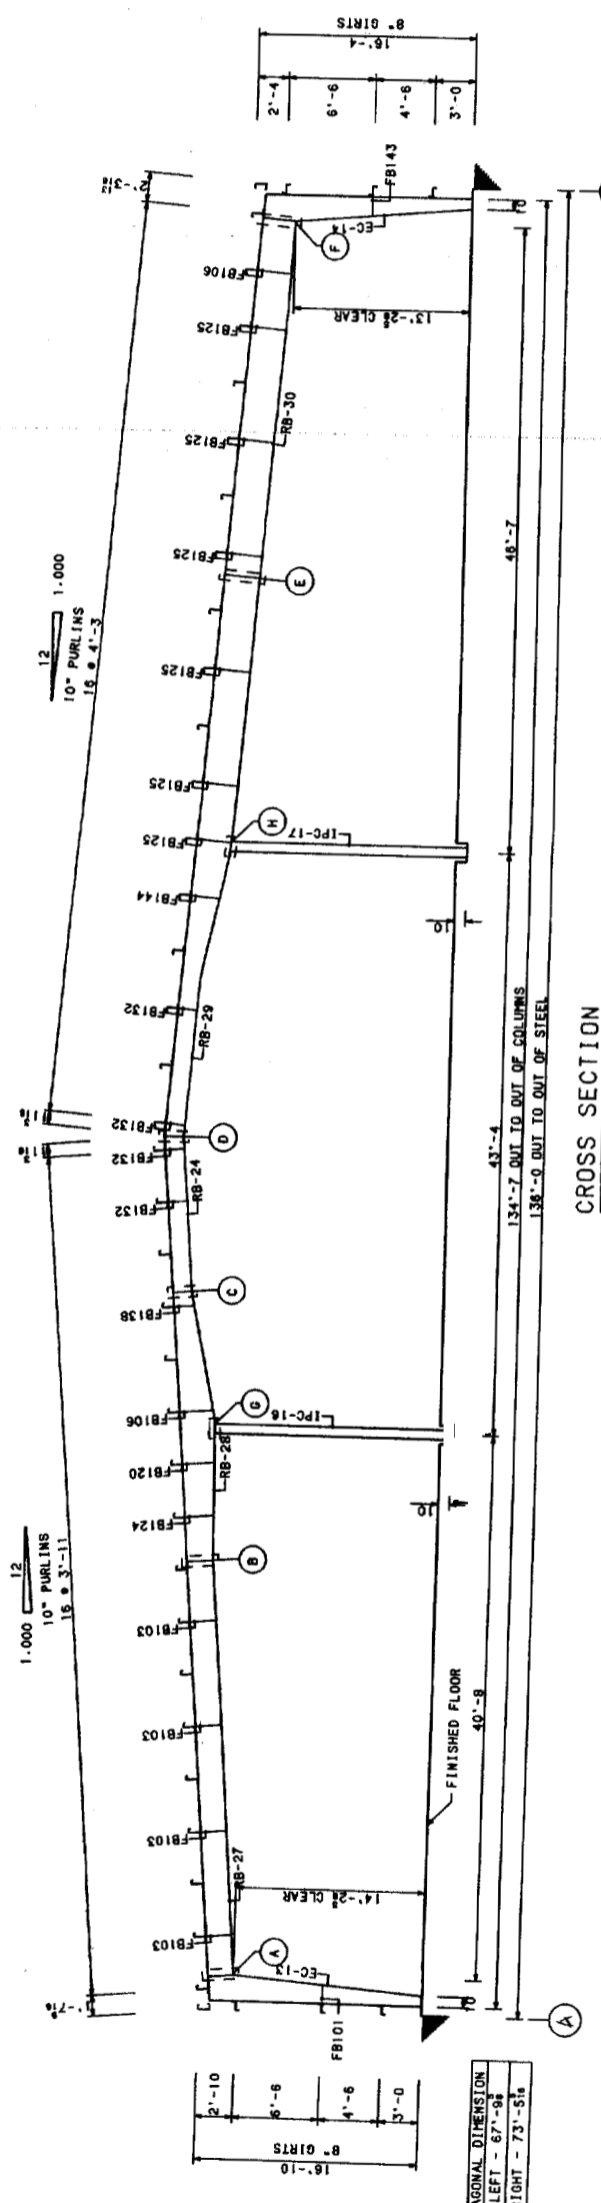

REFERENCE NOTES

- BOLTING RECOMMENDATIONS---ALL HIGH STRENGTH BOLTS ARE A-325 WITH HEAVY HEX NUTS AND ARE TO BE INSTALLED USING THE SNUG TIGHT METHOD SPECIFIED IN SECTION 5.10.3.1 FOR STRUCTURAL JOINTS USING ASTM A325 BOLTS. SNUG TIGHT SHALL BE DETERMINED BY THE CONTRACTOR. THIS METHOD IS DESCRIBED IN THE MANUAL OF METRIC PRACTICES, DATED JUNE 30-2004. SNUG TIGHT SHALL BE ACHIEVED WITH A FEW IMPACTS OF AN IMPACT WRENCH OR THE EFFORT OF AN IRON WORKER USING AN ORDINARY SPUD WRENCH TO BRING THE PLIES INTO FIRM CONTACT.
- BOLT AND NUT SPECIFICATIONS---ALL BOLTS AND NUTS SPECIFIED THROUGHOUT THESE DRAWINGS SHALL BE HIGH STRENGTH BOLTS AND NUTS CONFORMING TO THE REQUIREMENTS OF SAE J429 GRADE 5 BOLT SPECIFICATIONS AND SAE J429 GRADE 5 NUT SPECIFICATIONS. SUBSTITUTION OF HIGH STRENGTH BOLTS AND NUTS SHALL BE ALLOWED AND ANY FIELD SUBSTITUTION WILL VOID THE DESIGN WARRANTY.
- ALL ELEVATION DIMENSIONS ARE TAKEN FROM BOTTOM OF FRAME COLUMN BASE PLATE. BASE OF COLUMN IS AT ELEVATION 100'-0".
- TEMPORARY BRACING SHALL BE INTRODUCED WHEREVER NECESSARY TO TAKE CARE OF ALL LOADS APPLIED UPON THE STRUCTURE DURING THE ERECTION PROCESS.
- ALL DIMENSIONS ARE IN INCHES UNLESS OTHERWISE MARKED.
- ALL DRAWINGS ARE NOT TO SCALE.
- NOTE 1 - REFER TO GENERAL DETAILS AND SECTIONS FOR ROOF SHEET OVERLAP AND SPLICE LAP DIMENSIONS.
- FLANGE BRACES ARE REQUIRED ONLY ON ONE SIDE OF FRAME, EXCEPT THOSE FLANGE BRACES THAT ARE PRECEDED WITH A (2)FB... ARE REQUIRED ON BOTH SIDES OF THE FRAME.
- EAVE HEIGHT DIMENSION IS NOT ALWAYS TO THE TOP OF THE EAVE STRUT. DUE TO THERMAL BLOCK SITUATIONS, EAVE HEIGHT DIMENSION AND TOP GIRT SPACE DIMENSION MAY VARY AT THE INTERSECTION OF THE TOP OF THE PURLINS. REFER TO THE EAVE DETAILS FOR MORE INFORMATION.

SPLICE BOLT TABLE		
SPLICE	NO	DEPTH
A	10	2'-0
B	12	2'-0
C	12	2'-0
D	12	2'-0
E	12	2'-0
F	12	2'-0
G	12	2'-0
H	12	2'-0

EAVE HEIGHT	
SP	HT
1	2'-8 1/2
2	2'-8
3	2'-8
4	2'-8

SEAL: NEITHER THE ENGINEER NAMED NOR CHIEF BUILDINGS IS ACTING AS THE ENGINEER OF RECORD. CHIEF BUILDINGS IS RESPONSIBLE FOR THE DESIGN OF THE STRUCTURAL PERFORMANCE OF THE PRE-ENGINEERED COMPONENTS DESIGNED BY CHIEF BUILDINGS.

UNUSO DELIUM
BRADCO SUPPLY / BRADCO-WICKES LUMBER
PORTLAND, ME
RFM 178X200X16"-10 1+12 25' BAYS

DRAWN	CHECK	ORDER NO.
CO		C084705
7-DEC-05		CS7

CHIEF BUILDINGS
P.O. BOX 2078
ORLAND, ME 04552-2078

NEW STORAGE BUILDING FOR

BRADCO / WICKES SUPPLY CORP.

238 RIVERSIDE STREET

PORTLAND, MAINE

	ARCHITECTURE INTERIOR DESIGN P.O. BOX 6179 FALMOUTH, MAINE 04105 (207) 871-6900	DRAWING TITLE COVER SHEET	SCALE NO SCALE	DATE 7 Nov '05	DRAWN BY MPH/mck	JOB NO. 050644	DRAWING NO.	
	BRADCO/WICKES SUPPLY NEW STORAGE BUILDING FOR 235 RIVERSIDE ST PORTLAND, MAINE							
	REVISIONS 15 OCT '05 EQUIPMENTING 7 Nov '05 EQUIPMENTING							
	ASSOCIATES							

ABBREVIATIONS		GENERAL NOTES		MATERIALS		SYMBOLS		DRAWING INDEX		CONSULTANTS	
A-100 ACROBAT A-101 ACROBAT A-102 ACROBAT A-103 ACROBAT A-104 ACROBAT A-105 ACROBAT A-106 ACROBAT A-107 ACROBAT A-108 ACROBAT A-109 ACROBAT A-110 ACROBAT A-111 ACROBAT A-112 ACROBAT A-113 ACROBAT A-114 ACROBAT A-115 ACROBAT A-116 ACROBAT A-117 ACROBAT A-118 ACROBAT A-119 ACROBAT A-120 ACROBAT A-121 ACROBAT A-122 ACROBAT A-123 ACROBAT A-124 ACROBAT A-125 ACROBAT A-126 ACROBAT A-127 ACROBAT A-128 ACROBAT A-129 ACROBAT A-130 ACROBAT A-131 ACROBAT A-132 ACROBAT A-133 ACROBAT A-134 ACROBAT A-135 ACROBAT A-136 ACROBAT A-137 ACROBAT A-138 ACROBAT A-139 ACROBAT A-140 ACROBAT A-141 ACROBAT A-142 ACROBAT A-143 ACROBAT A-144 ACROBAT A-145 ACROBAT A-146 ACROBAT A-147 ACROBAT A-148 ACROBAT A-149 ACROBAT A-150 ACROBAT A-151 ACROBAT A-152 ACROBAT A-153 ACROBAT A-154 ACROBAT A-155 ACROBAT A-156 ACROBAT A-157 ACROBAT A-158 ACROBAT A-159 ACROBAT A-160 ACROBAT A-161 ACROBAT A-162 ACROBAT A-163 ACROBAT A-164 ACROBAT A-165 ACROBAT A-166 ACROBAT A-167 ACROBAT A-168 ACROBAT A-169 ACROBAT A-170 ACROBAT A-171 ACROBAT A-172 ACROBAT A-173 ACROBAT A-174 ACROBAT A-175 ACROBAT A-176 ACROBAT A-177 ACROBAT A-178 ACROBAT A-179 ACROBAT A-180 ACROBAT A-181 ACROBAT A-182 ACROBAT A-183 ACROBAT A-184 ACROBAT A-185 ACROBAT A-186 ACROBAT A-187 ACROBAT A-188 ACROBAT A-189 ACROBAT A-190 ACROBAT A-191 ACROBAT A-192 ACROBAT A-193 ACROBAT A-194 ACROBAT A-195 ACROBAT A-196 ACROBAT A-197 ACROBAT A-198 ACROBAT A-199 ACROBAT A-200 ACROBAT		1. ALL WORK SHALL CONFORM TO LOCAL AND STATE LAWS, ORDINANCES AND REGULATING EDITIONS OF ADOPTED BUILDING CODES. IT IS THE CONTRACTOR'S RESPONSIBILITY TO SECURE ALL PERMITS FOR WORK. 2. THE CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS PRIOR TO COMMENCING THE WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER IMMEDIATELY. THE CONTRACTOR SHALL PROCEED WITH THE WORK ONLY AFTER SUCH DISCREPANCIES HAVE BEEN RESOLVED. THE CONTRACTOR SHALL ALLOW A 48-HOUR TIME FRAME FOR RESOLVING DISCREPANCIES ONCE THE ARCHITECT HAS ACKNOWLEDGED THE CONDITION. 3. CONTRACTOR SHALL REVIEW AND VERIFY ALL EXISTING CONDITIONS PRIOR TO STARTING THE WORK IN ANY GIVEN AREA. 4. WORK WITH GIVEN DIMENSIONS AND LAJZE SCALE DETAILS; DO NOT SCALE THE DRAWINGS AS THE REPRODUCTION PROCESS TENDS TO DISTORT THE ACCURACY OF THE GRAPHIC SCALE INDICATED. 5. ALL CONSTRUCTION ACTIVITIES SHALL BE PERFORMED IN A NEAT, SAFE AND CLEAN MANNER. ALL CONSTRUCTION WASTE SHALL BE REMOVED FROM THE BUILDING. SITE BURNING IS NOT ALLOWED. LEAVE WORK AREA IN A CLEAN, SAFE CONDITION. 6. ALL CONSTRUCTION DEBRIS SHALL BE DISPOSED OF AT AN APPROVED OFF-SITE FACILITY IN COMPLIANCE WITH ALL REGULATIONS. 7. ALL WOOD IN CONTACT WITH MASONRY OR CONCRETE SHALL BE PRESURE TREATED. 8. ALL CEILING SHALL BE LEVEL TO A TOLERANCE OF 1/8" IN A 20'-0" BAYOUS WHEN CHECKED WITH A 10' STRAIGHT EDGE. 9. INSTALL SOLID BLOCKING AT WALL FRAMING BEHIND ALL SURFACE MOUNTED FIXTURES, TRIM AND HANDRAILS. 10. ALL CURB BARS AND HANDRAILS SHALL BE ABLE TO SUPPORT A DEAD WEIGHT OF 250 LBS. AT ANY POINT. 11. THE LOCATION OF ANY DOOR LAMBS NOT DIMENSIONED SHALL BE 6" FROM ADJACENT PERPENDICULAR WALL. 12. ALL WALL PARTITIONS SHALL EXTEND FLOOR TO STRUCTURE ABOVE, UNLESS OTHERWISE NOTED. 13. ALL NEW SHEETROCK IN WET AREAS (E.g. JUMPING FIXTURES) SHALL BE MOISTURE RESISTANT TYPE, UNLESS OTHERWISE NOTED. 14. ALL EXTERIOR WALLS SHALL HAVE FULL-THICK ACoustICAL BATT INSULATION (R-19 MIN). 15. ALL INTERIOR WALLS SHALL HAVE FULL-THICK ACoustICAL BATT INSULATION. 16. THE OWNER SHALL BE RESPONSIBLE FOR THE REMOVAL OF ALL HAZARDOUS MATERIALS PRIOR TO THE COMMENCEMENT OF THE CONTRACTOR'S WORK. 17. THESE ARCHITECTURAL DRAWINGS WERE PREPARED FOR THE GENERAL CONTRACTOR/OWNER AS PART OF AN AGREEMENT FOR SERVICES AGREEMENT, AND AS SUCH, DO NOT DELINEATE ALL ASPECTS OF THE WORK. 18. THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR THE COORDINATION OF ALL ASPECTS OF THE WORK, INCLUDING BUT NOT LIMITED TO, CIVIL, STRUCTURAL, MECHANICAL AND ELECTRICAL ENGINEERING DISCIPLINES. 19. REFER TO THE ACCESSIBILITY DETAIL SHEET FOR AMERICANS WITH DISABILITIES ACT (ADA) AND MAINE HUMAN RIGHTS ACT (MHRA) CONSTRUCTION CRITERIA.		CONCRETE CONCRETE MASONRY UNIT BRICK GRAVEL SOIL SLOD PARTITION (NEW) STEEL WOOD FRAMING WOOD BLOCKING PLYWOOD OSB/UM BOARD SUSPENDED ACoustICAL TILE BATT INSULATION RIGID INSULATION FINISH WOOD ONE HOUR RATED PARTITION TWO HOUR RATED PARTITION EXISTING PARTITION (SCREENED) NEW PARTITION		ROOM NUMBER DOOR NUMBER WINDOW NUMBER BUILDING SECTION WALL SECTION DETAIL SECTION CASEWORK ELEVATION INTERIOR ELEVATION VERTICAL ELEVATION PARTITION TYPE STRUCTURAL CENTERLINE		AO COVER SHEET A1 FLOOR PLAN A2 NFPA FLOOR PLAN A3 EXTERIOR ELEVATIONS A4 SECTIONS & NOTES A5 SCHEDULES & DETAILS A6 ACCESSIBILITY DETAILS		STRUCTURAL ENGINEERING JAC ENGINEERING INC. PO BOX 925 6849 MALE CA009 207-697-1928 CIVIL ENGINEERING SEBAK TECH INC. PO BOX 1959 WESTBROOK, MAINE 04098 207-886-0277 PROJECT MANAGEMENT PM CONSTRUCTION INC. 91 INDUSTRIAL PARK ROAD PO BOX 728 540 MAINE CA072 207-282-1677 (Voice) 207-282-1677 (Fax)	