


80 feet

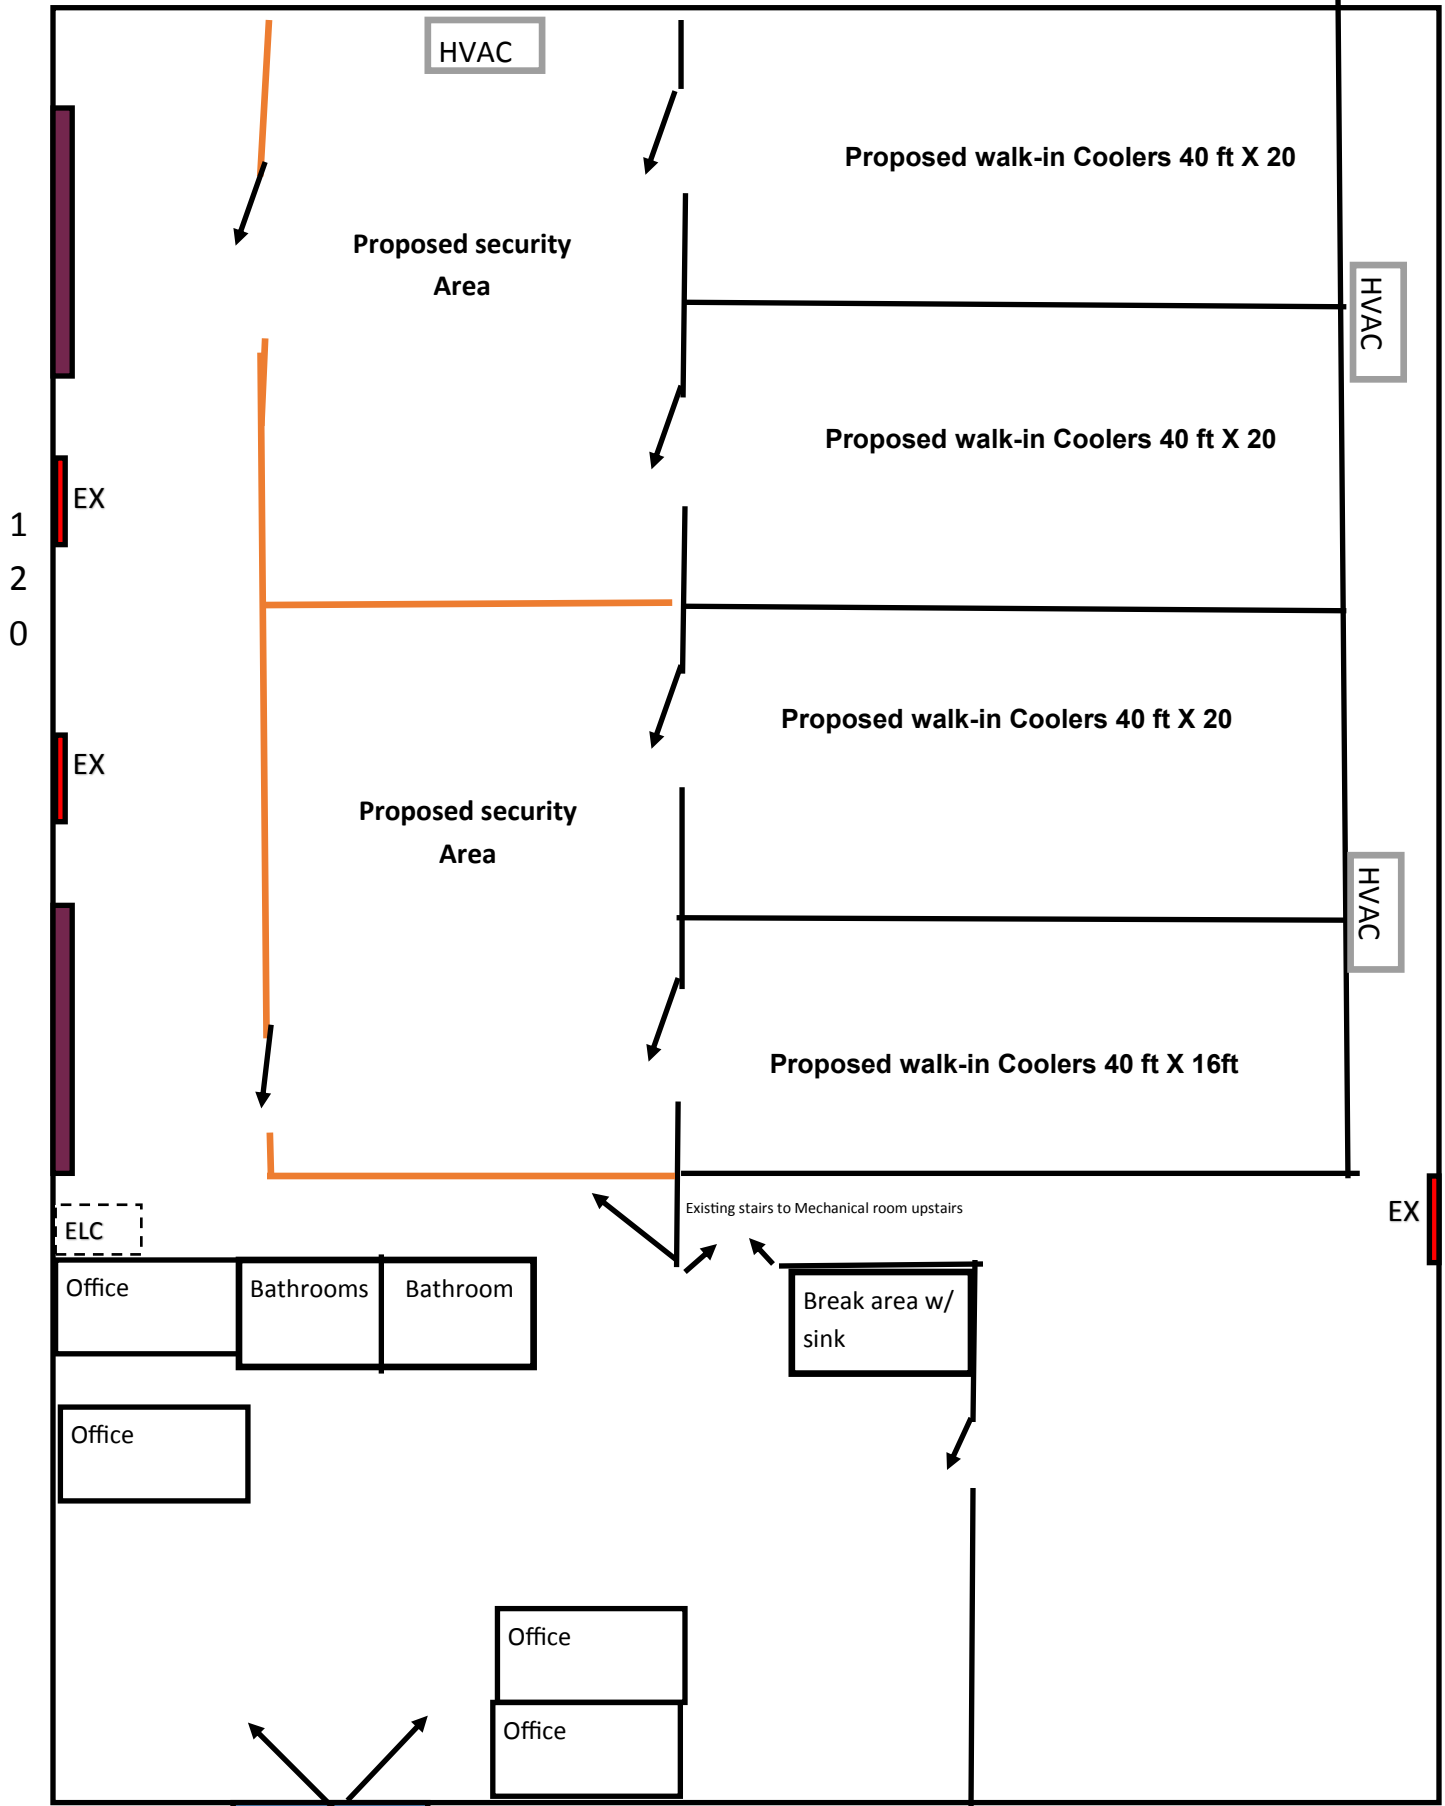

HVAC

Proposed walk-in Coolers 40 ft X 20

Proposed security Area

HVAC

Proposed walk-in Coolers 40 ft X 20

1
2
0

EX

Proposed walk-in Coolers 40 ft X 20

EX

Proposed security Area

HVAC

Proposed walk-in Coolers 40 ft X 16ft

EX

ELC

Existing stairs to Mechanical room upstairs

Office Bathrooms Bathroom

Break area w/
sink

Office

Office

Office