


CEILING VIEW

NOTE:

1. ALL DIMENSION ARE ACCURATE $\pm 1/4"$
2. CABLE TRAY SHALL BE 94 1/2" A.F.F.
3. USE 18" CABLE RACK U.N.O.
4. LAYOUTS USES (4) COMPLETE PIECES OF 116 1/2" 18" CABLE TRAY.

REFERENCE DRAWINGS REQUIRED
TO COMPLETE THIS SHEET

DRAWING NO.	DESCRIPTION
MECH-0006	CABLE RACK W/ SEISMIC BRACING MOUNTING DETAILS

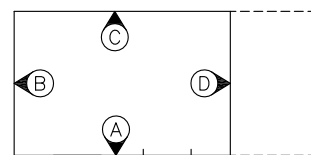

ELEVATION KEY

REV.	BY	DATE	REVISION	APP.	DATE	BOM	DATE

THESE PLANS ARE THE CONFIDENTIAL PROPERTY AND TRADE SECRETS OF FIBREBOND CORPORATION. ANY USE OF THESE DRAWINGS OR THE INFORMATION CONTAINED HEREIN FOR ANY REASON OTHER THAN AS EXPRESSLY AUTHORIZED BY FIBREBOND CORPORATION IS STRICTLY PROHIBITED. THESE DRAWINGS HAVE BEEN DISTRIBUTED WITH THE UNDERSTANDING THAT ANYONE RECEIVING OR OTHERWISE OBTAINING POSSESSION OF THEM WILL BE EXPRESSLY NOTIFIED OF THEIR CONFIDENTIAL NATURE.

1300 DAVENPORT DRIVE MINDEN, LA. 71055
ph. (800) 824-2614 www.fibrebond.com

AT&T MOBILITY
11'-5" X 24'-0" PATIO SHELTER
CABLE RACK CEILING VIEW

DRN. BY: CSP	DATE: 6/5/13	APP. BY: CSP	DATE: -
CHK. BY:	DATE:	APP. BY: MG	DATE: -

F
FIBREBOND

SCALE: 3/8"=1'-0" SHEET NO.: 6

DWG NO.: **D-9312**