


SECOND FLOOR SPRINKLER MONITORING PLAN  
SCALE: 1/8"=1'-0"

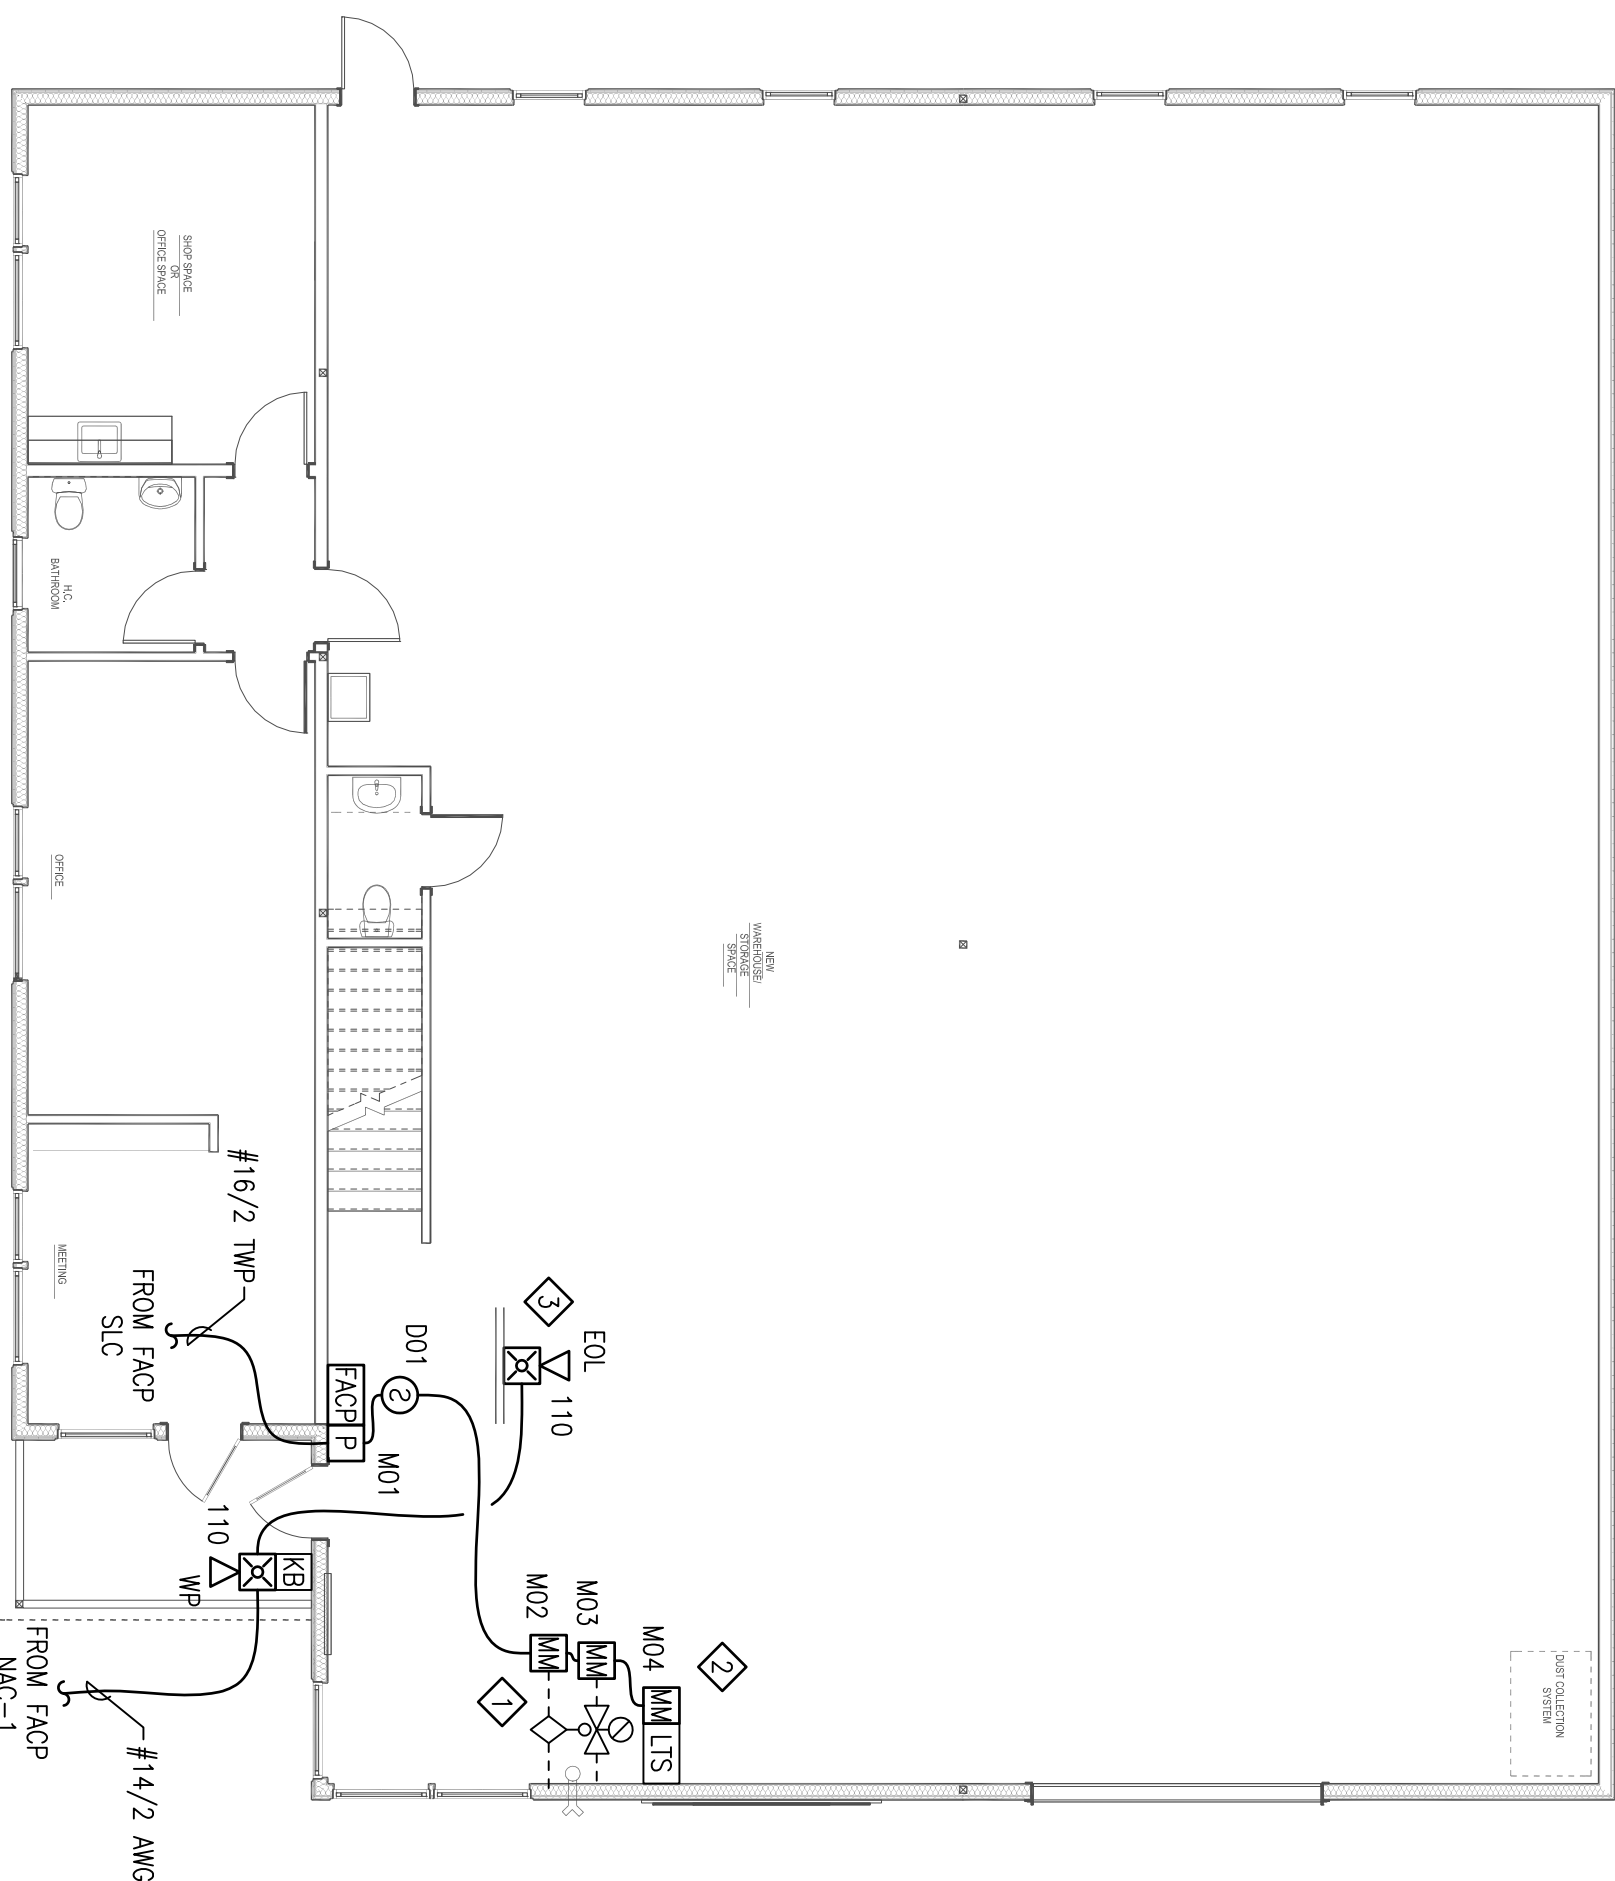

FIRST FLOOR SPRINKLER MONITORING PLAN  
SCALE: 1/8"=1'-0"

- SHEET NOTES:
- ◇ ADDRESSABLE MONITOR MODULE(S) PROVIDED TO MONITOR ALL WATER FLOW PRESSURE SWITCHES, WATER SWITCHES AND POST INDICATING VALVES ASSOCIATED WITH THE FIRE SPRINKLER SYSTEM. INSTALLING CONTRACTOR SHALL VERIFY EXACT MOUNTING, CIRCUITING AND PROGRAMMING REQUIREMENTS. FIELD VERIFY EXACT QUANTITY AND LOCATION(S).
  - ◇ ADDRESSABLE MONITOR MODULE PROVIDED TO MONITOR THE LOW TEMPERATURE SENSOR. INSTALLING CONTRACTOR SHALL VERIFY EXACT MOUNTING, CIRCUITING AND PROGRAMMING REQUIREMENTS. FIELD VERIFY EXACT QUANTITY AND LOCATION(S).
  - ◇ FIELD VERIFY EXACT MOUNTING LOCATION OF INTERIOR HORN STROBE.

RESERVED FOR CITY STAMP

REVISION	DESCRIPTION	DATE
0	ISSUED FOR REVIEW & APPROVAL	10/14/2015

**CUNNINGHAM**  
**Security Systems**

10 Princes Point Road, Yarmouth, Maine 04096  
Office: 207.846.3350 • Fax: 207.846.6080

**PAPI AND ROMANO BUILDERS**  
**828 RIVERSIDE STREET**  
**PORTLAND, MAINE 04103**  
**SPRINKLER MONITORING SYSTEM PLAN**

DESIGNED BY	JPB
DRAWN	UNICAD JOB #15707
CHECKED	WAYNE B. HAWES
DATE	10/14/2015
REVISION	0
SCALE	AS NOTED

**FA-2**

**UNICAD**  
INC.

578 W. 40th St.  
Portland, ME 04102  
Office: 800.563.6110  
www.unicad.me

Fire Alarm Design & Drafting Services