



UNDERGROUND DUCTBANK DETAILS

- NOTE:
1. ALL UNDERGROUND CONDUITS UTILIZED ON THIS PROJECT SHALL BE UL LISTED AS ELECTRICAL RACEWAYS.

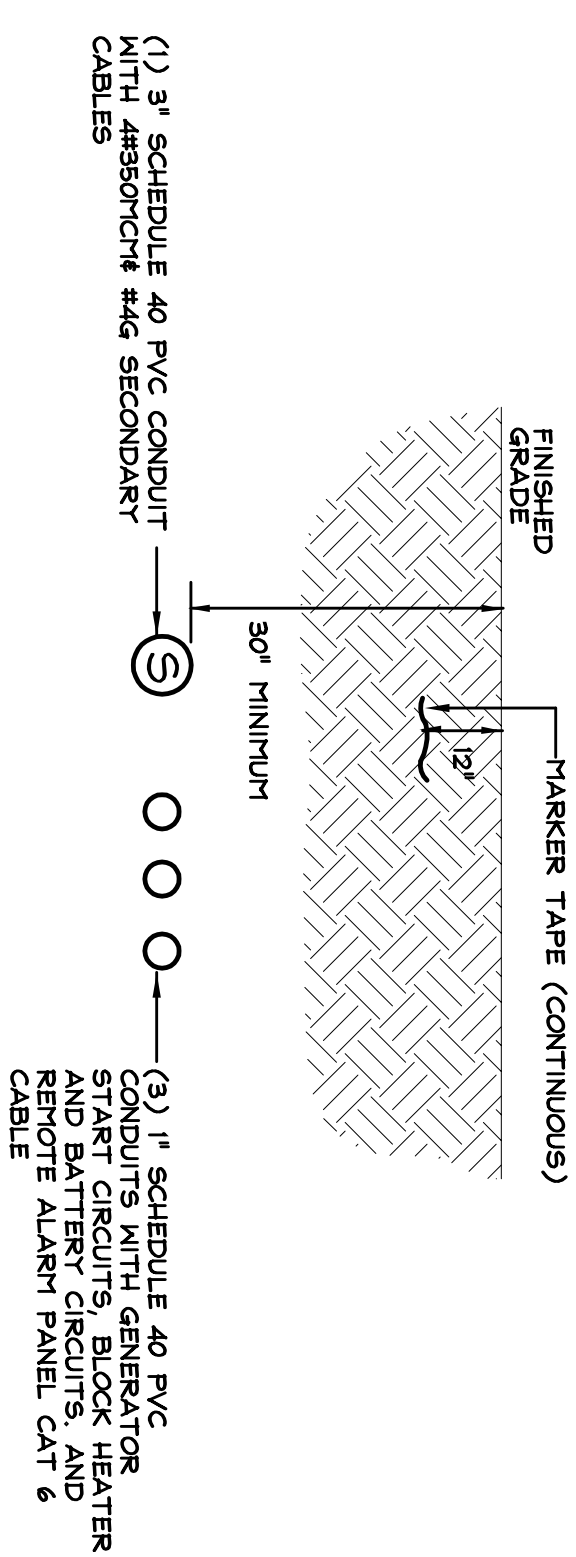


PARTIAL SITE PLAN


DIG SAFE - 1-888-DIG-SAFE
THE CONTRACTOR IS RESPONSIBLE TO CONTACT DIG SAFE AT LEAST 72 HOURS PRIOR TO THE START OF ANY EXCAVATION. THE CONTRACTOR SHALL ALSO CONTACT AND COORDINATE WITH A PRIVATE LOCATING SERVICE.

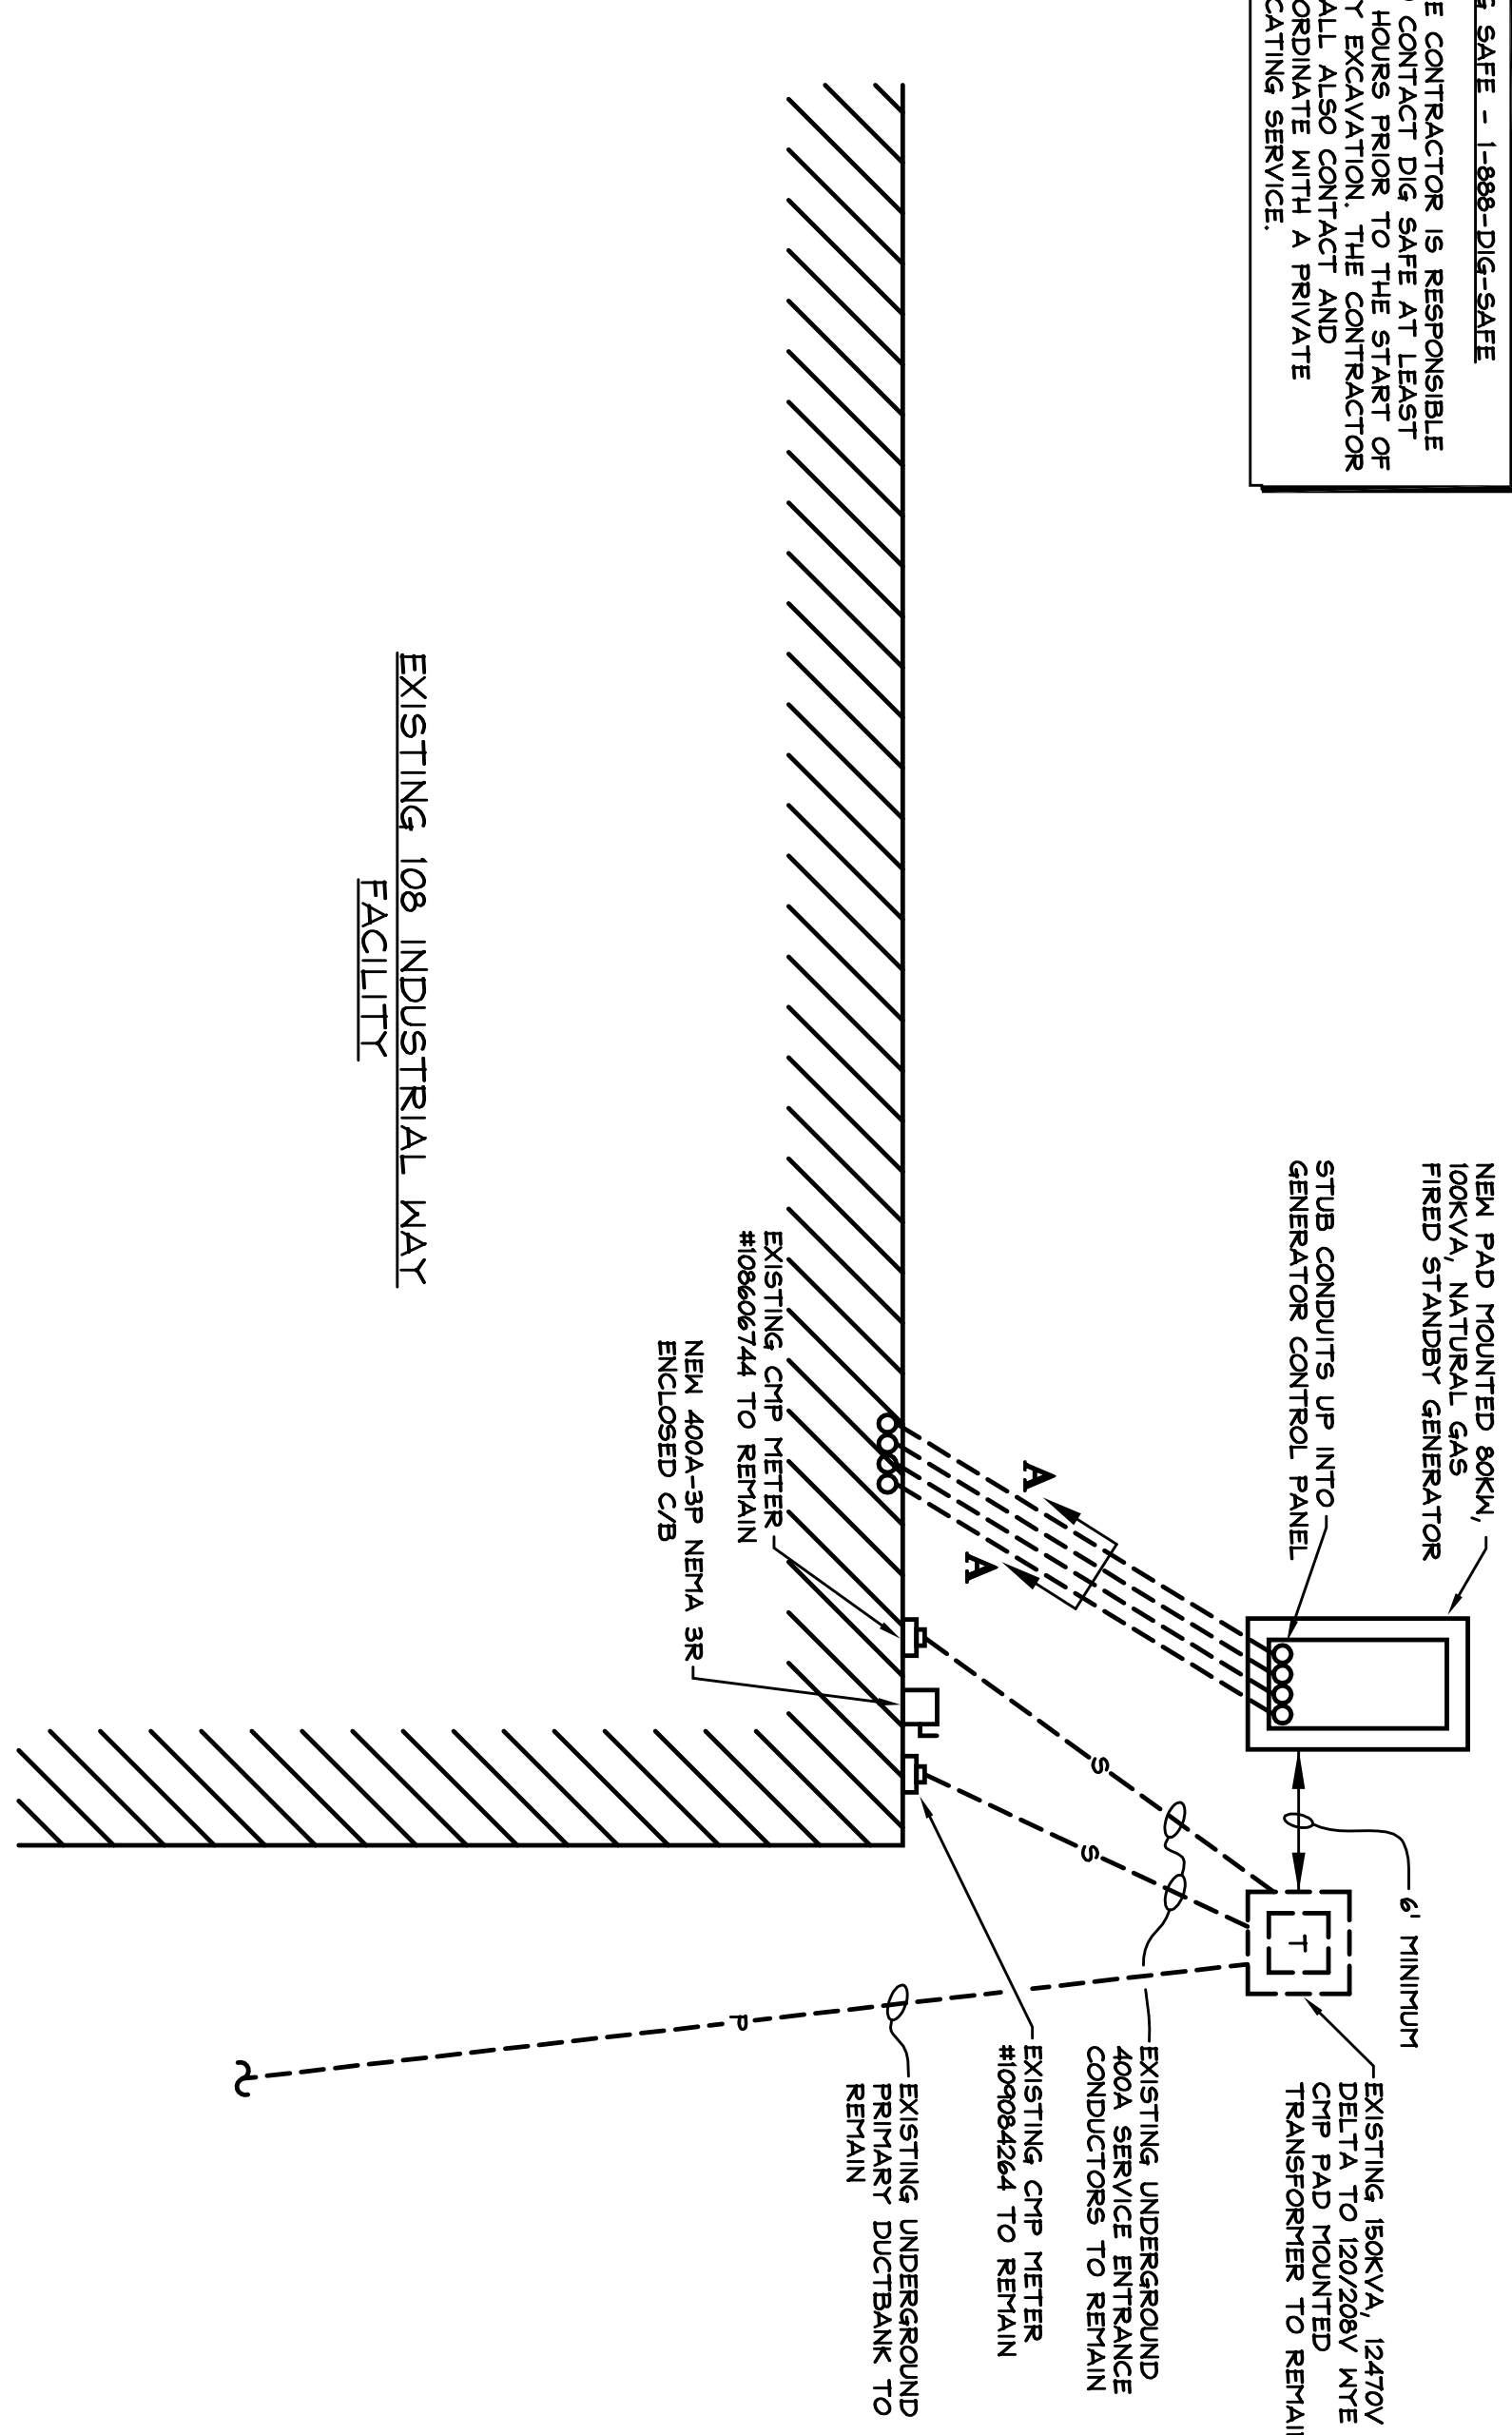

ENCLOSED GENERATOR - TOP VIEW

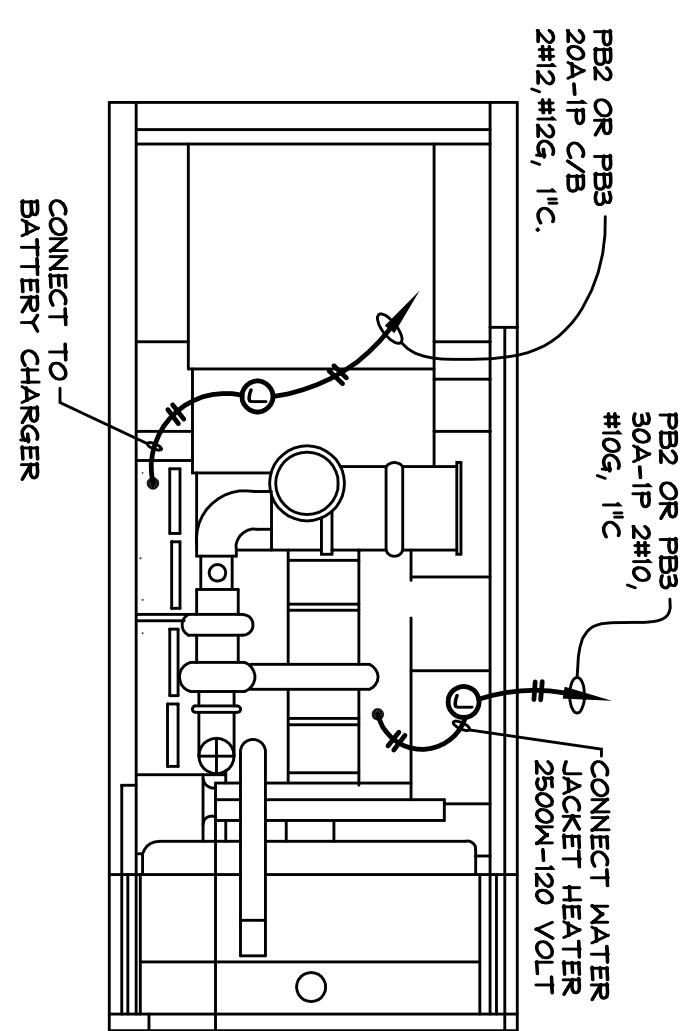

GENERATOR CONCRETE PAD AND GROUNDING DETAIL

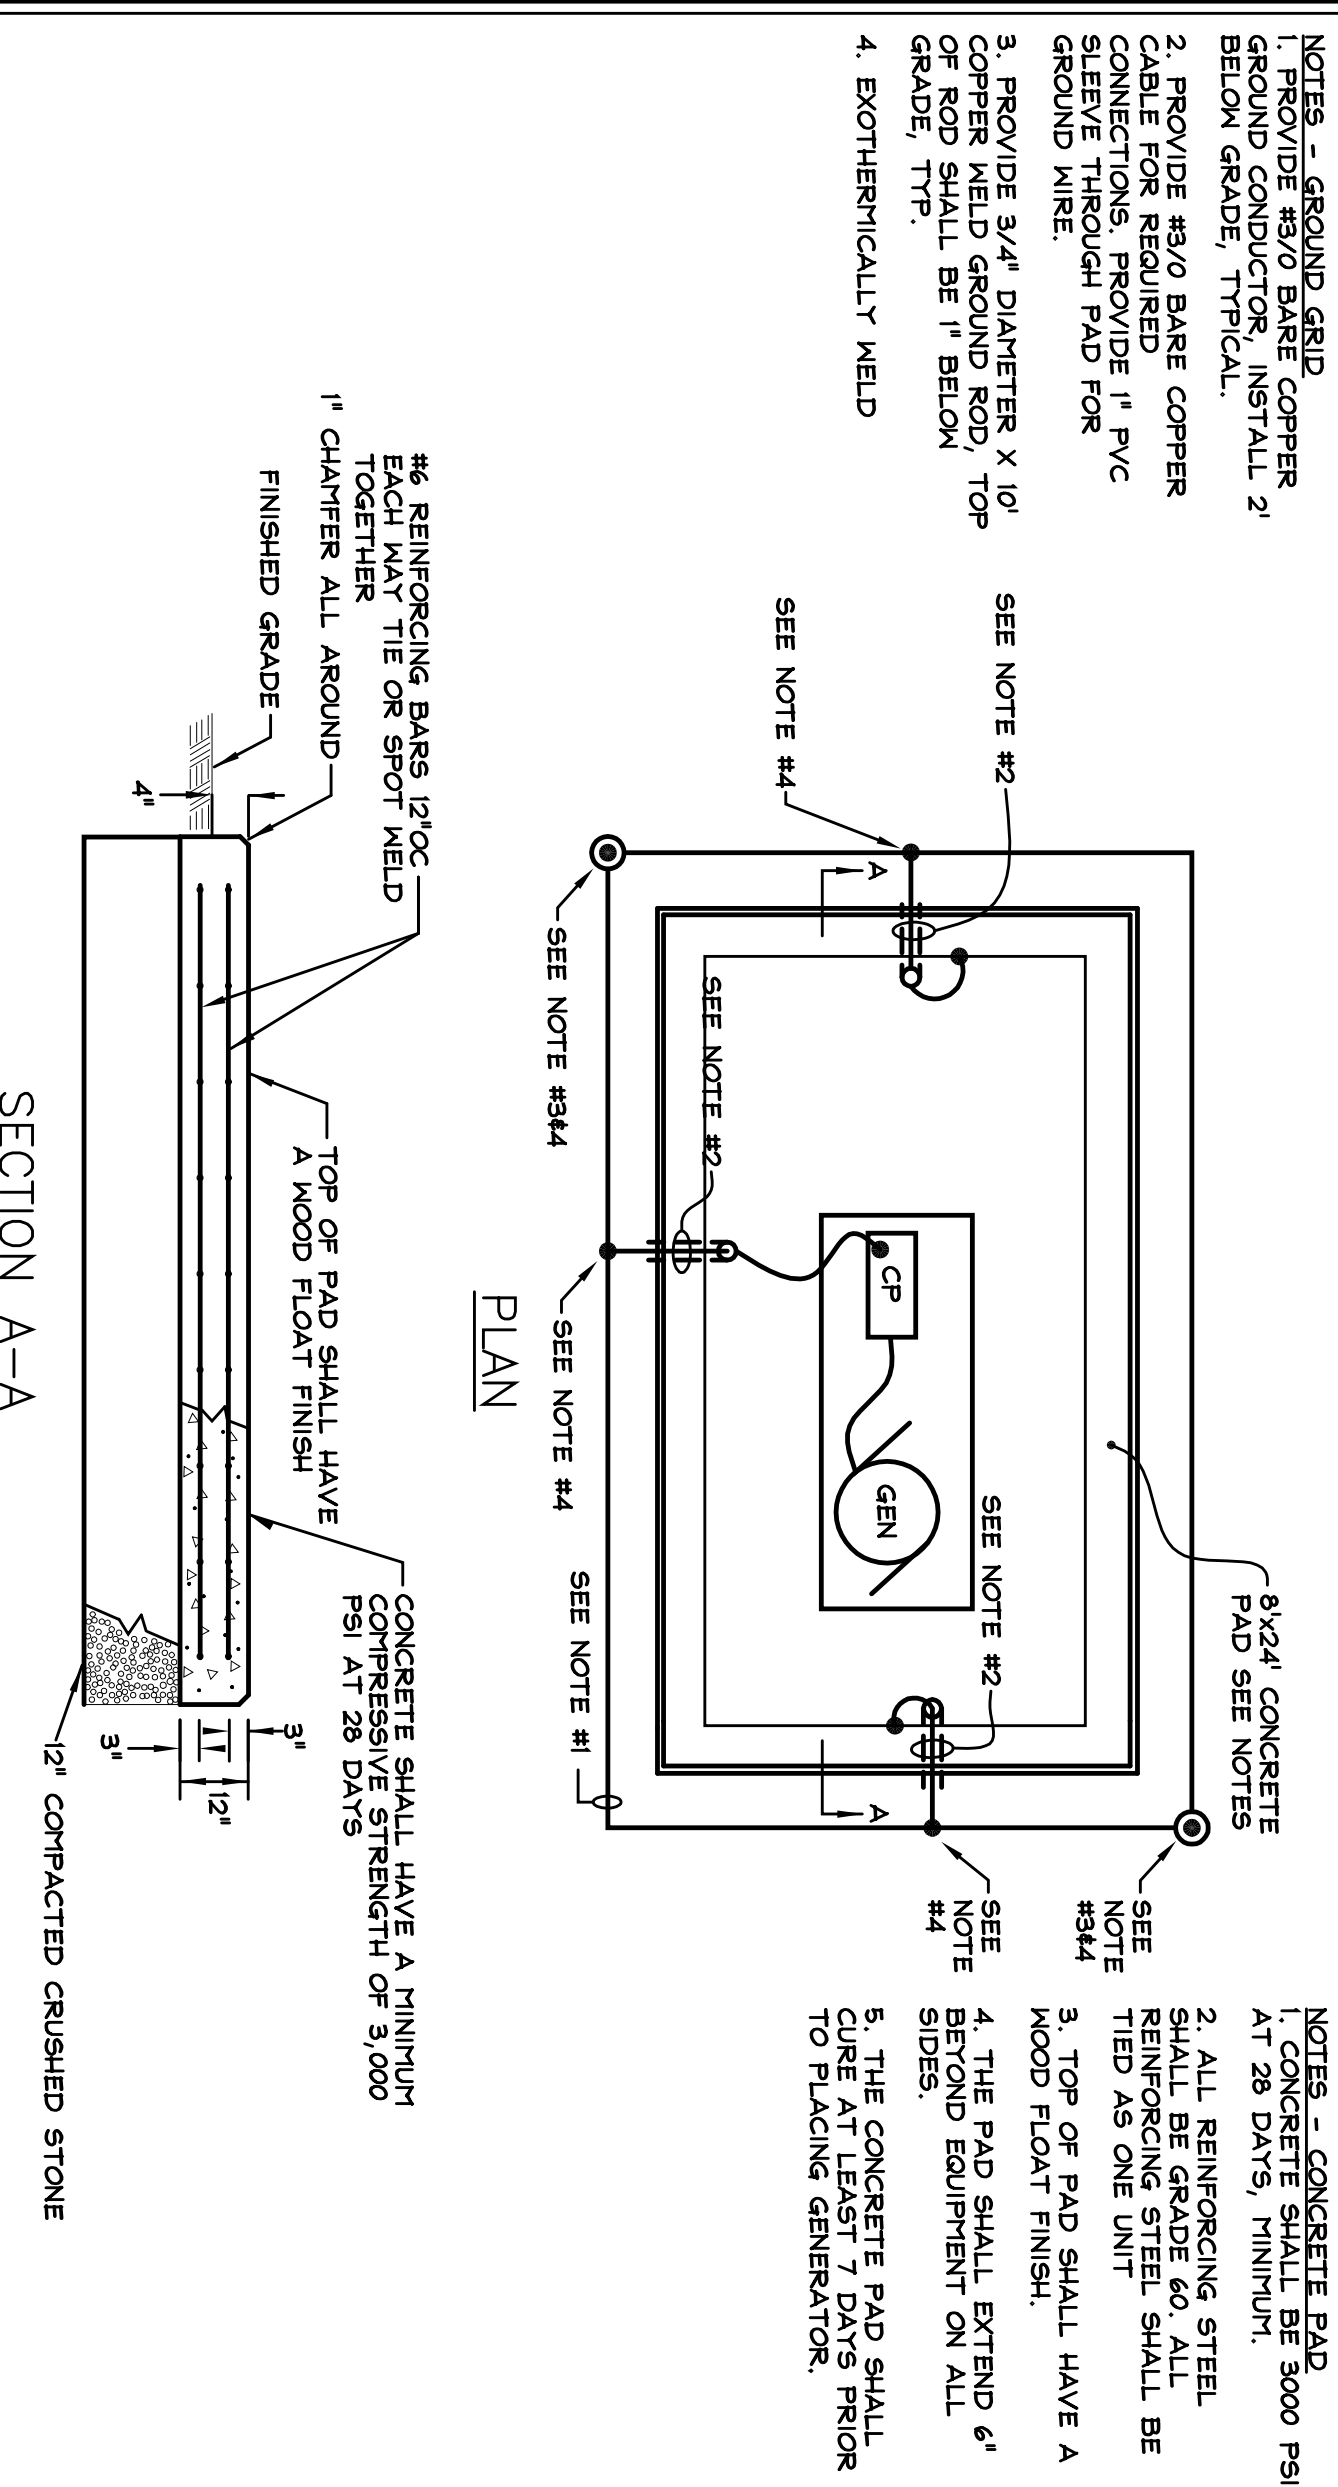

STANDBY GENERATOR GROUNDING DETAIL

