

HOOD NO.	TAG	MODEL	LENGTH	MAX. COOKING TEMP.	EXHAUST PLENUM RISERS			HOOD CONSTRUCTION	HOOD END TO END	ROW
					TOTAL LENGTH	WIDTH	DIA.			
1		3347 BD-2	4' 0.00"	600 Deg	800	10"	800	-0.333"	430 SS Where Exposed	ALONE


HOOD INFORMATION

HOOD NO.	TAG	TYPE	QTY	HEIGHT	LENGTH	EFFICIENCY	MICRONS	QTY	TYPE	LIGHTS	UTILITY CABINETS		FIRE SYSTEM	SWITCHES QUANTITY	FIRE SYSTEM PIPING	HOOD HANGING WT
											SIZE	MODEL #				
1		SS Baffle with Handles	2	16"	16"	30%	9	2	Screw In Compact	430 SS	None	None	None	None	None	179 LBS

HOOD OPTIONS


HOOD NO.	TAG	OPTION
1		RIGHT QUARTER END PANEL 23" Top Width, 0" Bottom Width, 23" High 430 SS
		LEFT QUARTER END PANEL 23" Top Width, 0" Bottom Width, 23" High 430 SS
		INSULATION FOR TOP OF HOOD
		INSULATION FOR BACK OF HOOD

1" LAYER OF INSULATION FACTORY INSTALLED IN BACK STANDOFF. MEETS 0 INCH REQUIREMENTS FOR CLEARANCE TO COMBUSTIBLE SURFACES.

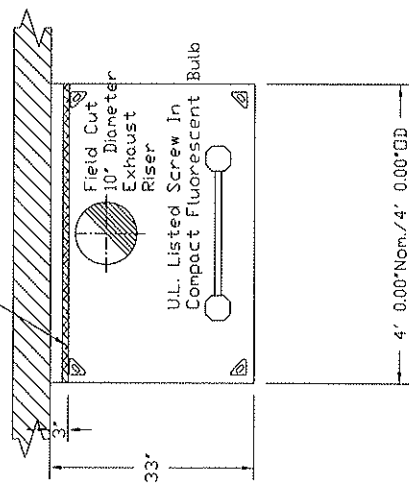

PLAN VIEW -- Hood #1
4' 0.00" LONG 3347BD-2

SCREW IN COMPACT FLUORESCENT BULB, L55 SERIES E26 CANDOPY LIGHT FIXTURE - HIGH TEMP ASSEMBLY, INCLUDES CLEAR THERMAL AND SHOCK RESISTANT GLOBE
1" LAYER OF INSULATION FACTORY INSTALLED ON TOP OF HOOD. MEETS 0 INCH REQUIREMENTS FOR CLEARANCE TO COMBUSTIBLE SURFACES

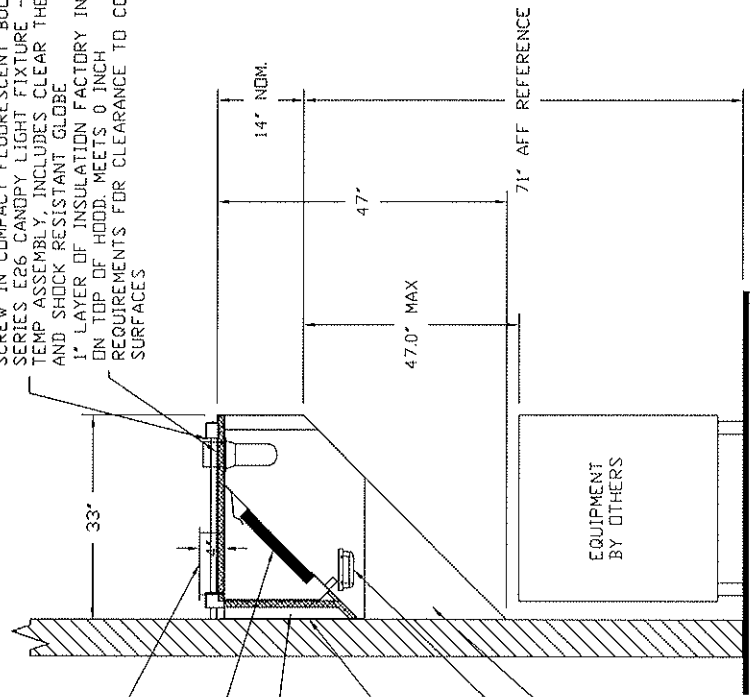

FIELD CUT EXHAUST RISER
16" SS BAFFLE WITH HANDLES AND HOOK INSTALLED IN 3" INTERNAL STANDOFF. MEETS 0 INCH REQUIREMENTS FOR CLEARANCE TO COMBUSTIBLE SURFACES. IT IS THE RESPONSIBILITY OF THE ARCHITECT/OWNER TO ENSURE THAT THE HOOD CLEARANCE FROM LIMITED-COMBUSTIBLE AND COMBUSTIBLE MATERIALS IS IN COMPLIANCE WITH LOCAL CODE REQUIREMENTS.
GREASE DRAIN WITH REMOVABLE CUP FIELD INSTALLED QUARTER END PANELS

SECTION VIEW -- MODEL 3347BD-2
HOOD -- #1

CUSTOMER APPROVAL TO MANUFACTURE:

Approved as Noted

Approved with NO Exception Taken

Revise and Resubmit

SIGNATURE _____






CAPTIVE

JOB Kaufman House r2
 LOCATION PORTLAND, ME. 04103
 DATE 6/4/2015
 JOB # 2347011
 DWG # 1
 DRAWN BY BFC-21