

**GENERAL STRUCTURAL NOTES**

- ALL WORK SHALL CONFORM TO THE REQUIREMENTS OF ALL APPLICABLE STATE AND LOCAL CODES, INCLUDING BUT NOT LIMITED TO:
  - INTERNATIONAL BUILDING CODE - 2009 ED
  - ANSI-ASCE 7-05
  - ACI 318-05 "BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE"
  - ACI 301 "SPECIFICATIONS FOR STRUCTURAL CONCRETE FOR BUILDINGS"
  - AISC STEEL CONSTRUCTION MANUAL
  - SISI COLD FORMED STEEL DESIGN MANUAL
  - ANSI-AFPA NDS-2005
- DESIGN LOADS
  - GRAVITY ROOF DESIGN LOADS:
 

SNOW LOAD	$P_g = 60 \text{ PSF}$
	$P_f = 50 \text{ PSF BALANCED}$
	$P_s = 34 \text{ PSF SLOPED-BALANCED}$

$C_l = 1.2, C_e = 0.9, I = 1.0$   
 UNBALANCED SNOW LOADS CONSIDERED - SEE DETAILS.  
 DEAD LOAD AS NOTED ON DETAILS.
  - LATERAL - WIND:  $V = 98 \text{ MPH}$ , EXPOS. B,  $I = 1.0, K_d = 0.85, K_z = 0.7, K_{zt} = 1.0, Q_n = 4.7 \text{ PSF}$ , OPEN FREE ROOF PER FIG. 6-18B, MAIN WINDFORCE CASE A:  $+1.375, -6.2 \text{ PSF}$ , CASE B  $+0, -1.375 \text{ PSF}$ .
  - LATERAL - SEISMIC:  $S_s = 0.31, S_1 = 0.076, S_{I1} = 1.52, F_v = 2.4, S_{D1} = 0.314, S_{D2} = 0.125, I = 1.0, SDC = B, R = 7, V = 1.0 \text{ (PAVILION ROOF)}$ .
- CONTRACTOR SHALL BRING TO THE ATTENTION OF THE ENGINEER ANY CONDITIONS DIFFERENT FROM THOSE SHOWN ON THE DRAWINGS AND ALSO ANY CONDITIONS THAT PREVENT THE CONTRACTOR'S COMPLETION OF THE WORK AS SHOWN ON THE CONSTRUCTION DRAWINGS.
- ALL WORK SHALL BE PERFORMED BY PERSONS QUALIFIED IN THEIR TRADE AND LICENSED TO PRACTICE SUCH TRADE IN THE STATE IN WHICH THE PROJECT IS LOCATED.
- THESE DRAWINGS SHALL BE USED IN CONJUNCTION WITH ANY ARCHITECTURAL, MECHANICAL, AND ELECTRICAL DRAWINGS, IN ADDITION TO SPECIFICATIONS AND ANY SHOP DRAWINGS PROVIDED BY SUBCONTRACTORS AND SUPPLIERS.
- ALL DIMENSIONS, ELEVATIONS, AND CONDITIONS SHALL BE VERIFIED IN THE FIELD BY GENERAL CONTRACTOR (G.C.) AND ANY DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER FOR CLARIFICATION BEFORE PROCEEDING WITH THE AFFECTED PART OF THE WORK.
- UNLESS OTHERWISE NOTED, DETAILS, SECTIONS, AND NOTES SHOWN ON ANY DRAWING SHALL BE CONSIDERED TYPICAL FOR ALL SIMILAR DETAILS.
- THESE DRAWINGS DO NOT SHOW SIZE, LOCATION OR TYPE OF OPENING IN THE FOUNDATION SYSTEM FOR ELECTRICAL PLUMBING OR MECHANICAL EQUIPMENT. THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR LOCATING THESE ITEMS.
- ALL SHOP DRAWINGS PROVIDED BY OTHERS SHALL BE SUBMITTED TO THE ENGINEER FOR REVIEW PRIOR TO FABRICATION OF MATERIAL OR THE PURCHASE OF NON-RETURNABLE STOCK. DIMENSIONAL REVIEW IS THE CONTRACTOR'S RESPONSIBILITY.

**EARTHWORK NOTES**

- SITE WORK AND CONCRETE CONTRACTORS ARE REQUIRED TO REVIEW THE ON-SITE SUBSURFACE SOIL CONDITIONS WITH THE SER AT THE START OF INITIAL CONSTRUCTION. SITE CONTRACTOR WILL NOTIFY SER AFTER EXCAVATION HAS STARTED AND PRIOR TO THE PLACEMENT OF ANY STRUCTURAL FOUNDATIONS.
- REMOVE ALL TOPSOIL AND UNCONTROLLED FILL FOR THE AREAS RECEIVING BUILDING FOUNDATIONS.
- BACKFILL TO THE NECESSARY SUBGRADES REQUIRED ON THE STRUCTURAL FOUNDATION PLANS WITH CONTROLLED STRUCTURAL FILL MATERIAL MEETING THE FOLLOWING GRADATION:
 

PERCENT PASSING	SCREEN OR SIEVE SIZE
100	100
6	90-100
NO. 4	35-70
NO. 40	5-35
NO. 200	0-5
- PLACE CONTROLLED STRUCTURAL FILL IN UNIFORM LIFTS AND COMPACT TO A MINIMUM OF 95% OF THE MAXIMUM DENSITY IN ACCORDANCE WITH ASTM D1557 MODIFIED PROCTOR DENSITY.
- PROVIDE SITE GRADING AROUND THE PERIMETER OF THE BUILDING TO PROVIDE POSITIVE DRAINAGE AWAY FROM THE FOUNDATION DURING AND AFTER CONSTRUCTION.
- MAINTAIN THE INTEGRITY OF NATURAL SOILS AND CONTROLLED STRUCTURAL FILLS DURING CONSTRUCTION. PROTECT FOOTING AND STRUCTURE SUBGRADES AGAINST FREEZING AND EXCESSIVE WETTING. REMOVE AND REFILL FROZEN SUBGRADES, MOISTURE CONDITION, OR REPLACE EXCESSIVELY WET SUBGRADE MATERIALS.
- NOTIFY ENGINEER TO OBSERVE SUBGRADES PRIOR TO PLACING FOOTINGS. FOOTINGS ARE DESIGNED FOR A MIN. SOIL BEARING CAPACITY OF 2000PSF, OR FOR BEARING ON SOUND LEDGE.
- CONTRACTOR SHALL IMMEDIATELY NOTIFY ENGINEER IF LEDGE IS ENCOUNTERED TO DETERMINE PINNING REQUIREMENTS.
- ALL FOOTINGS SHALL EXTEND A MINIMUM OF 4'-6" BELOW EXTERIOR FINISHED GRADE, OR BE DOWELED TO LEDGE.

**EARTHWORK NOTES**

- PROOF ROLL SUBGRADE PRIOR TO SLAB CONSTRUCTION. PROVIDE STRUCTURAL FILL MEETING THE GRADATION SPECIFIED HEREIN FOR FILL MATERIALS BELOW THE SLAB, MAXIMUM PERCENT PASSING 200 SIEVE = 5%.
- COMPACT CONTROLLED STRUCTURAL FILL IN ACCORDANCE WITH THE FOLLOWING SCHEDULE AND ASTM D1557. USE ONLY HAND-OPERATED EQUIPMENT ADJACENT TO WALLS. FILL BOTH SIDES OF WALLS TO EQUAL ELEVATIONS BEFORE COMPACTING.
 

DEGREE OF COMPACTION: COMPACT TO THE FOLLOWING MINIMUM DENSITIES:	FILL AND BACKFILL LOCATION	DENSITY
	UNDER STRUCTURE FOUNDATIONS	95% OF MAX.
	TOP 2 FEET UNDER PAVEMENT	95%
	BELOW TOP 2 FEET UNDER PAVEMENT	92%
	TRENCHES THROUGH UNPAVED AREAS	90%
	EMBANKMENTS	90%
	PIPE BEDDING	92%
	BEHIND STRUCTURE FOUNDATION WALLS	90%
	TANK WALLS AND RETAINING WALLS	90%
	UNDER PIPES THROUGH STRUCTURAL FILLS	90%
	UNDER DRAIN FILTER SAND	92%

MAXIMUM DENSITY: ASTM D1557, MODIFIED.

FIELD DENSITY TESTS: ASTM D1556 (SAND CONE), ASTM D2167 (RUBBER BALLOON), OR ASTM D2922 (NUCLEAR METHODS).
- CONTRACTOR IS REQUIRED TO CONFORM TO OSHA (29 PART 1926.650-652) SUBPART P "CONSTRUCTION STANDARD FOR EXCAVATIONS".

**CONCRETE NOTES (CONT.)**

- ADMITTURES:
 

PROVIDE ADMIXTURES WHICH ARE CHEMICALLY COMPATIBLE FOR THEIR INTENDED USE. COMPLY WITH MANUFACTURER'S INSTRUCTIONS FOR USE. BASE DOSAGE RATES ON CEMENT CONTENT. CALCIUM CHLORIDE IS NOT ALLOWED.

  - HIGH RANGE WATER REDUCERS (SUPER PLASTICIZERS): EQUAL TO DARACEM 100 BY W.R. GRACE & CO., ASTM C-494.
  - ACCELERATORS: EQUAL TO DARASET BY W.R. GRACE & CO., ASTM C-404 TYPE C OR E.
  - AIR ENTRAINING: EQUAL TO "DARAVAIR" BY W.R. GRACE & CO., ASTM C-260 AND ARMY CORP'S CRD-C-13.
- CONCRETE SURFACE COATINGS:
  - CURING COMPOUND: "KURE-N-SEAL" BY SONNEBORN, OR EQUIVALENT.
- FORMS AND RELATED MATERIAL:
  - FORMS FOR CONCRETE SURFACES THAT WILL BE EXPOSED IN THE FINISHED BUILDING SHALL BE PLYFORM CLASS I, B-B EXTERIOR TYPE CONFORMING TO U.S. PRODUCT STANDARD PS-1. FORMS FOR CONCRETE SURFACES NOT EXPOSED IN THE FINISHED BUILDING MAY BE PLYFORM OR MATCHED LUMBER.
  - FORM OIL USED ON SURFACE OF FORMS SHALL BE A NON-STAINING TYPE.
- ALUMINUM PRODUCTS:
  - NO ALUMINUM CONDUIT, PIPE, INSERTS, REGISTS, ETC. SHALL BE PLACED IN ANY CONCRETE, UNLESS COATED WITH BITUMINOUS DAMPPROOFING.
  - NO EQUIPMENT MADE OF ALUMINUM OR ALUMINUM ALLOYS SHALL BE USED FOR PUMP LINES, TRIMERS OR CRUISES IN CONVEYING CONCRETE TO POINT OF PLACEMENT.
- ROUT:
  - NON-SHRINK GROUT FOR USE UNDER COLUMN BASE PLATES AND BEAM BEARING PLATES SHALL BE EMBECO GROUT #895, PRE-MIXED, AS MANUFACTURED BY MASTER BUILDERS, OR APPROVED EQUIVALENT.
- PREFORMED EXPANSION JOINT FILLER:
  - A NON-EXTENDING AND RESILIENT BITUMINOUS TYPE JOINT FILLER, 1/2" THICK.
- EMBEDDED ITEMS:
  - EMBEDDED ITEMS SUCH AS ANCHOR BOLTS, ETC., SHALL BE INSTALLED USING A TEMPLATE AND BE SECURELY HELD IN PLACE DURING CONCRETE PLACEMENT.
- SPACERS, SUPPORTS AND FASTENERS:
  - FORM SPACERS, REINFORCING TIES AND CHAIRS, AND OTHER DEVICES NEEDED FOR PROPER SPACING, SUPPORTING, AND FASTENING REINFORCEMENT SHALL BE PROVIDED. CLAY BRICKS ARE NOT ALLOWED FOR USE AS SLAB STEEL BOLSTERS.

**CONCRETE NOTES (CONT.)**

- CONSTRUCTION PRACTICES:
    - REINFORCEMENT:
 

COMPLY WITH REQUIREMENTS OF CRS1, LATEST EDITION.

      - MINIMUM CONCRETE COVER: 3" FOR CONCRETE CAST AGAINST SOIL; 2" FOR OTHER CONCRETE, UNLESS OTHERWISE SHOWN.
    - DEVELOPMENT AND SPLICING:
 

PROVIDE DEVELOPMENT AND TENSION LAP SPICE LENGTHS IN ACCORDANCE WITH THE FOLLOWING, UNLESS NOTED OTHERWISE ON PLANS:

DEVELOPMENT BAR SIZE	LENGTH*	CLASS C LAP SPICE
#4	12	20"
#5	12	20"
#6	15	26"
#7	18	36"
#8	21	48"

\*INCREASE BY 30% FOR BARS SPACED < 6".
  - CHAMFERS:
 

CHAMFER ALL EXPOSED EDGES AND CORNERS OF CONCRETE 1/4" OR 1" SIMILAR THROUGHOUT.
  - JOINTS:
    - CONSTRUCTION JOINTS: PLACE PERPENDICULAR TO THE MAIN REINFORCEMENT. CONTINUE REINFORCEMENT ACROSS CONSTRUCTION JOINTS. PROVIDE KEYWAYS AT LEAST 1/2" UNLESS OTHERWISE SHOWN) DEEP IN CONSTRUCTION JOINTS IN WALLS, SLABS, AND BETWEEN WALLS AND FOOTINGS. ACCEPTED BULKHEADS DESIGNED FOR THIS PURPOSE MAY BE USED IN SLABS. PROVIDE WATERSTOP WHERE INDICATED.
    - ISOLATION JOINTS: PROVIDE IN SLABS-ON-GRADE AT POINTS OF CONTACT BETWEEN SLABS-ON-GRADE AND VERTICAL SURFACES, SUCH AS FOUNDATION WALLS, GRADE BEAMS, COLUMN PEDESTALS, AND ELSEWHERE AS NECESSARY.
    - CONTRACTION (CONTROL) JOINT: PROVIDE IN SLABS-ON-GRADE BY USING INSERTS OR BY SAW CUTTING TO A DEPTH OF 1/2 THE SLAB THICKNESS. PROVIDE A ONE PART ELASTOMERIC JOINT SEALANT TO JOINT GROOVE. A MINIMUM OF 60 DAYS AFTER SLAB PLACEMENT UNLESS OTHERWISE APPROVED.
- CONCRETE MIXING:
  - READY-MIXED CONCRETE SHALL BE MIXED AND DELIVERED IN ACCORDANCE WITH THE REQUIREMENTS SET FORTH IN ASTM C94.
  - ALL CONCRETE SHALL BE MIXED UNTIL THERE IS A UNIFORM DISTRIBUTION OF THE MATERIALS BEFORE DISCHARGE. THE MIXING SHALL BE CONTINUOUS AFTER THE WATER HAS BEEN ADDED TO THE MIX IN THE DRUM.
  - NO CONCRETE SHALL BE PLACED IN THE FORMS MORE THAN 90 MINUTES AFTER THE WATER HAS BEEN ADDED.
  - AFTER THE MAXIMUM WATER CEMENT RATIO HAS BEEN ACHIEVED, RETEMPERING OF THE CONCRETE WILL NOT BE ALLOWED, UNLESS APPROVED BY ENGINEER.
- CONCRETE PLACEMENT:
  - DEPOSIT CONCRETE CONTINUOUSLY IN LAYERS NOT DEEPER THAN 24" OVER PREVIOUS LAYERS WHICH ARE STILL PLASTIC. AVOID COLD JOINTS. CONSOLIDATE CONCRETE BY MECHANICAL VIBRATING EQUIPMENT, SUPPLEMENTED BY HAND-SPACING, RODDING AND TAMPING. DO NOT USE MECHANICAL VIBRATORS TO TRANSPORT CONCRETE.
  - HOT-WEATHER PLACEMENT: PLACE CONCRETE ACCORDING TO RECOMMENDATIONS IN ACI 308R AND AS FOLLOWS, WHEN HOT-WEATHER CONDITIONS EXIST:
    - COOL INGREDIENTS BEFORE MIXING TO MAINTAIN CONCRETE TEMPERATURE BELOW 90 DEG F AT TIME OF PLACEMENT. CHILLED MIXING WATER OR CHOPPED ICE MAY BE USED TO CONTROL TEMPERATURE, PROVIDED WATER EQUIVALENT OF ICE IS CALCULATED TO TOTAL AMOUNT OF MIXING WATER. USING LIQUID NITROGEN TO COOL CONCRETE IS CONTRACTOR'S OPTION.
    - COVER STEEL REINFORCEMENT WITH WATER-SOAKED BURLAP 50 STEEL TEMPERATURE WILL NOT EXCEED AMBIENT AIR TEMPERATURE IMMEDIATELY BEFORE EMBEDDING IN CONCRETE.
    - FOG-SPRAY FORMS, STEEL REINFORCEMENT, AND SUBGRADE JUST BEFORE PLACING CONCRETE. KEEP SUBGRADE MOISTURE UNIFORM WITHOUT STANDING WATER, SOFT SPOTS, OR DRY AREAS.
  - COLD-WEATHER PLACEMENT: COMPLY WITH ACI 306.1 AND AS FOLLOWS.
    - PROTECT CONCRETE WORK FROM PHYSICAL DAMAGE OR REDUCED STRENGTH THAT COULD BE CAUSED BY FROST, FREEZING ACTIONS, OR LOW TEMPERATURES.
    - WHEN AIR TEMPERATURE HAS FALLEN TO OR IS EXPECTED TO FALL BELOW 40 DEG F, UNIFORM HEAT WATER AND AGGREGATES BEFORE MIXING TO OBTAIN A CONCRETE MIXTURE TEMPERATURE OF NOT LESS THAN 50 DEG F AND NOT MORE THAN 80 DEG F AT POINT OF PLACEMENT.
    - DO NOT USE FROZEN MATERIALS OR MATERIALS CONTAINING ICE OR SNOW. DO NOT PLACE CONCRETE ON FROZEN SUBGRADE OR ON SUBGRADE CONTAINING FROZEN MATERIALS.
    - DO NOT USE CALCIUM CHLORIDE, SALT, OR OTHER MATERIALS CONTAINING ANTI-FREEZE AGENTS OR CHEMICAL ACCELERATORS, UNLESS OTHERWISE SPECIFIED AND APPROVED IN MIX DESIGNS.
- CONCRETE CURING:
  - SLABS: USE MOISTURE CURE OR CURING COMPOUND. APPLY CURING COMPOUND WITHIN 2 HOURS OF FINAL FINISHING BY SPRAY OR ROLLER. RECOAT AREAS SUBJECT TO HEAVY RAINFALL. DO NOT USE CURING COMPOUND ON SLABS WHICH WILL RECEIVE LIQUID FLOOR HARDENER OR OTHER FINISHES.
  - FORMED SURFACES: CURE FORMED SURFACES WITH FORMS IN PLACE FOR ENTIRE CURING PERIOD, UNLESS ALTERNATE METHODS ARE APPROVED BY THE ENGINEER. CONTACT STRUCTURAL ENGINEER @ 207-878-1751 FOR ALTERNATIVE CURING METHODS. DURING COLD WEATHER CURING, PROVIDE CAST-IN THERMOMETERS FOR MONITORING CONCRETE CURING TEMPERATURE AT LOCATIONS AS DIRECTED BY ENGINEER. MAINTAIN A 50°F WITH USE OF INDIRECT HEAT OR INSULATIVE BLANKETS.
- ANCHOR BOLTS: USE TYPE, SIZE, AND LENGTH AS INDICATED ON PLANS.

**WOOD FRAMING NOTES**

- STRUCTURAL TIMBERS: #1 DOUGLAS FIR OR BETTER LAMINATED VENEER LUMBER (LVL) BY BOISE:
  - BEAMS: 31 COFV VERSA-LAM LVL
  - COLUMNS: 2650 FB VERSA-LAM LVL
- DESIGN CODES:
  - NATIONAL DESIGN SPECIFICATIONS FOR WOOD CONSTRUCTION BY THE NATIONAL FOREST PRODUCTS ASSOCIATION.
- FASTENERS: COMPLY WITH RECOMMENDED FASTENING SCHEDULE IBC 2009 TABLE 2304.9.1 UNLESS SHOWN OTHERWISE ON THE DRAWINGS.
- ALL BOLTED WOOD CONNECTIONS TO BE MADE WITH G90 HOT DIP GALVANIZED HEX HEAD THROUGH BOLTS. SIZE AS INDICATED ON THE DRAWINGS. DOME HEADED CARRIAGE BOLTS ARE NOT PERMITTED.
- ALL NAILS TO SIMPSON PRODUCTS AND PT LUMBER TO BE G90 HOT DIP GALVANIZED 0.162" COMMON BOX NAILS, OR AS RECOMMENDED BY SIMPSON.
- ALL SIMPSON PRODUCTS IN CONTACT WITH PT LUMBER TO BE "ZMAX" (G185 GALVANIZED) COATED.
- ALL STEEL PLATE TO BE A36.
- PROVIDE TIMBER TRUSS SHOP DRAWINGS INDICATING TIMBER FRAMING GEOMETRY, CONNECTIONS, TIMBER SPECIES/GRADE, LAYOUT, AND DETAILS.



**FOUNDATION NOTES:**

- TOC INDICATES TOP OF CONCRETE
- TOP OF CONCRETE AND TOP OF FOOTING ELEVATIONS ARE REFERENCED FROM FINISHED FLOOR ELEVATION = (+ 83.5) = 0'-0"

FOOTING SCHEDULE		
MARK	SIZE	BOTTOM REINFORCING
F6	6'-0"x6'-0"x1'-4"	(6) #6'S E.W.
F49	4'-0"x9'-0"x1'-4"	(14) #5'S S.W. (5) #5'S L.W.

PIER SCHEDULE		
MARK	SIZE	REINFORCING
P1	12"x20"	4-#5 VERT U-BARS, #3 TIES 10" O.C.
P2	10"x10"	2-#5 VERT U-BARS, #3 TIES 10" O.C.

**CONCRETE PIER TO POST**  
SCALE: 1" = 1'-0"

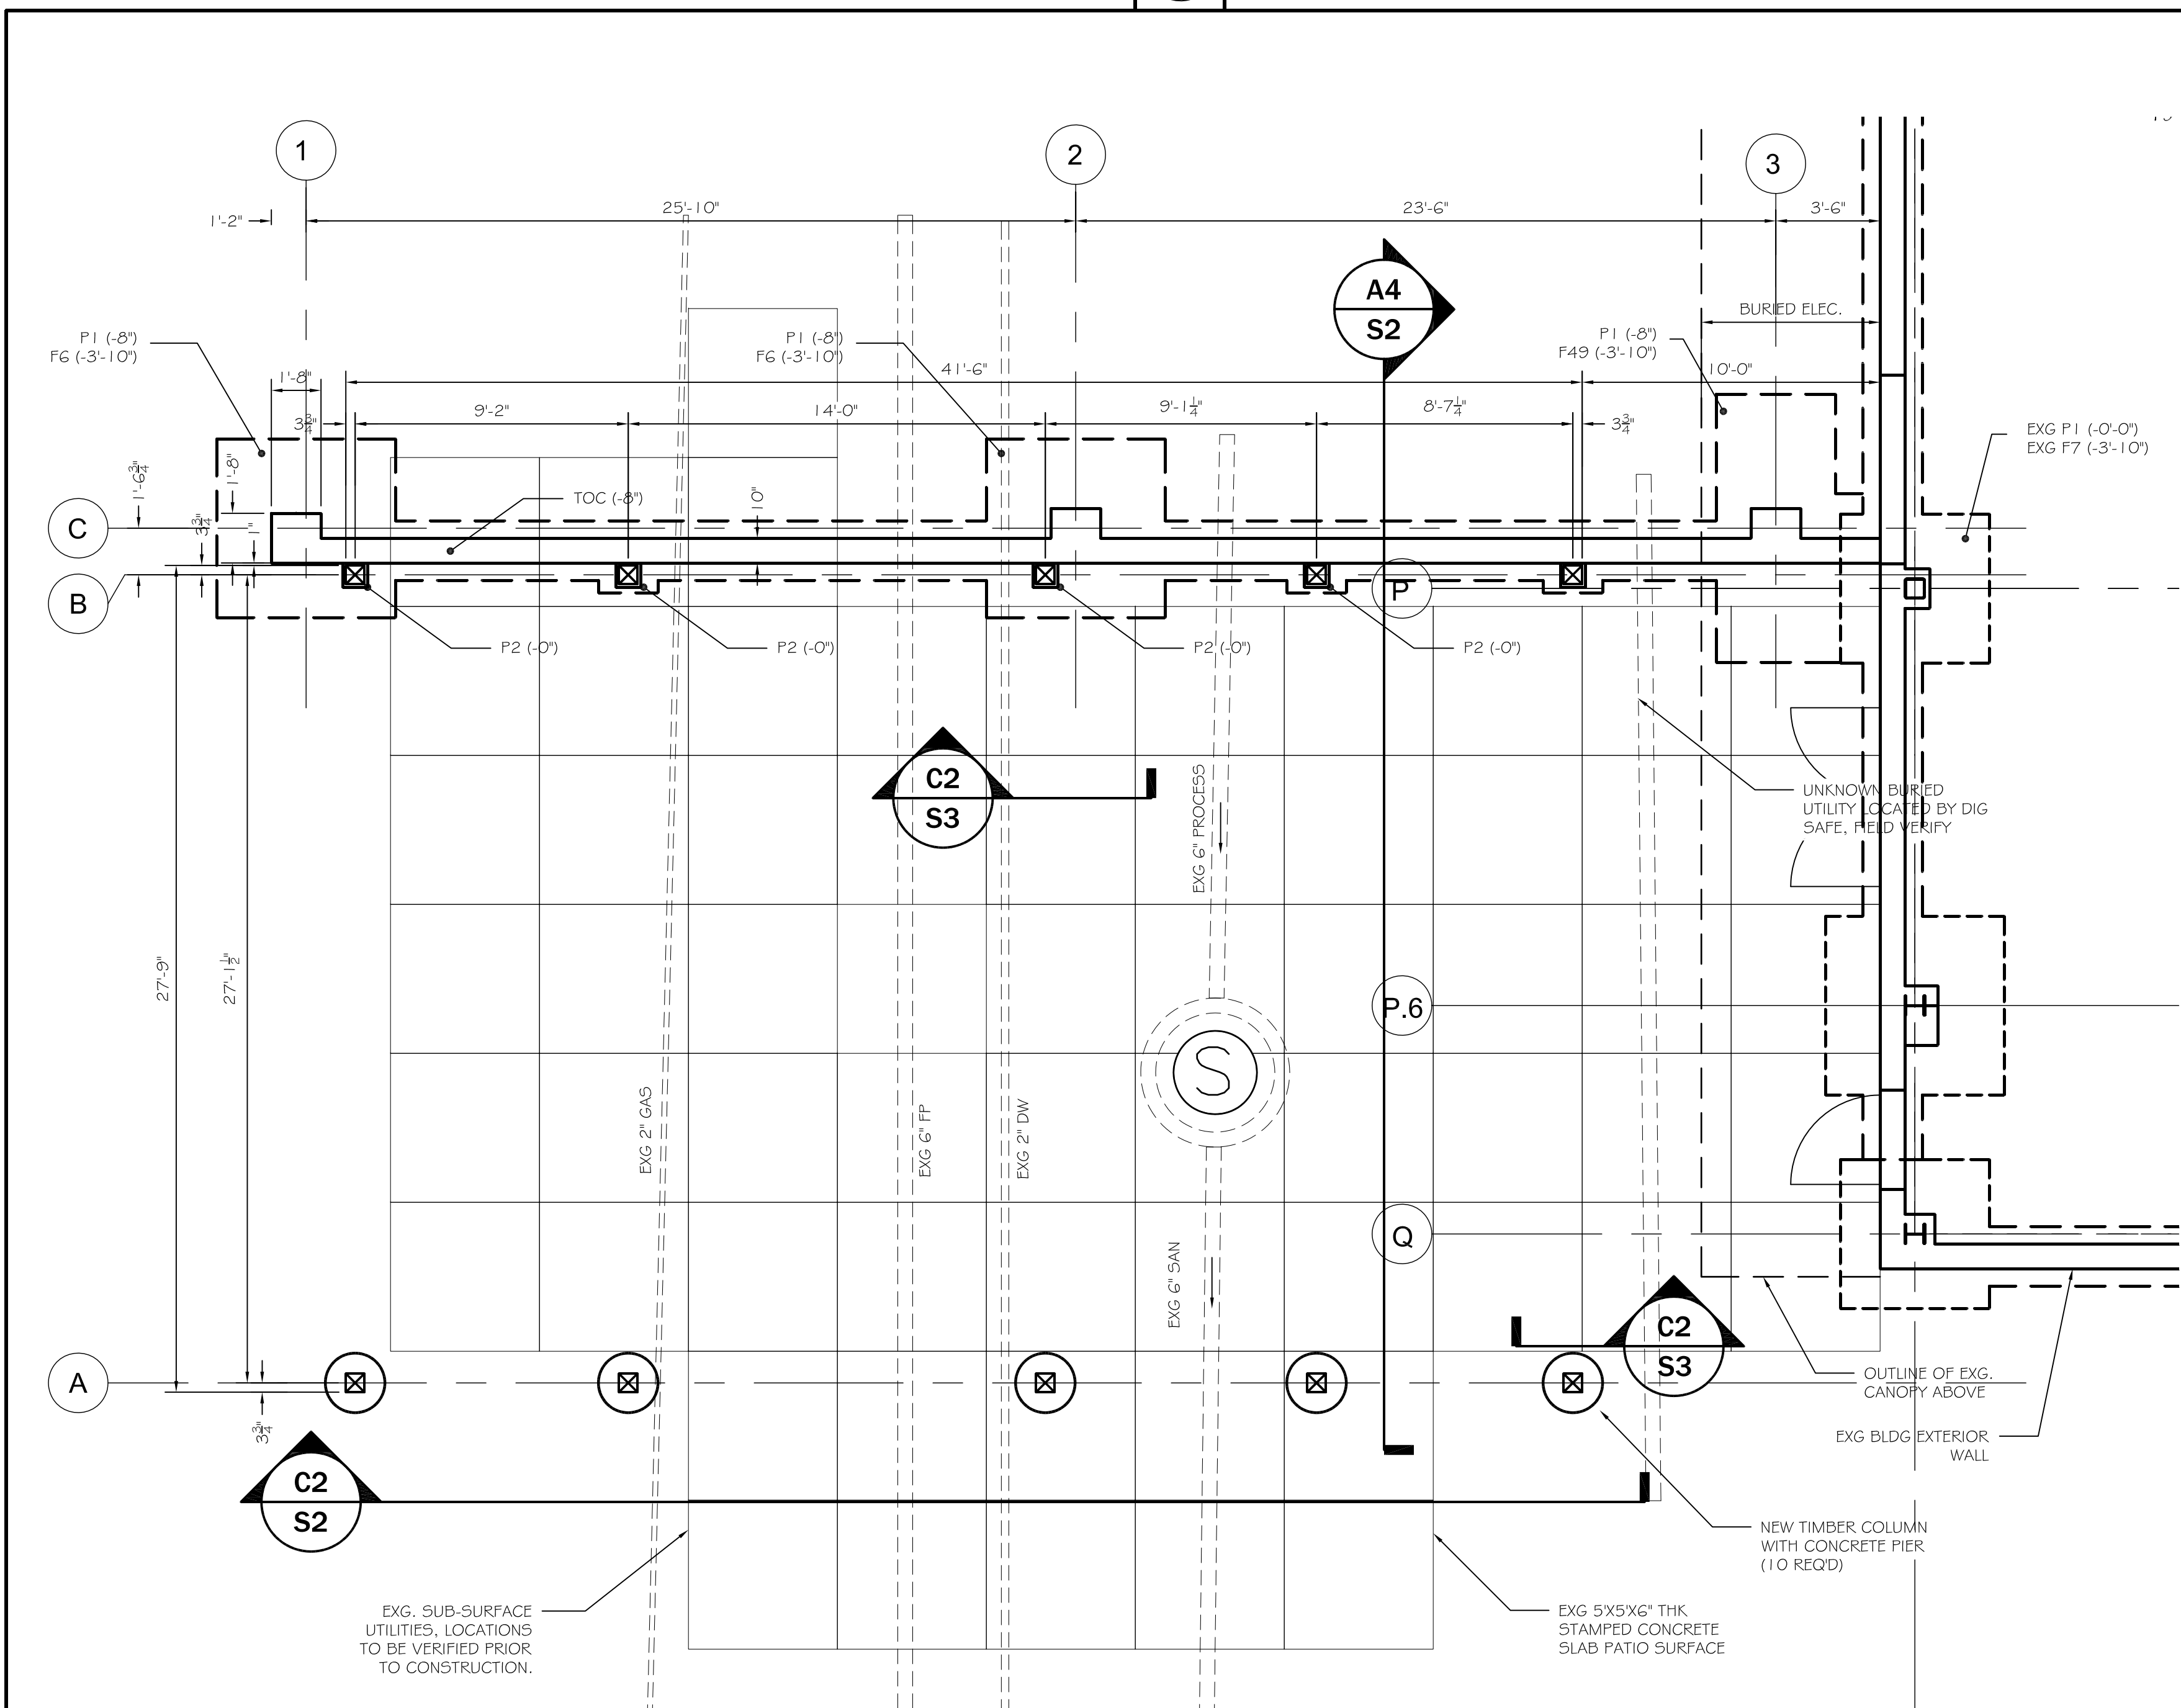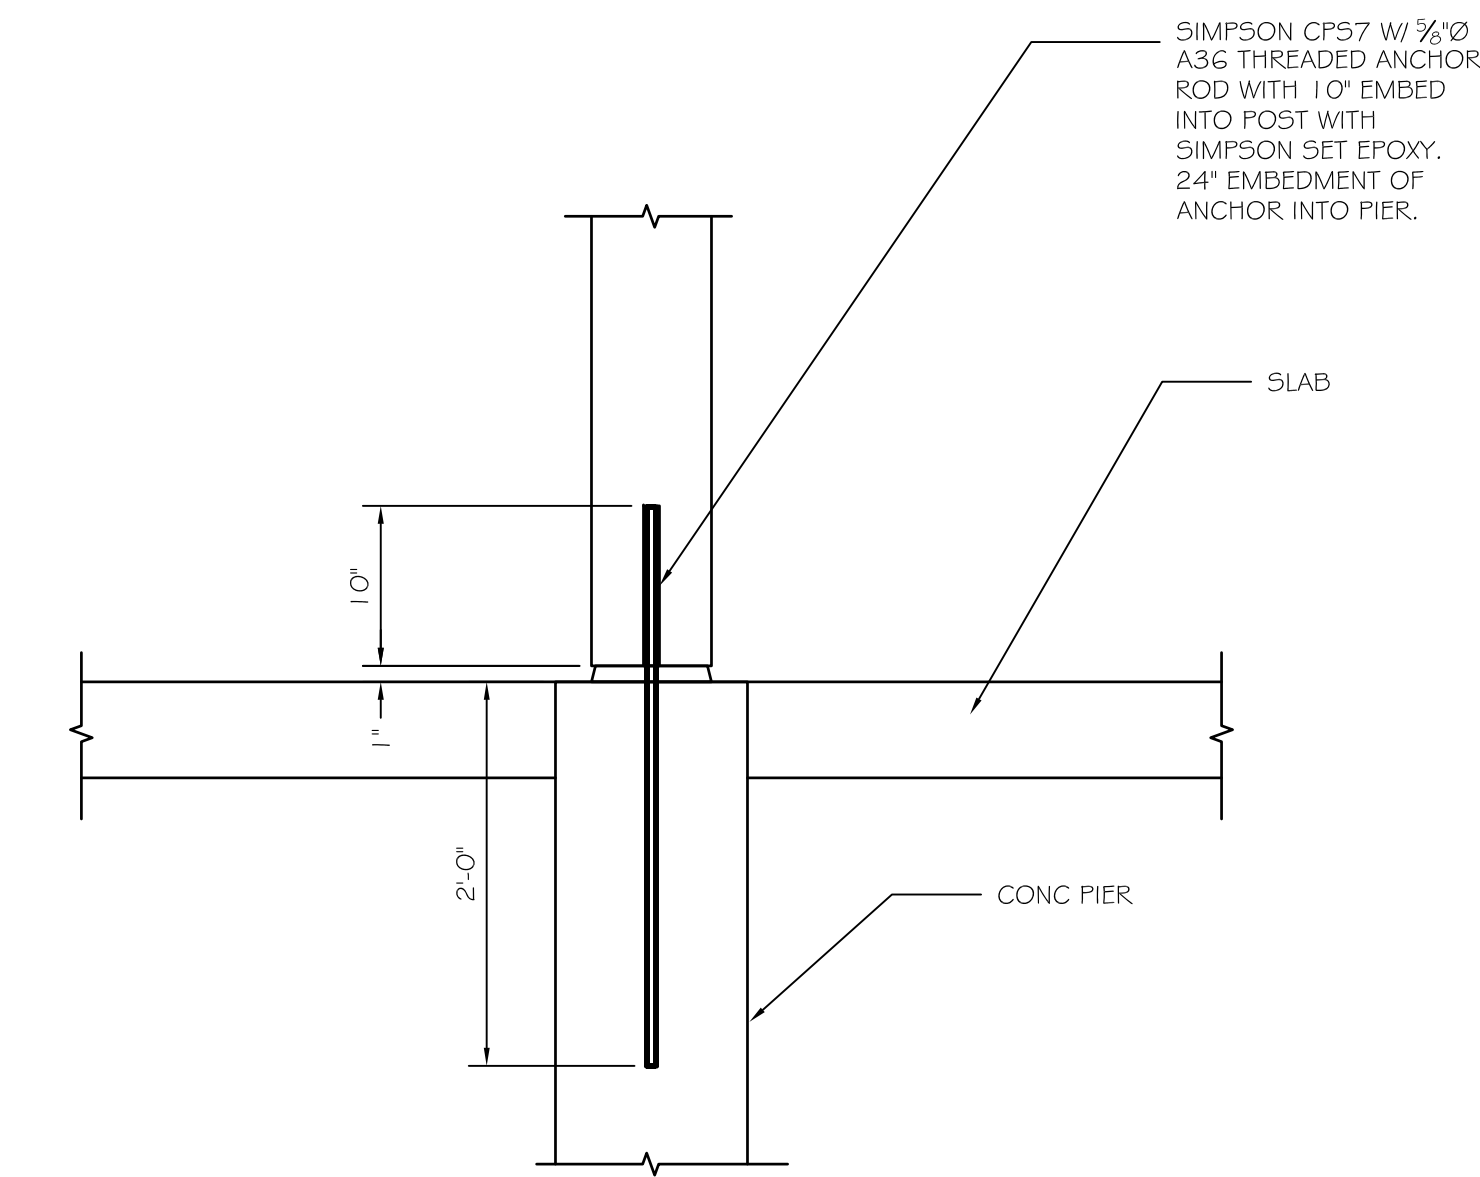


A4

NOTES

A1

FOUNDATION PLAN

SCALE: 1/4" = 1'-0"

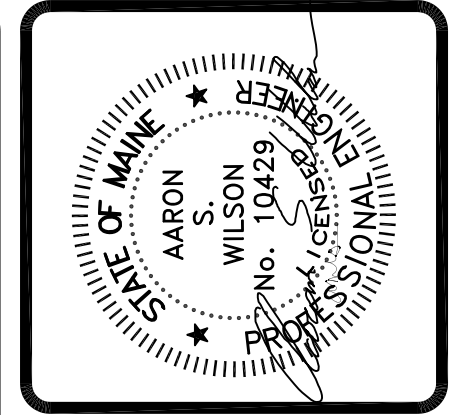

**ASSOCIATED DESIGN PARTNERS INC.**  
 Office: (207) 878-1751  
 Fax: (207) 878-1788  
 E-Mail: [adp@adpengineering.com](mailto:adp@adpengineering.com)  
 80 Leighton Road  
 Falmouth, Maine 04105

THIS DRAWING, DESIGN AND ELECTRONIC FILE ARE THE PROPERTY OF ASSOCIATED DESIGN PARTNERS, INC. THE REPRODUCTION, COPYING OR ANY OTHER USE OF THIS DOCUMENT WITHOUT WRITTEN CONSENT IS PROHIBITED.

PROJECT: **ALLAGASH BREWING CO. PORTLAND, MAINE**  
 SHEET TITLE: **PATIO ROOF PROJECT FOUNDATION PLAN - ISSUED FOR PERMITTING**

NO.	BY	DATE	REVISIONS DESCRIPTION
1	ASW		
2	ASW		
3	ASW		

DATE: 6-11-15  
 SCALE: AS NOTED  
 DESIGN BY: ASW  
 DRAWN BY: RSC  
 PROJECT NUMBER: **15192**  
 SHEET NO: **S1**