




GRAVEL DRIVE SECTION
NOT TO SCALE

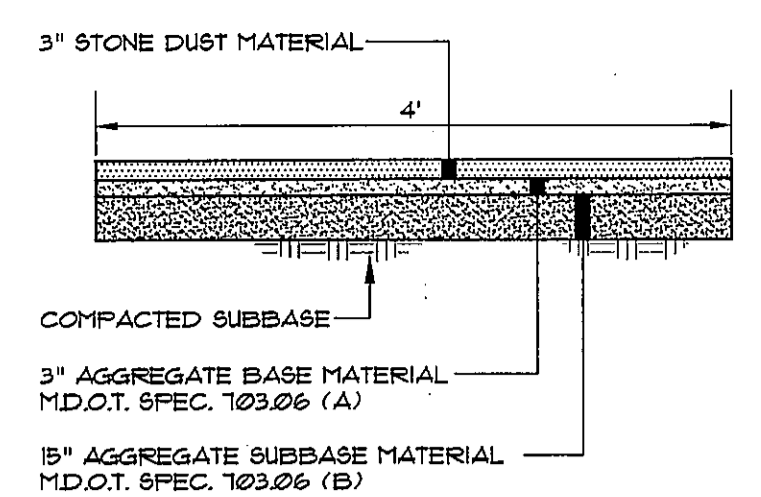


STONE DUST WALK SECTION
NOT TO SCALE

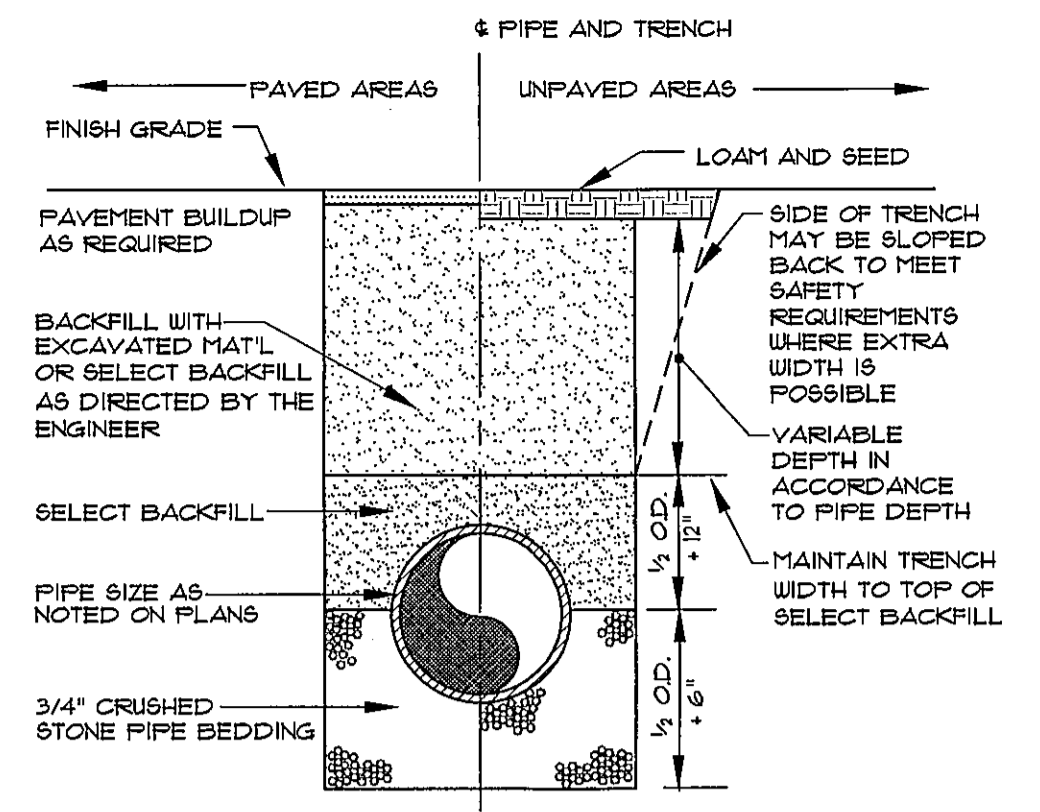

TYPICAL TRENCH SECTION
NOT TO SCALE

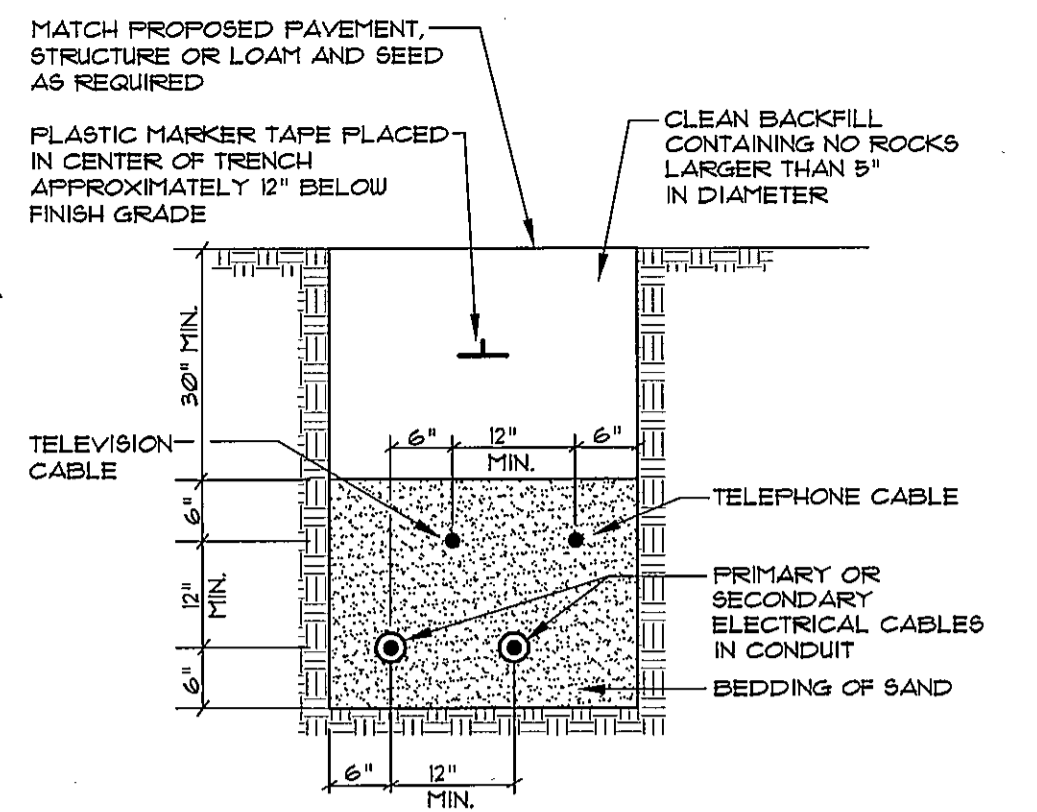


TYPICAL UNDERGROUND CABLE INSTALLATION
NOT TO SCALE

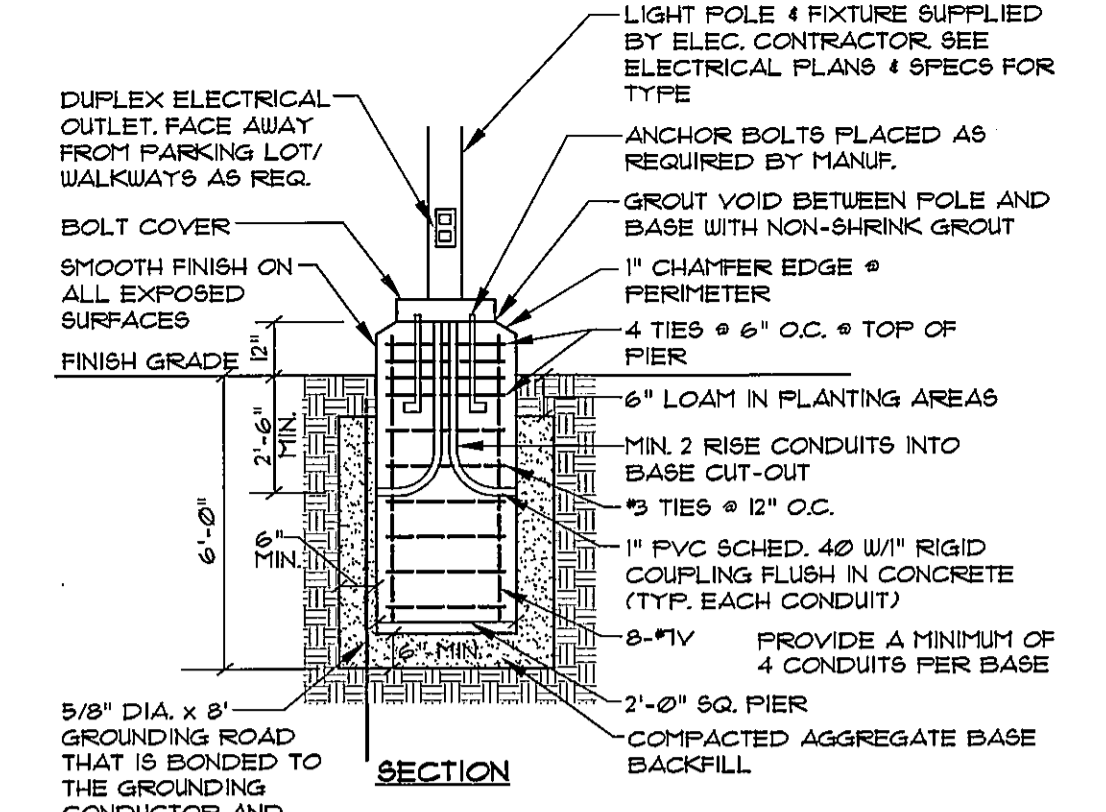

SECTION
PLAN


- NOTES:**
1. CONCRETE f'c=4000 psi.
 2. REIN. STEEL GRADE 60 NEW BARS.
 3. CONCRETE 3/4" AGG., 6 1/2-1% ENTRAINED AIR.
 4. PROVIDE 2 COATS BITUMINOUS DAMPROOFING FOR ALL CONCRETE BELOW GRADE.
 5. INSTALL BASE 3'-0" ABOVE FINISH GRADE IN LOCATIONS WHERE POLES ARE IN PARKING LOT PAVEMENT.
 6. BID ALT. CONTRACTOR MAY SUBSTITUTE PRECAST CONCRETE LIGHT POLE BASE EQUAL TO SPEC.

LIGHT POLE BASE
NOT TO SCALE

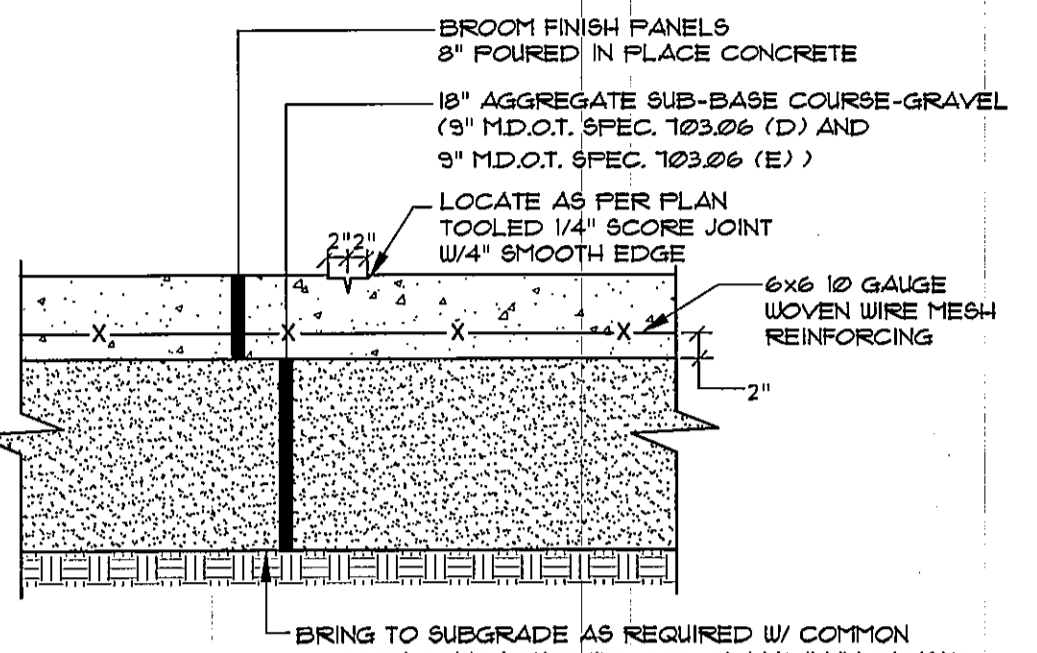


- NOTES:**
1. COMPACT GRAVEL SUB-BASE, BASE COURSE TO 92% OF MAXIMUM DENSITY USING HEAVY ROLLER COMPACTION.
 2. CONTRACTOR SHALL SET GRADE STAKES MARKING SUBBASE AND FINISH GRADE ELEVATIONS FOR CONSTRUCTION REFERENCE.

HEAVY DUTY CONCRETE PAVEMENT
NOT TO SCALE

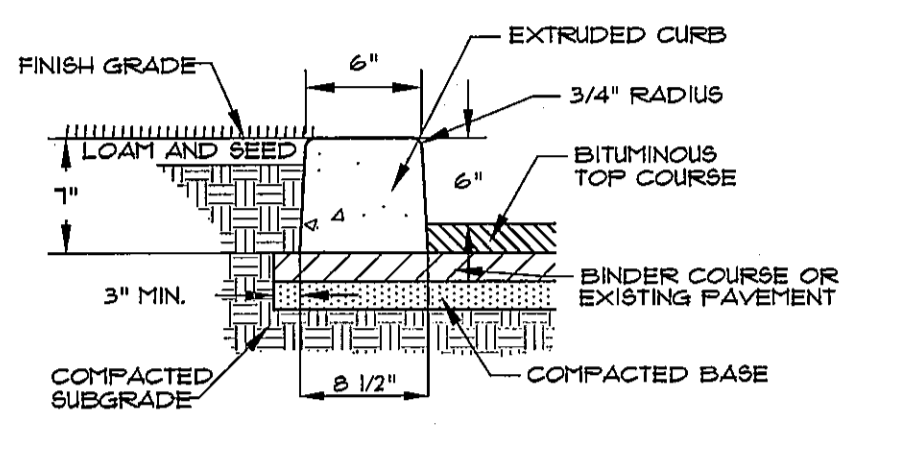


SLIPFORM CONCRETE CURB
NOT TO SCALE

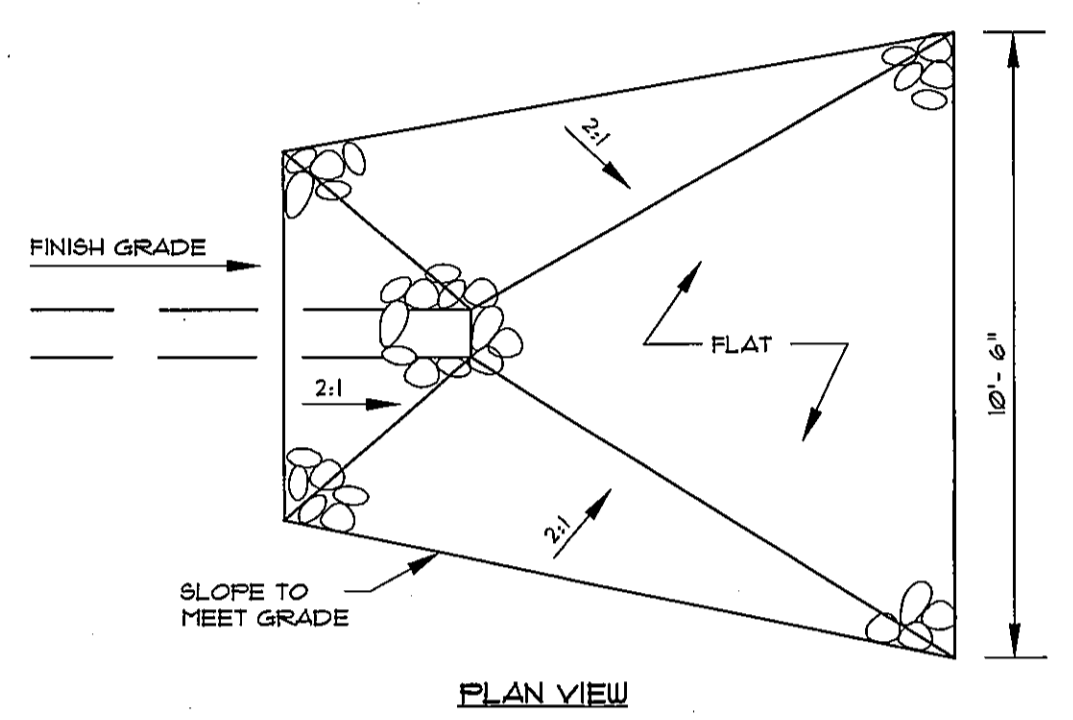


PLAN VIEW
SECTION VIEW


RIPRAP APRON
NOT TO SCALE

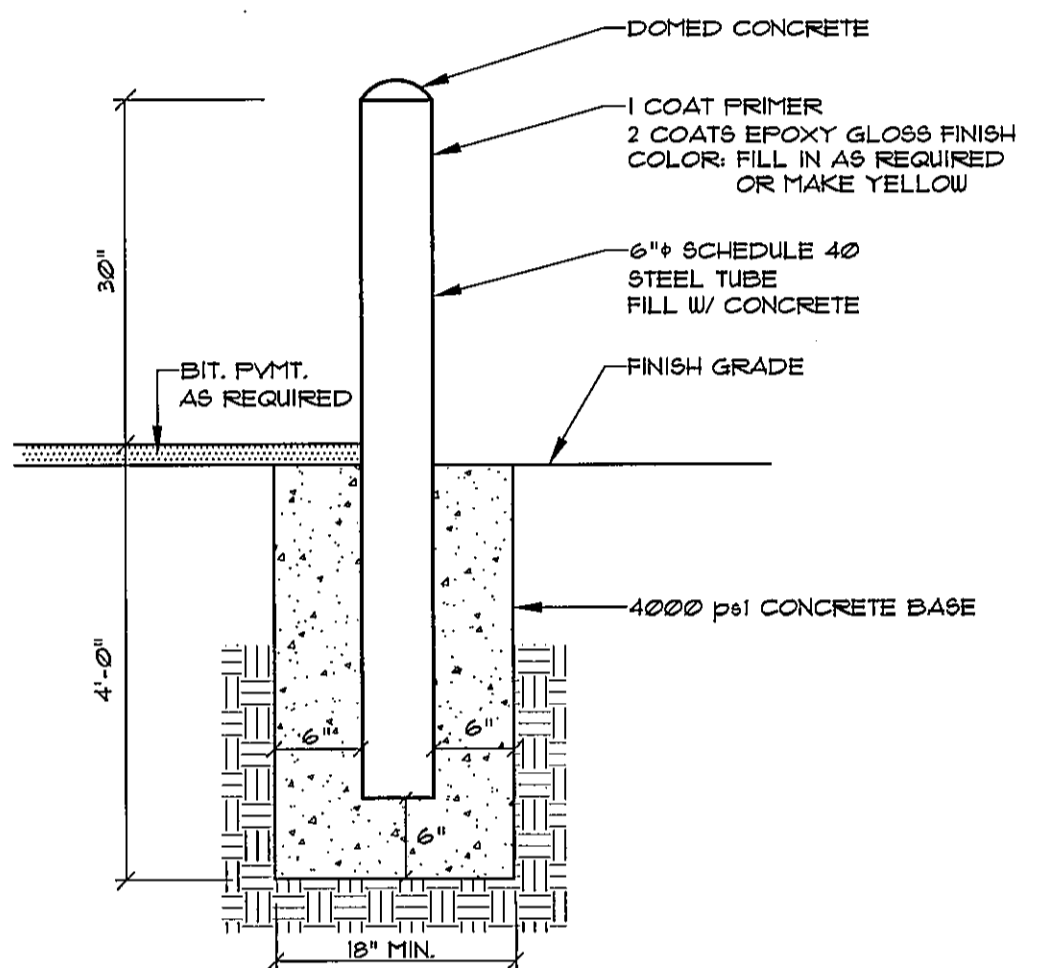

METAL BOLLARD
NOT TO SCALE

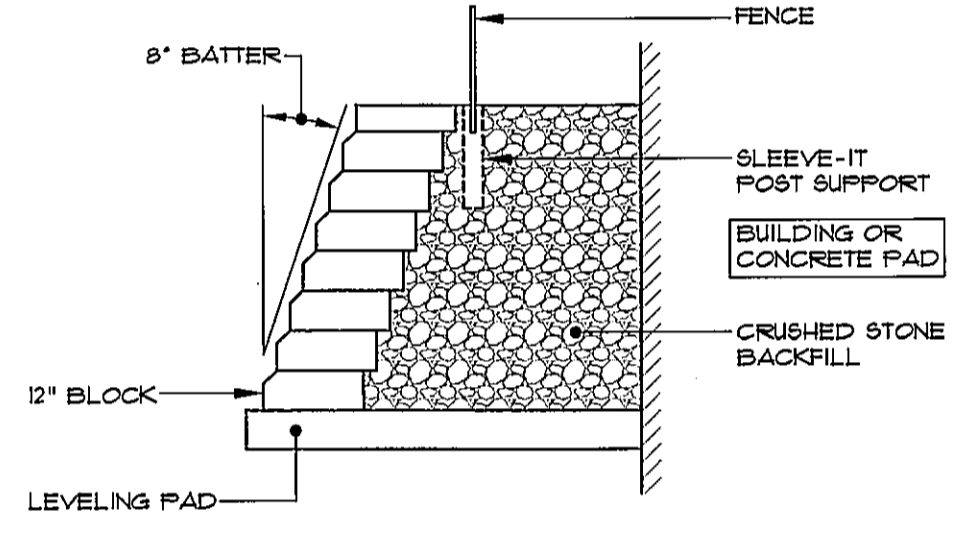


BLOCK RETAINING WALL
NOT TO SCALE

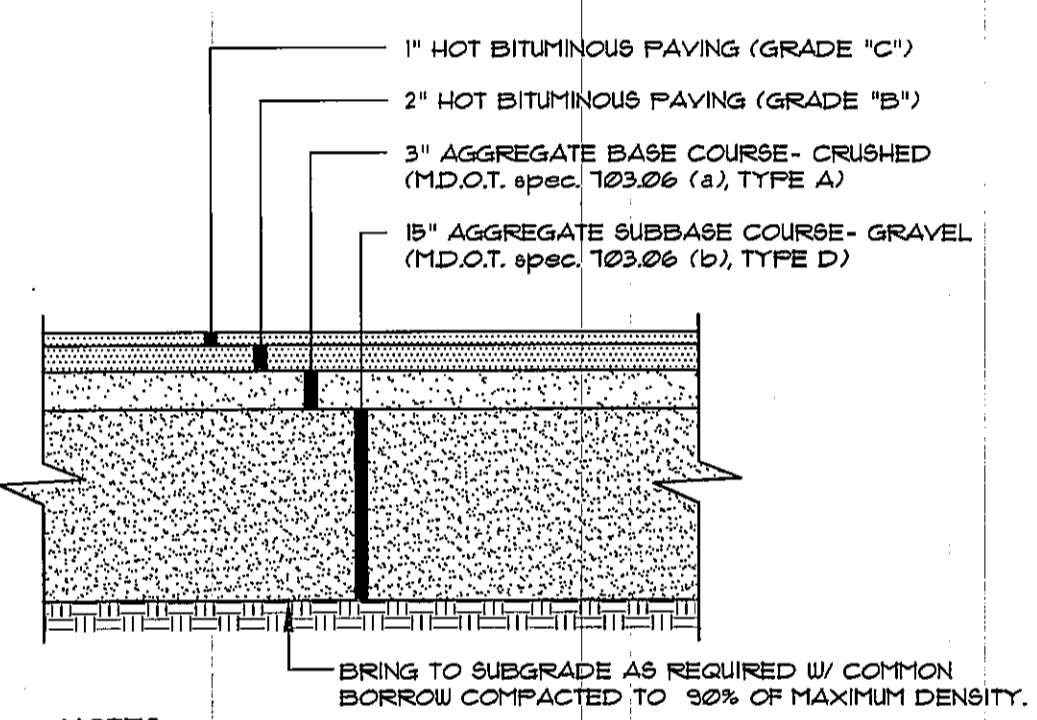


- NOTES:**
1. COMPACT GRAVEL SUBBASE, BASE COURSE TO 92% OF MAXIMUM DENSITY USING HEAVY ROLLER COMPACTION.
 2. CONTRACTOR SHALL SET GRADE STAKES MARKING SUBBASE AND FINISH GRADE ELEVATIONS FOR CONSTRUCTION REFERENCE.

TYP. PAVED PARKING LOT SECTION
NOT TO SCALE

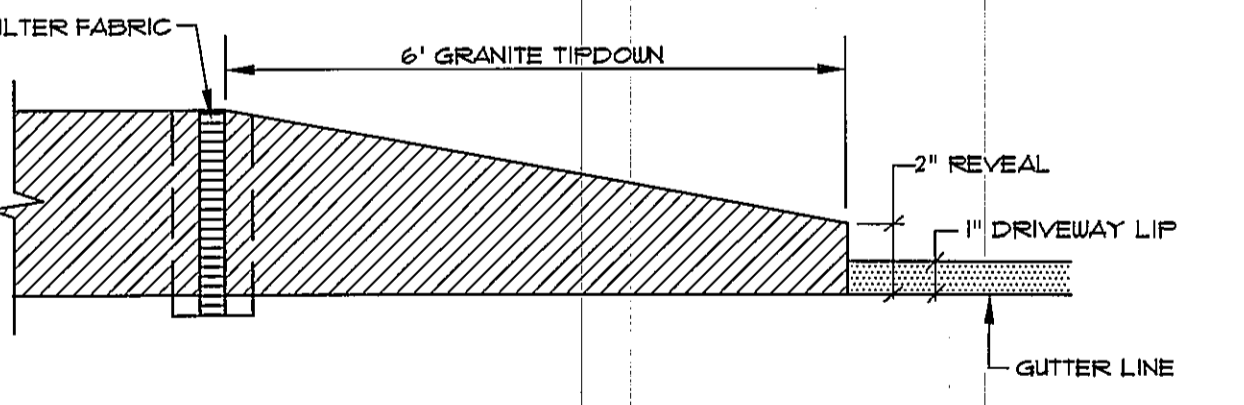


TYPICAL TIPDOWN CURB INSTALLATION
NOT TO SCALE

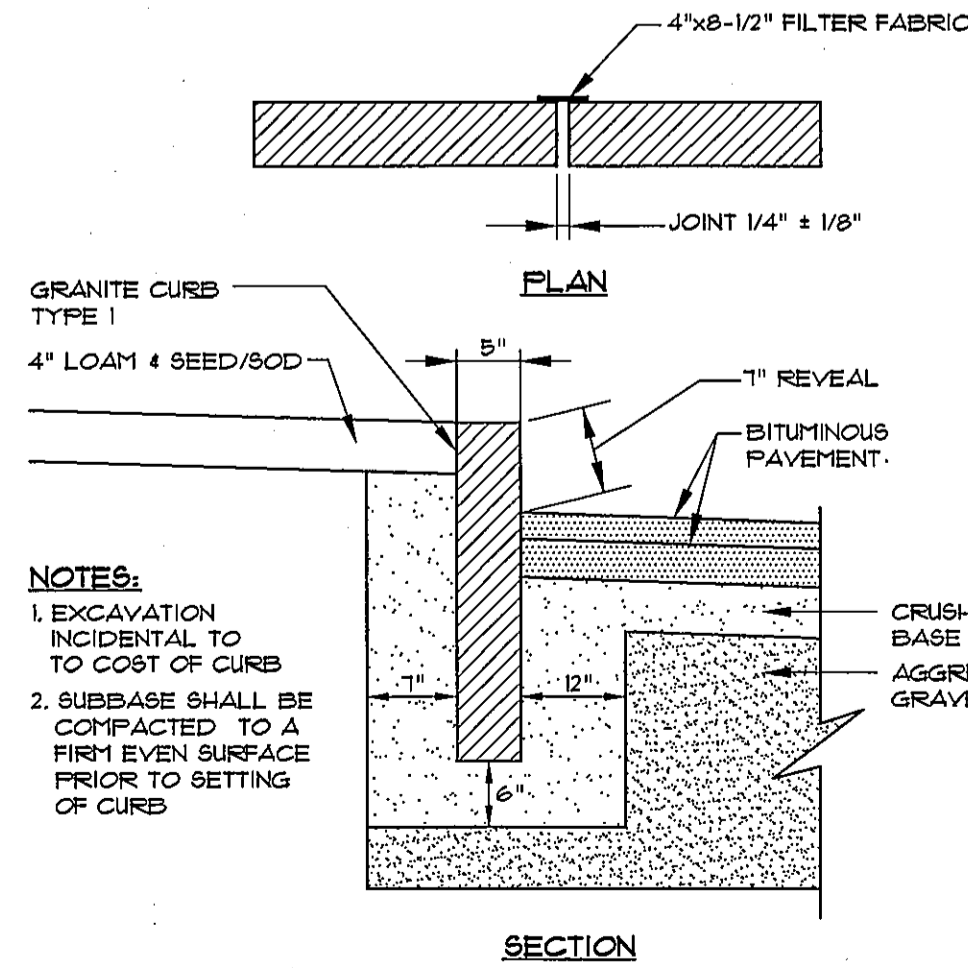


- NOTES:**
1. EXCAVATION INCIDENTAL TO TO COST OF CURB.
 2. SUBBASE SHALL BE COMPACTED TO A FIRM EVEN SURFACE PRIOR TO SETTING OF CURB.

VERTICAL GRANITE CURB
NOT TO SCALE

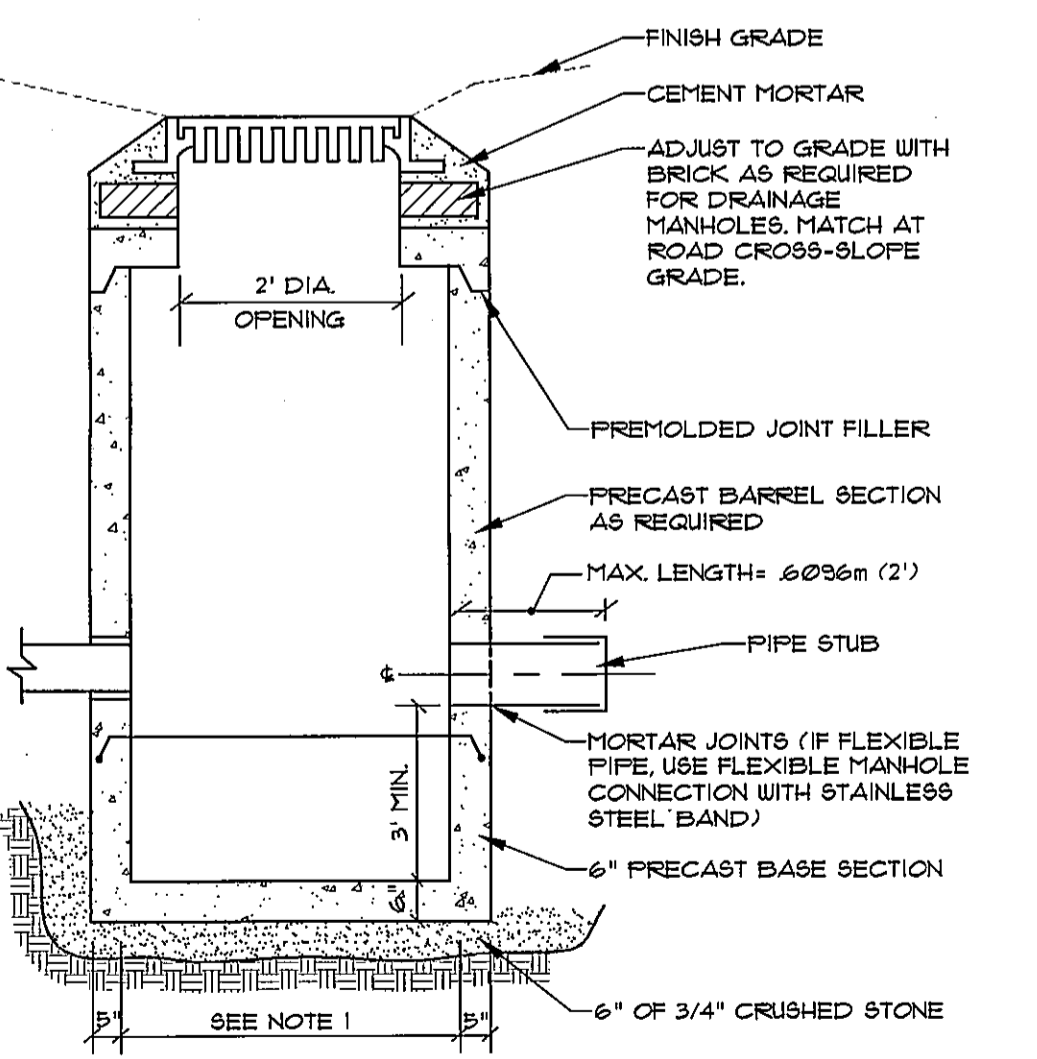


- NOTES:**
1. 4'-0" ID. TYPICAL. SOME STRUCTURES MAY REQUIRE LARGER ID. PROVIDE SHOP DRAWINGS.
 2. DRAINAGE STRUCTURES TO BE DESIGNED FOR H-20 LOADING.
 3. PIPE SIZES AND INVERTS AS NOTED ON PLANS.
 4. CATCH BASIN FRAME AND GRATE TO BE GENERAL FOUNDRY I2462 OR APPROVED EQUAL. LOW PROFILE FRAMES AND COVERS MAY BE USED AS A SUBSTITUTE.
 5. DRAINAGE MANHOLE FRAME AND COVER TO BE GENERAL FOUNDRY I2462 OR APPROVED EQUAL.

TYP. DRAINAGE STRUCTURE & CATCH BASIN
NOT TO SCALE

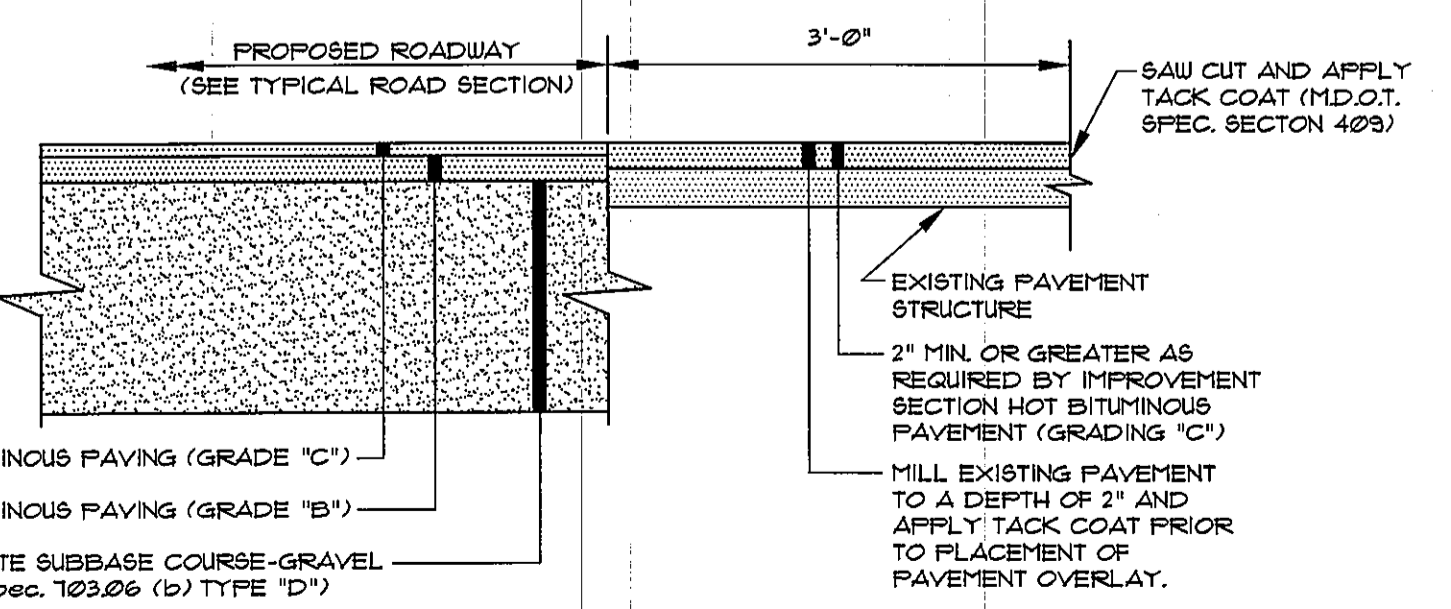


TYPICAL PAVEMENT JOINT
NOT TO SCALE

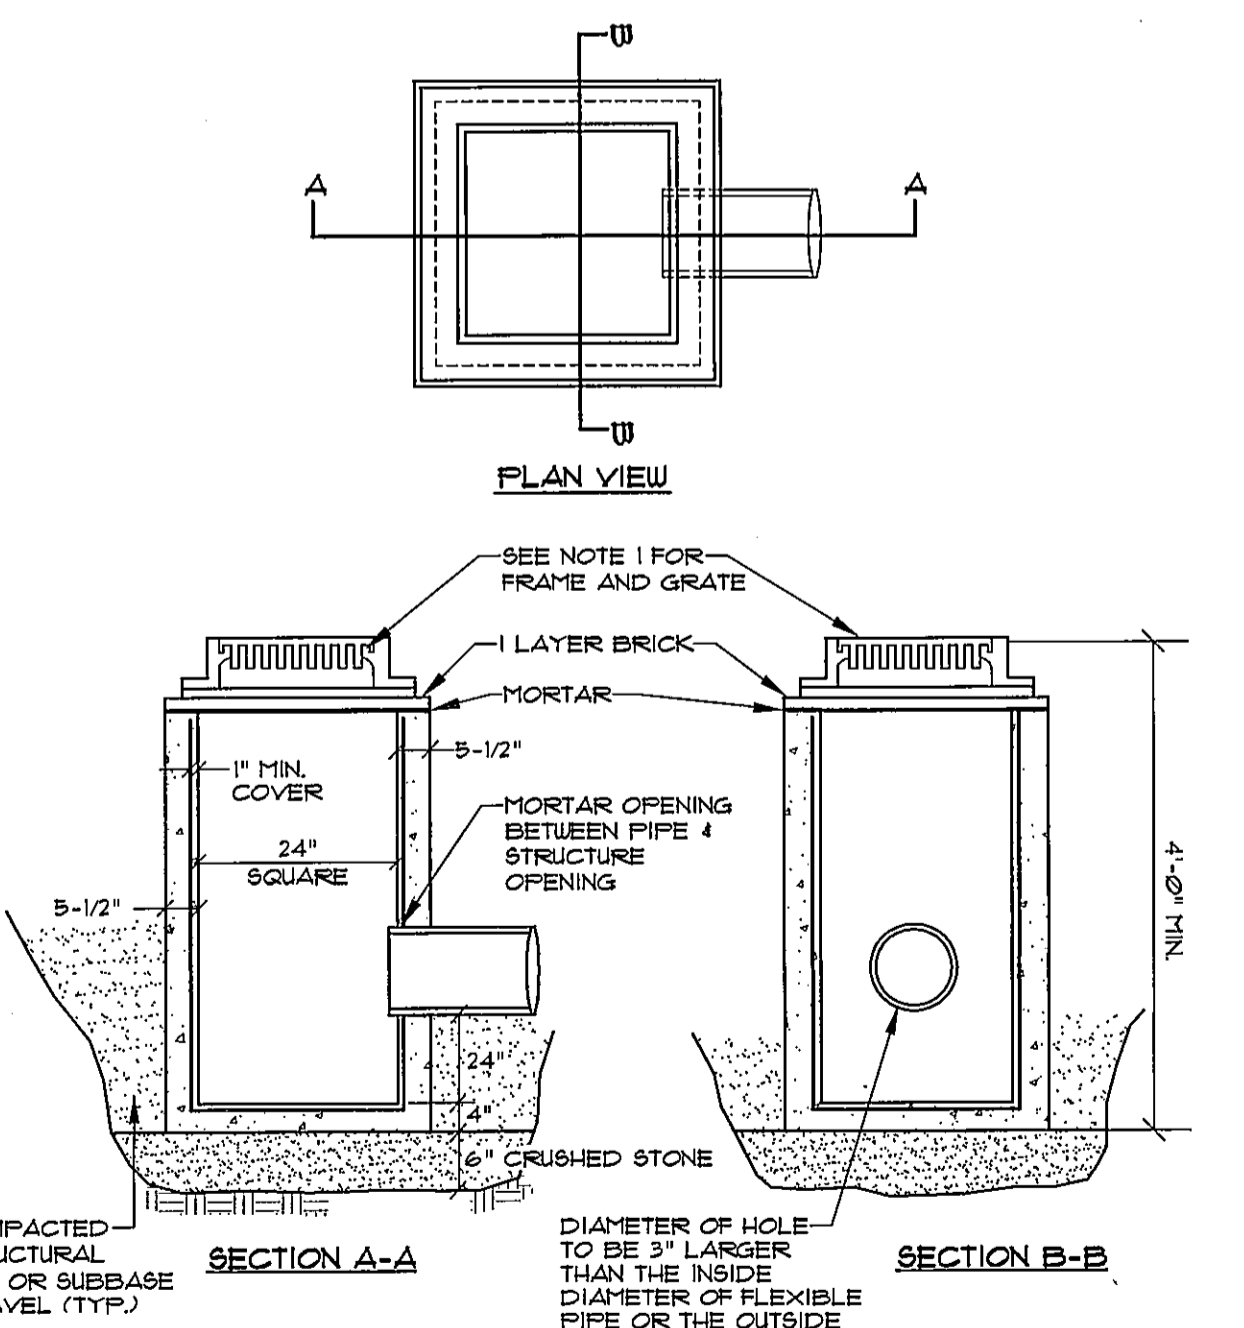

- NOTES:**
1. FRAME SHALL BE FOR 24" SQUARE GRATE - LEBARON TYPE 1" SQUARE FRAME (LF 249) 4" FLANGE OR ETHERIDGE SQUARE FRAME S249. GRATE SHALL BE 24"x24" CAST IRON.
 2. ENTIRE CATCH BASIN WITH EXCEPTION OF LEVELING BRICK FRAME AND GRATE TO BE PRECAST AS SINGLE PORTLAND CEMENT CONCRETE UNIT.

TYP. TYPE "F" CATCH BASIN
NOT TO SCALE

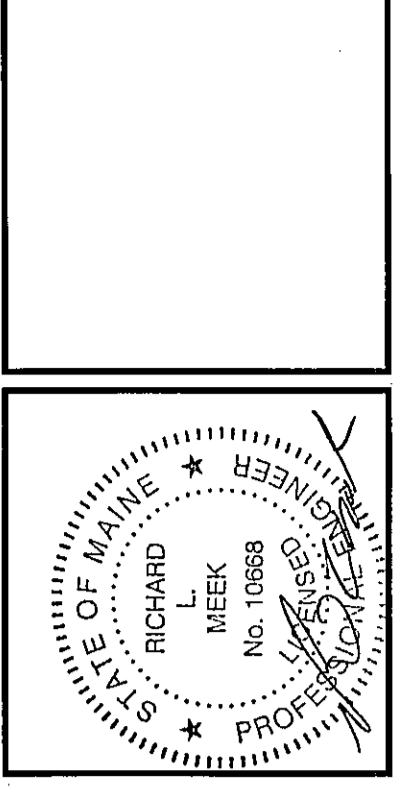

FINAL SITE PLAN SUBMISSION TO CITY	07-11-14	RLM	BY:	DATE:	STATUS:
SITE PLAN SUBMISSION TO CITY	06-03-14	RLM	BY:	DATE:	STATUS:
		A	REV:		

THIS PLAN SHALL NOT BE MODIFIED WITHOUT WRITTEN PERMISSION FROM SEBAGO TECHNICS, INC. ANY ALTERATIONS AUTHORIZED OR OTHERWISE, SHALL BE AT THE USER'S SOLE RISK AND WITHOUT LIABILITY TO SEBAGO TECHNICS, INC.

DESIGN	CHKD	RLM	ML
FIELD BOOK	DESIGN	CHKD	RLM
847			

PROJECT NO. 02249

SEBAGO TECHNICS
WWW.SEAGOTECHNICS.COM
78 John Roberts Rd. - Suite 1A
South Portland, ME 04106
Tel: 207-262-5100 Fax: 207-262-5888

ALLAGASH BREWING COMPANY
INDUSTRIAL WAY
PORTLAND, MAINE
FOR
50 INDUSTRIAL WAY
PORTLAND, MAINE 04103

DATE	SCALE
05-20-14	N.T.S.

SHEET C9