

NOTES:


- SEE SHEET E-001 FOR LEGEND, ABBREVIATIONS, AND GENERAL NOTES.
- SCOPE OF WORK REPRESENTED IS TYPICAL FOR BUILDINGS 12,17,25.
- HOUSE PANELBOARD LOCATED ON EXTERIOR OF BUILDING NEAR METER BANK. METER BANK LOCATION VARIES FROM BUILDING TO BUILDING. GENERALLY, METER BANK IS LOCATED AT NORTH WEST OR NORTH EAST CORNER OF BUILDING. ROUTE NEW CONDUIT ON EXTERIOR OF BUILDING.

KEYED NOTES:

- RELOCATE TELEPHONE SERVICE ENTRANCE. SEE SHEET ED-101 FOR EXISTING LOCATION.
- RELOCATE LIGHT FIXTURE TO NEW WASHER/DRYER ROOM. SEE SHEET ED-101 FOR EXISTING LOCATION.
- RELOCATE WASHER AND DRYER RECEPTACLES TO NEW WASHER/DRYER ROOM. SEE SHEET ED-101 FOR EXISTING LOCATIONS.
- PROVIDE NEW UTILITY LIGHT FIXTURE AND CONVENIENCE RECEPTACLE. PROVIDE 120V 20A-1P CIRCUIT FROM SPACE IN HOUSE PANELBOARD FOR LIGHT AND RECEPTACLE.
- PROVIDE 120V 20A-1P CIRCUIT FROM SPARE IN HOUSE PANELBOARD FOR EACH BOILER AND BOILER PUMP PAIR. PROVIDE BOILER SHUT OFF SWITCH FOR EACH BOILER ON WALL NEAR EXIT. PROVIDE TOGGLE SWITCH DISCONNECT FOR BOILER PUMP. PROVIDE POWER TO BOILER PUMPS THROUGH BOILER INTEGRATED CONTROL PANEL.

KEYED NOTES CONTINUED:

- PROVIDE 120V 20A-1P CIRCUIT FROM A SPARE IN HOUSE PANELBOARD FOR DOMESTIC WATER HEATER.
- PROVIDE 240V 20A-2P CIRCUIT FROM SPACE IN HOUSE PANELBOARD FOR HEATING HOT WATER CIRCULATOR PUMPS. PROVIDE TOGGLE SWITCH DISCONNECT FOR EACH PUMP.
- PROVIDE 120V 20A-1P CIRCUIT FROM SPACE IN HOUSE PANELBOARD FOR DOMESTIC HOT WATER CIRCULATOR PUMP. PROVIDE TOGGLE SWITCH DISCONNECT.
- PROVIDE 120V 20A-1P CIRCUIT FROM SPACE IN HOUSE PANELBOARD FOR ZONE CONTROLLERS.
- RELOCATE RECEPTACLE TO BE INSIDE WASHER/DRYER ROOM.

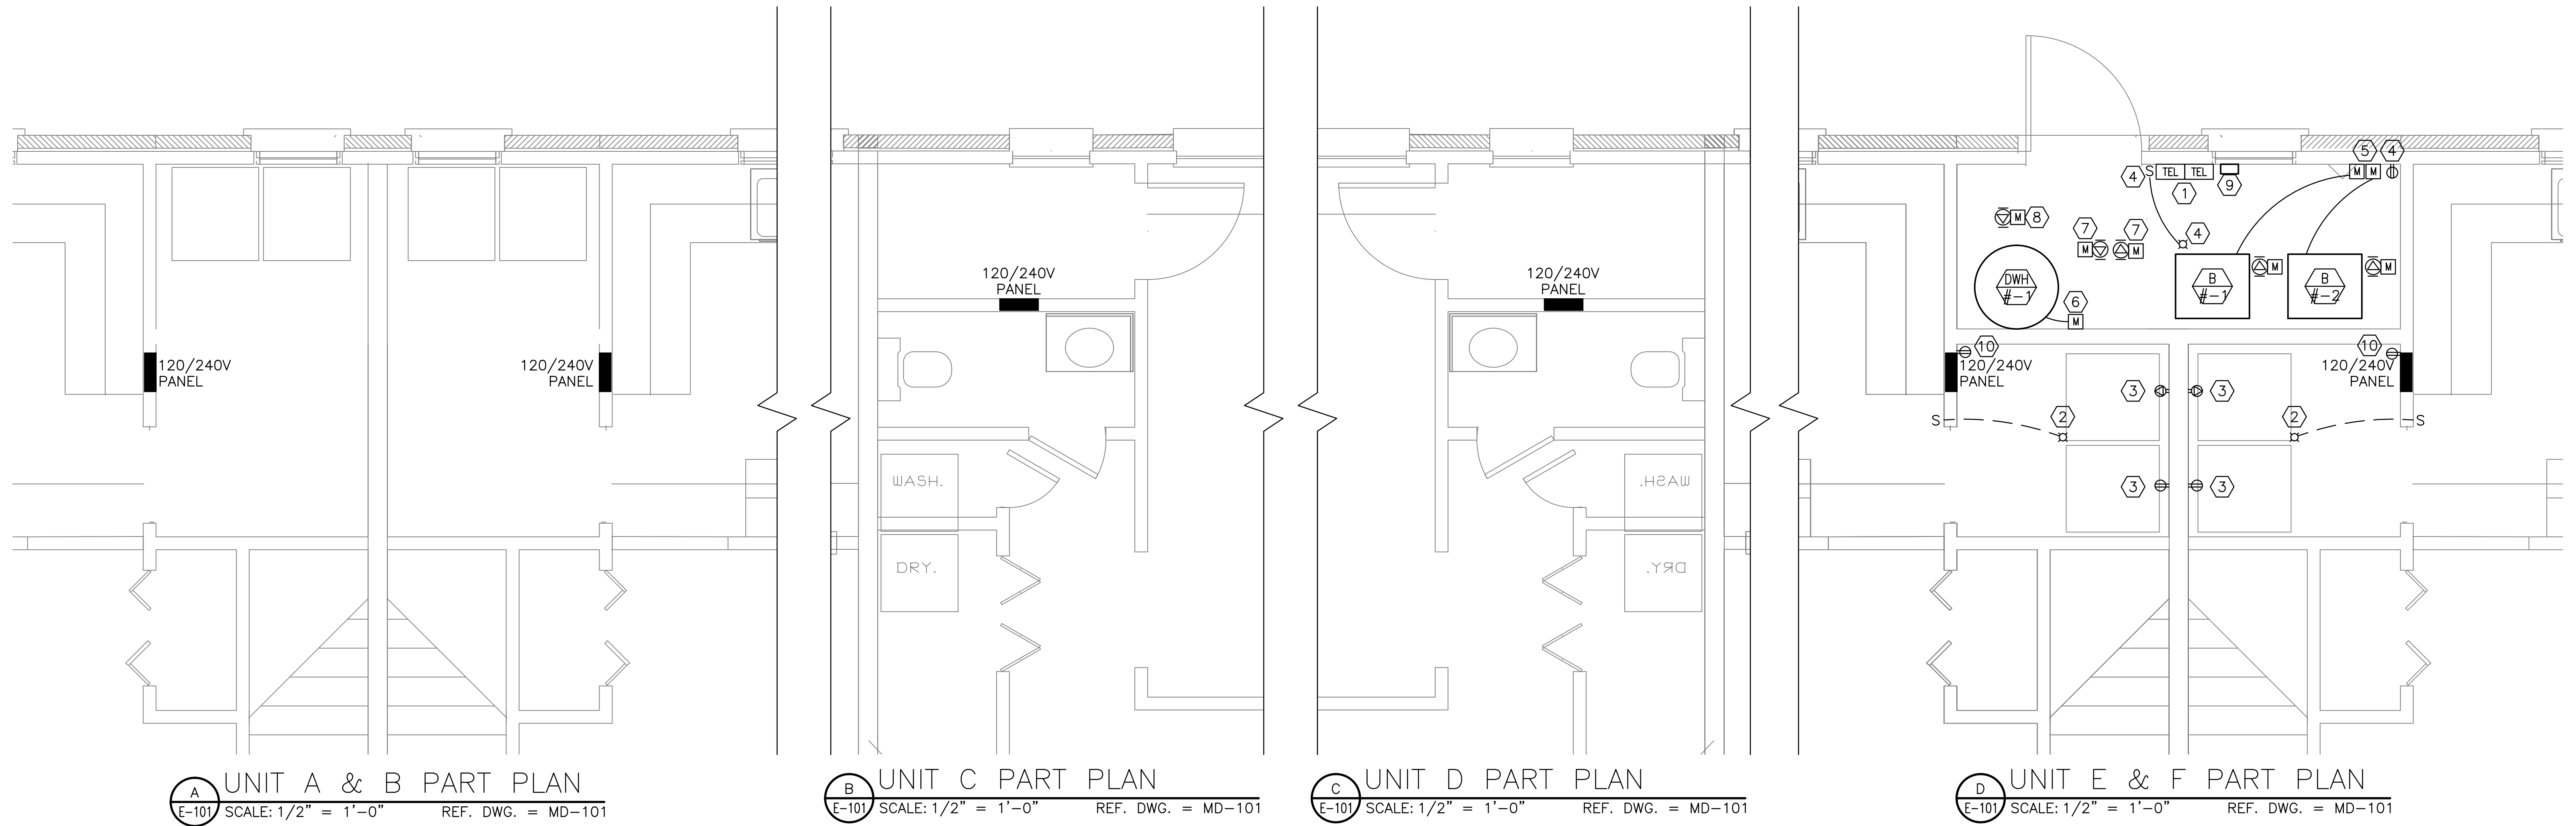


A UNIT A & B PART PLAN
E-101 SCALE: 1/2" = 1'-0" REF. DWG. = MD-101

B UNIT C PART PLAN
E-101 SCALE: 1/2" = 1'-0" REF. DWG. = MD-101



C UNIT D PART PLAN
E-101 SCALE: 1/2" = 1'-0" REF. DWG. = MD-101

D UNIT E & F PART PLAN
E-101 SCALE: 1/2" = 1'-0" REF. DWG. = MD-101

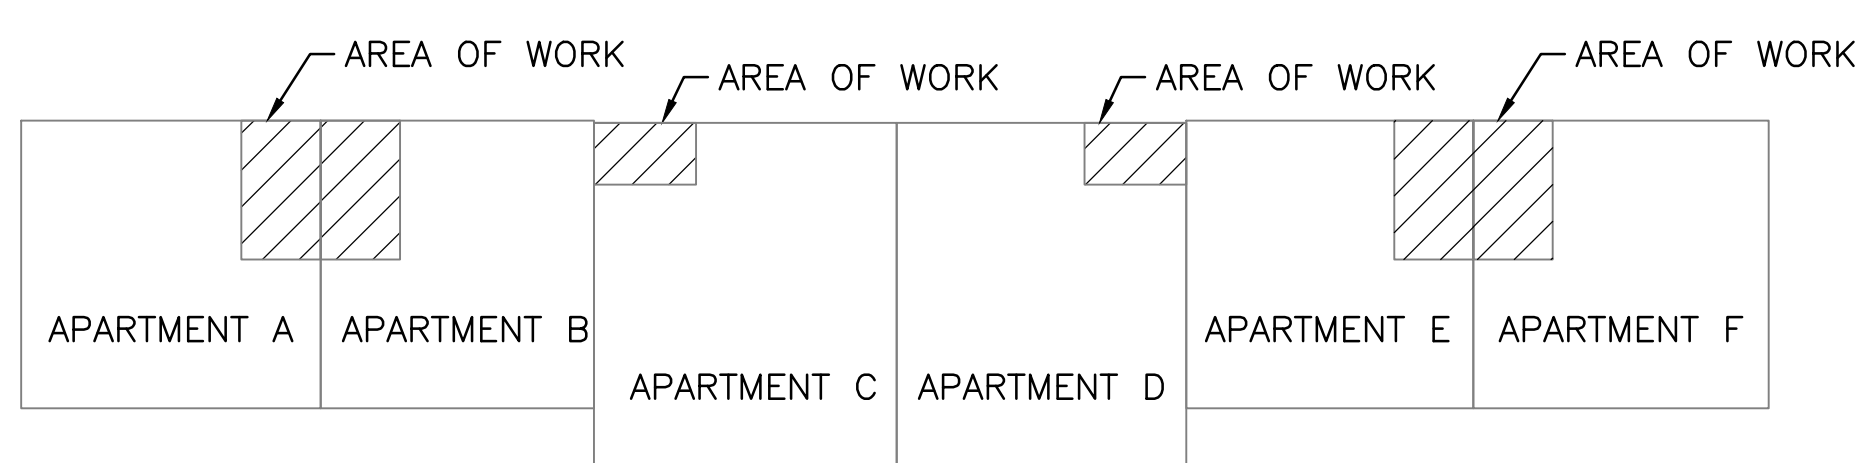

KEY PLAN
SCALE: NTS

PLANS REPRESENT A TYPICAL BUILDING CONFIGURATION. NOT ALL BUILDINGS ARE COMPLETELY IDENTICAL. FIELD VERIFY ALL CONDITIONS PRIOR TO PERFORMING ANY WORK.

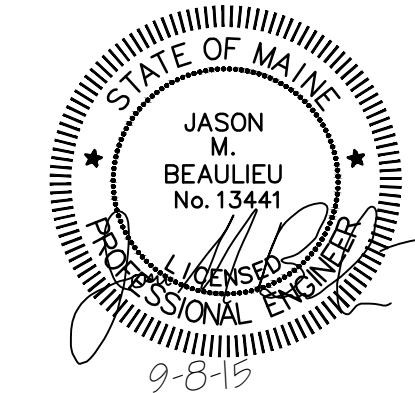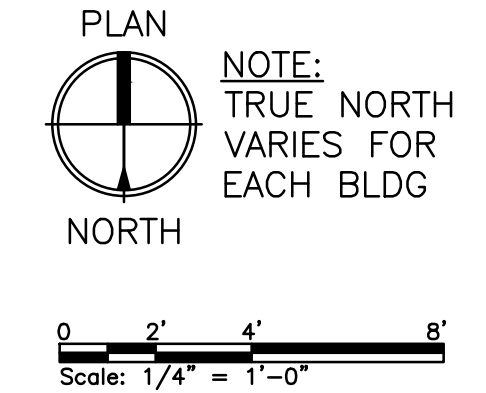

				PORTLAND HOUSING AUTHORITY PORTLAND, MAINE	
				RIVERTON BOILER REPLACEMENTS BUILDING NOS 12,17,25	
				ELECTRICAL PLAN	
0	ISSUED FOR CONSTRUCTION	JMB	MRL	9-8-15	
REV	DESCRIPTION	DWN	APP	DATE	
PLEASE NOTE: THIS DOCUMENT MAY NOT ACCURATELY REPRESENT THE FINAL DOCUMENT. ONLY AN ENGINEER, ARCHITECT OR SURVEYOR SIGNED, SEALED AND DATED PAPER COPY, PROVIDED BY THIS OFFICE, MAY BE UTILIZED FOR BIDDING OR CONSTRUCTION PURPOSES.		Colby Company engineering		74 York Street Portland, Maine 04101 207.533.7753 colbycoengineering.com	
SIZE:	ANSI D	PROJECT NO.	218.011.001		
DATE:	9-8-15	DRAWING NO.	E-101		
DES BY:	JMB	SHEET	16 OF 17		
DWN BY:	JMB				
CKD BY:	MRL				