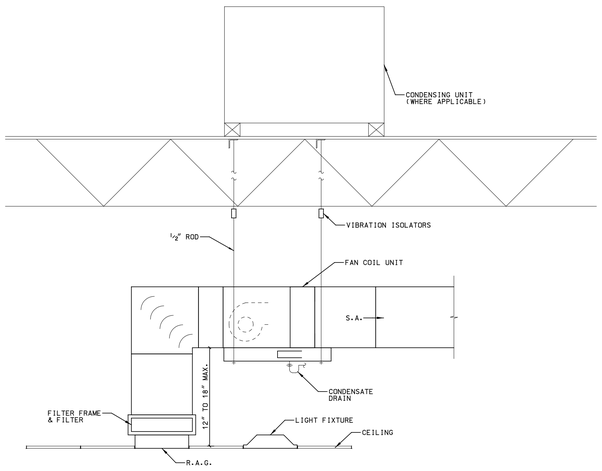

22 / M3 FAN COIL MOUNTING DETAIL
NOT TO SCALE

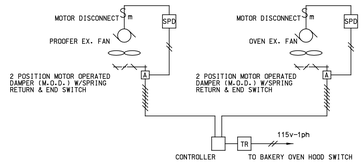

13 / M3 BAKERY OVEN/PROOFER EXHAUST FAN CONTROL SCHEMATIC
SCALE: NOT TO SCALE



14 / M3 EXHAUST FAN CONTROL SCHEMATIC (BAS)
SCALE: NOT TO SCALE

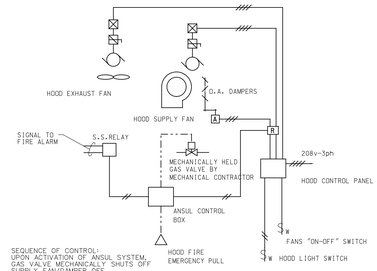

15 / M3 ROTISSERIE/FRYER HOOD CONTROL SCHEMATIC
SCALE: NOT TO SCALE

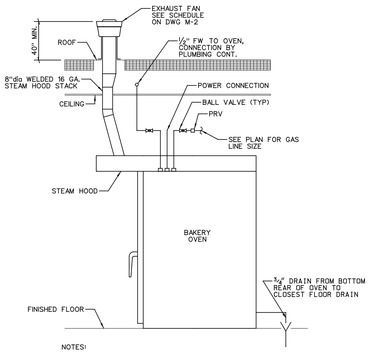

NOTES:

1. REFER TO SHEET M1 FOR POSSIBLE OFFSETS IN STACKS.
2. FIELD MEASUREMENT REQUIRED BEFORE FINAL EXHAUST DUCT IS FABRICATED.
3. 8" DIA DUCT FABRICATION AND INSTALLATION INCLUDES NECESSARY COLLARS.
4. HOOD EXHAUST FAN SHALL BE INTERLOCKED WITH OVEN CONTROLS TO OPERATE ONLY WHEN OVEN IS IN USE.
5. ANY OFFSET ANGLE FROM VERTICAL MUST BE LESS THAT 45 DEGREES, NO HORIZONTAL SECTIONS PERMITTED FOR ANY EXHAUST STACK.

26 / M1 OVEN STACK DETAIL
SCALE: NOT TO SCALE

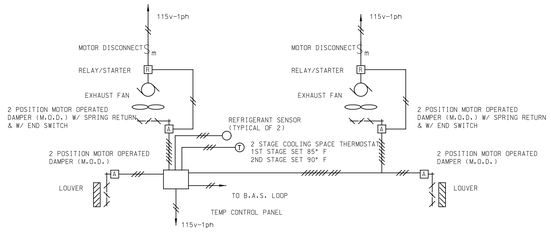

23 / M3 MECHANICAL POD EXHAUST FAN CONTROL SCHEMATIC
SCALE: NOT TO SCALE

Hannaford Bros. Co.
Engineering Design Services
PO Box 1000
Portland, ME 04104
(207) 883-7911

NO	REVISIONS	BY	DATE

BY	DATE
MEM	8/30/04

NO	REVISIONS
0	ISSUED FOR CONSTRUCTION

PROJECT TITLE
Hannaford
Riverside Street
Portland, Maine

SHEET TITLE
Mechanical Details and Control Diagrams

scale	1/8" = 1'-0"
design	M.Morin
drawn	M.Morin
checked	Dept
proj mgr	BCM
date	AUGUST, 2004

© 2004 Hannaford Bros Co

SHEET
M-3
proj no. PRSSA

P:\Master\Portland Riverside\03-000\dgn\mp-pkg_sequence.dgn
MODEL NAME: Default
08/31/2004 03:57:53 PM