


**3 SEAL FITTING INSTALLATION**  
 NTS

**2 EMERGENCY SHUT OFF W/ COVER**  
 NTS

FUELING CONTRACTOR: EXTEND CONDUITS AS REQUIRED TO NEW DISPENSERS AND FUEL TANKS. TIE TO EXISTING WHERE IT IS POSSIBLE. SEE SPECIFICATION SHEET G16, SECTION VII, 3.2.1 FOR CONDUIT TYPES.

NOTE: PULL ALL NEW WIRES AND PULL STRINGS AS REQUIRED.

NOTE: TIE NEW DISPENSER AND SUMP CONDUIT INTO EXISTING ELECTRICAL EXISTING ROOM AS REQUIRED. FIELD VERIFY EXISTING CONDITIONS.

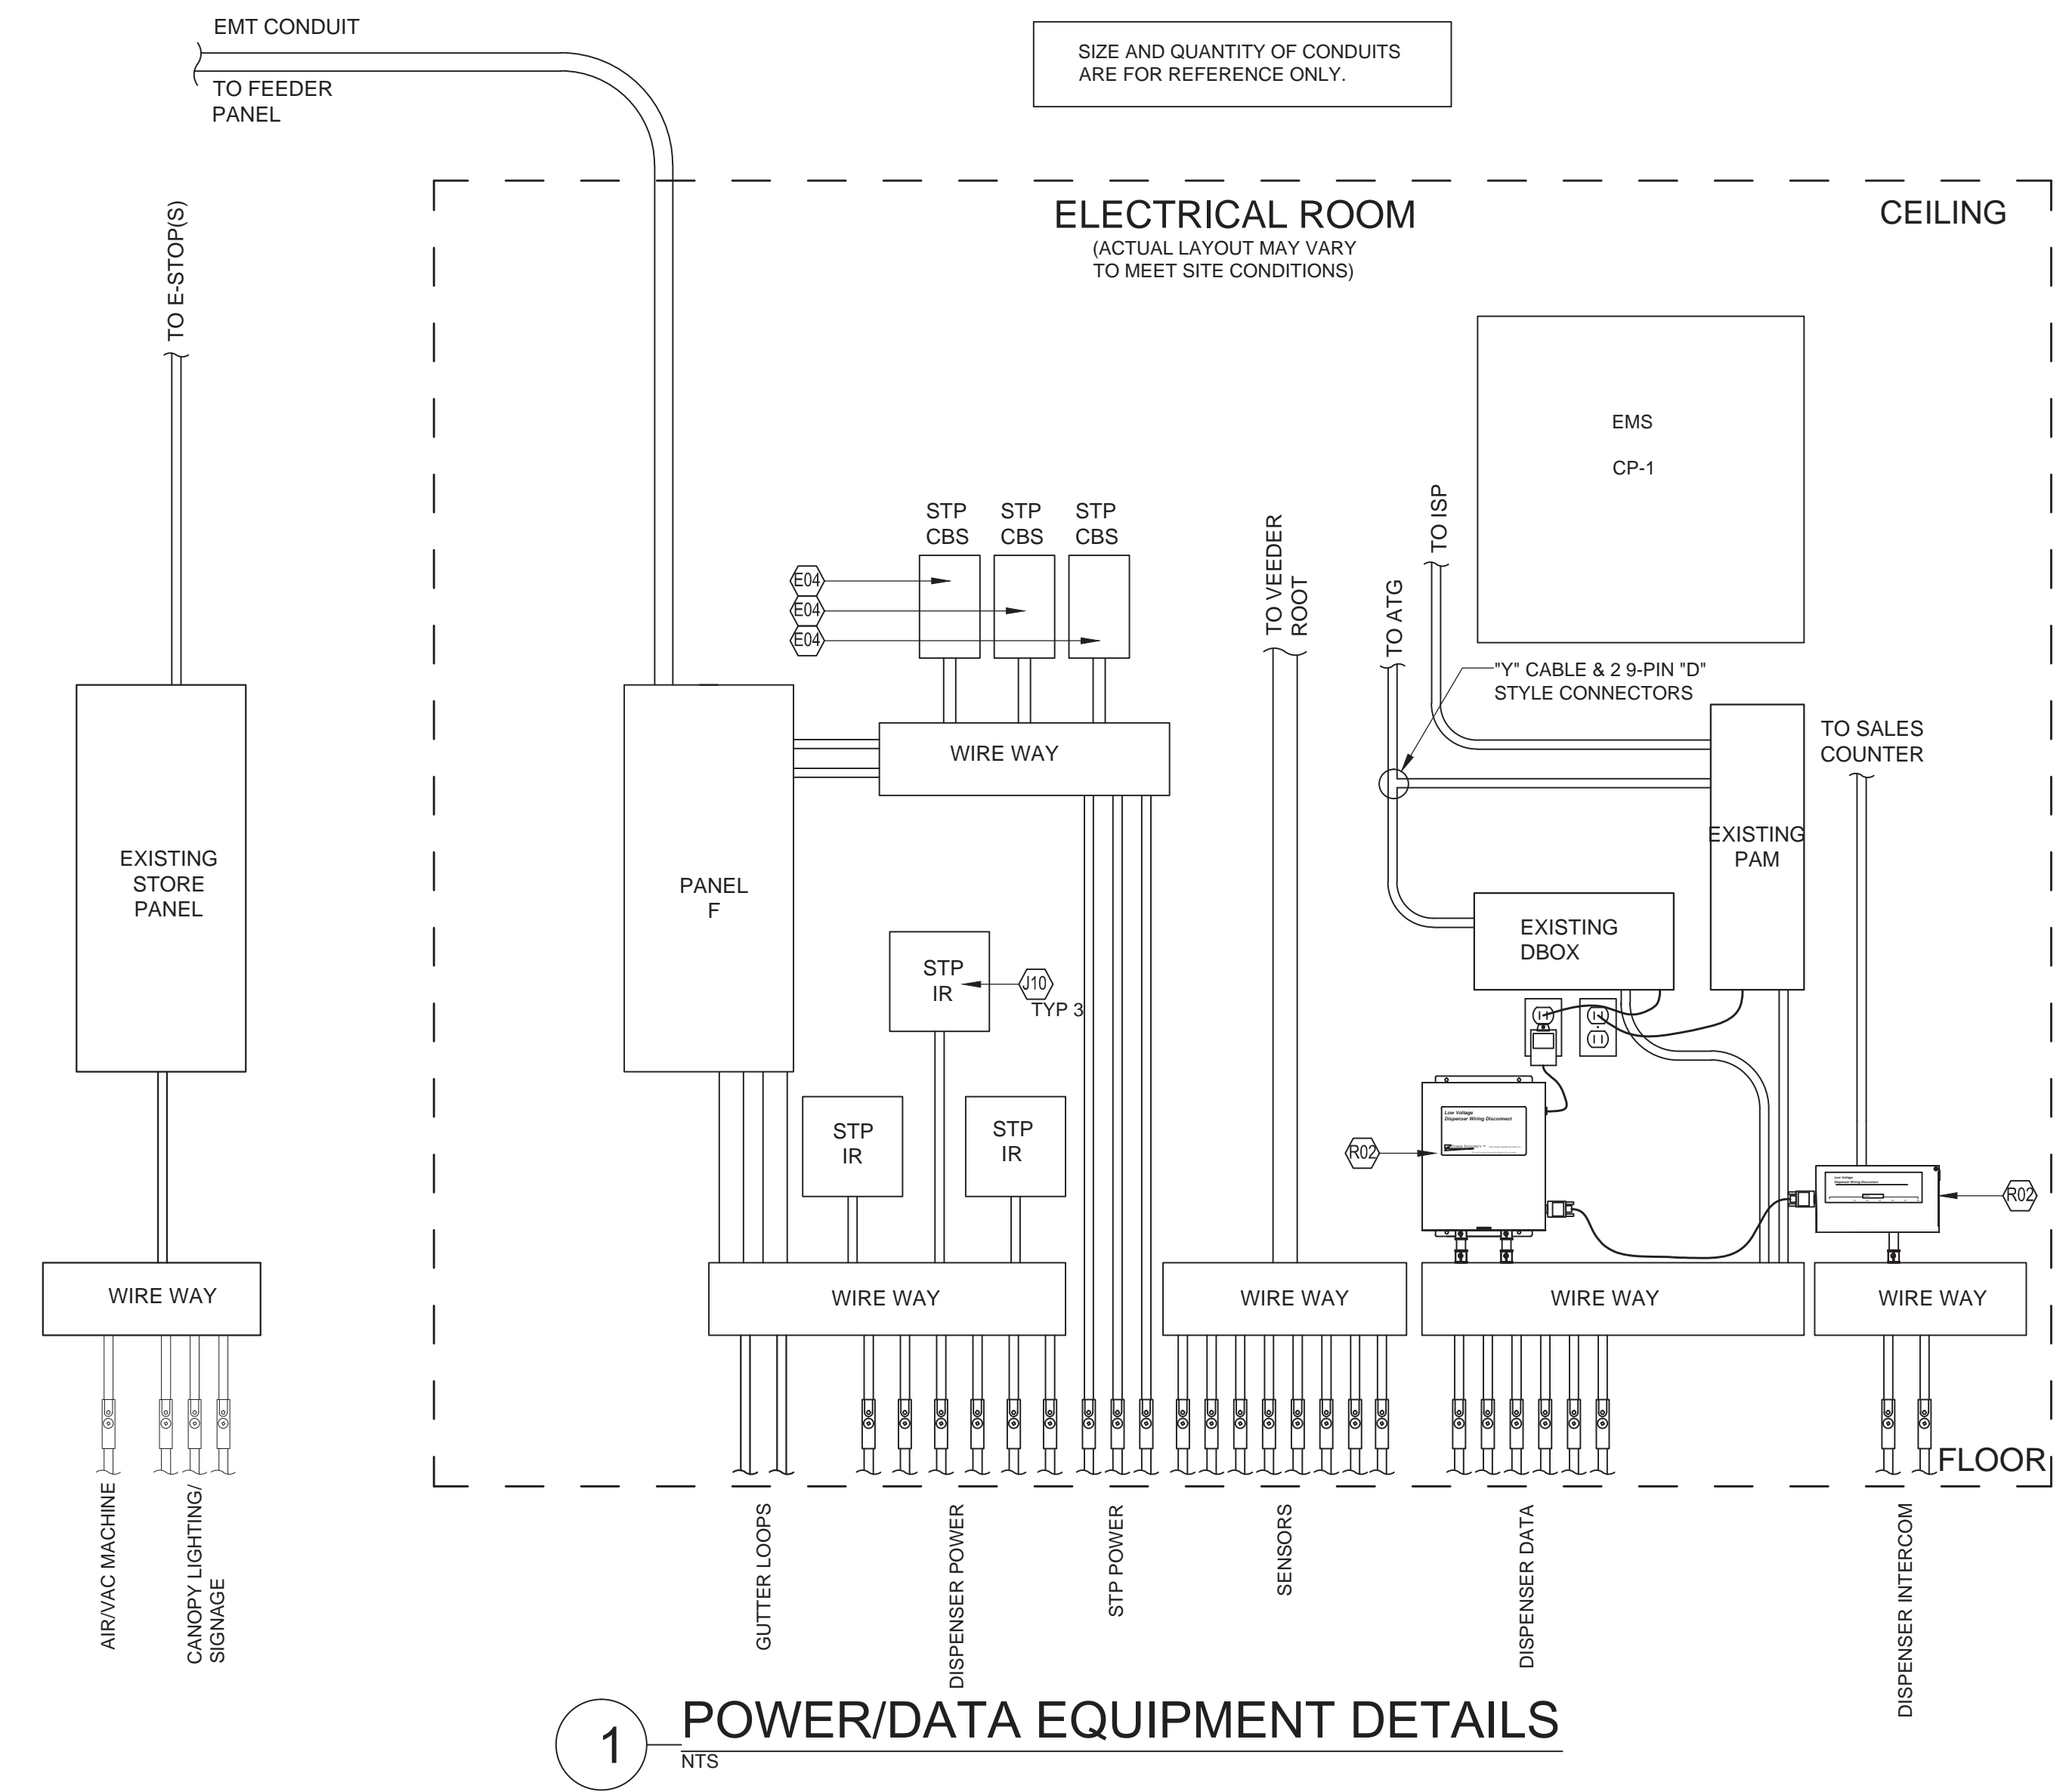


Rev. #	Date	Description

Proto 2nd Qtr 04-03-15

**7-ELEVEN, INC.**  
 3200 HACKBERRY ROAD, IRVING, TEXAS 75063

**7-11 #32541**  
 1917 FOREST AVE  
 PORTLAND, ME 04103

MISCELLANEOUS ELECTRICAL  
 DETAILS

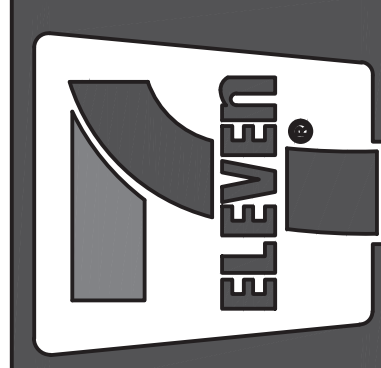

Job#: SEI-16380.0222  
 Scale: AS NOTED  
 Date: 01/21/16  
 Drawn By: JMR  
 Checked By: CPS

Documents prepared by Core States Group are to be used only for the specific project and specific use for which they are intended. Any extension of use to other projects, by owner or other party, without the expressed, written consent of Core States Group is prohibited. Core States Group is not responsible for any claims or damages, including consequential, arising from the use of these documents for any other than the specifically intended use. Core States Group shall not be held liable for any claims or damages, including consequential, arising from the use of these documents for any other than the specifically intended use.

