

1 WIRING DIAGRAM FOR ISOLATION RELAY BOX
 NTS

KEY NOTES

1. INSTALL A SINGLE EMERGENCY POWER CUTOFF CONTROL TO REMOVE AC POWER FROM SITE DISPENSING EQUIPMENT. (THE CONTROL IS AN ADDITION SAFETY FEATURE AND NOT A SUBSTITUTE FOR NEC/NFPA30 CIRCUIT BREAKER REQUIREMENTS.
 * LABEL THE EMERGENCY POWER CUTOFF SWITCH AND INSTRUCT OWNER TO KEEP AREA CLEAR OF OBSTACLES.
2. CONNECT INSULATED GROUNDING CONDUCTOR FROM THE DISPENSER POWER PANEL TO THE SITE GROUNDING ELECTRODE. SIZE PER NEC.
3. INSTALL POWER BREAKERS TO EACH CIRCUIT LEADING TO THE DISPENSING UNIT AND STP. THEY MUST BE CAPABLE OF SIMULTANEOUSLY DISCONNECTING HOT AND NEUTRAL CONDUCTORS.
4. REFER TO INSTALLATION ADDENDA FOR SPECIFIC PRODUCT FIELD WIRING CONNECTIONS. CAP ALL UNUSED WIRES. LOCAL AND NEC MAY APPLY.
5. INSTALL CONDUIT PER NEC FOR HAZARDOUS LOCATIONS.
6. WIRES - ALL WIRES ARE 14AWG (STANDARD) UNLESS OTHERWISE NOTED. PUMP / DISP. GROUND - WIRE IS 12 AWG (STANDARD).
 POWER LOADING AND DISTANCE RUN MAY REQUIRE LARGER WIRE SIZE.
7. NOT USED
8. STP ISOLATION RELAY BOXES ARE MANDATED BY THE NEC (ARTICLE 514.13 - PROVISIONS FOR MAINTENANCE AND SERVICE OF DISPENSING EQUIPMENT) AND ARE REQUIRED TO:
 A. ALLOW SERVICE OF ONE UNIT SAFELY WITHOUT REMOVING POWER FROM ALL DISPENSING EQUIPMENT.
 B. PREVENT DAMAGE TO EQUIPMENT FROM CROSS-PHASING.
 DAMAGE CAUSED BY CROSS-PHASING IS NOT COVERED BY WARRANTY
9. FOR STPs GREATER THAN 1-1/2HP (SINGLE OR THREE PHASE) CONNECT TO MOTOR CONTRACTOR COIL OF SEPARATE STP RELAY BOX.
10. L1 FEEDS STP BOX CONTRACTOR COIL. THEREFORE L1 & EMC MUST BE ON THE SAME PHASE OR DAMAGE TO EMC WILL RESULT. WHEN EMC IS NOT USED, JUMPER STP BOX TERMINALS P0 AND P1 TOGETHER TO COMPLETE THIS CIRCUIT.
11. V.F.C. or STP C.B.S.


Rev. #	Date	Description

Proto 2nd Qtr 04-03-15

7-ELEVEN, INC.
 3200 HACKBERRY ROAD, IRVING, TEXAS 75063

7-11 #32541
 1917 FOREST AVE
 PORTLAND, ME 04103

ISOLATION RELAY BOX DETAIL

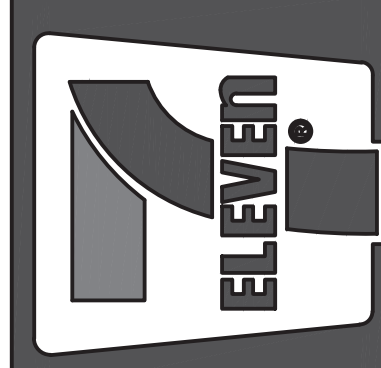

CORE STATES GROUP

1700 Industrial Drive, Suite B
 Rogers, AK 99756
 Phone: (907) 479-4400
 Fax: (907) 986-4401

Job#:	SEL-16380.0222
Scale:	AS NOTED
Date:	01/21/16
Drawn By:	JMR
Checked By:	CPS

Documents prepared by Core States Group are to be used for the specific use for which they are intended. Any extension of use to other projects, by owner or otherwise, without the expressed, written consent of Core States Group is prohibited. Core States Group is not liable for any claims or damages, including attorney's fees, arising from the use of these documents for any purpose other than that specifically intended, user will hold Core States Group harmless from all claims and losses.

