



SECTION AT DOCK DOOR




TYPICAL POST AT VERTICAL PANEL JOINT

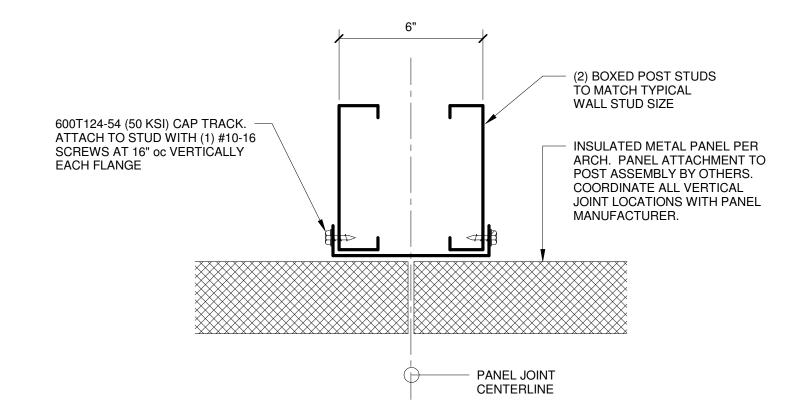

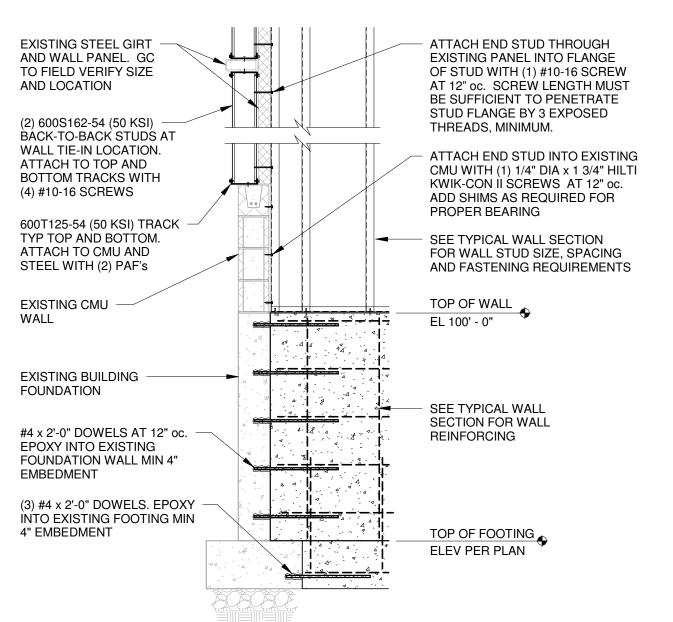


SECTION AT NEW BUILDING WALL TIE-IN

1/2" = 1'-0"

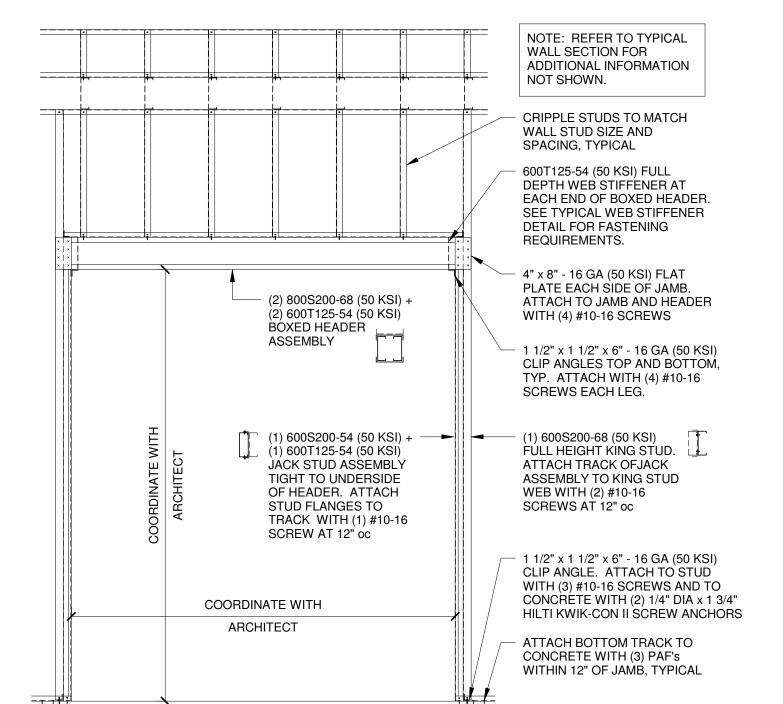

- 1. ALL HEADER MEMBERS MUST BE CONTINOUS AND UNPUNCHED (NO SPLICE ALLOWED).
- 2. HEADER AND JAMB MEMBERS SPECIFIED ARE TO BE CONSIDERED MINIMUM PER STRUCTURAL DESIGN. FLANGE WIDTH AND GAUGE MAY BE INCREASED IF NECESSARY.
- 3. BUILT-UP MEMBERS TO BE CONNECTED BY WITH (2) #10-16 SCREWS AT 12" oc THROUGH WEBS AND (1) #10-16 SCREWS AT 12" oc AT EACH FLANGE, TYPICAL.

ELEVATION AT DOCK DOOR FRAMING

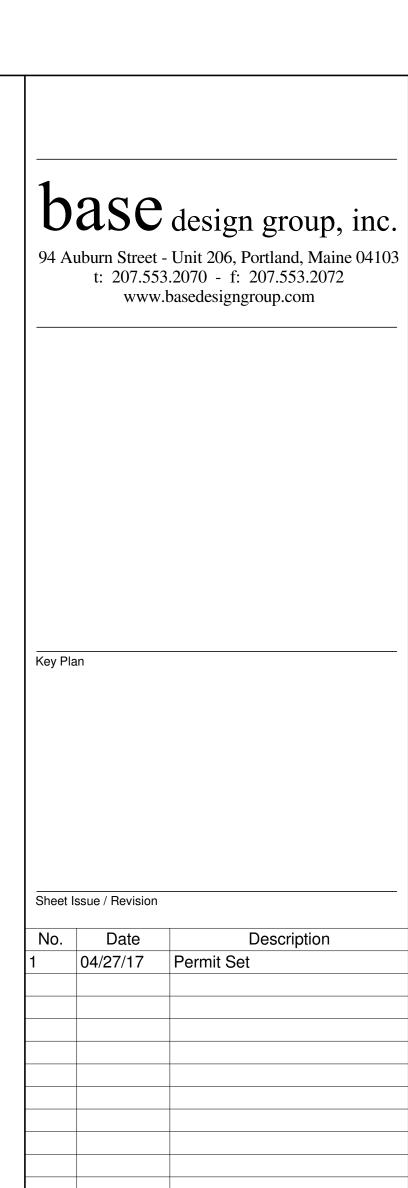

BETANCOURT

UNIT 5 - LOADING DOCK 1039 RIVERSIDE STREET PORTLAND, MAINE

Client

Seal/Signature

HardyPond Construction Portland, Maine

SECTIONS AND **DETAILS**

Project Number 17068-0 Drawn By Author Checked By Checker

S-301

Scale

As indicated