

GENERAL NOTES


- REFER TO DRAWING E-201-C FOR LIGHTING FIXTURE SCHEDULE.
- UNLESS OTHERWISE NOTED ALL FIXTURES ON THIS SHEET SHALL BE FED FROM PANEL LPI LOCATED ON SECOND FLOOR ELECTRICAL RM. 215.
- THE CEILINGS IN THE PROCESS ROOMS WILL BE PLASTER AND THE AREAS ABOVE THE CEILINGS WILL NOT BE ACCESSIBLE WHEN CEILING IS IN PLACE. LAY OUT CONDUIT ROUTING SO THAT JUNCTION BOXES, PULL BOXES, OR CONDUIT BODIES THAT NEED ACCESS WILL NOT BE LOCATED IN THE SPACES ABOVE THESE CEILINGS.
- PROCESS ROOMS ARE CLASSIFIED AS WET LOCATIONS. ALL ELECTRICAL WORK WITHIN THESE ROOMS SHOULD COMPLY WITH NEC AND PROJECT SPECIFICATIONS FOR WET LOCATIONS. FURNISH AND INSTALL WEATHERPROOF COVERS FOR ALL SWITCHES IN PROCESS ROOMS.
- ALL CONDUIT ON FIRST FLOOR TO BE RIGID CONDUIT. ALL CONDUIT IN CEILING CAVITY TO BE RIGID CONDUIT. ALL EXPOSED CONDUIT IN PROCESS AREAS TO BE UL LISTED STAINLESS STEEL. ALL FASTENERS IN PROCESS AREA TO BE STAINLESS STEEL.
- HATCHED FIXTURES INDICATE EMERGENCY LIGHT. WIRE A HEAD OF LOCAL LIGHT SWITCH UNLESS OTHERWISE NOTED.
- HATCHED FIXTURES INDICATED EMERGENCY LIGHT. WIRE AHEAD OF LOCAL LIGHT SWITCH UNLESS OTHERWISE NOTED.

KEYED NOTES

- UNDER PLATFORM LIGHT SWITCH.
- FIXTURES SHALL BE INSTALLED 15' AFF.
- FIXTURES SHALL BE MOUNTED UNDER PLATFORM TIGHT TO STRUCTURE.
- SEE SECOND FLOOR LIGHTING PLAN FOR FIXTURES IN THIS AREA.
- CLASS I HAZARDOUS AREA. SEE DWG E-201-C FOR EXTENTS.
- PROCESS RM

Revision	By	App'd	DD.MMM.YYYY
0			08/19/2016
INTERIOR FIT-OUT - ISSUED FOR CONSTRUCTION			
PACKAGE C - INTERIOR FIT-OUT			
PACKAGE B - SUPERSTRUCTURE & SHELL			
PACKAGE A - FOUNDATIONS & BELOW SLAB			
Issued			07.22.2016

Permit-Seal

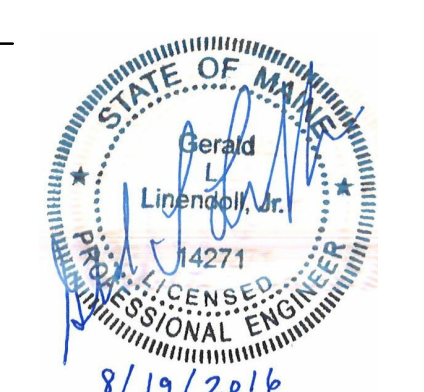

Client/Project
IMMUCELL

Lot 11 - Second Tee Business Park
1039 Riverside Street
Portland, Maine 04103

Title
FIRST FLOOR - LIGHTING PLAN


Project No.
191504176

Revision
0

Scale
1/4" = 1'-0"

Drawing No.

E-201-C

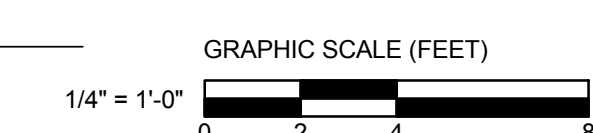

1 FIRST FLOOR - LIGHTING PLAN
1/4" = 1'-0"

ORIGINAL SHEET: A40-E (04.14)

