

FIRE ALARM SYSTEM DESCRIPTION / SCOPE OF WORK

1. PROVIDE NEW FIRE ALARM SYSTEM FEATURING MANUAL ALARM, SELECTIVE SMOKE DETECTION, SPRINKLER ALARM, EMERGENCY VOICE/ALARM COMMUNICATION AND AUTO DIALER TO LOCAL FIRE DEPARTMENT.
2. FIRE ALARM SYSTEM SHALL BE INSTALLED PER REQUIREMENTS OF MAINE STATE BUILDING CODE 2015 AND NFPA 72.
3. UPON COMPLETION OF THE INSTALLATION OF THE SYSTEMS, A SATISFACTORY TEST OF THE ENTIRE SYSTEM SHALL BE MADE.
4. A STAMPED SET OF APPROVED FIRE ALARM DESIGN DOCUMENTS SHALL BE ON THE JOB SITE AND USED FOR INSTALLATION.
5. ANY DISCREPANCIES BETWEEN THE DRAWINGS AND THE CODE OR RECOGNIZED STANDARDS SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT/ENGINEER OF THE PROJECT.
6. ARCHITECT/ENGINEER AND OWNER SHALL BE NOTIFIED A MINIMUM OF 48 HOURS PRIOR TO THE FINAL INSPECTION AND/OR TESTING.
7. ALL PENETRATIONS THROUGH RATED ASSEMBLIES, REQUIRING OPENING PROTECTION SHALL BE PROVIDED WITH A PENETRATION FIRE STOP SYSTEM AS IDENTIFIED IN CBC CHAPTER 7. UL OR OTHER LAB TESTING CRITERIA, APPROVED TYPE OF MATERIALS SHALL BE IDENTIFIED WITHIN THE SPECIFICATION WITHIN THE FIRE ALARM SECTION.
8. WALL MOUNTED VISUAL NOTIFICATION DEVICES SHALL HAVE THEIR BOTTOMS MOUNTED AT 80" MINIMUM AND 90" MAXIMUM FROM FINISHED FLOOR.
9. WALL MOUNTED AUDIBLE NOTIFICATION DEVICES SHALL HAVE THEIR TOPS MOUNTED AT 90" MINIMUM AND 100" MAXIMUM FROM FINISHED FLOOR AND NO CLOSER THEN 6" TO A HORIZONTAL STRUCTURE.
10. AUDIBLE DEVICES TO BE AT LEAST 15 DBA ABOVE THE AVERAGE AMBIENT SOUND LEVEL BUT NOT LESS THAN 75 DBA AT 10 FEET OR MORE THAN 110 DBA AT THE MINIMUM HEARING DISTANCE. SOUND LEVEL SHALL BE MAINTAINED FOR DURATION OF AT LEAST 60 SECONDS & DBA MUST BE MAINTAINED.
11. AUDIBLE DEVICES SHALL BE SYNCHRONIZED TEMPORAL CODE 3 PATTERN.
12. THE CONTRACTOR SHALL ADJUST/INSTALL ALL DEVICES TO MAXIMIZE PERFORMANCE AND TO MINIMIZE FALSE ALARMS.
13. VISUAL DEVICES SHOULD NOT EXCEED 2 FLASHES PER SECOND AND SHOULD NOT BE SLOWER THAN 1 FLASH EVERY SECOND. THE DEVICE SHALL HAVE A PULSING LIGHT SOURCE NOT LESS THAN 15 CANDELA. VISUAL DEVICES WITHIN 55' FROM EACH OTHER SHALL BE SYNCHRONIZED.
14. UNDERGROUND AND EXTERIOR CONDUITS TO HAVE WATERTIGHT FITTINGS AND WIRE TO BE APPROVAL FOR WET LOCATIONS.
15. ALL FIRE ALARM WIRING SHALL BE FLP OR FPLP (FIRE POWER LIMITED OR FIRE POWER LIMITED FLEXIBLE) AS REQUIRED FOR APPLICATION. WIRING IN CONDUIT ABOVE GROUND MAY BE THHN OR THWN.
16. PER CEC STANDARDS, ALL WIRING IS TO BE PULLED THROUGH EACH JUNCTION BOX AND CONNECTED DIRECTLY TO EACH FIRE DEVICE. DO NOT SPLICE THE WIRE. THERE MUST BE AT LEAST 6" OF LEAD WIRE FROM THE BOX TO THE DEVICE. ALL BOXES TO BE SIZED PER CEC.
17. SMOKE DETECTORS SHALL NOT BE ANY CLOSER THAN 1" FROM FIRE SPRINKLERS OR 3" FROM ANY SUPPLY DIFFUSER. IN AREA OF CONSTRUCTION OR POSSIBLE DAMAGE/CONTAMINATION ON NEWLY INSTALLED FIRE ALARM DEVICES SHALL BE COVERED UNTIL THAT AREA IS READY TO BE TURNED OVER TO THE OWNER.
18. ALL FIRE ALARM CIRCUITS SHALL BE IN CONDUIT. SURFACE RACEWAY OR OPEN RUN ABOVE CEILING, UNDER FLOORS AND IN WALLS IN A NEAT AND PROTECTED MANNER AS INDICATED ON DESIGN DOCUMENTS. EXPOSED CIRCUITS ARE ONLY PERMITTED WHEN NOTED AS EXPOSED ON DESIGN DOCUMENTS.
19. ALL WIRE TO BE AS PER MANUFACTURER REQUIREMENTS & FIRE DEPT. APPROVED UNLESS OTHERWISE NOTED. DO NOT EXCEED MANUFACTURERS MAXIMUM LENGTH AND VOLTAGE DROPS.
20. FIRE ALARM PANEL AND COMPONENTS SHALL BE SECURED TO MOUNTING SURFACES PER MANUFACTURERS SPECIFICATIONS. NO SINGLE DEVICE SHALL EXCEED THE WEIGHT OF 20 LBS. WITHOUT SPECIAL MOUNTING DETAILS.
21. A DEDICATED BRANCH CIRCUIT SHALL BE PROVIDED FOR FIRE ALARM EQUIPMENT. THIS CIRCUIT SHALL BE ENERGIZED FROM THE COMMON USE AREA PANEL AND SHALL HAVE NO OTHER OUTLETS. THE BREAKER SHALL HAVE A RED LOCKING DEVICE TO BLOCK THE HANDLE IN THE "ON" POSITION. THE CIRCUIT BREAKER SHALL BE LABELED "FIRE ALARM CIRCUIT CONTROL". CIRCUIT ID TO BE LABELED AT FIRE PANEL/EXTENDERS.
22. THE INSTALLING CONTRACTOR SHALL PROVIDE A RECORD OF COMPLETION PER NFPA 72, FIGURE 10.18.2.1.1.
23. THE INSTALLING CONTRACTOR SHALL PROVIDE SYSTEM PROGRAMMING FOR SUPERVISORY MONITORING PER CBC SECTION 901.6.2.
24. SUPERVISORY MONITORING SHALL BE TESTED AND VERIFIED AS SENDING CORRECT SIGNALS IN CONJUNCTION WITH FINAL ACCEPTANCE TEST.
25. OWNER SHALL BE RESPONSIBLE FOR ESTABLISHING A FIRE SYSTEM MONITORING CONTRACT OR PROVISIONS.
26. THE FIRE ALARM SYSTEM SHALL BE A NICET CERTIFIED FIRE ALARM SYSTEM DESIGN WITH ALL REQUIRED LOAD CALCULATIONS, DEVICE CUT SHEETS, PLANS WITH DEVICE ADDRESSES AND CONFIGURATION AS REQUIRED FOR THE PROJECT CONDITIONS AND SPECIFICATIONS. ALL SUBMITTALS AND PLANS SHALL CONTAIN NICET CERTIFICATION NUMBER.
27. PROVIDE AND INSTALL INTERFACE MODULES TO UNLOCK POWER LOCKS ON ACTIVATION OF FIRE ALARM SYSTEM.

FIRE ALARM CODE DATA SUMMARY SHEET

BUILDING OCCUPANCY GROUP	Group A - Assembly <input type="checkbox"/>	Group B - Business <input checked="" type="checkbox"/>	Group E - Education <input type="checkbox"/>	Group F - Factory <input type="checkbox"/>	Group H - Hazardous <input type="checkbox"/>	Group I - Institutional <input type="checkbox"/>	Group M - Mercantile <input type="checkbox"/>	Group R - Residential <input type="checkbox"/>	Group S - Storage <input type="checkbox"/>	Group U - Utility / Misc. <input type="checkbox"/>	
BUILDING CHARACTERISTICS	Occupant Load: N/A	Number of stories: 2	Number of occupants above or below lowest exit discharge: 0	N/A							
GENERAL REQUIREMENTS	Manual System (General Alarm Only) <input type="checkbox"/>	Sprinkler System (Supervision Only) <input type="checkbox"/>	Fully Automatic Fire Detection System (Manual Initiation/General Alarm, Sprinkler Supervision, and Smoke Detection) <input checked="" type="checkbox"/>								
SECONDARY POWER REQUIREMENTS BY SYSTEM TYPE	15 Minutes Alarm <input type="checkbox"/>	24 Hour Standby <input type="checkbox"/>	5 Minutes Alarm <input type="checkbox"/>	60 hours Standby <input type="checkbox"/>	5 Minutes Alarm <input type="checkbox"/>	60 hours Standby <input type="checkbox"/>	5 Minutes Alarm <input type="checkbox"/>	60 hours Standby <input type="checkbox"/>	Proprietary N/A <input type="checkbox"/>		
PRIMARY POWER SOURCE	Building Power <input checked="" type="checkbox"/>	Generator <input type="checkbox"/>	WIRING METHODS: Class 1, 2, 3 Signal Cds. NEC 725 <input checked="" type="checkbox"/> Duct/Plenum NEC 300-22 <input type="checkbox"/> Power Limited <input type="checkbox"/> Non-Power Limited <input type="checkbox"/>								
LIFE SAFETY CONTROLS	Smoke Door <input type="checkbox"/>	N/A <input type="checkbox"/>	Shaft Pressurization <input type="checkbox"/>	N/A <input type="checkbox"/>	Duct Detector <input type="checkbox"/>	N/A <input type="checkbox"/>	Door Release <input type="checkbox"/>	N/A <input type="checkbox"/>	Elevator Capture <input type="checkbox"/>	Dampers/Controls <input type="checkbox"/>	N/A <input type="checkbox"/>
VOICE ALARM SYSTEM	Pre-Recorded <input type="checkbox"/>	N/A <input type="checkbox"/>	Live <input type="checkbox"/>	N/A <input type="checkbox"/>	Entire Building <input type="checkbox"/>	Selected Building Sections <input type="checkbox"/>	N/A <input type="checkbox"/>	Survivability Reqrmts. <input type="checkbox"/>	N/A <input type="checkbox"/>	2-Way Comms. <input type="checkbox"/>	N/A <input type="checkbox"/>
SMOKE DETECTOR SYSTEM	Cross-Zoned <input type="checkbox"/>	N/A <input type="checkbox"/>	Alarm Verification <input type="checkbox"/>	N/A <input type="checkbox"/>	Approved Equivalent <input type="checkbox"/>	N/A <input type="checkbox"/>					
WIRING CLASS	Class A System <input checked="" type="checkbox"/> N/A <input type="checkbox"/>				Class B System <input type="checkbox"/> N/A <input type="checkbox"/>						
SPECIAL SYSTEMS	FM200 <input type="checkbox"/>	N/A <input type="checkbox"/>	Hood Systems <input type="checkbox"/>	N/A <input type="checkbox"/>	Pre-Action <input type="checkbox"/>	N/A <input type="checkbox"/>	Spray-Booth <input type="checkbox"/>	N/A <input type="checkbox"/>	Other: AFFF FOAM SYSTEM <input type="checkbox"/>		

FIRE ALARM SEQUENCE OF OPERATION

1. UPON ACTIVATION OF ANY MANUAL PULL STATION, THE FOLLOWING SHALL OCCUR:
 - A. AUDIBLE/VISUAL SIGNALS WILL ACTIVATE AT THE FIRE ALARM CONTROL PANEL INDICATING THE DEVICE IN ALARM AND FLOOR.
 - B. ACTIVATE ALL STROBES, SOUND ALL COMMON CODES FOR EACH PULL STATION THROUGH COMBINATION HORN/STROBE UNITS THROUGHOUT THE BUILDING.
 - C. A SIGNAL WILL BE SENT TO THE FIRE DEPARTMENT VIA THE AUTO DIALER.
 - D. SHUT DOWN ALL AHU UNITS.
 - E. UNLOCK POWER LOCKS ON CARD ACCESS DOORS.
2. ACTIVATION OF SMOKE OR DUCT SMOKE DETECTOR SHALL:
 - A. AUDIBLE/VISUAL SIGNALS WILL OCCUR AT THE FIRE ALARM CONTROL PANEL INDICATING THE DEVICE IN ALARM AND FLOOR.
 - B. ACTIVATE ALL STROBES AND SOUND ALARM THROUGH COMBINATION HORN/STROBE UNITS THROUGHOUT THE BUILDING.
 - C. A SIGNAL WILL BE SENT TO THE FIRE DEPARTMENT VIA THE AUTO DIALER.
 - D. SHUT DOWN ALL AHU UNITS.
 - E. UNLOCK POWER LOCKS ON CARD ACCESS DOORS.

FIRE ALARM SYMBOLS

	MANUAL PULL BOX
	VISUAL ONLY ALARM SIGNAL NUMBER DESIGNATES CANDELA RATING
	AUDIBLE AND VISUAL ALARM SIGNAL NUMBER DESIGNATES CANDELA RATING
	SMOKE DETECTOR - PHOTOELECTRIC
	DUCT MOUNTED SMOKE DETECTOR PROVIDE REMOTE TEST STATION ON AHU SERVED
	CARBON MONOXIDE DETECTOR
	HEAT DETECTOR - RATE OF RISE
	SPRINKLER FLOW SWITCH
	SPRINKLER TAMPER SWITCH
	REMOTE TEST STATION
	FIRE ALARM CONTROL PANEL
	NOTIFICATION APPLIANCE CIRCUIT PANEL
	AFFF FOAM TANK PRESSURE SWITCH


SYSTEM INPUT/OUTPUT MATRIX

INPUT DEVICE	OUTPUT FUNCTION				
	1	2	3	4	5
AREA SMOKE DETECTOR	X	X	X		
DUCT SMOKE DETECTOR	X	X	X	X	
MANUAL PULL STATION	X	X	X		
SPRINKLER FLOW SWITCH	X	X	X		
SPRINKLER VALVE TAMPER SWITCH					X

OUTPUT FUNCTIONS:

1. SOUND GENERAL ALARM ON BOTH FLOOR LEVELS
2. INDICATE ALARM AT FIRE ALARM CONTROL PANEL.
3. NOTIFY FIRE DEPARTMENT VIA CENTRAL STATION.
4. INITIATE SUPERVISORY SIGNAL TO CENTRAL STATION.
5. INITIATE EQUIPMENT SHUTDOWN AND/OR ACTUATE FIRE/SMOKE DAMPER.

1 FIRE ALARM RISER DIAGRAM
12" = 1'-0"

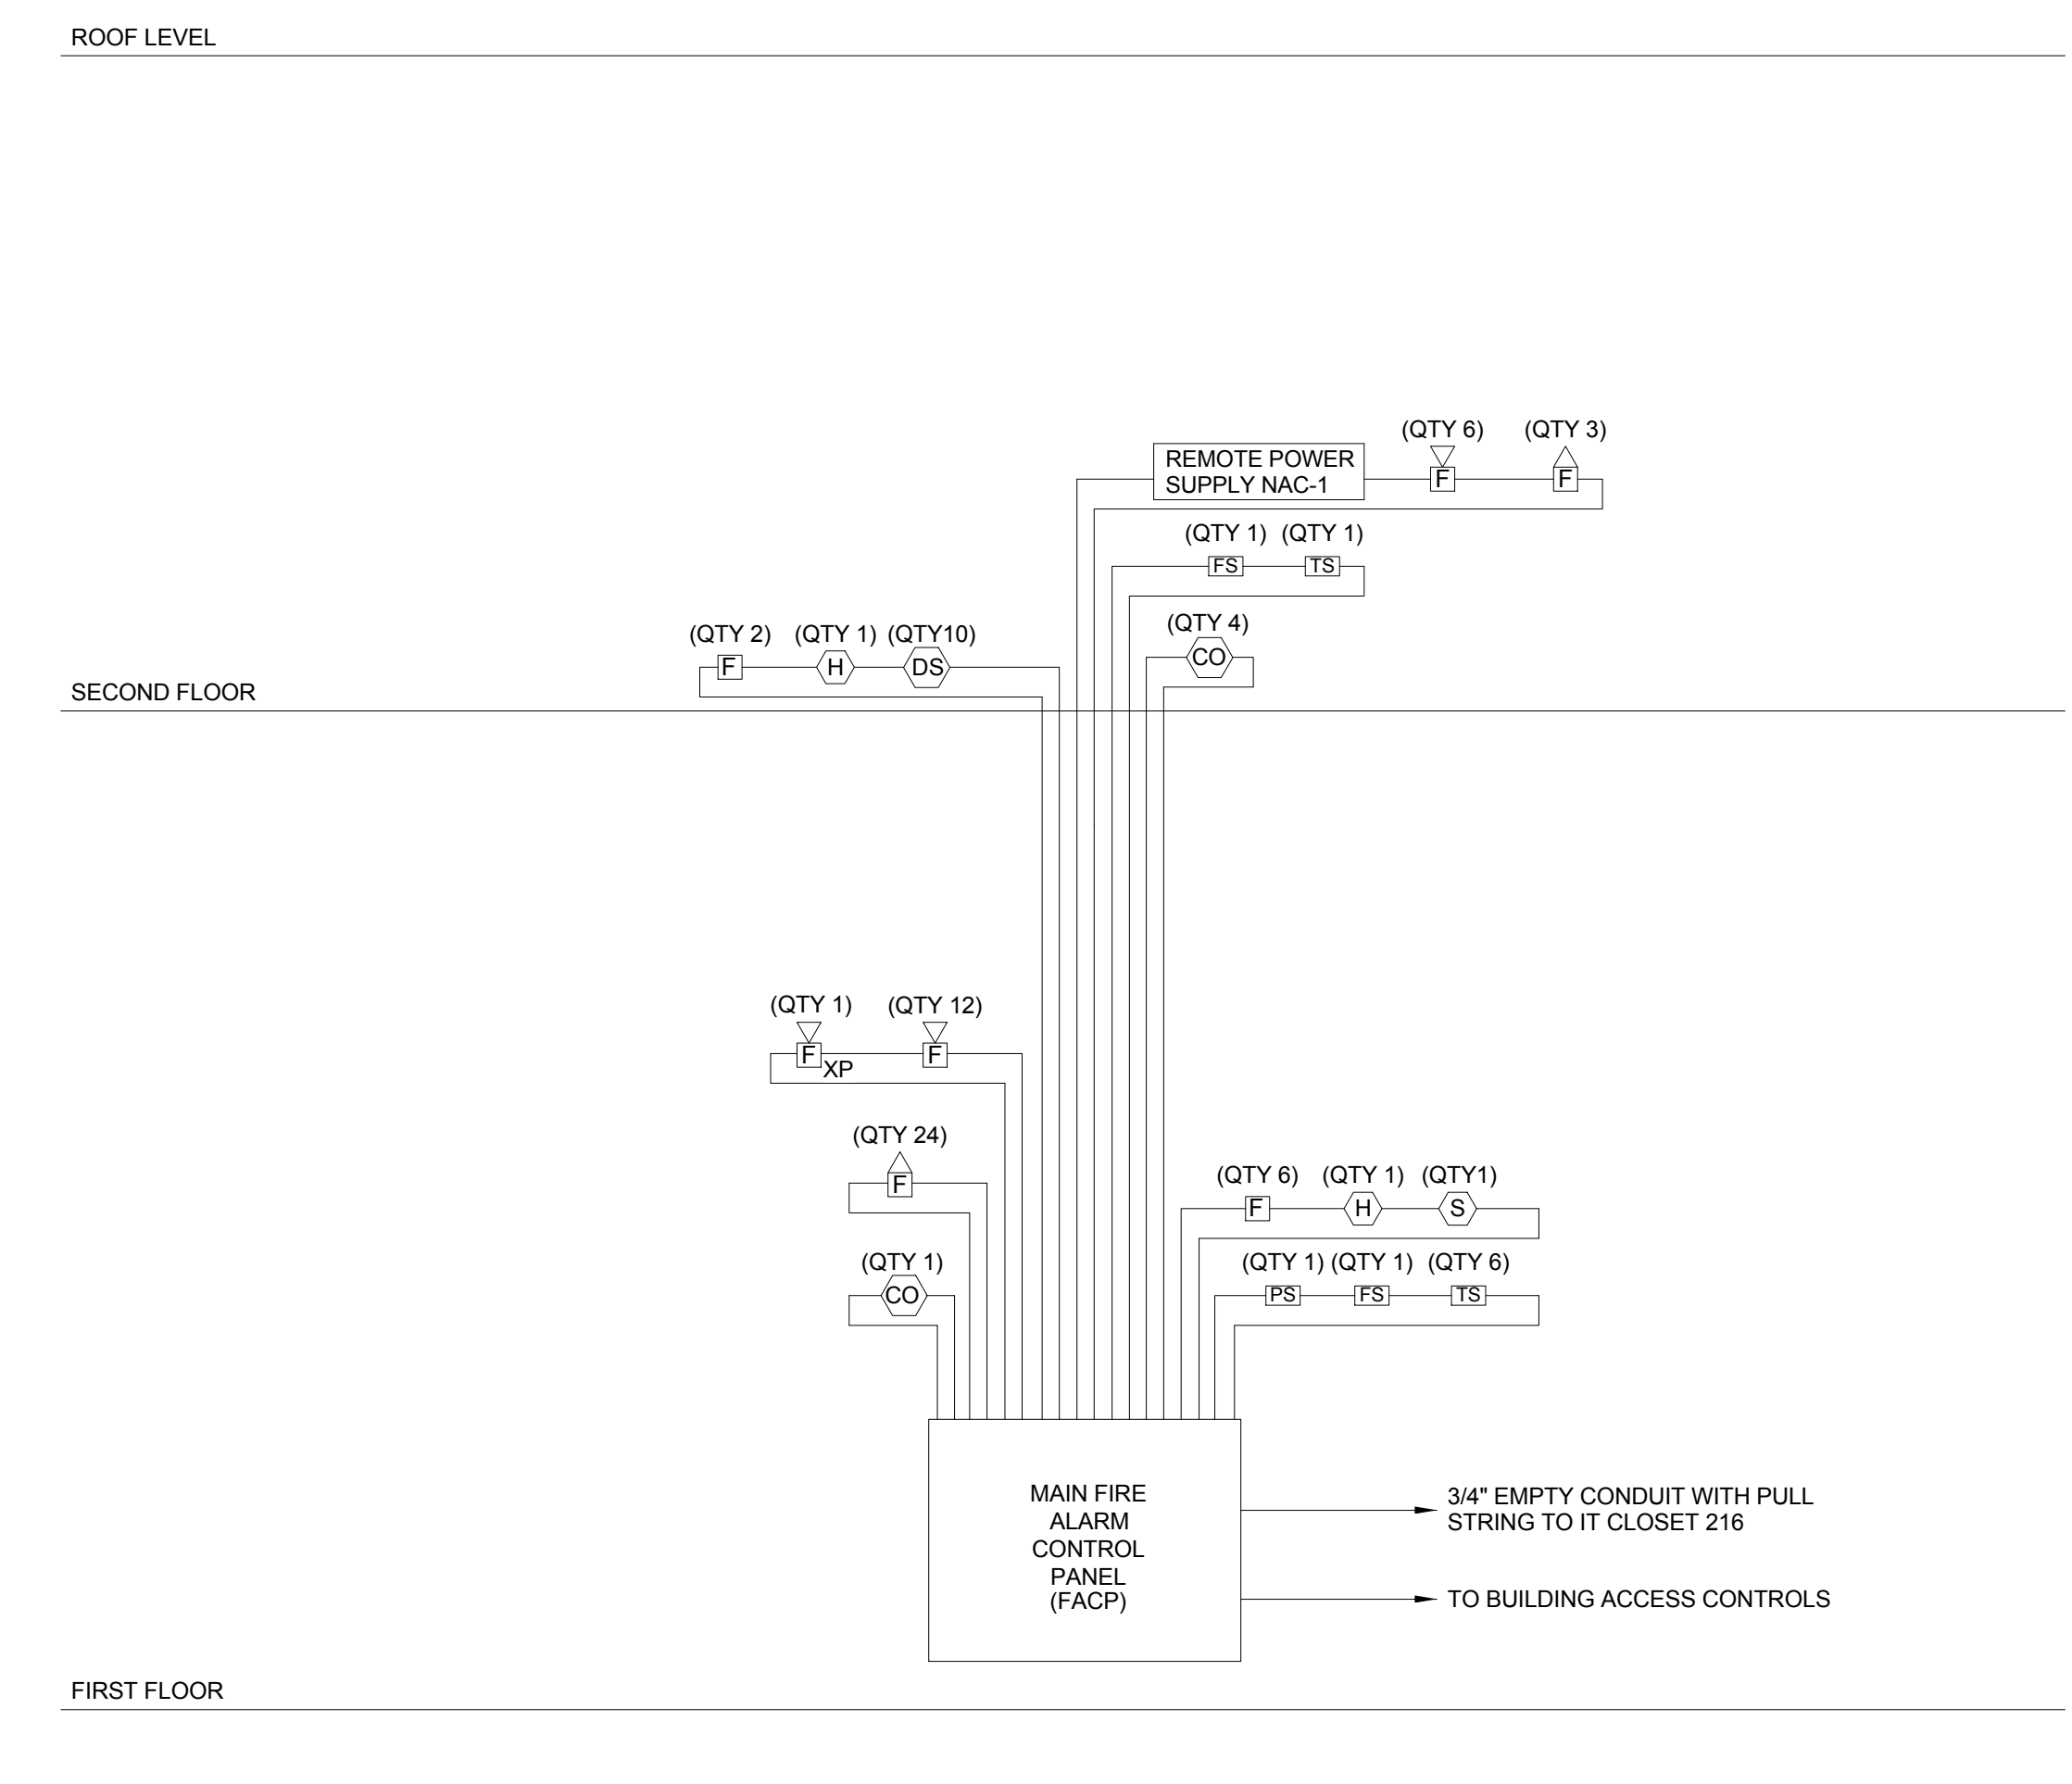

FIRE ALARM RISER NOTES

1. DEVICES SHOWN ARE TYPICAL ONLY. REFER TO FLOOR PLANS FOR EXACT PANEL AND DEVICE LOCATIONS.
2. PROVIDE 3/4" CONDUIT WITH WIRING FROM FIRE ALARM CONTROL PANEL TO ALL DOORS WITH SECURITY HARDWARE FOR OVERRIDE.




Stantec Consulting Services Inc.
3 Columbia Circle Suite 6
Albany, NY 12203-5198
Tel: (518) 452-4358 / Fax: (518) 452-9234
www.stantec.com

Copyright Reserved
The Contractor shall verify and be responsible for all dimensions, DO NOT scale the drawing - any errors or omissions shall be reported to Stantec without delay.
The Copyright in all designs and drawings are the property of Stantec. Reproduction or use for any purpose other than that authorized by Stantec is forbidden.

Client
ImmuCell

Lot 11 - Second Tee Business Park
1039 Riverside Street
Portland, Maine 04103
Consultants

0	INTERIOR FIT-OUT - ISSUED FOR CONSTRUCTION	08/19/2016
Revision	By	Asgd DD.MA.YYYY
PACKAGE C - INTERIOR FIT-OUT		08.19.2016
PACKAGE B - SUPERSTRUCTURE & SHELL		08.05.2016
PACKAGE A - FOUNDATIONS & BELOW SLAB		07.22.2016
Issued	By	Asgd DD.MA.YYYY

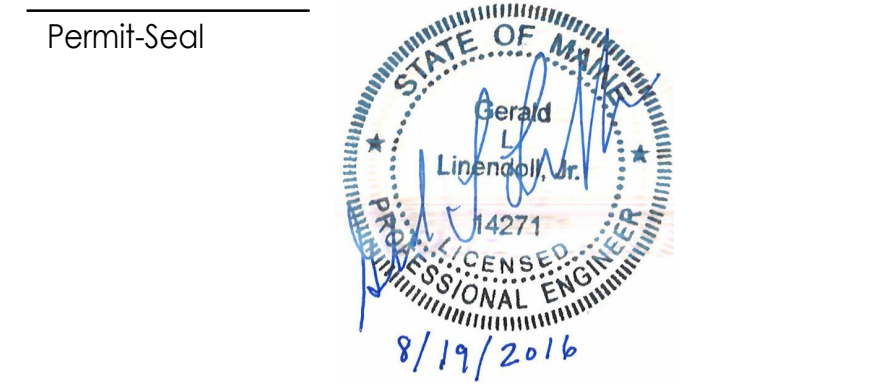

Client/Project
IMMUCELL

Lot 11 - Second Tee Business Park
1039 Riverside Street
Portland, Maine 04103

Title
FIRE ALARM SYMBOLS, NOTES & RISER

Project No. 191504176	Scale 12" = 1'-0"
Revision 0	Drawing No. E-400-C

E:\Projects\191504176\191504176.dwg, ImmuCell, 11/20/16, 11/20/16