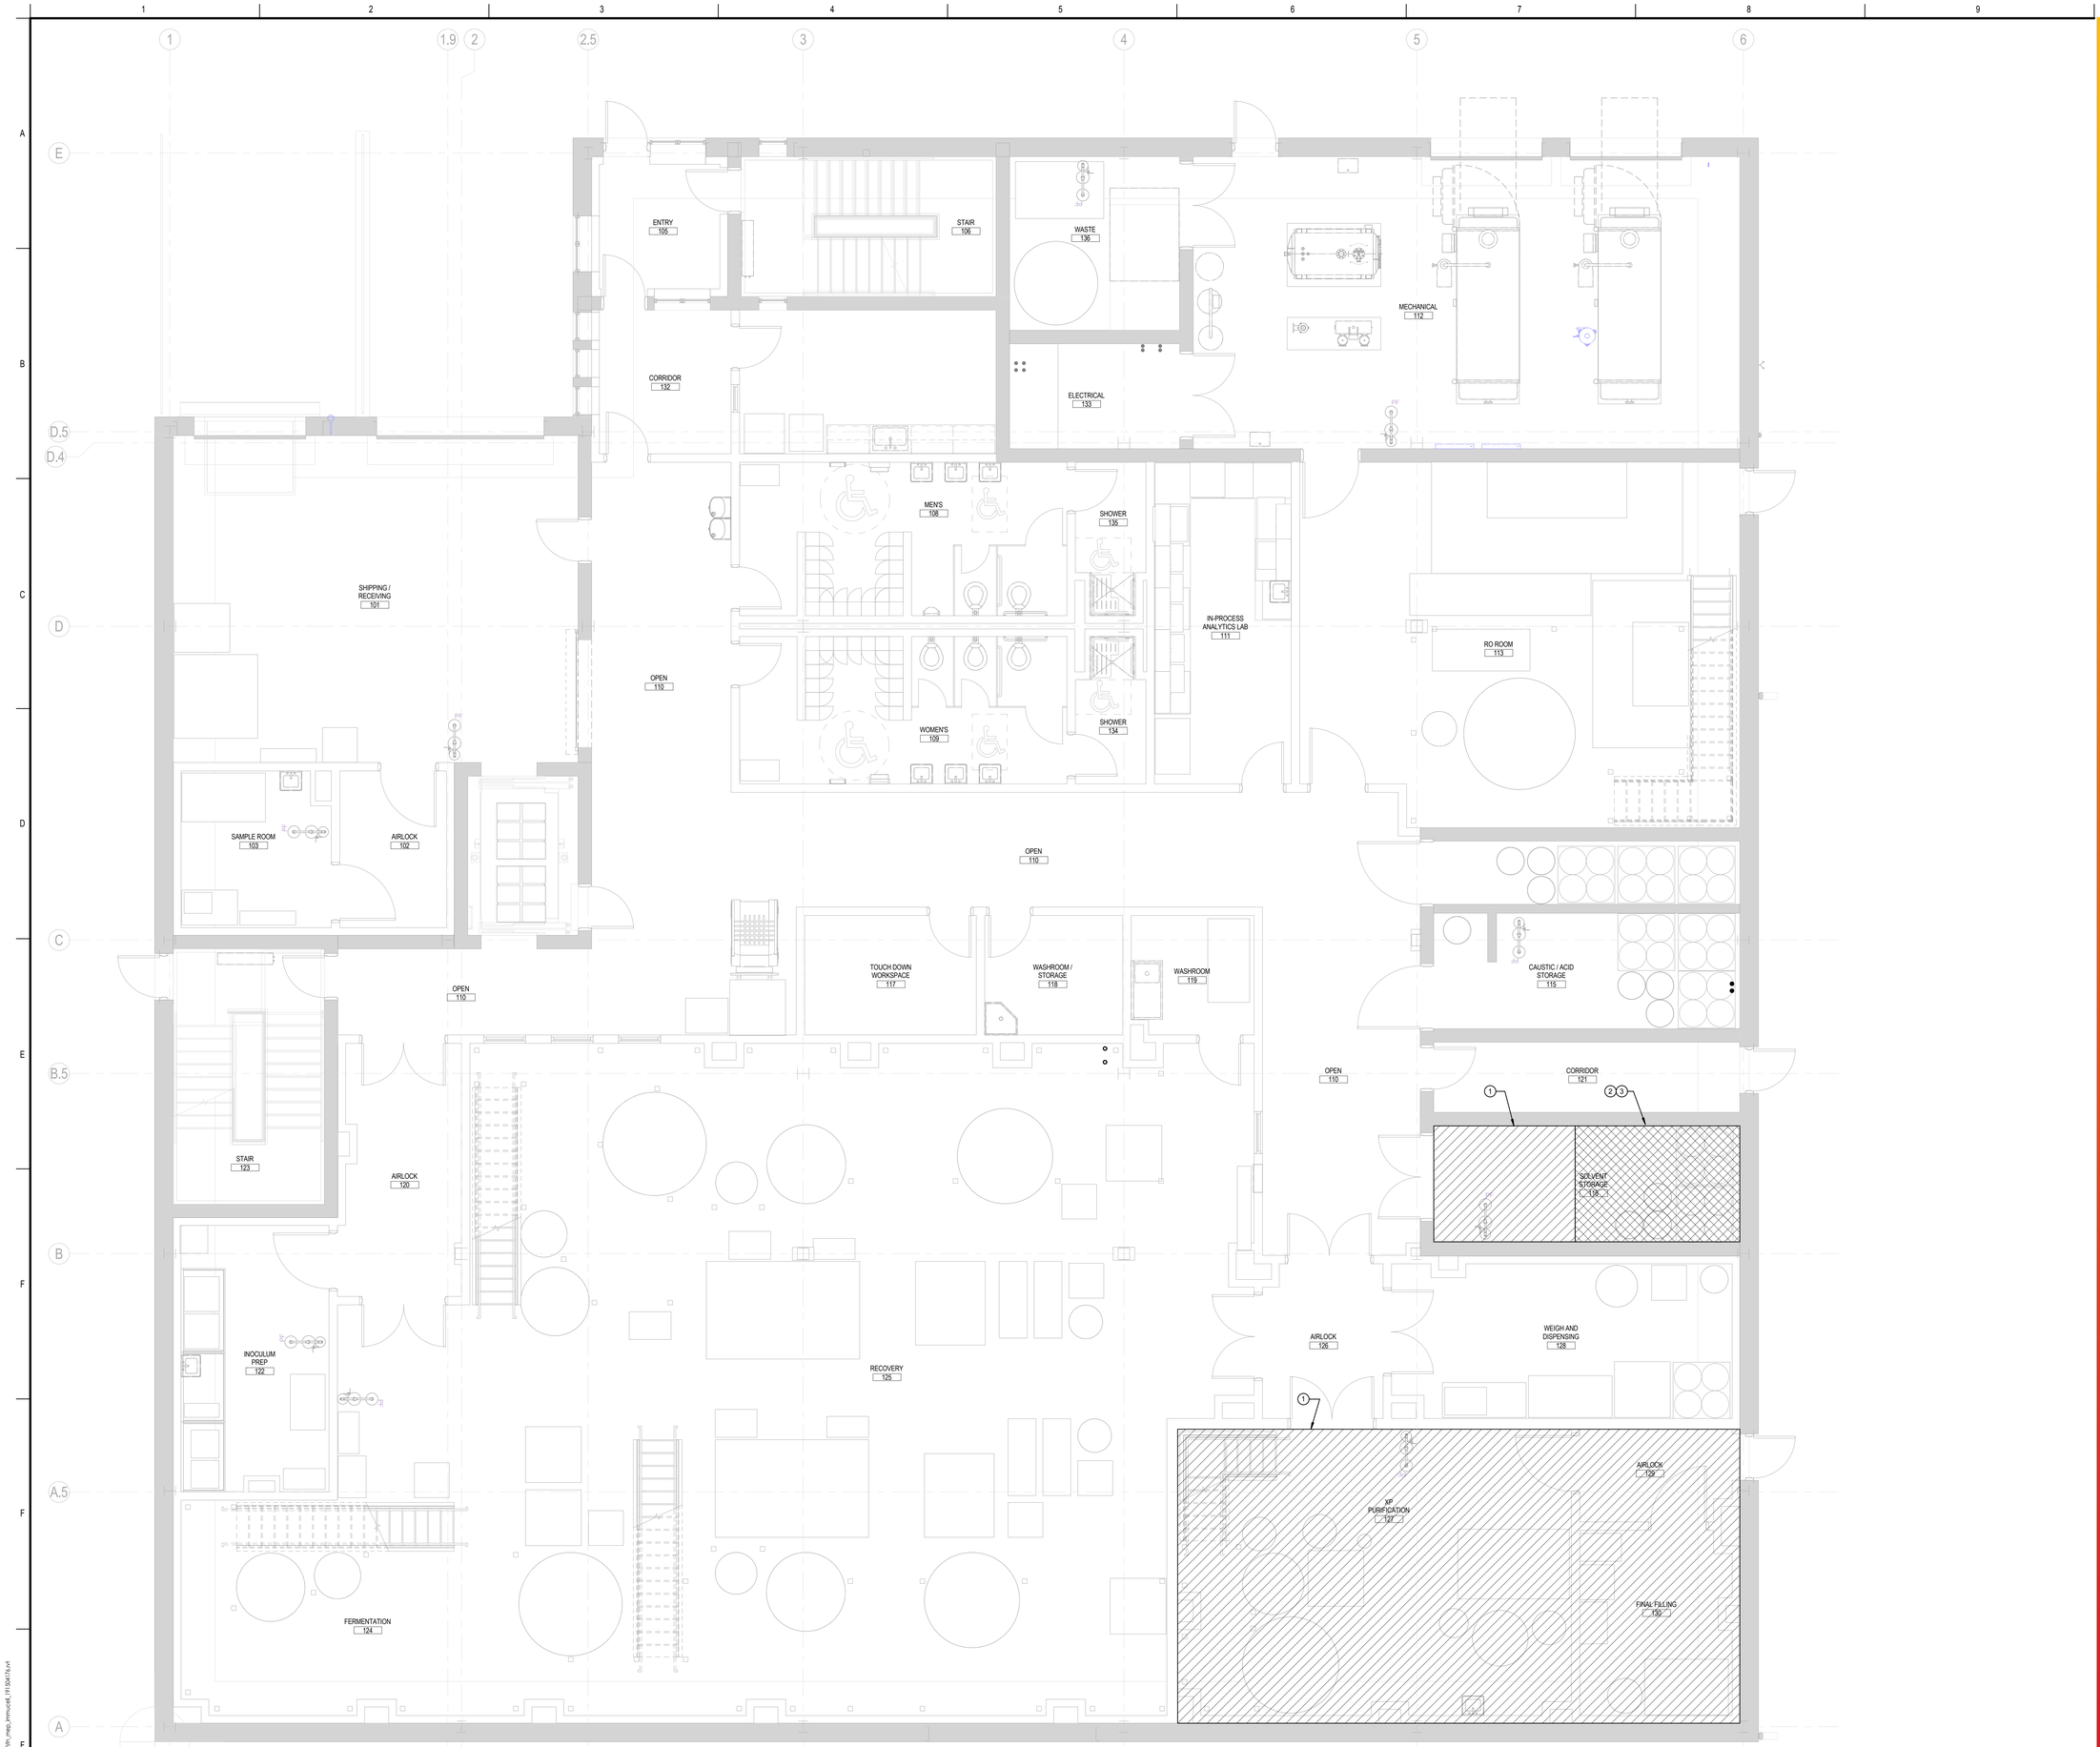

1 E-501-C

FIRST FLOOR - HAZARDOUS CLASSIFICATION PLAN

1/4" = 1'-0"

GRAPHIC SCALE (FEET)

1/4" = 1'-0" 0 2 4 8

NORTH

Stantec

Stantec Consulting Services Inc.
3 Columbia Circle Suite 6
Albany, NY 12203-5158
Tel: (518) 452-4358 / Fax: (518) 452-9234

www.stantec.com

Copyright Reserved

The Contractor shall verify and be responsible for all dimensions. DO NOT scale the drawing - any errors or omissions shall be reported to Stantec without delay.
The Copyrights to all designs and drawings are the property of Stantec. Reproduction or use for any purpose other than that authorized by Stantec is forbidden.

Client

ImmuCell

Lot 11 - Second Tee Business Park
1039 Riverside Street
Portland, Maine 04103

Consultants

GENERAL NOTES

1. ALL EQUIPMENT, DEVICES, FITTINGS AND INSTALLATION FOR HAZARDOUS LOCATIONS SHALL COMPLY WITH APPLICABLE CODES AN REGULATIONS.
2. ELECTRICAL INSTALLATIONS WITHIN HATCHED AREAS SHALL COMPLY WITH NEC ARTICLE 500 AND 501.

(#) KEYED NOTES

1. AREA IS RATED CLASS I DIV 2 UP TO 1' BELOW LIGHT FIXTURES.
2. AREA IS RATED CLASS I DIV 1 UP TO 71" AFF.
3. AREA ABOVE CLASS I DIV 1 BUBBLE SHALL BE RATED CLASS I DIV 2 UP TO 1' BELOW LIGHT FIXTURES.

LEGEND

- NON HAZARDOUS
- CLASS I DIV 1 GROUP D
- CLASS I DIV 2 GROUP D

Revision	By	Appd	DD.MM.YYYY
0 INTERIOR FIT OUT - ISSUED FOR CONSTRUCTION			08/19/2016

Issued	By	Appd	DD.MM.YYYY
PACKAGE C - INTERIOR FIT-OUT			**08.19.2016**
PACKAGE B - SUPERSTRUCTURE & SHELL			08.05.2016
PACKAGE A - FOUNDATIONS & BELOW SLAB			07.22.2016

Permit-Seal

STATE OF MAINE
Gerald Linnehan Jr.
14071
LICENSED PROFESSIONAL ENGINEER
8/19/2016

Client/Project
IMMUCELL

Lot 11 - Second Tee Business Park
1039 Riverside Street
Portland, Maine 04103

Title
HAZARDOUS CLASSIFICATION PLAN

Project No. 191504176

Scale 1/4" = 1'-0"

Revision 0

Drawing No. E-501-C

R:\0_PROJECTS\191504176\Arch_Plans\E-501-C.dwg, 8/19/2016 4:42:23 PM

ORIGINAL SHEET - ANSI E (34"x44")