

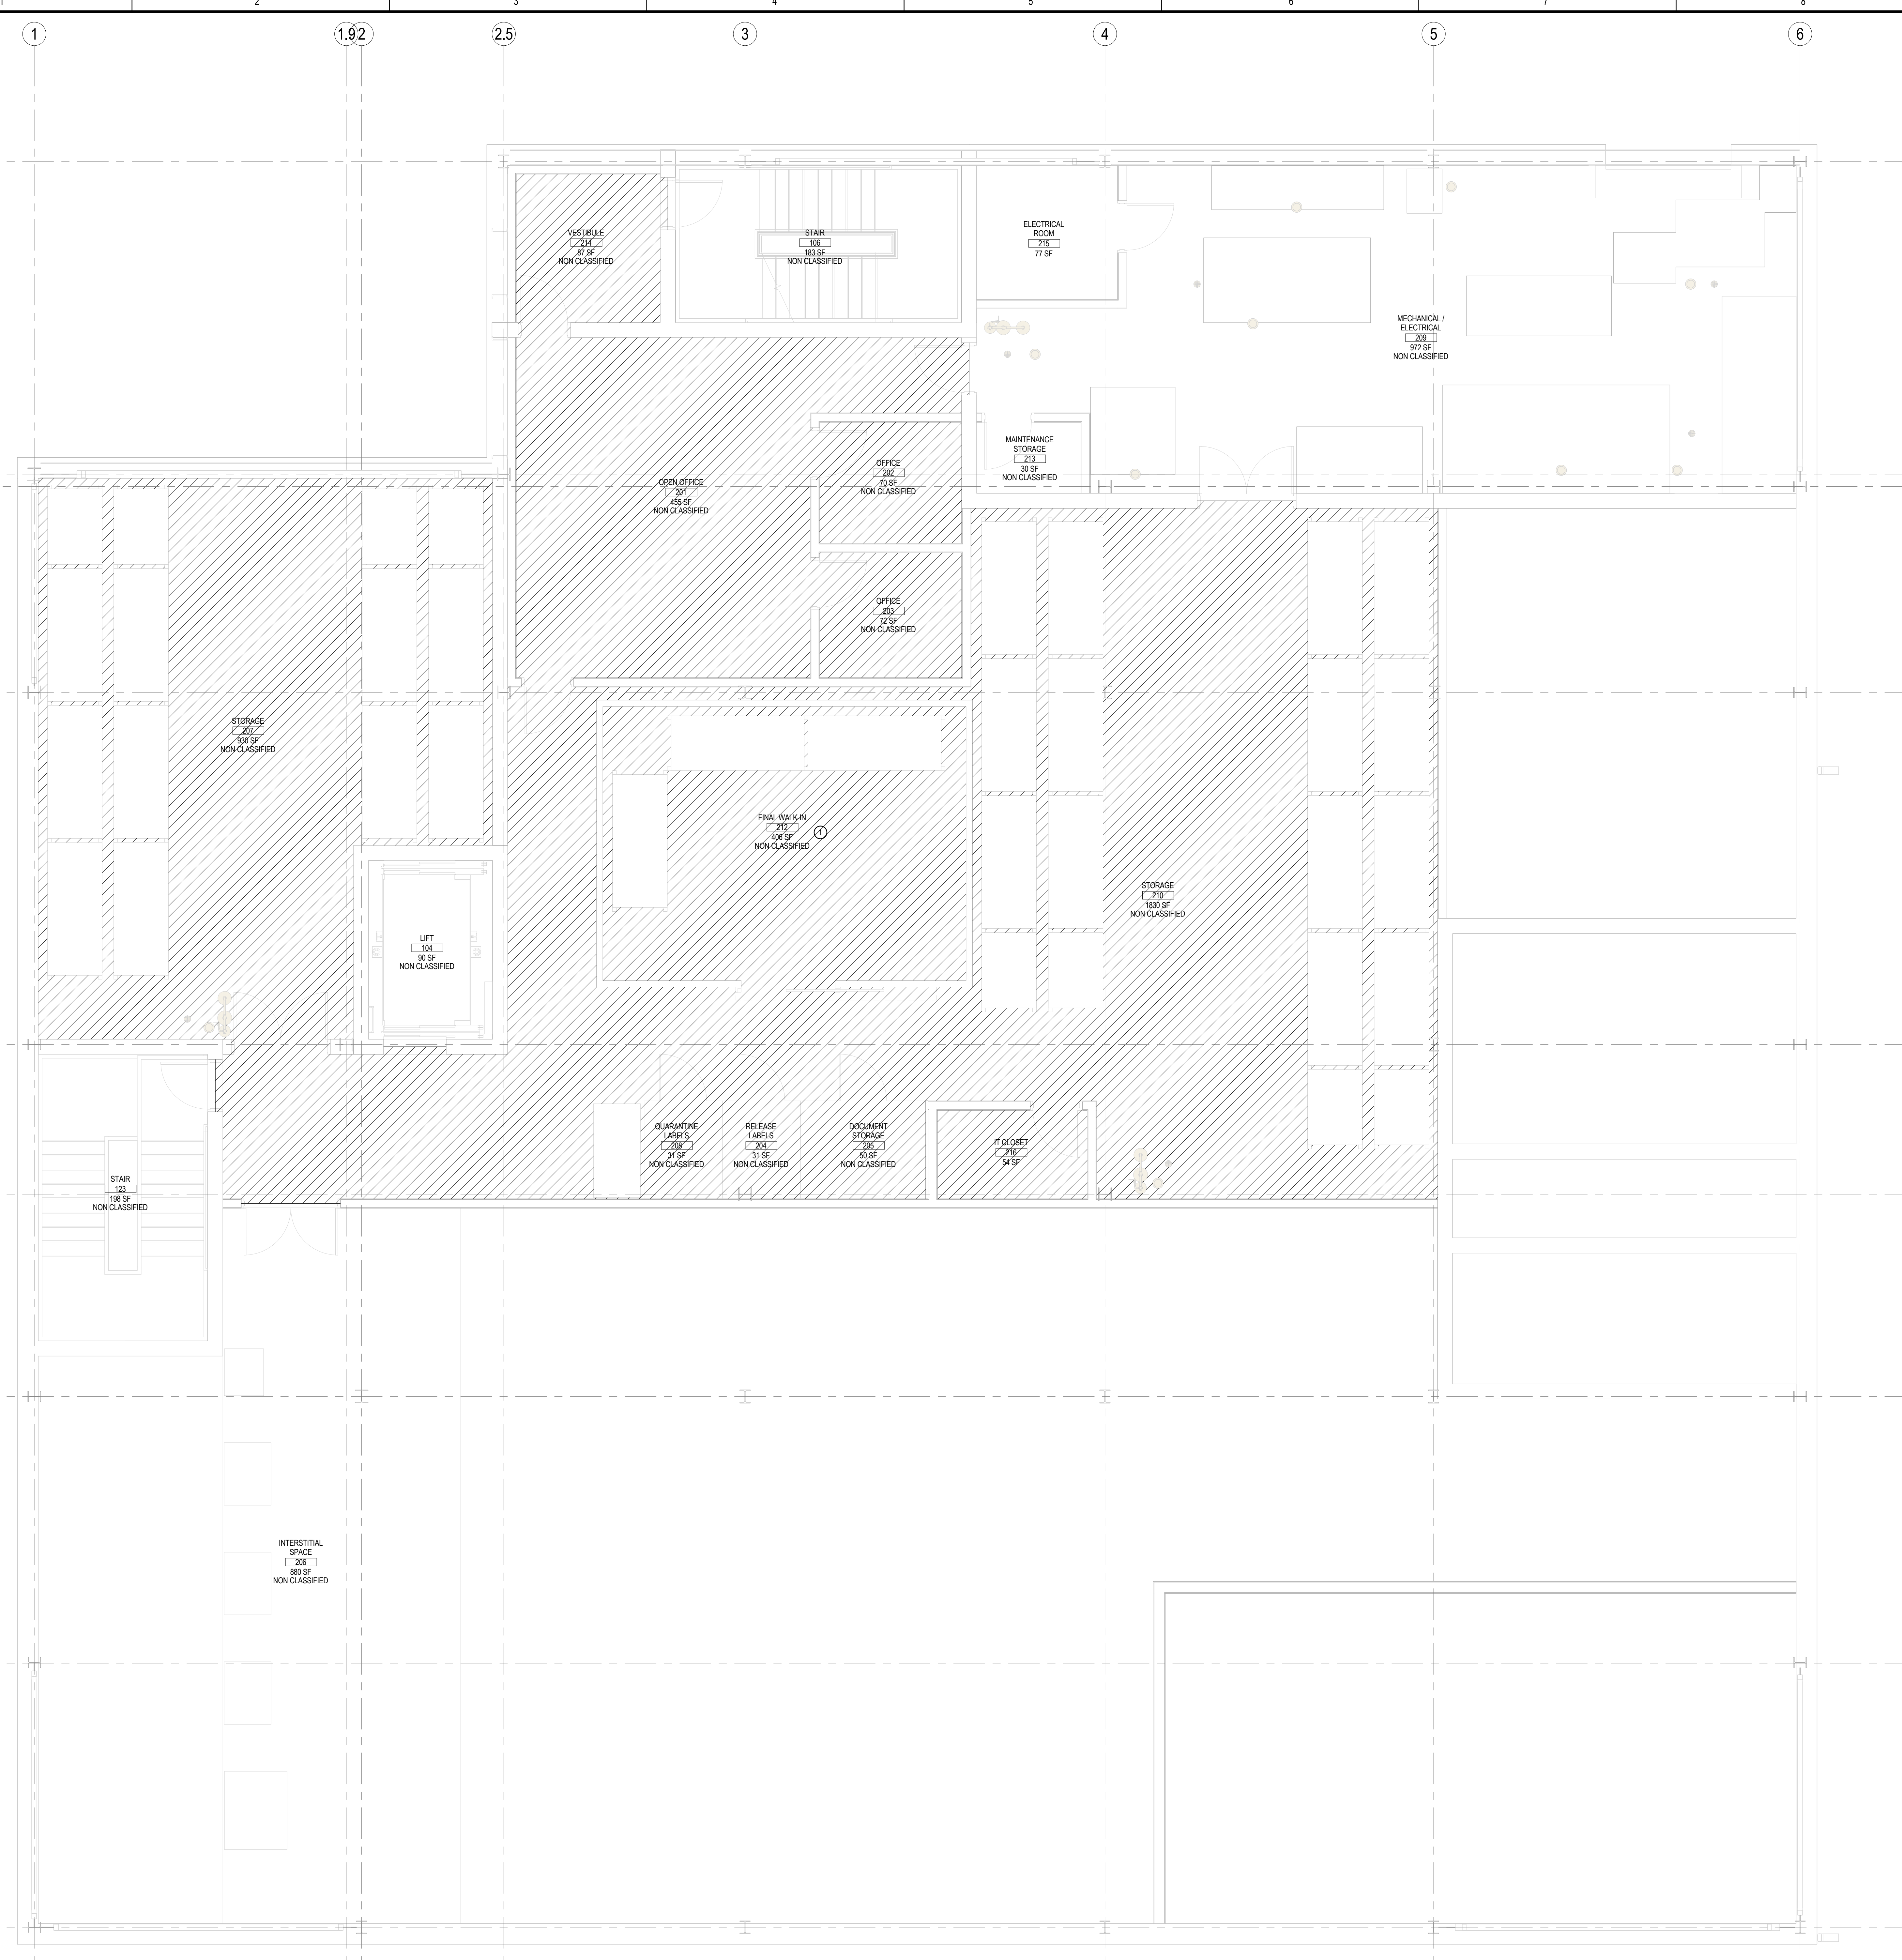


**KEYED NOTES**

- ROOM 212 - FINAL WALK IN SHALL BE A CONTROLLED ENVIRONMENT ROOM. THIS SPACE SHALL BE SERVED BY A SEPARATE HVAC SYSTEM. SEE SPECIFICATION FOR ADDITIONAL INFORMATION.

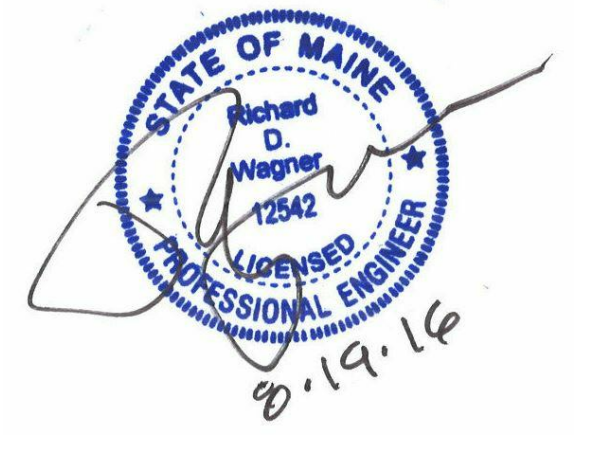

**1 SECOND FLOOR - HVAC ZONING CLASSIFICATION**  
 1/4" = 1'-0"

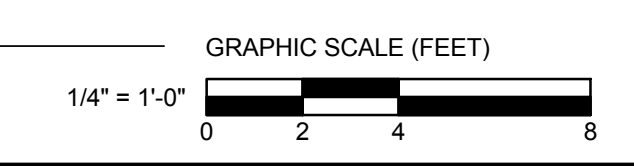

Revision	By	App'd	DD.MM.YYYY
0			08/19/2016
INTERIOR FIT-OUT - ISSUED FOR CONSTRUCTION			
<b>PACKAGE C - INTERIOR FIT-OUT</b>			
PACKAGE B - SUPERSTRUCTURE & SHELL			
PACKAGE A - FOUNDATIONS & BELOW SLAB			
Issued			07/22/2016

Permit-Seal

Client/Project  
**IMMUCELL**

Lot 11 - Second Tee Business Park  
 1039 Riverside Street  
 Portland, Maine 04103

Title  
**SECOND FLOOR - AHU ZONING PLAN**

Project No.	Scale
191504176	1/4" = 1'-0"
Revision	Drawing No.
0	

**MH-102-C**

ORIGINAL SHEET: A08 (3/4/14)