


**GENERAL NOTES**

1. BOD DIMENSIONS AND RATINGS ARE DIAGRAMMATIC IN NATURE. MECHANICAL CONTRACTOR IS RESPONSIBLE FOR FIELD VERIFICATION, ROUTING AND COORDINATION OF NEW DUCTWORK.
2. ALL BOD DIMENSIONS ARE IN REFERENCE THE FIRST FLOOR FINISHED FLOOR.
3. OUTLINES INDICATE UNIT COIL FULL ORIENTATION AND CLEARANCES.
4. FURNISH AND INSTALL FLEXIBLE CONNECTION TO EQUIPMENT. SEE SPECIFICATIONS FOR ADDITIONAL INFORMATION.
5. ALL DUCTWORK SHALL BE SUPPORTED AS PER DETAILS ON SHEET MH-802. ALL EQUIPMENT SHALL BE SUPPORTED AS PER THE SPECIFICATIONS.

**KEYED NOTES**

1. PROVIDE A 20" VERTICAL EXHAUST STACK FOR FAN DISCHARGE WEST OF FAN. DISCHARGE POINT SHALL BE NO LESS THAN 10' ABOVE TOP OF ROOF. STACK SHALL HAVE SLANTED BOTTOM PLATE AND DRAIN CONNECTION. STACK DISCHARGE SHALL BE SEE HVAC DETAILS FOR ADDITIONAL INFORMATION.
2. PROVIDE A 20" VERTICAL EXHAUST STACK FOR FAN DISCHARGE EAST OF FAN. DISCHARGE POINT SHALL BE NO LESS THAN 10' ABOVE TOP OF ROOF. STACK SHALL HAVE SLANTED BOTTOM PLATE AND DRAIN CONNECTION. STACK DISCHARGE SHALL BE SEE HVAC DETAILS FOR ADDITIONAL INFORMATION.
3. BOILER VENT STACK SHALL EXTEND 10' BEYOND ROOF LEVEL. COORDINATE PENETRATION THROUGH DRAINAGE WITH STRUCTURAL DISCIPLINE. VENT STACK SHALL BE DOUBLE WALL DUCTWORK WITH AN 180 INCHER REQUIREMENT. SEE MH-802 FOR ADDITIONAL DETAILS.
4. PROVIDE A WEATHERHOOD AND INSET SCREEN ON DISCHARGE OF AIR COMPRESSOR VENT DUCTWORK. SUPPORT DUCTWORK FROM CHILLER PLATFORM STEEL AS REQUIRED BY SPECIFICATIONS.
5. CONTRACTOR SHALL COORDINATE LOCATION OF UNITS TO ALLOW FOR ACCESS TO ALL PIPE ENCLOSURES.

Revision	By	App'd	DD.MM.YYYY
1	ADDENDUM #1		09/16/2016
0	INTERIOR FIT OUT - ISSUED FOR CONSTRUCTION		08/19/2016
	PACKAGE D - PROCESS		09/16/2016
	PACKAGE C - INTERIOR FIT-OUT		08/19/2016
	PACKAGE B - SUPERSTRUCTURE & SHELL		08/05/2016
	PACKAGE A - FOUNDATIONS & BELOW SLAB		07/22/2016
	Issued		

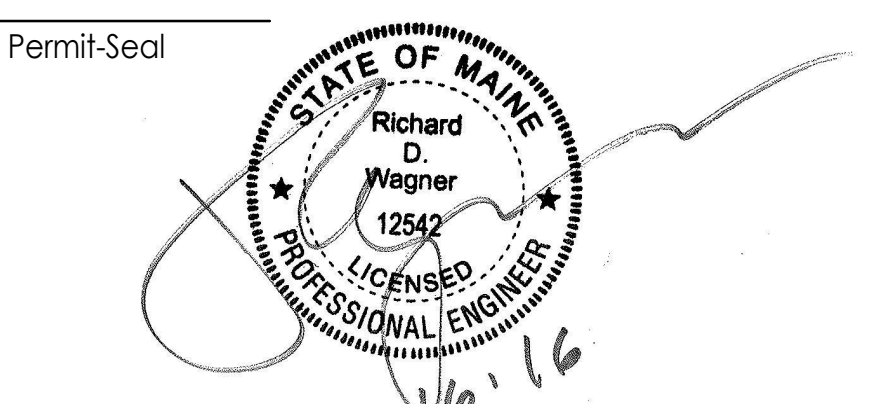


Client/Project  
**IMMUCELL**

Lot 11 - Second Tee Business Park  
 1039 Riverside Street  
 Portland, Maine 04103

Title  
**ROOF - MECHANICAL DUCTWORK PLAN**

Project No.	Scale
191504176	1/4" = 1'-0"
Revision	Drawing No.
1	

**MH-603-C**

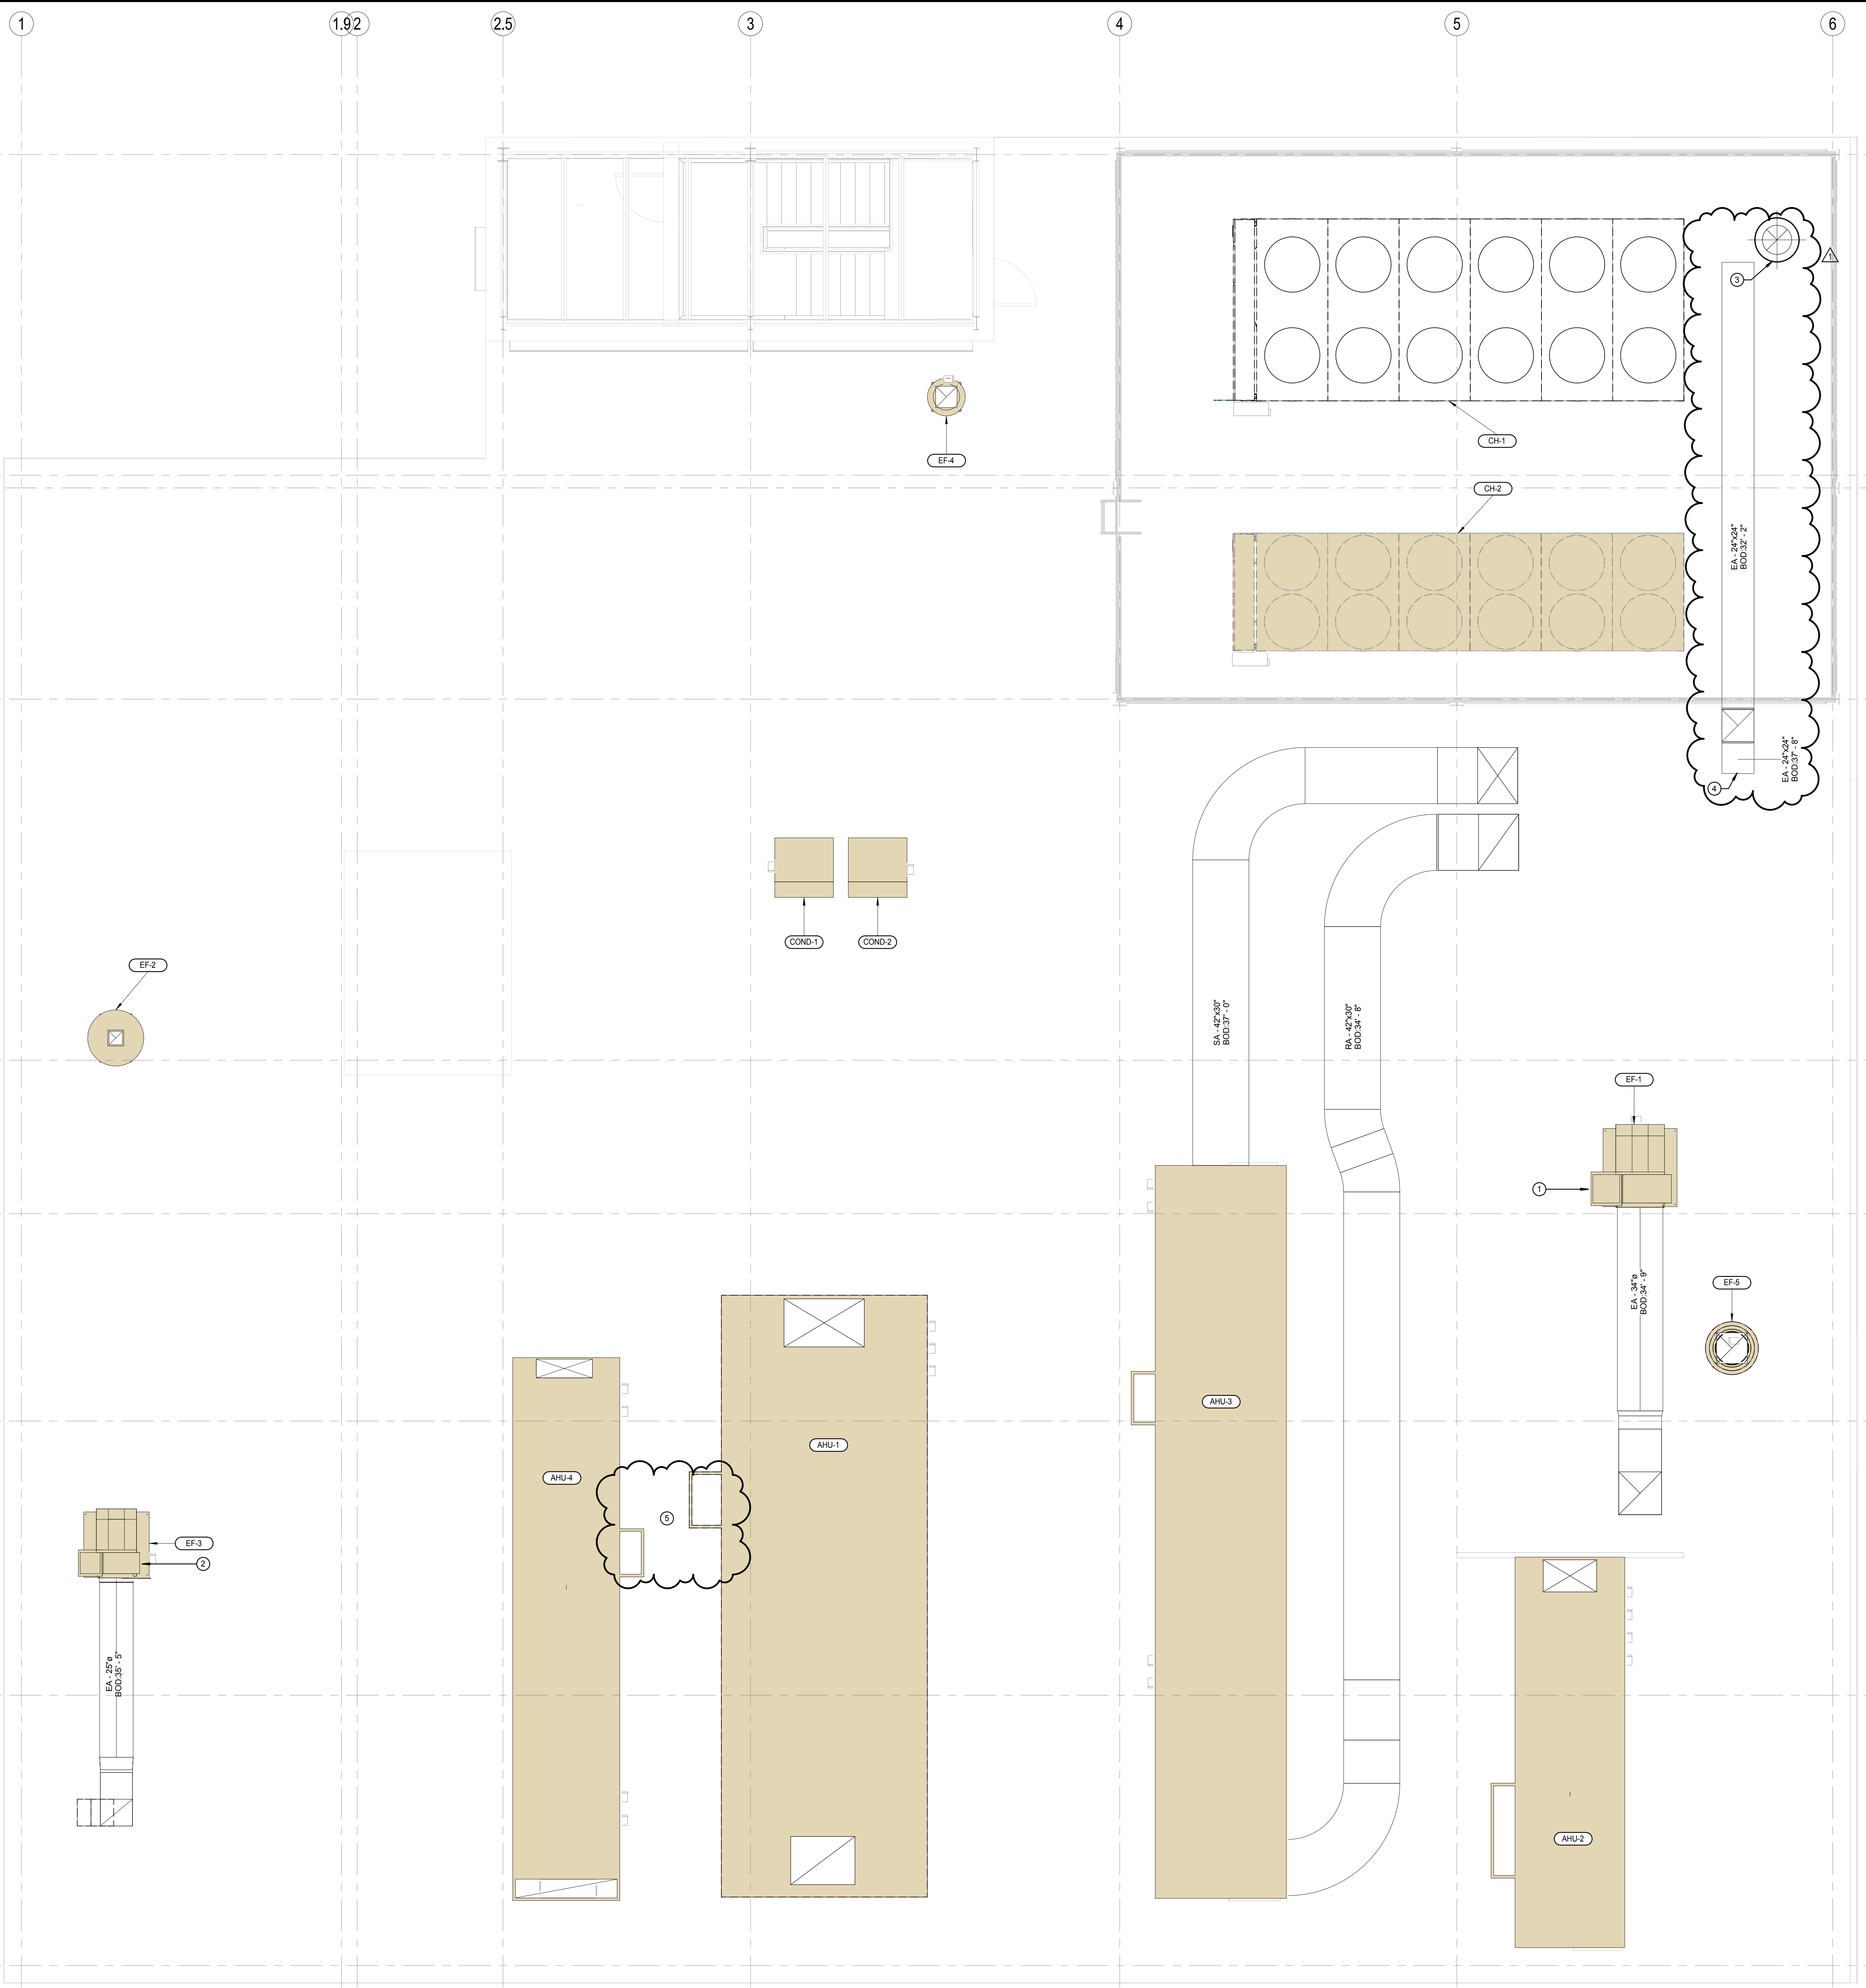

**1 ROOF - HVAC PLAN**  
 1/4" = 1'-0"

