


No.	Date	Description
B		Revision Schedule

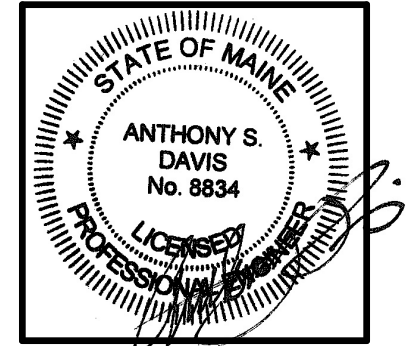

JOB NO.
17056

DRWN. CHK
Checker


SCALE:

ISSUE
Permitting Set
19 February 2018

TITLE
MECHANICAL
DEMO

SHEET

MD-100

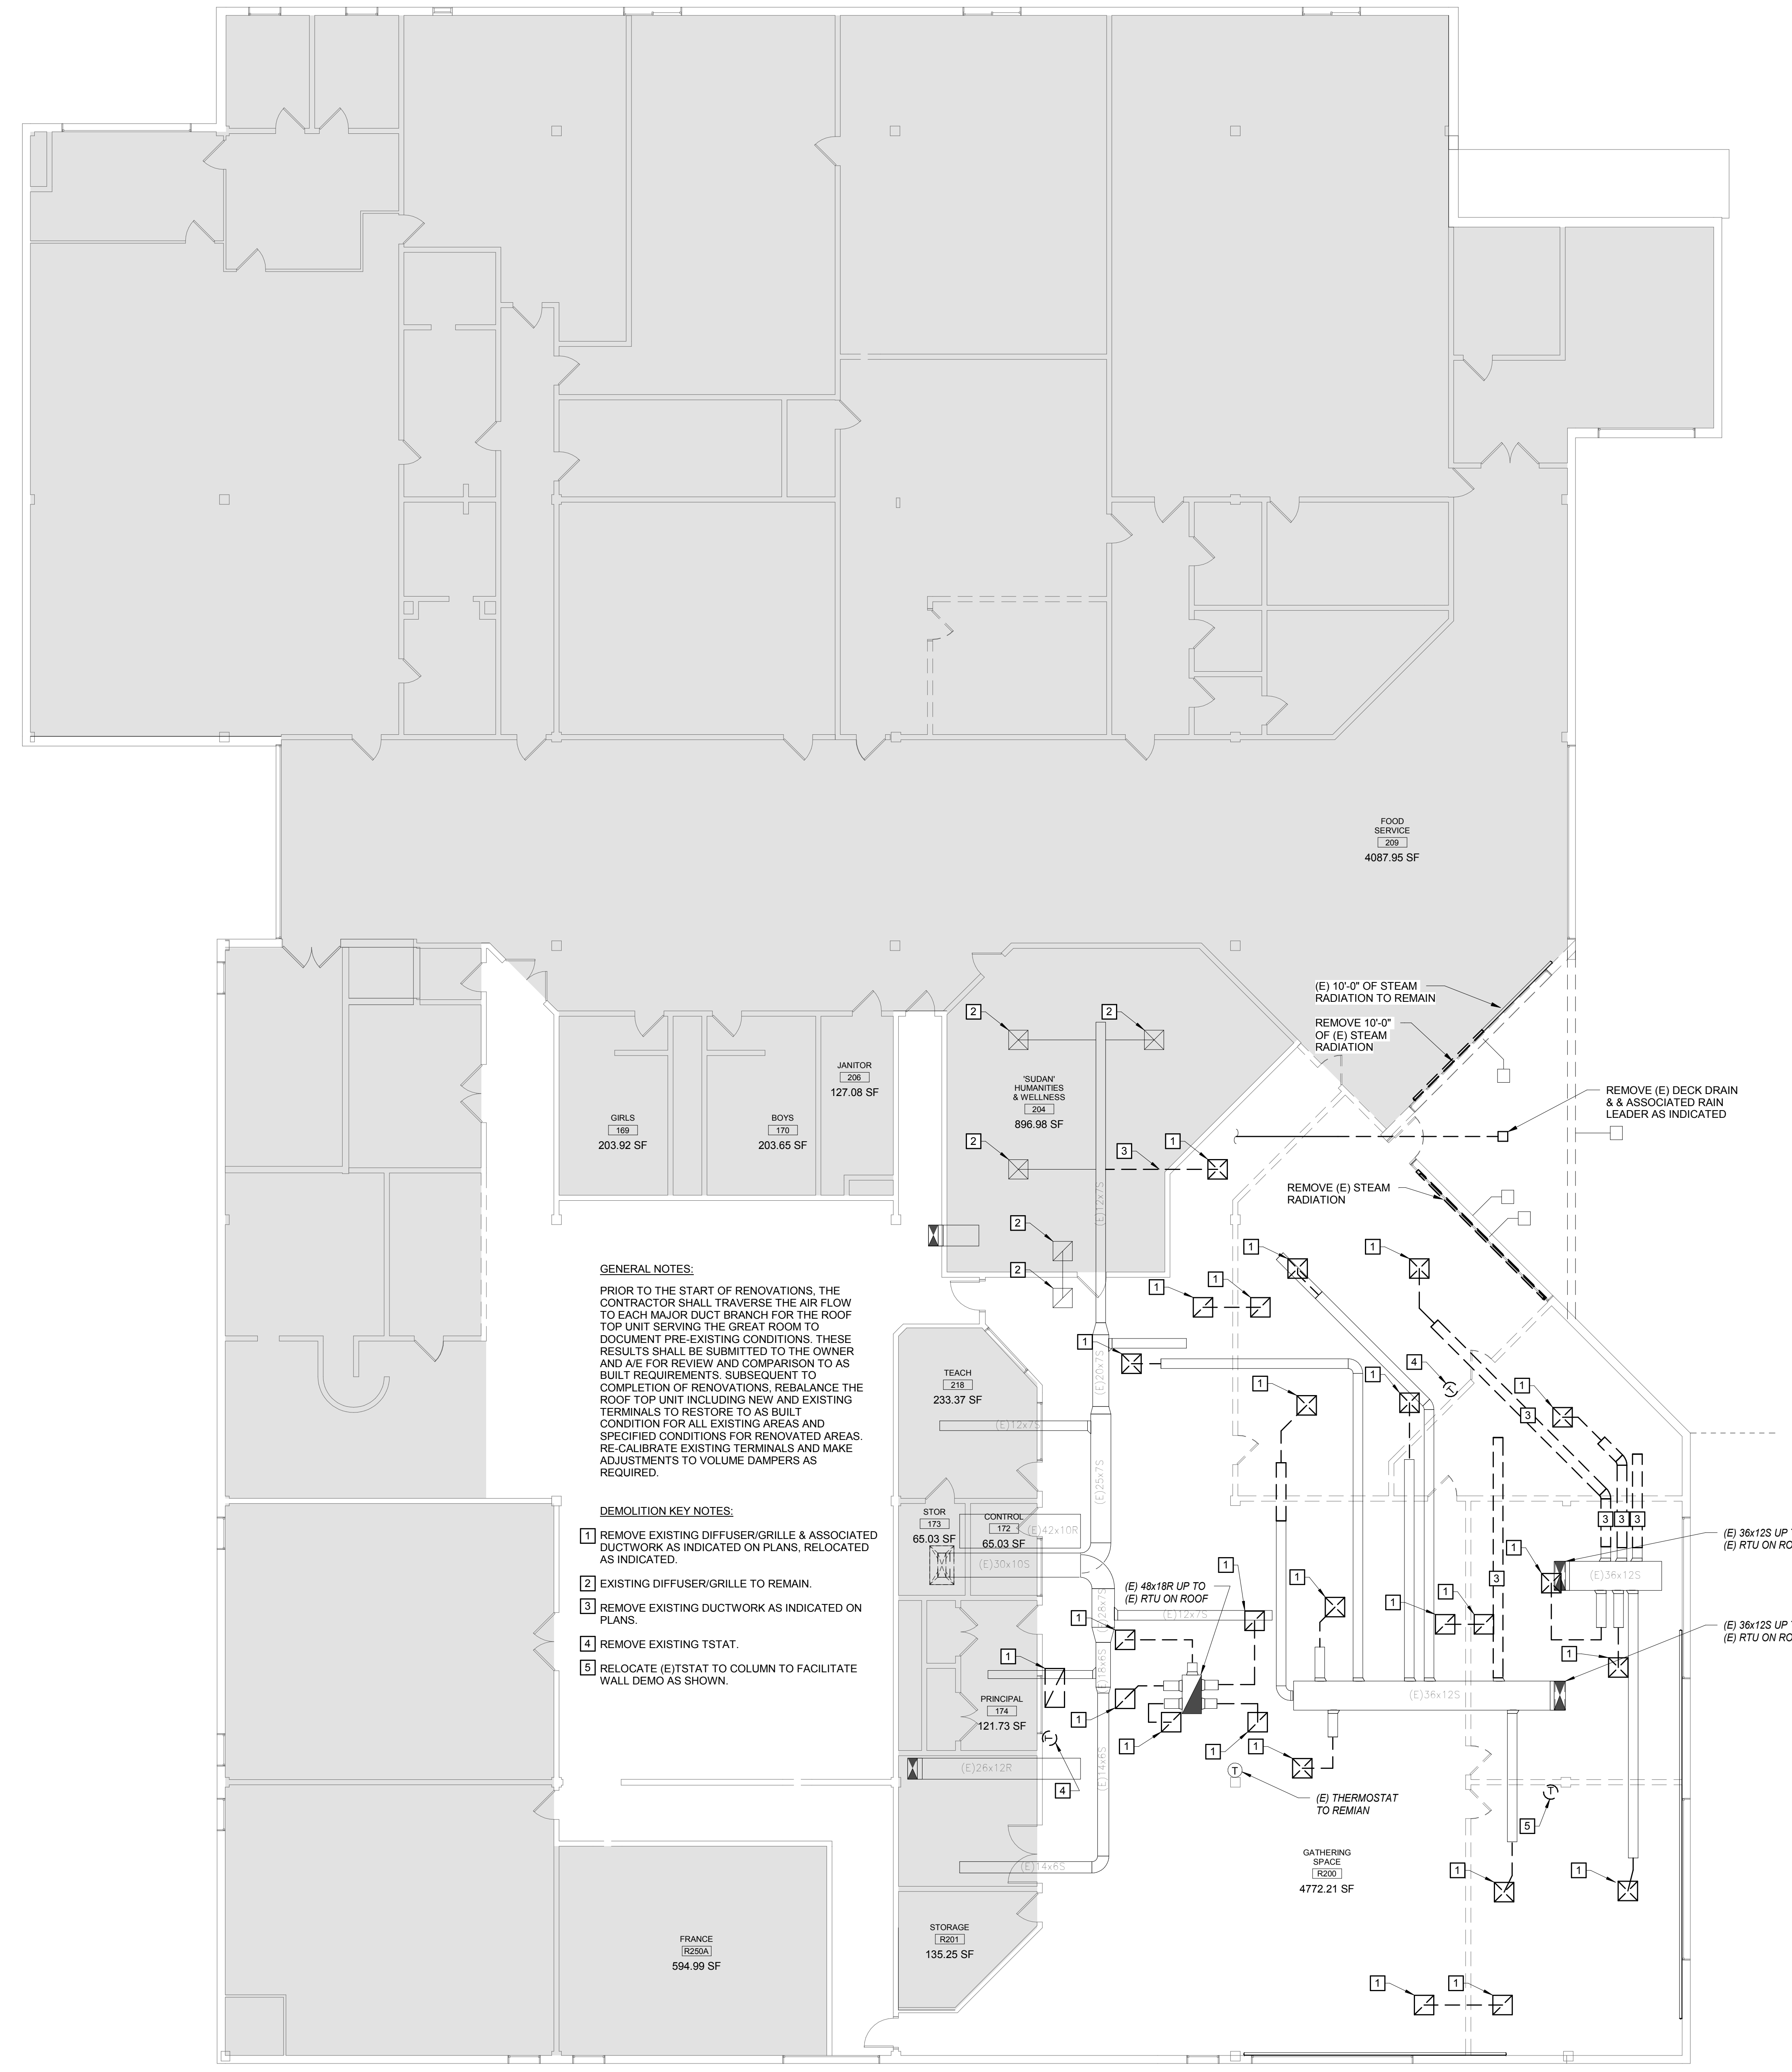

- GENERAL NOTES:**
PRIOR TO THE START OF RENOVATIONS, THE CONTRACTOR SHALL TRAVERSE THE AIR FLOW TO EACH MAJOR DUCT BRANCH FOR THE ROOF TOP UNIT SERVING THE GREAT ROOM TO DOCUMENT PRE-EXISTING CONDITIONS. THESE RESULTS SHALL BE SUBMITTED TO THE OWNER AND A/E FOR REVIEW AND COMPARISON TO AS BUILT REQUIREMENTS, SUBSEQUENT TO COMPLETION OF RENOVATIONS, REBALANCE THE ROOF TOP UNIT INCLUDING NEW AND EXISTING TERMINALS TO RESTORE TO AS BUILT CONDITION FOR ALL EXISTING AREAS AND SPECIFIED CONDITIONS FOR RENOVATED AREAS. RE-CALIBRATE EXISTING TERMINALS AND MAKE ADJUSTMENTS TO VOLUME DAMPERS AS REQUIRED.
- DEMOLITION KEY NOTES:**
- 1 REMOVE EXISTING DIFFUSER/GRILLE & ASSOCIATED DUCTWORK AS INDICATED ON PLANS, RELOCATED AS INDICATED.
 - 2 EXISTING DIFFUSER/GRILLE TO REMAIN.
 - 3 REMOVE EXISTING DUCTWORK AS INDICATED ON PLANS.
 - 4 REMOVE EXISTING TSTAT.
 - 5 RELOCATE (E)TSTAT TO COLUMN TO FACILITATE WALL DEMO AS SHOWN.