

3/7/16/2017 8:13 PM T:\02 PROJECTS - MAINE\101-4200\41000 PAINS FIRE ALARM UPGRADES\DESIGN\DWG\BUILDINGS FIRE ALARM UPGRADES\SHETS\1A102B SECOND FLOOR FIRE ALARM UPGRADES\STEPHANE.LAPLANT




GENERAL NOTES:

- 1. TO THE EXTENT POSSIBLE, INSTALL FIRE ALARM CABLES IN SPECIFIED UNENCLOSED WIRING METHOD ABOVE ACCESSIBLE CEILINGS.

TECHNICAL NOTES:

- ① POWER SHALL BE PROVIDED FROM EXISTING ADJACENT PANEL. FIELD COORDINATE EXACT CIRCUIT + PROVIDE 120V, 1P CIRCUIT BREAKER IF REQUIRED.

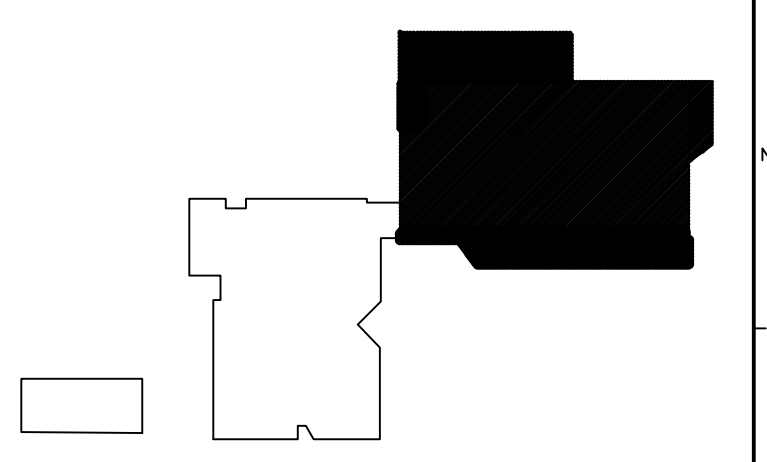

KEY PLAN

LEGEND:

- E EXISTING TO REMAIN
- FR EXISTING RELOCATED
- NR NEW TO REPLACE EXISTING IN EXISTING LOCATION
- R EXISTING TO BE REMOVED
- RR REMOVE & RELOCATE EXISTING
- ☐ FIRE ALARM HORN / LIGHT
- ▽ MULTI-CANDELA STROBE
- ☐ MULTI-CANDELA HORN/STROBE
- ☐ CEILING MOUNTED MULTI-CANDELA HORN/STROBE
- ⊙ FIRE ALARM SYSTEM CEILING MOUNTED HEAT DETECTOR - 'EL' FOR ELEVATOR SHUNT TRIP
- ⊙ FIRE ALARM SYSTEM CEILING MOUNTED SMOKE DETECTOR - 'EL' FOR ELEVATOR RECALL
- ☐ WALL MOUNTED FIRE ALARM SYSTEM MANUAL PULL STATION
- ☐ KNOX BOX
- ☐ JUNCTION BOX
- ☐ DOOR HOLD-OPEN DEVICE CONNECTION
- ⊙ FIRE ALARM SYSTEM/SPRINKLER SYSTEM PRESSURE SWITCH
- ⊙ FIRE ALARM SYSTEM/SPRINKLER SYSTEM FLOW SWITCH
- ⊙ FIRE ALARM SYSTEM/SPRINKLER SYSTEM TAMPER SWITCH
- ⊙ FIRE ALARM SYSTEM DUCT MOUNTED SMOKE DETECTOR
- ⊙ FIRE ALARM SYSTEM CONTROL PANEL
- ⊙ FIRE ALARM ANNUNCIATOR
- ⊙ GAS SHUT-OFF
- ⊙ RADIO TRANSMITTER BOX
- ⊙ MONITOR MODULE
- ⊙ TEST STATION
- ⊙ RELAY MODULE
- ⊙ ANSUL GAS TANK

REV.	DESCRIPTION	DATE
0	ISSUE FOR BID	03.14.17

PROJECT NORTH

WBRC
ARCHITECTS • ENGINEERS
WWW.WBRC.COM
BANGOR, MAINE 207-647-4511
PORTLAND, MAINE 207-628-4511
SARASOTA, FLORIDA 941-556-0075

PORTLAND ARTS AND TECHNICAL HIGH SCHOOL FIRE ALARM UPGRADES
PORTLAND, ME

PROJECT: SECOND FLOOR FIRE ALARM BUILDING B PLAN

SHEET TITLE:	4145.00 - FA102B
WBRC CAD FILE:	4145.00
PROJECT No.:	AS NOTED
SCALE:	GRAPHIC SCALE: 0"
PROJECT MANAGER:	SJL
DRAWN BY:	DVS
CHECKED BY:	SJL

A1 SECOND FLOOR BUILDING B FIRE ALARM PLAN

1/8" = 1'-0"

FA102B