

DRAWINGS/SPECIFICATIONS BY:

WALGREENS'	<input type="checkbox"/>
LANDLORD'S CONSULTANT	<input checked="" type="checkbox"/>
ALL CONSTRUCTION WORK, UNLESS NOTED OTHERWISE, BY:	
WALGREENS' CONTRACTOR	<input type="checkbox"/>
LANDLORD'S CONTRACTOR (TURNKEY CONSTRUCTION)	<input type="checkbox"/>

STORE	BUILDING
NEW	<input checked="" type="checkbox"/>
REMODELING	<input type="checkbox"/>
RELOCATION	<input type="checkbox"/>
OTHERS	<input type="checkbox"/>

NO.	DATE	BY	DESCRIPTION	CONST.
REVISIONS				

REVISIONS			
NO.	DATE	BY	DESCRIPTION

CERTIFICATION AND SEAL

I HEREBY CERTIFY THAT THIS PLAN AND SPECIFICATION WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY REGISTERED ARCHITECT OR ENGINEER UNDER THE LAWS OF THE STATE OF MAINE AS SIGNIFIED BY MY HAND AND SEAL.

FISCAL 2007 CRITERIA - STORE #12326

WALGREENS
(NWC) WASHINGTON & ALLEN AVES.
PORTLAND, MAINE

DRAWING TITLE
FLOOR PLAN - POWER

CADD PLOT:	SCALE: AS NOTED	DRAWING NO.
VOID PLOT:	DRAWN BY: TD	E1.2
RELEASED TO CONSTRUCTION:	DATE: 3-26-09	
	REVIEWED BY: SAM	

POWER KEYED NOTES (CONT.)

- 74 ONE (1) 20A 120V 1PH CIRCUIT TO OUTLET 1'-0" A.F.F. FOR CONVEYOR, BALDOR DRIVE MOTOR WITH SCR (SPEED CONTROL) BY CONVEYOR MFG. FINAL CONNECTION BY ELECTRICAL CONTRACTOR TO FURNISH AND INSTALL FOUR (4) HUBBELL NO. CS1221 SWITCHES WIRING IN SERIES AND EQUALLY SPACED ALONG COUNTER AT 3'-9" A.F.F. (UNLESS NOTED OTHERWISE), SEE PHARMACY COUNTER ELEVATION DETAIL 2 / E4.3.
- 75 ONE (1) 20A 120V 1PH CIRCUIT TO OUTLET 1'-0" A.F.F. FOR CONVEYOR, BALDOR DRIVE MOTOR WITH SCR (SPEED CONTROL) BY CONVEYOR MFG. FINAL CONNECTION BY ELECTRICAL CONTRACTOR TO FURNISH AND INSTALL FOUR (4) HUBBELL NO. CS1221 SWITCHES WIRING IN SERIES AND EQUALLY SPACED ALONG COUNTER AT 3'-9" A.F.F. (UNLESS NOTED OTHERWISE), SEE PHARMACY COUNTER ELEVATION DETAIL 2 / E4.3.
- 76 ONE (1) 20A 120V 1PH CIRCUIT FOR PHOTO TERMINAL, RECEPTACLE MOUNTED INSIDE CABINET, 1'-6" A.F.F., CIRCUIT FROM PANEL "LP-CR".
- 77 LOCATE THE REMOTE TEST SWITCHES FOR THE RTU DUCT SMOKE DETECTORS IN THE ELECTRICAL EQUIPMENT ROOM. REFER TO SHEETS FPI.2 & M1.1.
- 78 ONE (1) 20A 120V 1PH CIRCUIT CONNECT TO ONE DUPLEX GFCI RECEPTACLE, MOUNTED 6'-6" A.F.F. FOR SILVER RECOVERY UNIT.
- 79 TWO (2) 20A 120V 1PH, DEDICATED CIRCUIT FOR GENERAL PURPOSE DUPLEX RECEPTACLES (IN A 2-GANG BOX WITH COVER - QUANTITY OF TWO) RECEPTACLES MOUNTED IN 2-GANG BOX WITH COVER SHALL BE MOUNTED 1'-6" A.F.F. WITH A 6" SEPARATION.
- 80 700W OUTLET WITH SOLID CONNECTION TO 5'-0" MULTI-OUTLET RACEWAY ASSEMBLY (PLUGMOLD OR PLUGTRAK) MOUNTED ON PHOTO COUNTER BACKSPASH. RECEPTACLES SHALL BE 6" ON CENTER.
- 81 1000W OUTLET WITH SOLID CONNECTION TO 4'-0" MULTI-OUTLET RACEWAY ASSEMBLY (PLUGMOLD OR PLUGTRAK) MOUNTED ON PHOTO COUNTER BACKSPASH. RECEPTACLES SHALL BE 6" O.C. (RACEWAY FLUSH WITH TOP OF BACKSPASH).
- 82 ONE (1) 20A 120V 1PH CIRCUIT FROM PANEL "LP-CR" (WITH WIRES COILED INSIDE JUNCTION BOX) MOUNTED ABOVE CEILING FOR FUTURE PHARMACY ROBOTICS POWER. (COORDINATE WITH REFLECTED CEILING PLAN).
- 83 FLOOR OUTLET WITH TWO (2) 20A 120V 1PH CIRCUITS CONNECTED TO TWO (2) DUPLEX RECEPTACLES (EACH CIRCUIT) FOR FAX.
- 84 ONE (1) 20A 120V 1PH CIRCUIT, CONNECT TO DUPLEX RECEPTACLE, 1'-6" A.F.F. FOR IRRIGATION CONTROLS.
- 85 FLOOR OUTLET WITH ONE (1) 20A 120V 1PH CIRCUIT CONNECTED TO A DUPLEX RECEPTACLE MOUNTED BELOW CABINET. PROVIDE ACCESS PANEL ON CABINET BASE.
- 86 NOT USED.
- 87 ONE (1) 20A 120V 1PH CIRCUIT FROM PANEL "LP-CR" FOR CCTV CAMERA. CONNECT TO DUPLEX RECEPTACLE MOUNTED ABOVE PHARMACY CEILING.
- 88 700W GENERAL PURPOSE DUPLEX RECEPTACLE, MOUNTED AT 10'-6" A.F.F. AT ACCESS PANEL TO AREA ABOVE WALK-IN COOLER/FREEZER, FOR MAINTENANCE USE.
- 89 EMPLOYEE ROOM EXHAUST FAN "EF-2", ROOF MOUNTED WITH LOCK-OUT AT MOTOR AND SWITCH "ON/OFF" VIA OCCUPANCY SENSOR, SPEED CONTROL SWITCH FURNISHED AND INSTALLED BY MECHANICAL CONTRACTOR.
- 90 FLOOR OUTLET WITH ONE (1) 20A 120V 1PH CIRCUIT FROM PANEL "LP-CR" CONNECTED TO TWO (2) DUPLEX RECEPTACLES (EACH CIRCUIT) FOR PHOTOCOPY.
- 91 ONE (1) 20A 120V 1PH CIRCUIT 1/2" C/S & 1" DEDICATED GROUNDING WITH DUPLEX RECEPTACLE MOUNTED AT 1'-4" AFF FOR FILM PROCESSOR RECEPTACLE. GROUNDING SHALL CONNECT TO LUG ATTACHED TO PANELBOARD ENCLOSURE (OF PANEL FEEDING THIS EQUIPMENT).
- 92 ELECTRICAL CONTRACTOR TO FURNISH AND INSTALL ONE (1) WEATHERPROOF JUNCTION BOX (RECESS MOUNT) WITH BLANK COVERPLATE AND 1" CONDUIT STUB INSIDE PHARMACY, BELOW DRIVE-THRU WINDOW FOR FUTURE INTERCOM GREETING STATION.

NOTES


- 1 - ALL WORK SHOWN SHALL COMPLY WITH ALL NATIONAL, STATE AND LOCAL CODES, ORDINANCES, ETC.
- 2 - REFERENCE TO HEIGHT OF OUTLET OR RECEPTACLE SHALL BE MEASURED FROM FINISHED SALES AREA FLOOR TO CENTER OF OUTLET OR RECEPTACLE.
- 3 - ALL RECEPTACLES SHALL BE GROUNDING TYPE.
- 4 - WALK-IN COOLER/FREEZER NOTES:
 - a. CONTRACTOR TO PROVIDE, DISCONNECT AT REFRIGERATION CONDENSING UNITS), INTERNAL WIRING OF CONDENSING UNITS), CONTROL TO EVAPORATOR COILS, WIRING OF DRAIN LINE HEATERS, ALL LIGHTS, WIRING OF LIGHTS AND WIRING EXHIBIT TO DOORS, AND WIRING OF PRESSURE RELIEF PORTS --- (ALL FINAL CONNECTIONS).
 - b. FOR ADDITIONAL INFORMATION SEE COOLER/FREEZER ELECTRICAL REQUIREMENTS (SEE PANEL SCHEDULE, E3.1) AND WIRING DIAGRAMS ON DRAWING E4.5.
- 5 - ALL COMPRESSORS LISTED (SEE DWG.M2.1) TO BE INSTALLED BY CONTRACTOR. ALL CIRCUITS TO BE ON LOCK-ON BREAKERS. (ALL COMPRESSORS TO HAVE BUILT-IN MAGNETIC STARTERS AND DISCONNECTS.)
- 6 - CONDUIT SIZE TO BE 1/2" MINIMUM. PVC CONDUIT AND FITTINGS ARE ACCEPTABLE ONLY BELOW SUBBASE MATERIAL OF GROUND BEARING FLOOR SLABS WHERE SUCH USE IS ACCEPTABLE TO THE AUTHORITY HAVING JURISDICTION.
- 7 - NOT USED.
- 8 - TEMPERATURE CONTROL WIRING - SEE MECHANICAL SPECIFICATIONS.
- 9 - SEE DRAWING E1.6 FOR SPARE CONDUIT REQUIREMENTS.
- 10 - ALL RECEPTACLES AND SWITCHES SHALL HAVE TWO(2) REVOLUTIONS OF ELECTRICAL TAPE (SCOTCH 33+) OVER ALL THE TERMINALS, TO PREVENT ACCIDENTAL CONTACT WITH THE JUNCTION BOX OR OUTLET BOX.
- 11 - NOT USED.
- 12 - ELECTRICAL CONNECTION FOR ROOF-TOP HVAC UNITS SHALL BE ROUTED UP THRU ROOF WITHIN UNIT CURB.
- 13 - DIMENSION IS FROM FINISHED WALL, SEE ARCHITECTURAL FOR WALL THICKNESS.
- 14 - CONDUIT SHALL BE ELECTRICAL METALLIC TUBING (EMT), RIGID STEEL (1/2" MIN.), OR CABLE WHERE ALLOWED BY CODE. (AT INTERVALS WHERE MC CABLE IS USED, PROPER SECUREMENT AND SUPPORT (AT INTERVALS NOT EXCEEDING 6 FEET) SHALL BE FOLLOWED PER NEC ART. 330.

LEGEND

- | | |
|--------|---|
| Ⓚ | KEY SWITCH |
| Ⓛ | SWITCH WITH PILOT LIGHT |
| Ⓛ/S | SOLID STATE SPEED CONTROL |
| Ⓛ/P | FRACTIONAL HORSEPOWER SINGLE POLE MANUAL STARTER WITH THERMAL OVERLOAD PROTECTION |
| Ⓛ | OUTLET (WATTAGE AND LOCATION AS NOTED) |
| Ⓛ/J | FLOOR JUNCTION BOX (WATTAGE & LOCATION AS NOTED) |
| Ⓛ | STANDARD SINGLE RECEPTACLE |
| Ⓛ/D | STANDARD DUPLEX RECEPTACLE |
| Ⓛ/TL | STANDARD SIMPLEX, TWIST-LOCK (TL), RECEPTACLE |
| Ⓛ/TVSS | TRANSIENT VOLTAGE SURGE SUPPRESSOR (TVSS) DUPLEX RECEPTACLE (SEE DETAIL 13/E4.4). |
| ↺ | HOMERUN |
| Ⓛ/M | MULTI-OUTLET RACEWAY ASSEMBLY (PLUGMOLD OR PLUGTRAK) |
| Ⓛ/FD | UNFUSED SAFETY DISCONNECT SWITCH |
| Ⓛ/FS | FUSED SAFETY DISCONNECT SWITCH |
| Ⓛ/FC | FINAL CONNECTION TO EQUIPMENT |
| Ⓛ/T | SENSOR FOR THERMOSTAT (SEE DRAWING M1.1) |
| Ⓛ/θ | THERMOSTAT, 5'-0" A.F.F. MAX. (SEE DRAWING M1.1) |
| Ⓛ/PC | PHOTO CONTROL/PHOTOCCELL |
| Ⓛ/M | METER SOCKET |
| Ⓛ/G | GROUNDING ELECTRODE (SEE DETAIL 5/E2.1) |
| Ⓛ/GR | SUPPLEMENTAL GROUND ROD (SEE DETAIL 5/E2.1) |
| Ⓛ/SSU | SURGE SUPPRESSION UNIT |
| Ⓛ/WP | WEATHER PROOF |
| Ⓛ/RTD | RESISTIVE TEMPERATURE DETECTOR |

POWER KEYED NOTES

- 1 ONE (1) 20A 120V 1PH CIRCUIT FOR CASH REGISTER (CR) LOCATION. SEE DETAIL 8/E4.4 FOR LOCATION. SEE DETAIL 13/E4.4 FOR LOCATION.
- 2 TWO (2) 20A 120V 1PH CIRCUIT FOR OFFICE SYSTEM EQUIPMENT RECEPTACLES, CIRCUIT FROM PANEL "LP-CR". SEE DETAIL 12/E4.4.
- 3 ONE (1) 20A 120V 1PH CIRCUIT FOR PHARMACY TERMINAL RECEPTACLE, CIRCUIT FROM PANEL "LP-CR". SEE DETAIL 10/E4.4 AND DETAIL 2/E4.3 FOR MOUNTING.
- 4 METER AND METER PANEL.
- 5 MAIN DISTRIBUTION PANELBOARD, TOP 7'-6" UP.
- 6 800 AMP FEED & 800AMP MAIN CIRCUIT BREAKER: 208/120V.3PH.4W. TOP 6'-6" UP.
- 7 NOT USED.
- 8 SURFACE MOUNTED ELECTRICAL PANEL "LP-4", TOP 6'-6" UP.
- 9 SURFACE MOUNTED ELECTRICAL PANEL "LP-CR", DEDICATED TO SPECIAL ELECTRICAL EQUIPMENT. SEE PANEL SCHEDULE ON DRAWING E3.1.
- 10 SURFACE MOUNTED ELECTRICAL PANEL "LP-1"
- 11 SURFACE MOUNTED ELECTRICAL PANEL "LP-2", TOP 6'-6" UP.
- 12 SURFACE MOUNTED ELECTRICAL PANEL "LP-3", TOP 6'-6" UP.
- 13 NOT USED.
- 14 SIGN PANEL "LP-SP"
- 15 ONE (1) 20A 120V 1PH CIRCUIT FROM PANEL "LP-CR", CONNECT TO FOUR (4) DUPLEX RECEPTACLES (EACH CIRCUIT) FOR PHARMACY ROBOTICS EQUIPMENT. SEE DETAIL 14/E4.4 FOR ADDITIONAL INFORMATION.
- 16 NOT USED.
- 17 ONE (1) 20A 120V 1PH SATELLITE DIGITAL INTERFACE UNIT (DIU) CIRCUIT FROM PANEL "LP-CR". SEE DETAIL 13/E4.4 FOR ADDITIONAL INFORMATION.
- 18 NOT USED.
- 19 ONE (1) 20A 120V 1PH TIME/ATTENDANCE SYSTEM (ELECTRONIC TIMECLOCK) CIRCUIT FROM PANEL "LP-CR", RECEPTACLE 3'-6" UP. SEE DETAIL 9/E4.4.
- 20 NOT USED.
- 21 200W OUTLET (ABOVE ROOF) WITH GFCI DUPLEX RECEPTACLE AND TAYMAC NO. 20510 SAFETY OUTLET ENCLOSURE (GRANITE WHILE IN USE) OR PALM-S SEMI-MOUR WEATHERPROOF WHILE IN USE COVER ON ROOF FOR MAINTENANCE OF EQUIPMENT. SEE DETAILS 1/E4.2 AND 8/E4.3.
- 22 NOT USED.
- 23 COMPACTOR (5 HP/208V.3PH), PROVIDE A 30A WEATHERPROOF, LOCKABLE DISCONNECT SWITCH LOCATED ON EXTERIOR WALL (4'-0" FROM FACE) WITHIN 3'-0" OF THE COMPACTOR. FINAL CONNECTION AND CONTROL WIRING BY THE COMPACTOR INSTALLER.
- 24 1000W OUTLET WITH SOLID CONNECTION TO 5'-0" MULTI-OUTLET RACEWAY ASSEMBLY (PLUGMOLD OR PLUGTRAK) MOUNTED 1'-3" A.F.F. UNLESS NOTED OTHERWISE.
- 25 500W WATER COOLER OUTLET, MOUNTED 1'-6" A.F.F. PROVIDE LOCK-ON CIRCUIT BREAKER.
- 26 300W RECEPTACLE MOUNTED 1'-6" A.F.F. FOR TV/VCR.
- 27 1000 W GFCI OUTLET, RECEPTACLE 3'-8" A.F.F. AND BEYOND MIRROR EDGE. WITH PILOT LIGHT SWITCH. REFER TO ARCHITECTURAL INTERIOR ELEVATION.
- 28 500 W OUTLET, RECEPTACLE 1'-6" A.F.F. FOR EMPLOYEE ROOM REFRIGERATOR. ACCEPTABLE ALTERNATE: CADET NLW SERIES.
- 29 ELECTRIC WALL HEATER, RAYWALL AFG SERIES, 208V.1PH, 2000W, FORGED AIR, BUILT-IN THERMOSTAT, RECESS MOUNTED, 1'-0" A.F.F.
- 30 500 W OUTLET, RECEPTACLE 1'-6" A.F.F. FOR PHARMACY BIOLOGICAL REFRIGERATOR. PROVIDE LOCK-ON CIRCUIT BREAKER.
- 31 200 W OUTLET, RECEPTACLE 3'-6" A.F.F. FLUSH ABOVE WORK COUNTER, UNLESS NOTED OTHERWISE. SEE DETAIL 2/E4.4.
- 32 360W OUTLET (6'-9" A.F.F.) CONNECTED TO (2) DUPLEX RECEPTACLES MOUNTED ON SHELVING SHELVING CANOPY, CIRCUIT FROM PANEL "LP-18,34 & 36". SEE DETAIL 2/E4.4.
- 33 1.5A 120V OUTLET ABOVE PHARMACY CEILING FOR MOTORIZED ROLL-DOWN SHUTTER WITH SWITCH (FURNISH WITH UNIT) MOUNTED 3'-8" UP AS SHOWN, UNLESS OTHERWISE NOTED.
- 34 208V.3PH. WALK-IN COOLER/FREEZER CONDENSING UNIT (WG-3) WITH 60A.3P. DISCONNECT SWITCH ON ROOF. CIRCUIT BREAKER AT PANEL. SEE NOTES 4 & 5.
- 35 ONE (1) 20A 120V 1PH CIRCUIT FOR ANTHONY FREEZER/COOLER DOOR LIGHTING. OUTLET MOUNTED 10'-0" A.F.F.
- 36 ONE (1) 20A 120V 1PH CIRCUIT FOR ANTHONY COOLER GLASS DOOR & FRAME HEATERS. OUTLET MOUNTED 10'-0" A.F.F.
- 37 ONE (1) 20A 120V 1PH CIRCUIT FOR COOLER #1 & #2 EVAPORATOR OUTLET MOUNTED 10'-0" A.F.F.
- 38 ONE (1) 20A 120V 1PH CIRCUIT FOR WALK-IN COOLER/FREEZER MANDOUR HEATERS OUTLET MOUNTED 10'-0" A.F.F. SEE NOTE #4.
- 39 ONE (1) 20A 120V 1PH CIRCUIT FOR WALK-IN FREEZER DRAIN LINE HEATER OUTLET MOUNTED 10'-0" A.F.F.
- 40 ONE (1) 20A 120V 1PH CIRCUIT FOR ANTHONY FREEZER GLASS DOOR AND FRAME HEATERS OUTLET MOUNTED 10'-0" A.F.F. SEE NOTE #4.
- 41 200W RECEPTACLE (MOUNTED 9'-6" A.F.F.) FOR "HOT WATER RECIRCULATING PUMP". CONNECT TO PANEL "LP-1", CIRCUIT 21. REFER TO PLUMBING DRAWINGS FOR ADDITIONAL INFORMATION.
- 42 ONE (1) 20A 3P 5W 120/208V TWIST-LOCK RECEPTACLE, NEMA CONFIG. L21-20R FOR POWER MONITORING EQUIPMENT.
- 43 ONE (1) 20A 120V 1PH CIRCUIT FROM PANEL "LP-CR" FOR FIRE ALARM SYSTEM. HAND WIRED TO FIRE ALARM CONTROL PANEL.
- 44 ONE (1) 20A 120V 1PH CIRCUIT CONNECTED TO (2) DUPLEX RECEPTACLES MOUNTED INSIDE CASH REGISTER STAND. PROVIDE ACCESS PANEL FOR COOLERS PLUS/CORD ACCESS.
- 45 RTD. SEE DRAWINGS E2.1B & E2.1C FOR ADDITIONAL INFORMATION. (GENERAL ELECTRIC)
- 46 208V.1PH. (30A.2P.C/3) 1/2" (2ND.10 AND 1ND.10 DEDICATED GROUND, MIN.) TO HUBBELL NO. CS1221 SWITCHES (2) (1) 20A 120V 1PH CIRCUIT TO PAPER PROCESSOR MOUNTED 1'-6" A.F.F. GROUND SHALL CONNECT TO LUG ATTACHED TO PANELBOARD ENCLOSURE (OF PANEL FEEDING THIS EQUIPMENT). ELECTRICAL CONTRACTOR SHALL ALSO FURNISH AND INSTALL A CODE APPROVED POWER SUPPLY CHORD FOR POWER CONNECTION.
- 47 ONE (1) 20A 120V 1PH CIRCUIT FROM PANEL "LP-CR" FOR UPS COMMUNICATION. MOUNT RECEPTACLE 3'-6" A.F.F.
- 48 ONE (1) 20A 120V 1PH CIRCUIT FROM PANEL "LP-CR" FOR TRAINING TERMINAL MOUNT RECEPTACLE 3'-6" A.F.F.
- 49 ONE (1) 20A 120V 1PH CIRCUIT FROM PANEL "LP-CR" FOR COVERT CCTV SYSTEM. SEE DRAWING E1.4 FOR ADDITIONAL INFORMATION.
- 50 TWO (2) 20A 120V 1PH CIRCUITS FOR DRIVE-THRU WINDOW AUDIO SYSTEM, AND DRIVE ALERT. JUNCTION BOX 1'-9" A.F.F. INSIDE DRIVE-THRU WINDOW UNIT. SEE DETAIL 1/E4.3.
- 51 LED SIGN POWER SUPPLY RACK, SEE DRAWING E1.7 FOR COMPLETE INFORMATION.
- 52 1000W FLOOR OUTLET FOR MULTI-OUTLET RACEWAY ASSEMBLY (PLUGMOLD OR PLUGTRAK) TO BE MOUNTED ON SHELVING FIXTURE. 5'-0" MULTI-OUTLET RACEWAY ASSEMBLY. SEE DETAIL 8/E4.4.
- 53 700W FLOOR OUTLET CONNECTED TO 3'-0" PLUGMOLD AS SHOWN. CONNECT PLUGMOLD OR RECEPTACLE TO FLOOR OUTLET UNDER GONDOLA. SEE DETAIL 8/E4.4.
- 54 200W FLOOR OUTLET CONNECTED TO RECEPTACLE, 2 1/2" UP ON FACE OF BASE. MOUNT RECEPTACLE HORIZONTALLY. SEE DETAIL 1/E4.1.
- 55 350 W FLOOR OUTLET CONNECTED TO RECEPTACLE(S) ON TOP OF GONDOLA. SEE DETAIL 8/E4.4. (CIRCUITS FROM PANEL "LP-SP", SEE DRAWING E2.1A GROUP 11 CONTROL SCHEDULE).
- 56 ONE (1) 20A 120V 1PH CIRCUIT CONNECTED TO RECEPTACLE ON TOP OF GONDOLA. SEE DETAIL 8/E4.4. FROM PANEL "LP-CR" FOR PRICE CHECKER.
- 57 5A.120V OUTLET ABOVE CEILING FOR AUTOMATIC SLIDING DOOR(S).
- 58 NOT USED.
- 59 PROVIDE 20 AMP CIRCUIT TO GFCI RECEPTACLE AND TAYMAC NO. 20510 SAFETY OUTLET ENCLOSURE (GRANITE WHILE IN USE) OR PALM-S SEMI-MOUR WEATHERPROOF WHILE IN USE COVER ON ROOF FOR MAINTENANCE OF EQUIPMENT REFER TO NEC ARTICLE 210-63 UNDER 6 & 7 / E4.3, 1, 4, AND/OR 5 / E4.4 FOR OUTLET MOUNTING.
- 60 200 W OUTLET, WITH RECEPTACLE MOUNTED INSIDE CASH REGISTER STAND. REFER TO DETAILS 9 & 7 / E4.3, 1, 4, AND/OR 5 / E4.4 FOR OUTLET MOUNTING.
- 61 DRIVE-ALERT SYSTEM, ELECTRICAL CONTRACTOR TO FURNISH AND INSTALL MODEL D4-500 DRIVE-ALERT SYSTEM, (1) 20A 120V 1PH CIRCUIT TO APPROX. DRIVE-THRU WALL AS SHOWN IN THE DRAWING AS BUILT. SYSTEM SHALL BE FURNISHED AS BUILT SYSTEM WITH (800)388-9605. [NOTE: ONCE INSTALLED, ELECTRICAL CONTRACTOR SHALL TEST SYSTEM BY DRIVING A VEHICLE IN THE DRIVE-THRU LANE AND ADJUST SENSITIVITY AND BLANKET POTS AS REQUIRED UNTIL SYSTEM DETECTS THE VEHICLE ACCORDINGLY.]
- 62 ONE (1) 20A 120V 1PH CIRCUIT CONNECT TO DUPLEX RECEPTACLE MOUNTED 1'-6" A.F.F. FOR WALK-FILL.
- 63 MENS / WOMENS BATHROOM EXHAUST FAN "EF-1", ROOF MOUNT WITH LOCK-OUT AT MOTOR AND SWITCH "ON/OFF" VIA LIGHTING CONTROL SYSTEM, SPEED CONTROL SWITCH FURNISHED AND INSTALLED BY MECHANICAL CONTRACTOR. REFER TO SHEETS FPI.2 & M1.1.
- 64 AIR CURTAIN #1 (A/C-1), FURNISHED BY MECHANICAL CONTRACTOR AND INSTALLED BY ELECTRICAL CONTRACTOR. REFER TO DRAWINGS M4.5, E3.1, E4.5, M1.1 & M2.21 FOR ADDITIONAL INFORMATION.
- 65 ONE (1) 20A 120V 1PH CIRCUIT FROM PANEL "LP-CR", CONNECTED TO RECEPTACLE 1'-6" A.F.F. FOR FUTURE TERMINAL MOUNT RECEPTACLE 1'-6" A.F.F.
- 66 NOT USED.
- 67 500W FLOOR OUTLET, CONNECT TO 5'-0" MULTI-OUTLET RACEWAY ASSEMBLY (PLUGMOLD OR PLUGTRAK) MOUNTED ON TOP OF SHELVING FIXTURE (SEE DETAIL 8/E4.4).
- 68 500W WALL OUTLET, CONNECT TO 5'-0" MULTI-OUTLET RACEWAY (PLUGMOLD OR PLUGTRAK) MOUNTED ON TOP OF SHELVING FIXTURE (RECEPTACLES 6" ON CENTER).
- 69 200W GENERAL PURPOSE DUPLEX RECEPTACLE, MOUNTED 1'-6" A.F.F., UNLESS NOTED OTHERWISE.
- 70 ONE (1) 20A 120V 1PH 3W ATM OUTLET, UNSWITCHED DIRECT INDIVIDUAL BRANCH CIRCUIT FROM PANEL "LP-CR", PROVIDE THREE (3) #12 WITH THIRD AS GROUND. (CONDUIT GROUND NOT ACCEPTABLE). SEE DETAIL 9/E4.4.
- 71 TWO (2) 20A 120V 1PH CIRCUITS FROM PANEL "LP-CR" FOR RX COMMUNICATION EQUIPMENT RECEPTACLES.
- 72 ELECTRIC WALL HEATER, RAYWALL AFG SERIES, 208V. 4000W, FORGED AIR, BUILT-IN THERMOSTAT, RECESS MOUNTED, 1'-0" A.F.F. ACCEPTABLE ALTERNATE: CADET NLW SERIES.
- 73 THREE (3) 20A 120V 1PH CIRCUIT FROM PANEL "LP-CR" FOR OFFICE COMMUNICATION CABINET RECEPTACLES.

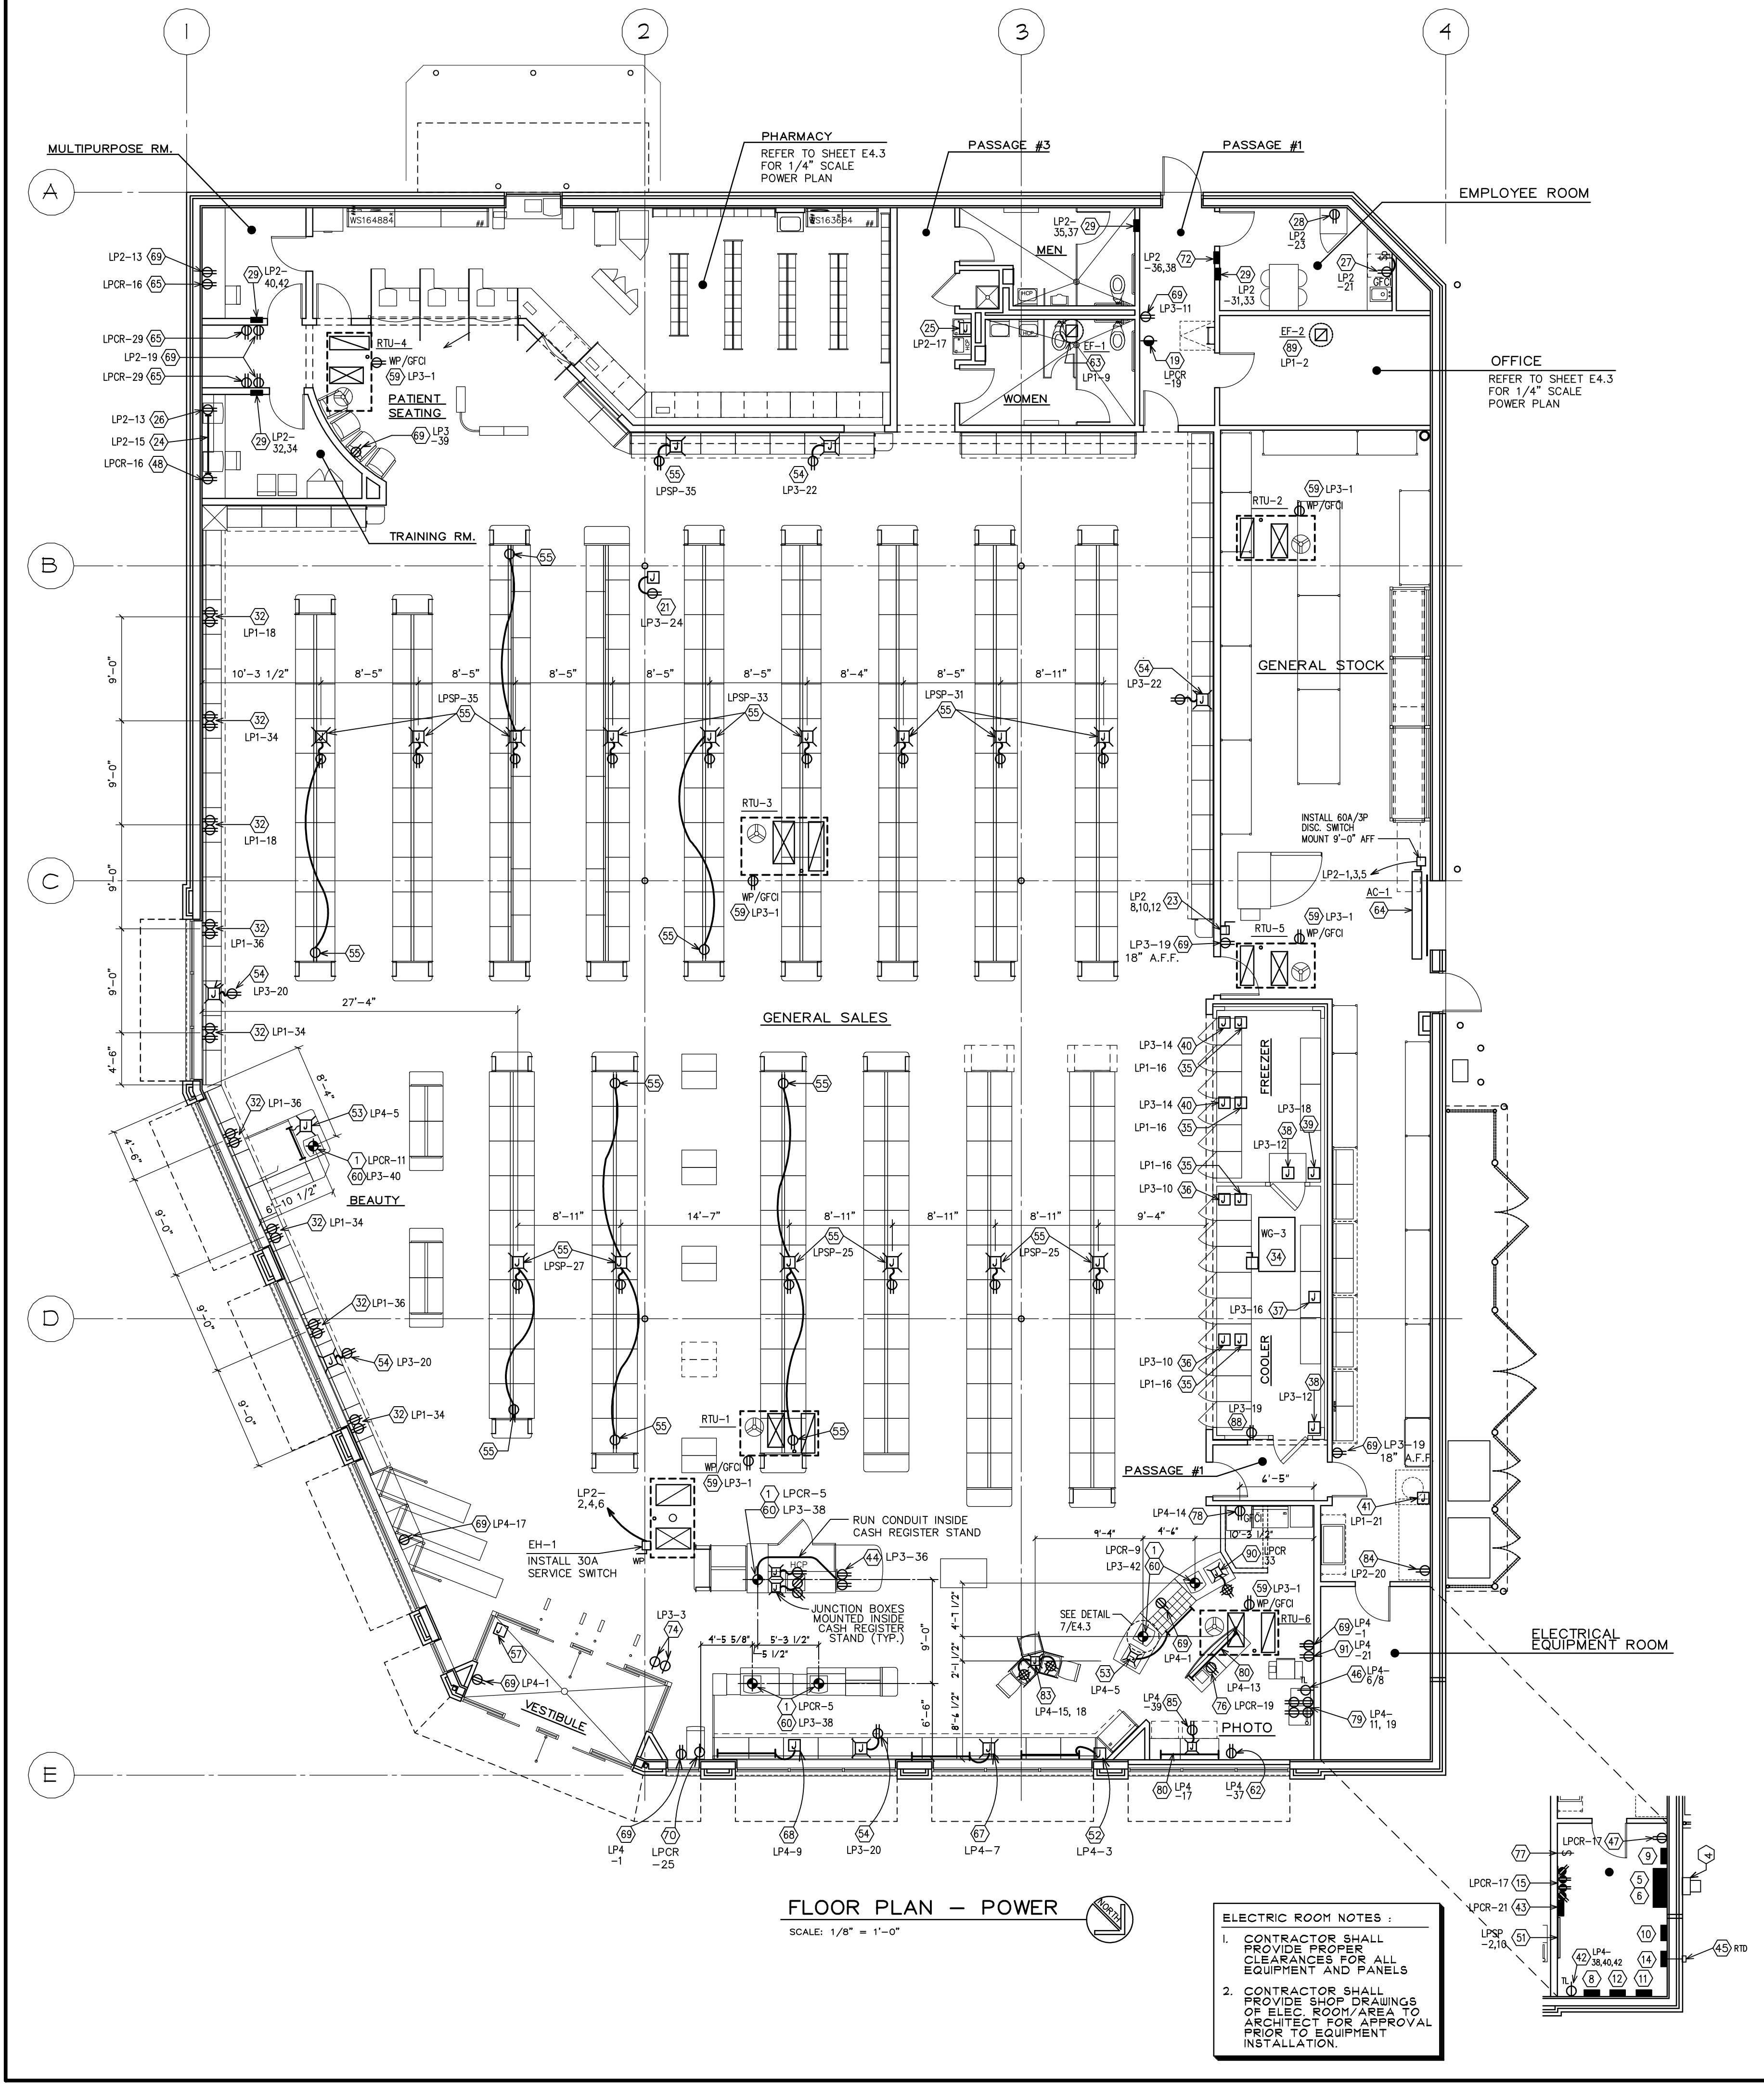

FLOOR PLAN - POWER
SCALE: 1/8" = 1'-0"

ELECTRIC ROOM NOTES :

1. CONTRACTOR SHALL NOTED OTHERS PROVIDE CLEARANCES FOR ALL EQUIPMENT AND PANELS.
2. CONTRACTOR SHALL PROVIDE SHOP DRAWINGS OF ELEC. ROOM AREA TO ARCHITECT FOR APPROVAL PRIOR TO EQUIPMENT INSTALLATION.