

SK 2 SIGN DRAWING



Reviewed for Code Compliance
Inspectors Division
Approved with Conditions



Date: 06/10/14

**Philadelphia Sign
COMPANY**

707 West Spring Garden Street
Palmyra, New Jersey 08065

Phone: 856-829-1409
Fax: 856-829-8549
E-mail: usa@philadelphia-sign.com

CUSTOMER:
ALLSTATE

JOB NUMBER:

SIGN TYPE:
ALST.MON_25

LOCATION:
Various

DATE:
07/06/2012

DRAWN BY:
JLTH

REVISION:
Number: 2 Date: 03/19/2013 By: JTR





SHEET: 1 OF 1
ENG DEPT

DWG NUMBER:
B-44750

ENGINEER SEAL:

**MAX DESIGN WIND SPEED 90 MPH
EXPOSURE C**

THIS IS AN ORIGINAL UNPUBLISHED DRAWING
CREATED BY PSCD. IT IS SUBMITTED FOR YOUR
PERSONAL USE IN CONJUNCTION WITH A PROJECT
BEING PLANNED FOR YOU BY PSCD. IT IS NOT TO
BE SHOWN TO ANYONE OUTSIDE YOUR
ORGANIZATION NOR IS IT TO BE USED, COPIED,
REPRODUCED, OR EXHIBITED IN ANY FASHION.

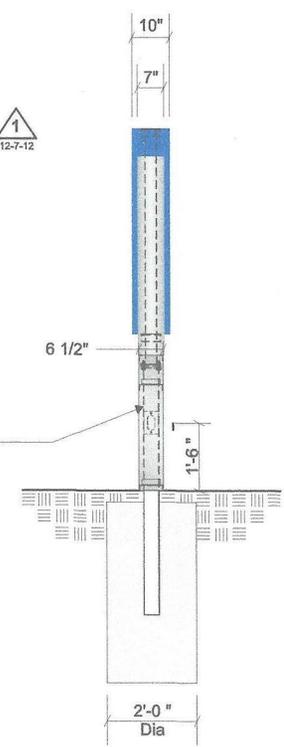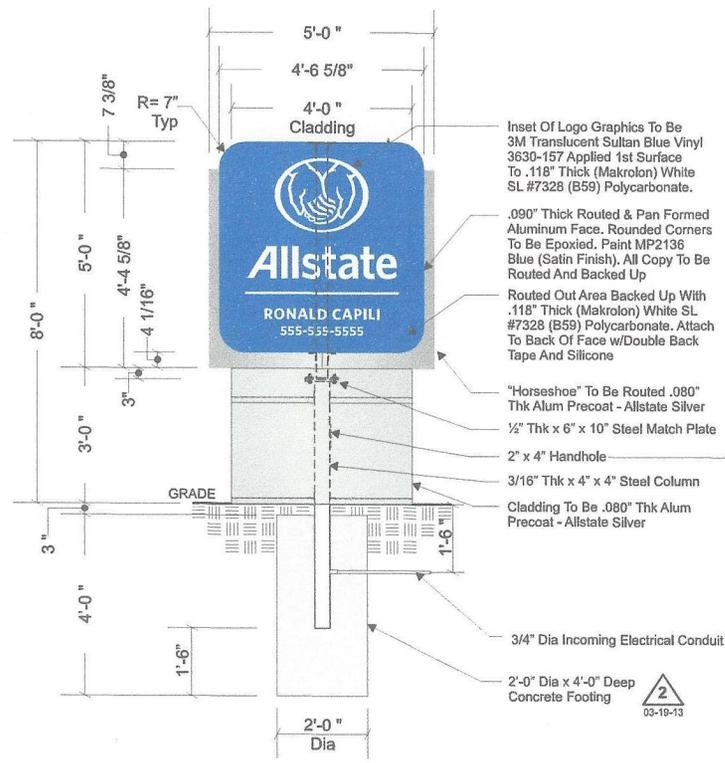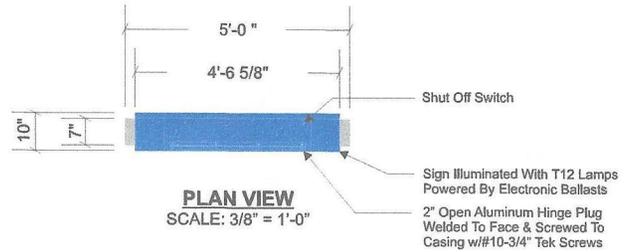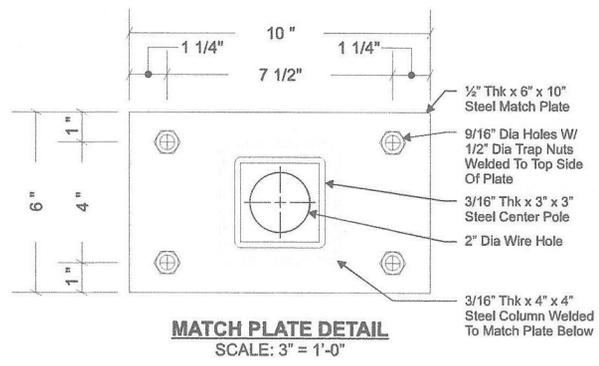

PERMITS
ONLY

Electrical Load
(2.34) Amps @ 120 Volts
Electrical Req'mts
(1) 20 Amp/120 Volt Circuits

- STANDARD PYLON NOTES:**
1. Sufficient Primary Circuit In Vicinity Of Sign By Others.
 2. Final Primary Hook-up By Sign Installer, Where Allowed By Local Codes.
 3. Sign Shall Be U.L. Listed.
 4. Soil Assumed To Be Medium Clay, Or Better, With Minimum Soil Bearing Capacity Of 2,500 PSF.
 5. Concrete 2,500 PSI @ 28 Days.
 6. Reinforcing Steel Shall Be ASTM A615 GR-40.
 7. Structural Steel Shall Be ASTM A36.
 8. All Welds Shall Conform To A.W.S Standards.

Note: This sign is intended to be installed in accordance with the requirements of Article 600 of the National Electrical Code and/or other applicable local codes. This includes proper grounding and bonding of the sign.