
## 3 piece(s) 1 3/4" x 11 7/8" 1.9E Microllam® LVL

Overall Length: 16' 0.00"

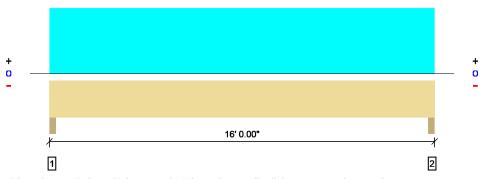

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	7638 @ 2.00"	13322 (3.50")	Passed (57%)		1.0 D + 1.0 S (All Spans)
Shear (lbs)	6415 @ 1' 3.38"	13622	Passed (47%)	1.15	1.0 D + 1.0 S (All Spans)
Moment (Ft-lbs)	29291 @ 8' 0.00"	30788	Passed (95%)	1.15	1.0 D + 1.0 S (All Spans)
Live Load Defl. (in)	0.775 @ 8'	0.783	Passed (L/243)		1.0 D + 1.0 S (All Spans)
Total Load Defl. (in)	0.987 @ 8' 0.00"	1.044	Passed (L/191)		1.0 D + 1.0 S (All Spans)

System: Roof


Member Type : Flush Beam Building Use: Residential Building Code: IBC Design Methodology: ASD Member Pitch: 0/12

- Deflection criteria: LL (L/240) and TL (L/180).
- Bracing (Lu): All compression edges (top and bottom) must be braced at 4' 3.04" o/c unless detailed otherwise. Proper attachment and positioning of lateral bracing is required to achieve member stability.


	Bearing Length			Loads to Supports (lbs)			
Supports	Total	Available	Required	Dead	Snow	Total	Accessories
1 - Column - HF	3.50"	3.50"	2.01"	1638	6000	7638	None
2 - Column - HF	3.50"	3.50"	2.01"	1638	6000	7638	None

Loads	Location	Tributary Width	Dead (0.90)	Snow (1.15)	Comments
1 - Uniform (PSF)	0 to 16' 0.00"	12' 6.00"	15.0	60.0	

## **Weyerhaeuser Notes**



The product application, input design loads, dimensions and support information have been provided by Forte Software Operator



Forte Software Operator	Job Notes
Guy Poisson Hammond Lumber (207) 495-3303 gpoisson@hammondlumber.com	