

PROPOSED USE:

IBC 2009:
BUSINESS GROUP B
LOW-HAZARD STORAGE, GROUP S-2

NFPA 101 (2009):
EXISTING BUSINESS STORAGE

FIRE SUPPRESSION:

FIRE SUPPRESSION SPRINKLER SYSTEM LAYOUT TO BE RECONFIGURED AS REQUIRED TO ACCOMMODATE SPACE LAYOUT.

FIRE PARTITIONS:

1 HOUR FIRE RATED ——— 1HR-FP ———

- SYMBOLS LEGEND:**
- EXIT SIGN - ARROW DENOTES EXIT SIGN TO BE PROVIDED WITH DIRECTIONAL ARROW
 - SEMI-RECESSED FIRE EXTINGUISHER CABINET AND FIRE EXTINGUISHER
 - WALL MOUNTED FIRE EXTINGUISHER
 - SMOKE DETECTOR
 - PULL STATION
 - HORN/STROBE DEVICE W/ CANDELLA RATING
 - STROBE DEVICE W/ CANDELLA RATING
 - EMERGENCY LIGHT FIXTURE
 - FIRE ALARM CONTROL PANEL
 - FIRE ALARM ANNUNCIATOR PANEL
 - KNOX-BOX

OVERALL BUILDING AREA:

FIRST FLOOR: 59,410 SF
SECOND FLOOR: 5,960 SF

TOTAL BUILDING: APPROXIMATELY 65,370 SF

TOTAL OCCUPANT LOAD:


BUSINESS USE:
AREA "A": 60
AREA "B": 43
SECOND FLOOR: 60
TOTAL: 163

STORAGE USE: 99

TOTAL BUILDING O.L.: 262

NOTES:

REMOVE ALL "NOT AN EXIT" SIGNS FROM ALL EXISTING DOORS THROUGHOUT ENTIRE BUILDING.

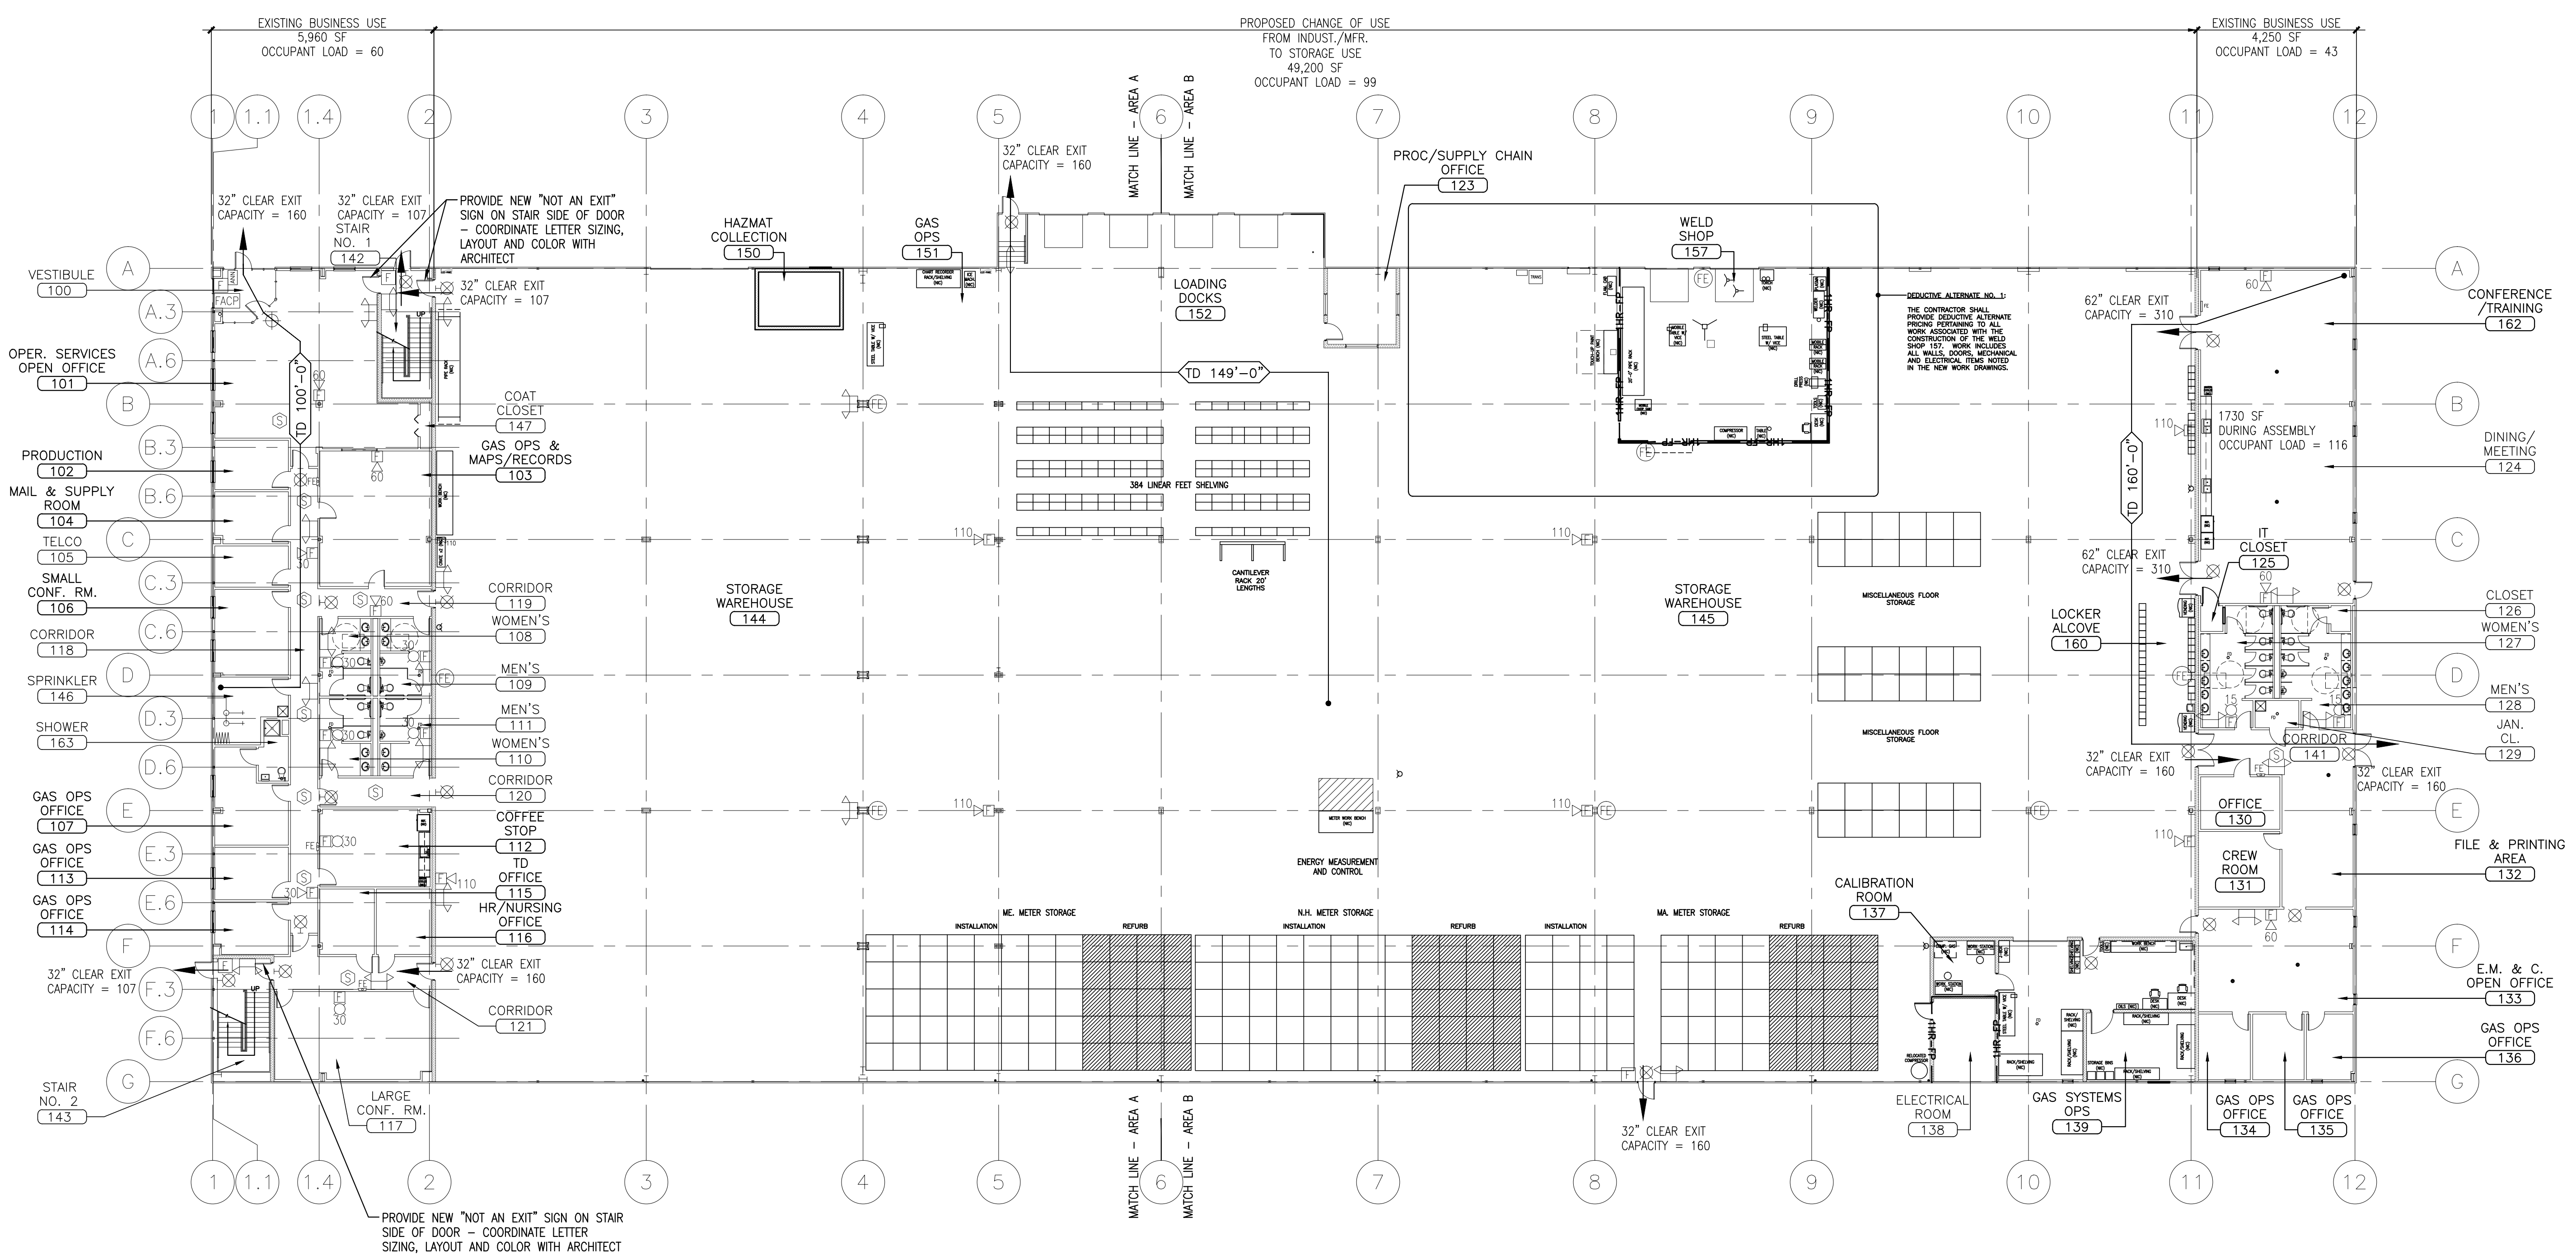

A5 FIRST FLOOR LIFE SAFETY PLAN

REFERENCED FROM: SCALE: 1/16" = 1'-0"

