


**FIRE ALARM SYSTEM NOTES**

- Ⓐ FACP TO BE REPLACED WITH ADDRESSABLE PANEL. NEW PANEL TO BE LOCATED IN SAME LOCATION AS EXISTING
- Ⓑ EXISTING FIRE ALARM HORN STROBES AND STROBE DEVICES SHALL REMAIN AND BE CONNECTED TO NEW ADDRESSABLE FACP.
- Ⓒ ALL EXISTING SMOKE DETECTORS AND PULL STATIONS SHALL BE REPLACED WITH NEW DEVICES COMPATIBLE WITH NEW FACP.
- Ⓓ EXISTING FLOW AND TAMPERS SWITCHES SHALL HAVE ADDRESSABLE MODULES ADDED TO INCORPORATE INTO NEW FACP.
- Ⓔ EXISTING DUCT SMOKE DETECTORS SHALL BE CONNECTED TO NEW FACP WITH ADDRESSABLE MODULES, QTY. 6. CONTRACTOR SHALL VERIFY IN FIELD QUANTITY AND LOCATIONS OF DEVICES.

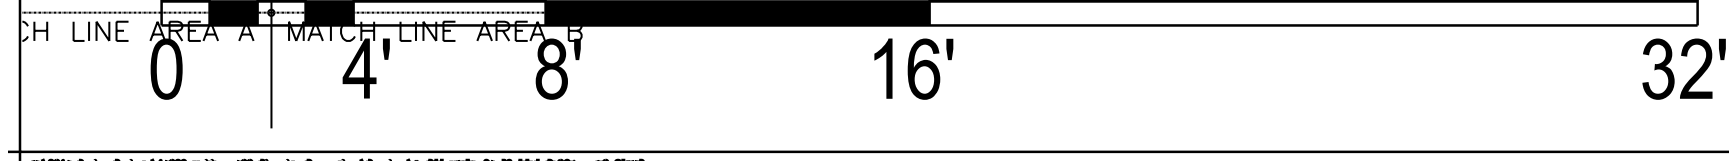

**REVISIONS**

NO.	DATE	DESCRIPTION