

FENCING NOTES:

1. CONTRACTOR MAY SUBSTITUTE MECHANICALLY DRIVEN LINE POSTS, DRIVEN TO A MINIMUM DEPTH


2. STANDARD CONCRETE POST BASES SHALL BE INSTALLED AT CORNER POST AND AT LINE POST ADJACENT TO CORNERS.

3. STANDARD CONCRETE POST BASES SHALL BE INSTALLED AT GATE SUPPORT POSTS AND AT LINE

Not To Scale

POSTS ADJACENT TO GATES. | 4. FENCE TYPE A TO INCLUDE BLACK VERTICLE SLATS, TYPE B HAS NO SLATS.

PERIMETER FENCING - CHAIN LINK FENCE AND TOP GUARD WITH MOW STRIP

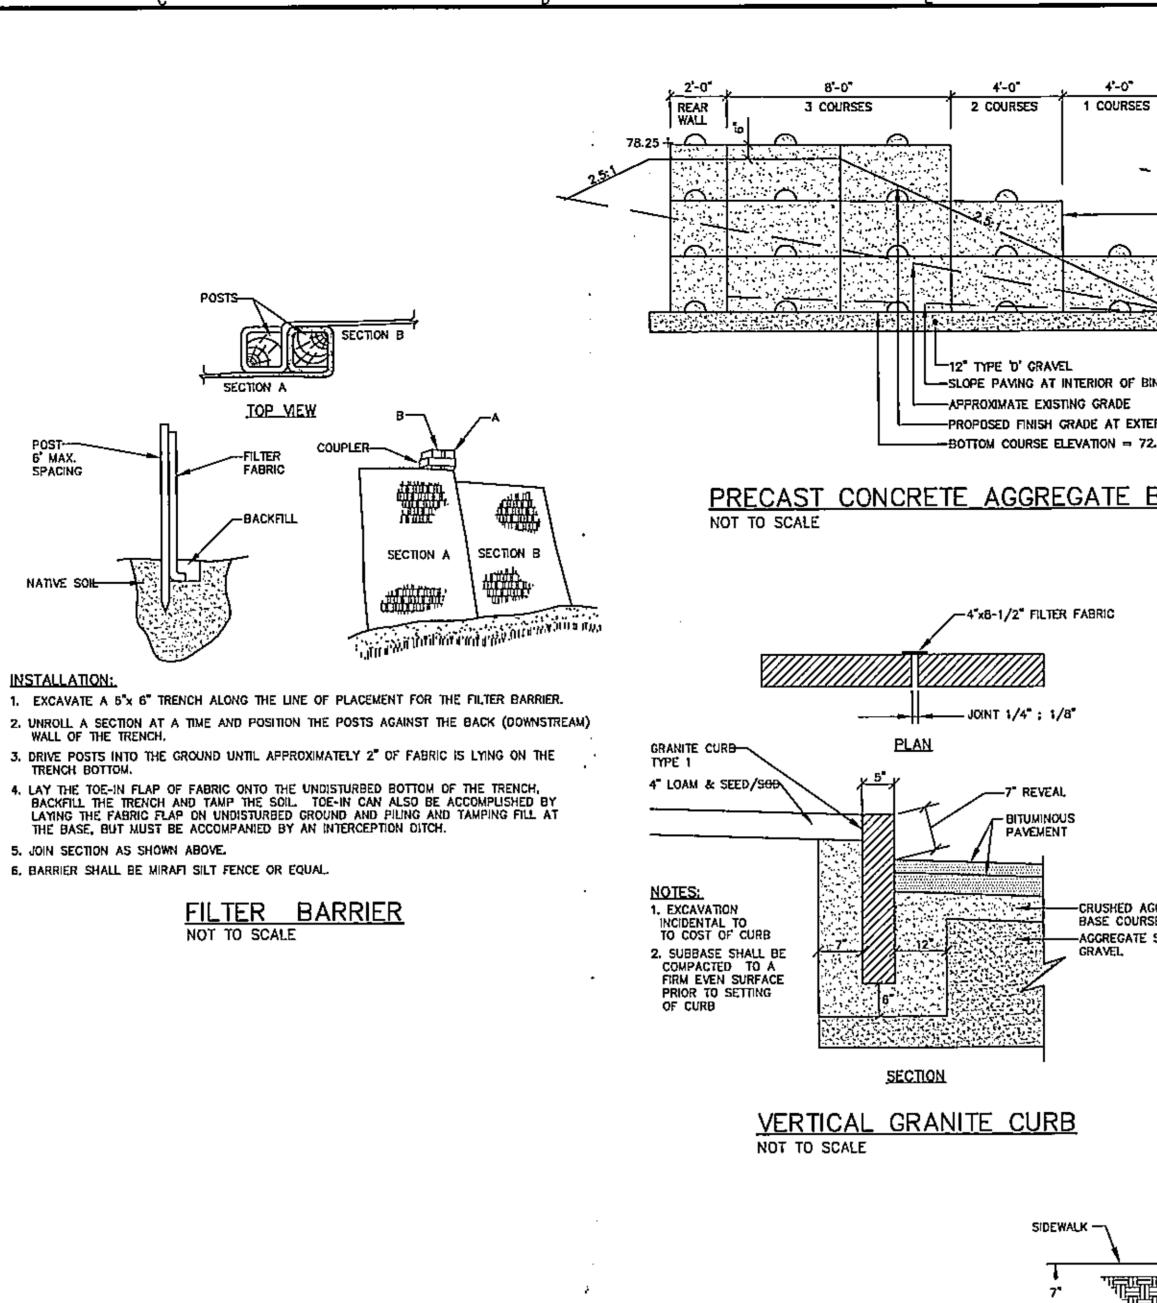

→ CATCH BASIN

FINISH GRADE

NEW INSTALLATION

—INSTALL CRUSHED STONE AROUND THE EDGE TO HOLD SACK

CATCH BASIN

SILT SACK PROTECTION

PRIOR TO FINAL GRADING AND PAYING OPERATIONS BEGIN A CATCH

CATCH BASIN PROTECTION DETAIL


(FOR PAVED AREAS)


NOT TO SCALE

BASIN INSERT (SUCH AS A SILT SACK OR A DANDY BAG II) MUST BE INSTALLED IN EACH BASIN PER MANUFACTURES INSTRUCTIONS. HAY BALES SHOULD BE REMOVED ONCE INSERTS ARE INSTALLED.

EX. GRADE


EXISTING BASIN

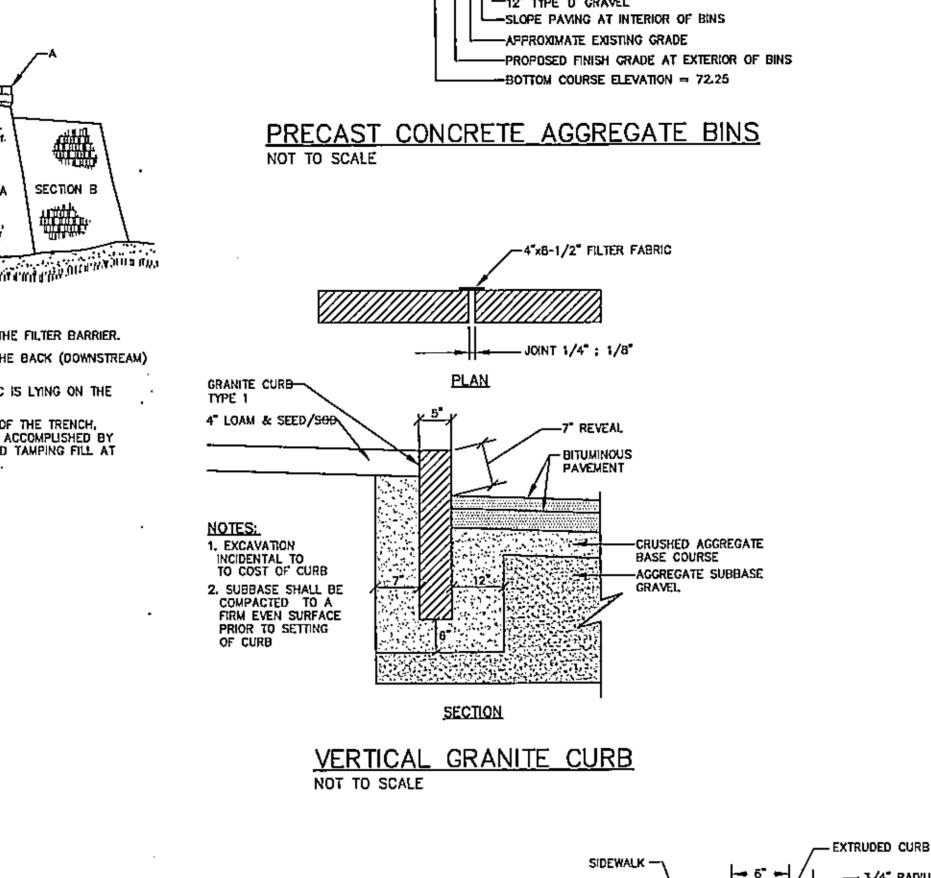

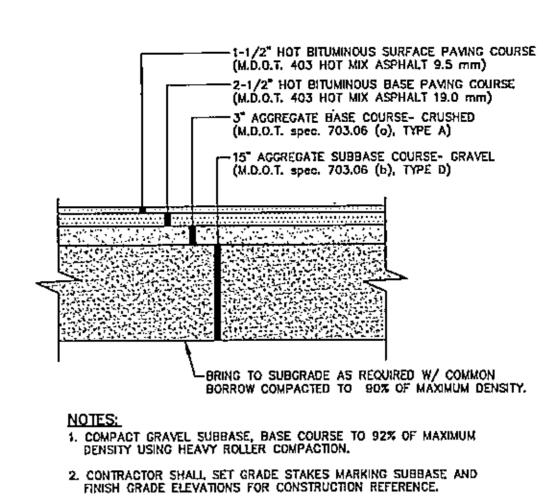


- 3. CONTRACTOR MAY REPLACE BITUMINOUS PAYING SECTION WITH TWO (2) 1-1/2" LIFTS OF 12.5mm SUPERPAVE MIX. SUBMIT PAVEMENT MIX DESIGN PRIOR TO CONSTRUCTION.

TYP. PAVED PARKING LOT SECTION NOT TO SCALE

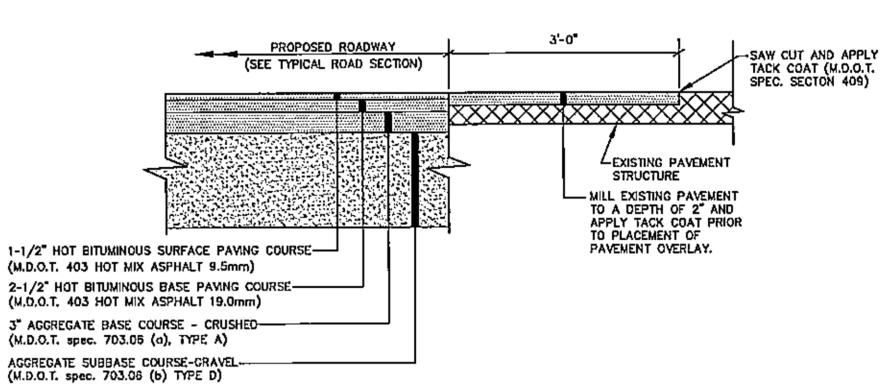


TYPICAL PAVEMENT JOINT

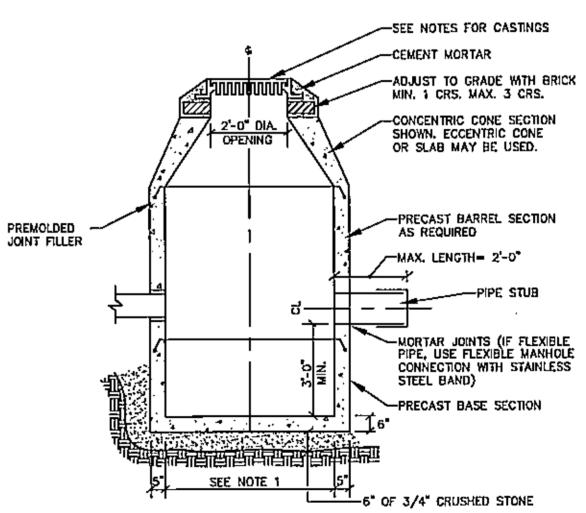



- 2. DRAINAGE STRUCTURES TO BE DESIGNED FOR H-20 LOADING.

NOT TO SCALE

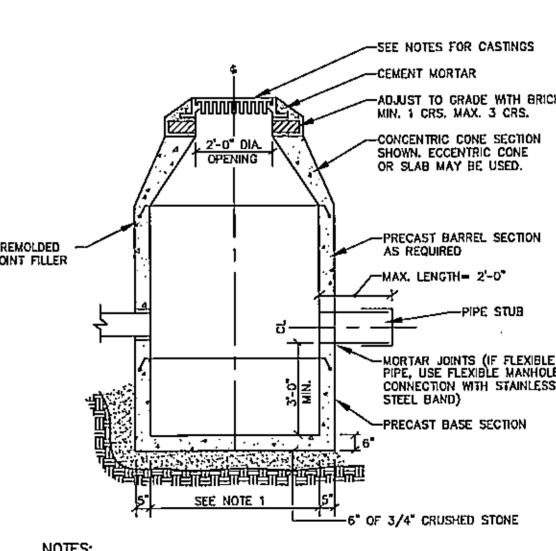

3. PIPE SIZES AND INVERTS AS NOTED ON PLANS.

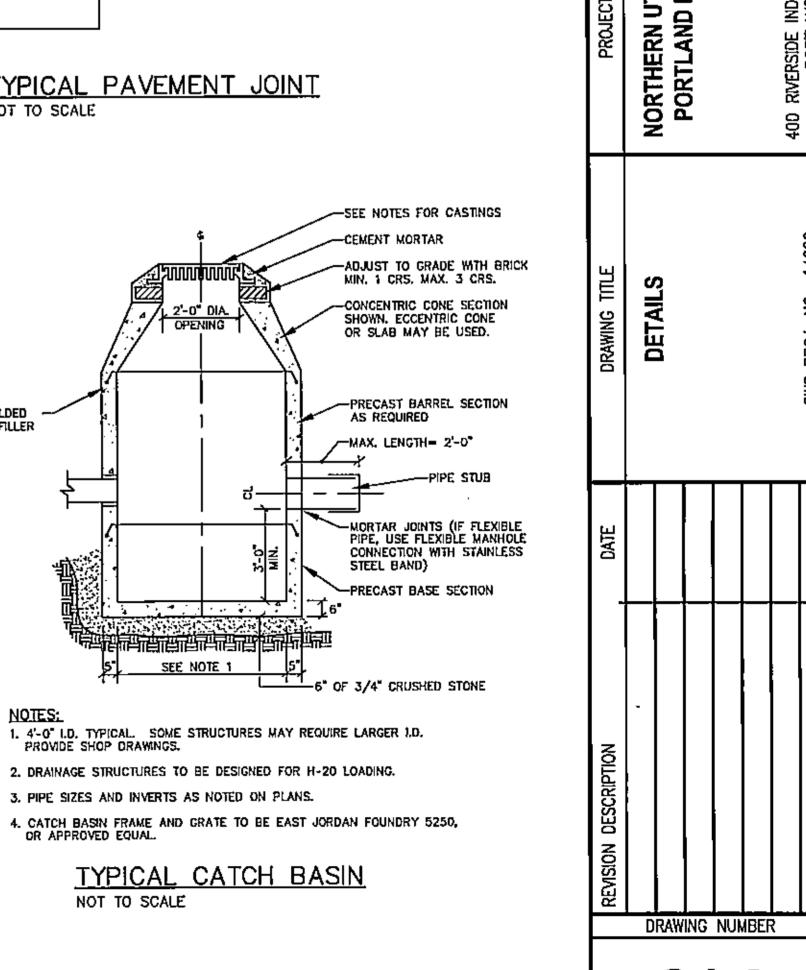

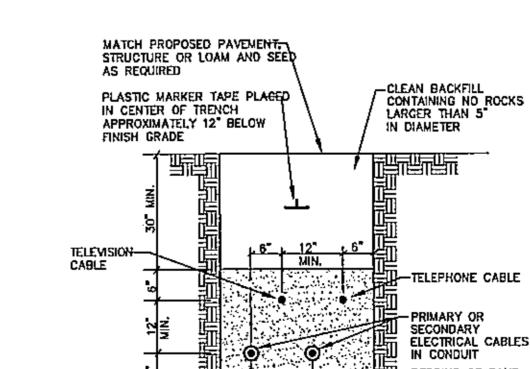

USE SLOPED MOLD WHEREVER CURB ABUTS LANDSCAPE AREAS.

NOT TO SCALE

SLIPFORM CONCRETE CURB

ELECTRICAL CABLES -BEDDING OF SAND

BINDER COURSE OR EXISTING PAVEMENT

COMPACTED BASE

-2'x2'x4" PRECAST CONCRETE BLOCK WITH KEYWAY

-NEW PAYING

CABLES TO BE ENCASED IN SCHEDULE 40 PVC CONDUIT WHEN RUN BENEATH PAVED AREAS.

TYPICAL UNDERGROUND CABLE INSTALLATION NOT TO SCALE

> DATE: 03/04/15 **ISSUED FOR 100% REVIEW**

SCALE: NTS

Architects

WILLIAM T.

CONWAY No. 108