



System No. W-L-3334

ANSI/UL1479 (ASTM E814)	CAN/ULC S115
F Ratings - 1, 2, 3 and 4 Hr (See Item 1)	F Ratings - 1, 2, 3 and 4 Hr (See Item 1)
T Ratings - 0, 1, 1-3/4, 2, 3 and 4 Hr (See Items 2 and 3)	FT Ratings - 0, 1, 1-3/4, 2, 3 and 4 Hr (See Items 2 and 3)
L Rating At Ambient - Less Than 1 CFM (See Item 2)	FH Ratings - 1, 2, 3 and 4 Hr (See Item 1)
L Ratings At 400 F - 1 and Less Than 1 CFM (See Item 2)	FTH Ratings - 0, 1, 1-3/4, 2, 3 and 4 Hr (See Items 2 and 3)
	L Rating At Ambient - Less Than 1 CFM (See Item 2)
	L Ratings At 400 F - 1 and Less Than 1 CFM (See Item 2)

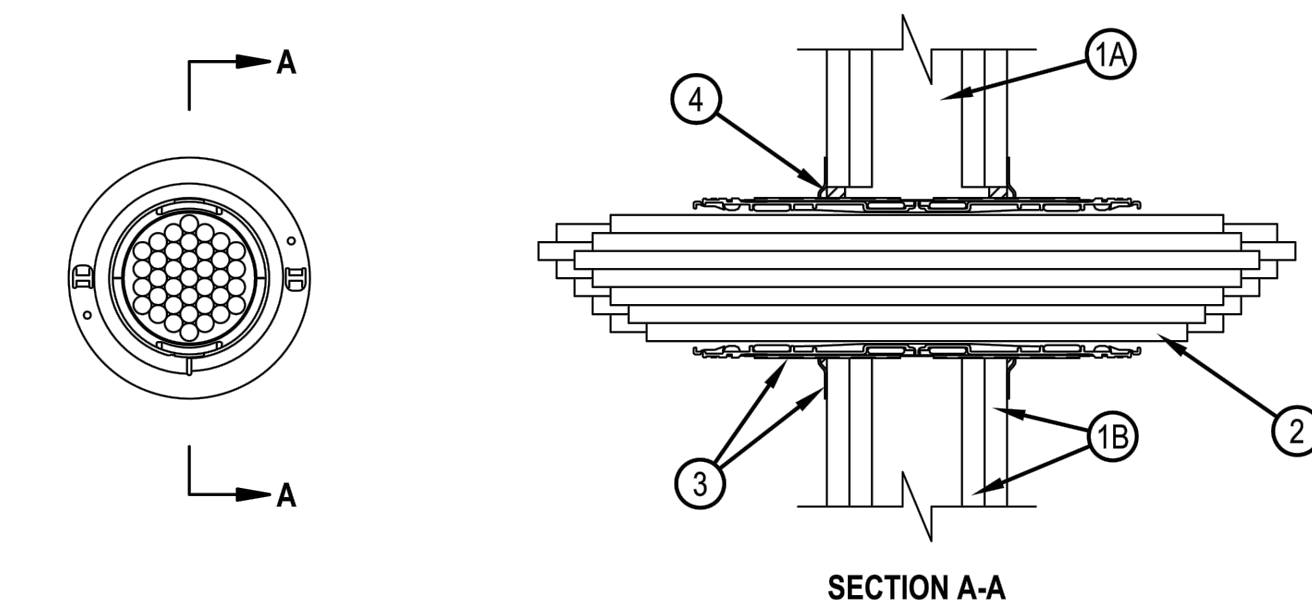

SECTION A-A

1. Wall Assembly — The 1, 2, 3 or 4 hr fire rated gypsum board/stud wall assembly shall be constructed of the materials and in the manner described within the individual U300, U400, V400 or W400 Series Wall and Partition Designs in the UL Fire Resistance Directory and shall incorporate the following construction features:
 A. Studs — Wall framing shall consist of either wood studs or steel channel studs. Wood studs to consist of nom 2 by 4 in. (51 by 102 mm) lumber spaced max 16 in. (406 mm) OC. Steel studs to be min 2-1/2 in. (64 mm) wide and spaced max 24 in. (610 mm) OC for 1 and 2 hr wall assemblies. Steel Studs to be 3-5/8 in. (92 mm) for 3 and 4 hr wall assemblies.
 B. Gypsum Board* — Nom 5/8 in. (16 mm) thick gypsum board as specified in the individual Wall and Partition Design. Opening in gypsum board to be max 2-1/2 in. (64 mm) diam for 2" device and max 4-1/2 in. (114 mm) diam for 4" device.
 The hourly F and FH Ratings of the firestop system are dependent upon the hourly rating of the wall in which it is installed.




Reproduced by HILTI, Inc. Courtesy of Underwriters Laboratories, Inc. March 14, 2012

Page: 1 of 2

System No. W-L-5028


**F Ratings - 1 and 2 Hr (See Item 1)
T Ratings - 3/4 Hr
L Rating at Ambient - Less Than 1 CFM/sq ft
L Rating at 400 F - Less Than 1 CFM/sq ft**

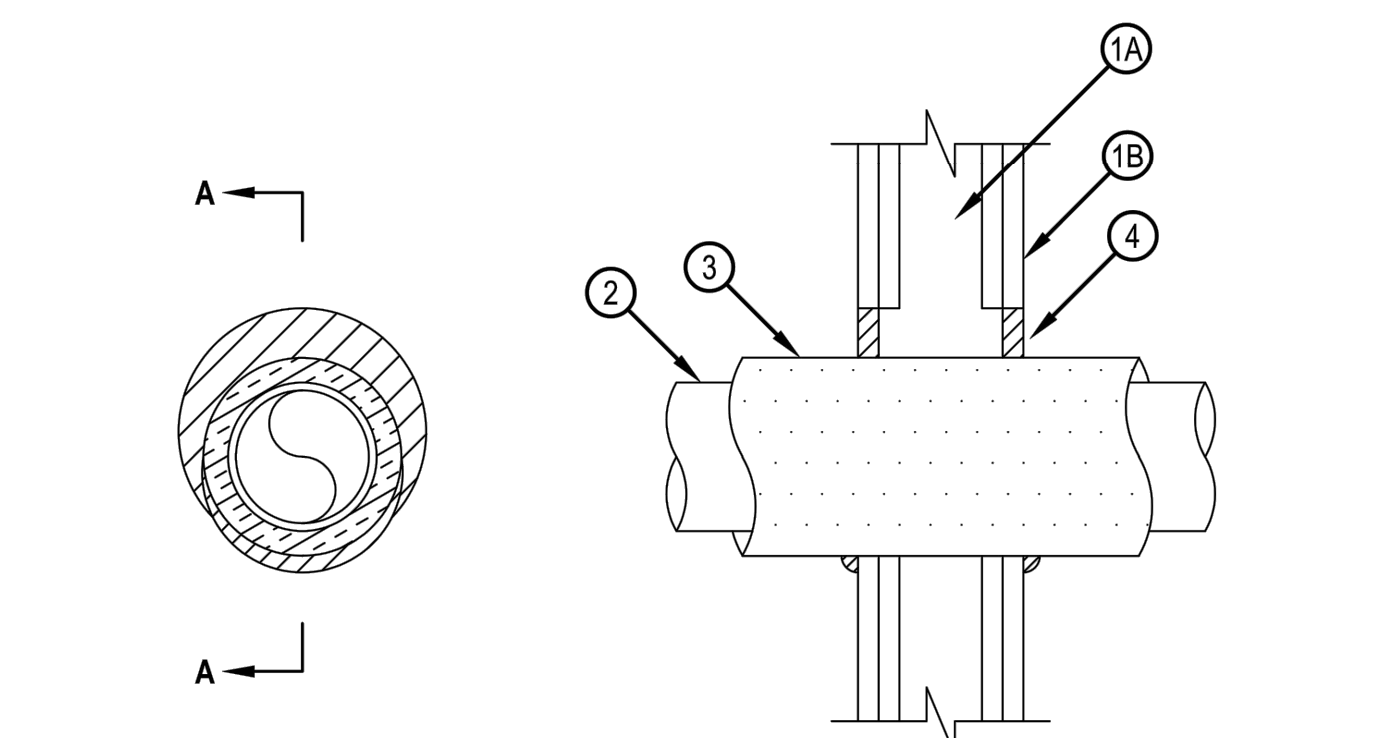

SECTION A-A

1. Wall Assembly — The 1 or 2 hr fire-rated gypsum wallboard/stud wall assembly shall be constructed of the materials and in the manner specified in the individual U300 or U400 Series Wall and Partition Designs in the UL Fire Resistance Directory and shall include the following construction features:
 A. Studs — Wall framing may consist of either wood studs or steel channel studs. Wood studs to consist of nom 2 by 4 in. lumber spaced 16 in. OC. Steel studs to be min 2-1/2 in. wide and spaced max 24 in. OC.
 B. Gypsum Board* — 5/8 in. thick, 4 ft wide with square or tapered edges. The gypsum wallboard type, thickness, number of layers, fastener type and sheet orientation shall be as specified in the individual Wall and Partition Design. Max diam of opening is 7-1/2 in. The hourly F Rating of the firestop system is equal to the hourly fire rating of the wall assembly in which it is installed.

2. Through Penetrants — One metallic pipe or tubing to be centered within the firestop system. Pipe or tubing to be rigidly supported on both sides of wall assembly. The following types and sizes of metallic pipes or tubing may be used:
 A. Steel Pipe — Nom 4 in. diam (or smaller) Schedule 40 (or heavier) steel pipe.
 B. Copper Tubing — Nom 2 in. diam (or smaller) Type L (or heavier) copper tubing.
 C. Copper Pipe — Nom 2 in. diam (or smaller) Regular (or heavier) copper pipe.




Reproduced by HILTI, Inc. Courtesy of Underwriters Laboratories, Inc. February 08, 2006

Page: 1 of 2


System No. W-L-7040

**F Ratings — 1 and 2 Hrs (See Items 1 and 3)
T Rating — 0 Hr**

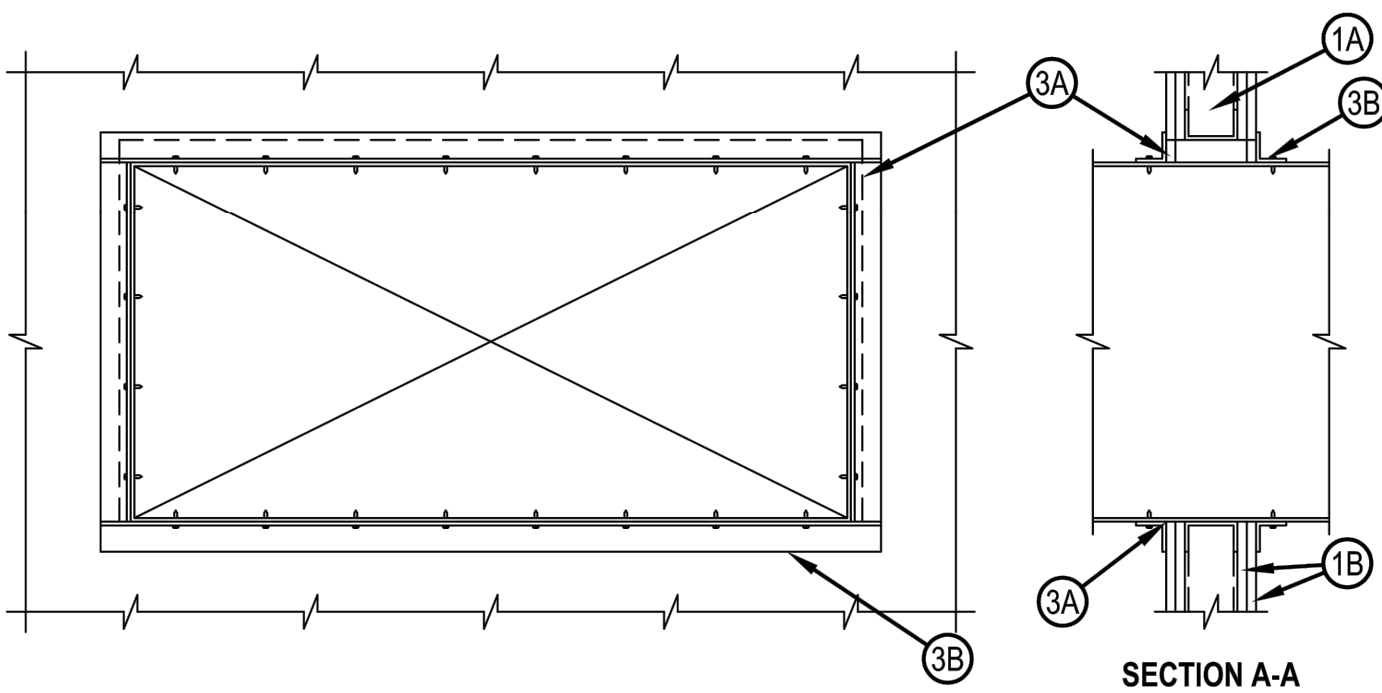

SECTION A-A

1. Wall Assembly — The fire-rated gypsum wallboard/stud wall assembly shall be constructed of the materials and in the manner specified in the individual U300 or U400 Series Wall and Partition Designs in the Fire Resistance Directory and shall include the following construction features:
 A. Studs — Wall framing may consist of either wood studs or steel channel studs. Wood studs to consist of nom 2 by 4 in. lumber spaced 16 in. OC. Steel studs to be min 2-1/2 in. wide and spaced max 24 in. Additional framing members shall be used to completely frame around opening.
 B. Gypsum Board* — Nom 5/8 in. thick with square or tapered edges. The gypsum wallboard type, number of layers and sheet orientation shall be as specified in the individual Wall and Partition Design Number. Max area of opening is 1300 in. with the dimension of 50 in. The hourly F rating of the firestop system is equal to the hourly fire rating of the wall assembly in which it is installed.
 2. Steel Duct — Nom 24 in. by 48 in. (or smaller) No. 24 gauge (or heavier) galv steel duct to be installed within the firestop system. The annular space shall be min 0 (point contact) in. to a max 2 in. Duct to be rigidly supported on both sides of the wall assembly.
 3. Firestop System — The firestop system shall consist of the following:
 A. Fill, Void or Cavity Material* — Sealant — Min 5/8 in. thickness of fill material applied within annulus flush with both surfaces of wall. At point contact location, a min 1/2 in. diam bead of fill material shall be applied to the wall/duct interface on both surfaces of wall.
 HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — FS-ONE Sealant, CP601S Elastomeric Firestop Sealant or CP606 Flexible Sealant.
 B. Steel Retaining Angle — No. 18 MSG (0.048 in.) galv steel angles cut to fit contour of duct with a 2 in. overlap on the duct and a min 1 in. overlap on the gypsum board assembly on both surfaces of wall. 2 in. leg of angle secured to duct with min No. 8 by 3/4 in. long sheet metal screws, spaced a max of 6 in. OC. When bead of fill material is used at joint contact locations, angles shall be installed prior to full material curing.
 *Bearing the UL Classification Mark



Reproduced by HILTI, Inc. Courtesy of Underwriters Laboratories, Inc. November 13, 2001

Page: 1 of 2


2. Cables — Within the loading area for each firestop device, the cables may represent a 0 to 100 percent visual fill. Cables to be tightly bundled within the device and rigidly supported on both sides of wall assembly. Any combination of the following types of cables may be used:
 A. Max 100 pair No. 24 AWG (or smaller) copper conductor telecommunication cable with polyvinyl chloride (PVC) jacketing and insulation.
 B. Max 7/C No. 12 AWG copper conductor control cable with PVC or XLPE jacket and insulation.
 C. Max 40 AWG Type RHH ground cable.
 D. Max 4 or No. 22 AWG Cat 5 or Cat 6 computer cables.
 E. Max RG 6/U coaxial cable with fluorinated ethylene insulation and jacketing.
 F. Fiber optic cable with polyvinyl chloride (PVC) or polyethylene (PE) jacket and insulation having a max diam of 1/2 in. (13 mm).
 G. Max 20/C No. 22 AWG shielded printer cable with PVC jacket.
 H. Through-Penetrating Product* — Two copper conductors No. 18 AWG (or smaller) Power or Non Power Limited Fire Alarm Cable with or without a jacket under a metal armor.
 AFC CABLE SYSTEMS INC
 I. Max. 1/4 in. (6 mm) diameter S-Video Cable consisting of 2 max 24 AWG 75 ohm coax or twisted pair cable with PE insulation and PVC jacket.
 J. Max 3/C No 12 AWG MC Cable.
 K. Through Penetrating Product* — Any cables, Armored Cable* or Metal Clad Cable* currently Classified under the Through Penetrating Product category. See Through Penetrating Product (XHLV) category in the Fire Resistance Directory for names of manufacturers.

For opening with cables, when the hourly rating of the wall assembly is 1 hr, the T, FT and FTH Ratings are 0 hr. For opening with cables, when the hourly rating of the wall assembly is 2 hr, the T, FT and FTH Ratings are 1-3/4 hr except that, when Item 2C, 2G, 2I, 2J or 2K is used, the T, FT and FTH Ratings are 1 hr for 2C, 2 OR 2I and the T, FT and FTH Ratings are 1/2 hr for 2J or 2K (See Item 3 also). When the hourly rating of the wall assembly is 3 or 4 hr, the T, FT and FTH Ratings are 2 hr. For wall assemblies with a 3 or 4 hr rating, Items 2G and 2I are not to be used.

L Ratings apply only when device flanges and CP 606 or FS-One Sealant are used. See Table below for L Ratings.

Max Cable Fill	Cable Type	L Rating, CFM/Sq Ft		L Rating, CFM	
		Ambient	400°F	Ambient	400°F
0%	-	Less Than 1	Less Than 1	Less Than 1	Less Than 1
100%	Item 2D only	5	1	Less Than 1	Less Than 1
100%	Any cables (Item 2) in any combination	9	10	Less Than 1	1

3. Firestop Device* — Firestop device consists of a corrugated steel tube with an inner plastic housing, intumescent material rings and twisted inner fabric smoke seal. Firestop device to be installed in accordance with the accompanying installation instructions. As an option, the inner fabric seal may remain open except that, to attain the L Rating, the inner fabric seal shall be twisted to completely close off the opening within device. Device slid into wall such that ends project an equal distance from the approximate centerline of the wall assembly. The annular space between the device and the periphery of the opening shall be min 0 in. (point contact). Device provided with flanges that are spun clockwise onto device threads, butting tightly to both sides of wall. Device flanges are optional. When the device flanges are not used, the T, FT and FTH Ratings for the firestop system are 0 hr. For blank opening (no cables), the T, FT and FTH Ratings for the firestop system equal the F and FH Ratings only when the device flanges are used.
 HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — CP 653 2" Speed Sleeve and CP 653 4" Speed Sleeve
 4. Fill, Void or Cavity Material* — Sealant — Min 1/2 in. (13 mm) thickness of fill material applied within the annulus between firestop device and wall, flush with both surfaces of wall, and an additional 1/4 in. (6 mm) bead applied around periphery of device. When device flanges are used, gypsum drywall compound may be used in place of the fill material.
 HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — FS-ONE or CP 606 Sealant
 *Bearing the UL Classification Mark



Reproduced by HILTI, Inc. Courtesy of Underwriters Laboratories, Inc. March 14, 2012

Page: 2 of 2

System No. W-L-5028

**F Ratings - 1 and 2 Hr (See Item 1)
T Ratings - 3/4 Hr
L Rating at Ambient - Less Than 1 CFM/sq ft
L Rating at 400 F - Less Than 1 CFM/sq ft**


3. Tube Insulation — Plastics+ — Nom 3/4 in. thick acrylonitrile butadiene/polyvinyl chloride (AB/PVC) flexible foam furnished in the form of tubing. An annular space of min 0 in. (point contact) to max 1-1/2 in. is required within the firestop system.

See Plastics+ (DMF22) category in the Recognized Component Directory for names of manufacturers. Any Recognized Component tube insulation material meeting the above specifications and having a UL 94 Flammability Classification of 94-5VA may be used. The hour T Rating of the firestop system is dependent on the hourly fire rating of the wall assembly in which it is installed, the size and type of through penetrant and the pipe covering thickness, as shown in the table below:

Wall Assembly Hr Rating	Type +	Through Penetrant Max Diam In.
1	A	4
1	A, B, or C	2
2	A	4
2	A, B, or C	2

+Indicates penetrant type as itemized in Item 2.

4. Fill, Void or Cavity Material* — Sealant — Min 5/8 in. thickness of fill material applied within the annulus, flush with both surfaces of wall. At the point contact location between pipe covering and gypsum wallboard, a min 1/2 in. diam bead of fill material shall be applied at the pipe covering/gypsum wallboard interface on both surfaces of wall.
 HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — FS-ONE Sealant
 *Bearing the UL Classification Mark



Reproduced by HILTI, Inc. Courtesy of Underwriters Laboratories, Inc. February 08, 2006


Page: 2 of 2

NOTE:
 THESE DETAILS ARE INCLUDED FOR REFERENCE PURPOSES AND DO NOT INCLUDE ALL APPLICABLE UL SYSTEM TESTED DETAILING TO BE UTILIZED THROUGH OUT THE PROJECT. PROVIDE APPLICABLE UL SYSTEM TESTED DETAILING FOR ALL FIRE RATED AND SMOKE PARTITION PENETRATIONS, WHETHER INDICATED WITHIN THESE DRAWINGS OR NOT.

CWS ARCHITECTS
ARCHITECTURE | INTERIOR DESIGN

264 US Route One Box 6, Suite 100-2A
Scarborough ME 04074
OFFICE: 207 774 4441 CWSARCH.COM

DESIGNER

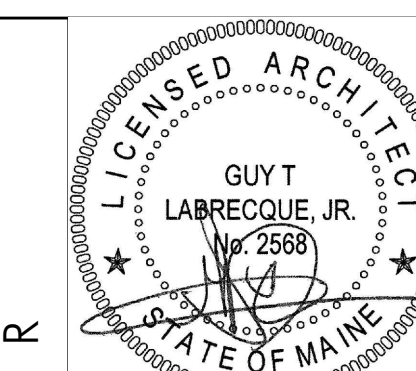

CWS ARCHITECTS
ARCHITECTURE | INTERIOR DESIGN
264 US ROUTE ONE
BOX 6, SUITE 100-2A
SCARBOROUGH, MAINE 04074
T: 207-774-4441
WWW.CWSARCH.COM

OWNER

FAIRPOINT COMMUNICATIONS

1 DAVIS ROAD
PORTLAND ME 04101

PROJECT

5 DAVIS FARM ROAD MERGER

5 DAVIS FARM ROAD
PORTLAND ME 04103

DRAWING

UL DESIGN DETAILS

REVISIONS

--	--	--	--	--	--

CWS PROJECT NUMBER: 17648

DRAWING NUMBER

LS3.03

SCALE: AS NOTED
DATE: 1-2-2018

ISSUED FOR PERMITTING