

City of Portland, Maine – Building or Use Permit Application 389 Congress Street, 04101, Tel: (207) 874-8703, FAX: 874-8716

Location of Construction: 1739 Washington Ave		Owner: Caroline Colley		Phone: 797-3630		Permit No: 980587	
Owner Address: SAA Ptld, ME		Lessee/Buyer's Name:		Phone:		Business Name:	
Contractor Name: Maine Window & Siding		Address: 71 Portland Rd Kennebunk, ME 04043		Phone: 985-2300		<div style="border: 2px solid black; padding: 5px; text-align: center;"> PERMIT ISSUED Permit Issued: JUN - 5 1998 CITY OF PORTLAND </div>	
Past Use: I-rem		Proposed Use:		COST OF WORK: \$ 4,200.00		PERMIT FEE: \$ 40.00	
				FIRE DEPT. <input type="checkbox"/> Approved <input type="checkbox"/> Denied		INSPECTION: Use Group: Type:	
Proposed Project Description: Construct 3 season patio room on deck (9 x 10)		Signature:		Signature:		Zone: R-3 CBL: 372-A-009 Zoning Approval: 6/3/98 Special Zone or Reviews: <input type="checkbox"/> Shoreland <input type="checkbox"/> Wetland <input type="checkbox"/> Flood Zone <input type="checkbox"/> Subdivision <input type="checkbox"/> Site Plan maj <input type="checkbox"/> minor <input type="checkbox"/> mm	
PEDESTRIAN ACTIVITIES DISTRICT (P.A.D.) Action: Approved <input type="checkbox"/> Approved with Conditions <input type="checkbox"/> Denied <input type="checkbox"/>		Signature:		Date:			
Permit Taken By: S.P.		Date Applied For: 01 June 1998					

1. This permit application does not preclude the Applicant(s) from meeting applicable State and Federal rules.
2. Building permits do not include plumbing, septic or electrical work.
3. Building permits are void if work is not started within six (6) months of the date of issuance. False information may invalidate a building permit and stop all work..

- Zoning Appeal**
- Variance
 - Miscellaneous
 - Conditional Use
 - Interpretation
 - Approved
 - Denied

- Historic Preservation**
- Not in District or Landmark
 - Does Not Require Review
 - Requires Review

Action:

- Approved
- Approved with Conditions
- Denied

Date: _____

PERMIT ISSUED WITH REQUIREMENTS

CERTIFICATION

I hereby certify that I am the owner of record of the named property, or that the proposed work is authorized by the owner of record and that I have been authorized by the owner to make this application as his authorized agent and I agree to conform to all applicable laws of this jurisdiction. In addition, if a permit for work described in the application is issued, I certify that the code official's authorized representative shall have the authority to enter all areas covered by such permit at any reasonable hour to enforce the provisions of the code(s) applicable to such permit

02 June 1998

SIGNATURE OF APPLICANT _____ ADDRESS: _____ DATE: _____ PHONE: _____

RESPONSIBLE PERSON IN CHARGE OF WORK, TITLE _____ PHONE: _____

White-Permit Desk Green-Assessor's Canary-D.P.W. Pink-Public File Ivory Card-Inspector

CEO DISTRICT 7

BUILDING PERMIT REPORT

DATE: 4 June 98 ADDRESS: 1739 Washington Ave. (372-A-009)

REASON FOR PERMIT: To construct 3 season patio on deck (9x10')

BUILDING OWNER: Caroline Coley

CONTRACTOR: Mario Window & Siding

PERMIT APPLICANT: [Signature]

USE GROUP A-3 BOCA 1996 CONSTRUCTION TYPE 53

CONDITION(S) OF APPROVAL

This Permit is being issued with the understanding that the following conditions are met:

Approved with the following conditions: *1 *2, *8 *16, *24 *26 *27 & 30

X1. This permit does not excuse the applicant from meeting applicable State and Federal rules and laws.

X2. Before concrete for foundation is placed, approval from the ~~Development Review Coordinator~~ and Inspection Services must be obtained. (A 24 hour notice is required prior to inspection)

3. Precaution must be taken to protect concrete from freezing. It is strongly recommended that a registered land surveyor check all foundation forms before concrete is placed. This is done to verify that the proper setbacks are maintained.

4. Private garages located beneath habitable rooms in occupancies in Use Group R-1, R-2, R-3 or I-1 shall be separated from adjacent interior spaces by fire partitions and floor/ceiling assembly which are constructed with not less than 1-hour fire resisting rating. Private garages attached side-by-side to rooms in the above occupancies shall be completely separated from the interior spaces and the attic area by means of 1/2 inch gypsum board or the equivalent applied to the garage means of 1/2 inch gypsum board or the equivalent applied to the garage side. (Chapter 4 Section 407.0 of the BOCA/1996)

5. All chimneys and vents shall be installed and maintained as per Chapter 12 of the City's Mechanical Code. (The BOCA National Mechanical Code/1993).

6. Sound transmission control in residential building shall be done in accordance with Chapter 12 section 1214.0 of the city's building code.

7. Guardrails & Handrails: A guardrail system is a system of building components located near the open sides of elevated walking surfaces for the purpose of minimizing the possibility of an accidental fall from the walking surface to the lower level. Minimum height all Use Groups 42", except Use Group R which is 36". In occupancies in Use Group A, B, H-4, I-1, I-2 M and R and public garages and open parking structures, open guards shall have balusters or be of solid material such that a sphere with a diameter of 4" cannot pass through any opening. Guards shall not have an ornamental pattern that would provide a ladder effect. Handrails shall be a minimum of 34" but not more than 38". Use Group R-3 shall not be less than 30", but not more than 38")

8. Handrail grip size shall have a circular cross section with an outside diameter of at least 1 1/4" and not greater than 2". Handroom in habitable space is a minimum of 7'6".

9. Stair construction in Use Group R-3 & R-4 is a minimum of 10" tread and 7 3/4" maximum rise. All other Use group minimum 11" tread, 7" maximum rise.

10. The minimum headroom in all parts of a stairway shall not be less than 80 inches. (6'8")

11. Every sleeping room below the fourth story in buildings of use Groups R and I-1 shall have at least one operable window or exterior door approved for emergency egress or rescue. The units must be operable from the inside without the use of special knowledge or separate tools. Where windows are provided as means of egress or rescue they shall have a sill height not more than 44 inches (1118mm) above the floor. All egress or rescue windows from sleeping rooms shall have a minimum net clear opening height dimension of 24 inches (610mm). The minimum net clear opening width dimension shall be 20 inches (508mm), and a minimum net clear opening of 5.7 sq. ft.

12. Each apartment shall have access to two (2) separate, remote and approved means of egress. A single exit is acceptable when it exits directly from the apartment to the building exterior with no communications to other apartment units.

13. All vertical openings shall be enclosed with construction having a fire rating of at least one (1) hour, including fire doors with self closer's. (Over 3 stories in height requirements for fire rating is two (2) hours.)

14. The boiler shall be protected by enclosing with (1) hour fire-rated construction including fire doors and ceiling, or by providing automatic extinguishment.

15. All single and multiple station smoke detectors shall be of an approved type and shall be installed in accordance with the

16. All single and multiple station smoke detectors shall be of an approved type and shall be installed in accordance with the

THIS IS NOT A PERMIT/CONSTRUCTION CANNOT COMMENCE UNTIL THE PERMIT IS ISSUED

**Building or Use Permit Pre-Application
Additions/Alterations/Accessory Structures
To Detached Single Family Dwelling**

In the interest of processing your application in the quickest possible manner, please complete the Information below for a Building or Use Permit.

NOTE If you or the property owner owes real estate or personal property taxes or user charges on any property within the City, payment arrangements must be made before permits of any kind are accepted.**

Location/Address of Construction: 1739 WASHINGTON ST

Tax Assessor's Chart, Block & Lot Number Chart# <u>372</u> Block# <u>A</u> Lot# <u>9</u>	Owner: <u>CAROLINE COALEY</u>	Telephone#: <u>797-3630</u>
Owner's Address: <u>1739 WASHINGTON ST</u>	Lessee/Buyer's Name (If Applicable)	Cost Of Work: Fee <u>\$ 4200.00</u> <u>\$ 40.00</u>

Proposed Project Description: (Please be as specific as possible)

3 SEASON PATIO ROOM ON DECK 9' x 10'

Contractor's Name, Address & Telephone
MAINE WINDOW & SIDING 71 Portland Rd 985-2300 Rec'd By: [Signature]

Separate permits are required for Internal & External Plumbing, HVAC and Electrical installation.


- All construction must be conducted in compliance with the 1996 B.O.C.A. Building Code as amended by Section 6-Art II.
- All plumbing must be conducted in compliance with the State of Maine Plumbing Code.
- All Electrical Installation must comply with the 1996 National Electrical Code as amended by Section 6-Art III.
- HVAC (Heating, Ventilation and Air Conditioning) Installation must comply with the 1993 BOCA Mechanical Code.

You must include the following with you application:

- 1) A Copy of Your Deed or Purchase and Sale Agreement
- 2) A Copy of your Construction Contract, if available
- 3) A Plot Plan (Sample Attached)

If there is expansion to the structure, a complete plot plan (Site Plan) must include:

- The shape and dimension of the lot, all existing buildings (if any), the proposed structure and the actual property lines. Structures include decks porches, a bow windows cantilever sections and roof overhangs, as well as, sheds, pools, garages and any other accessory structures.
- Scale and required zoning district setbacks

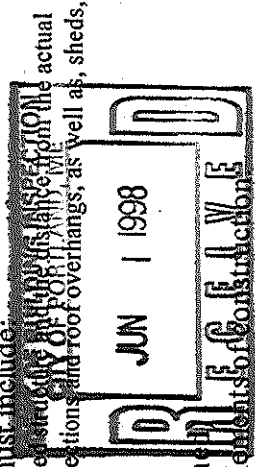

4) Building Plans (Sample Attached)

- A complete set of construction drawings showing all of the following elements for construction:
- Cross Sections w/Framing details (including porches, decks w/ railings, and accessory structures)
 - Floor Plans & Elevations
 - Window and door schedules
 - Foundation plans with required drainage and dampproofing
 - Electrical and plumbing layout. Mechanical drawings for any specialized equipment such as furnaces, chimneys, gas equipment, HVAC equipment (air handling) or other types of work that may require special review must be included.


Certification


I hereby certify that I am the Owner of record of the named property, or that the proposed work is authorized by the owner of record and that I have been authorized by the owner to make this application as his/her authorized agent. I agree to conform to all applicable laws of this jurisdiction. In addition, if a permit for work described in this application is issued, I certify that the Code Official's authorized representative shall have the authority to enter all areas covered by this permit at any reasonable hour to enforce the provisions of the codes applicable to this permit.

Signature of applicant: William Sargent Date: 6-1-98


Site Review Fee: \$150.00/Building Permit Fee: \$25.00 for the 1st \$1000.cost plus \$5.00 per \$1,000.00 construction cost thereafter.

Caroline Conkey

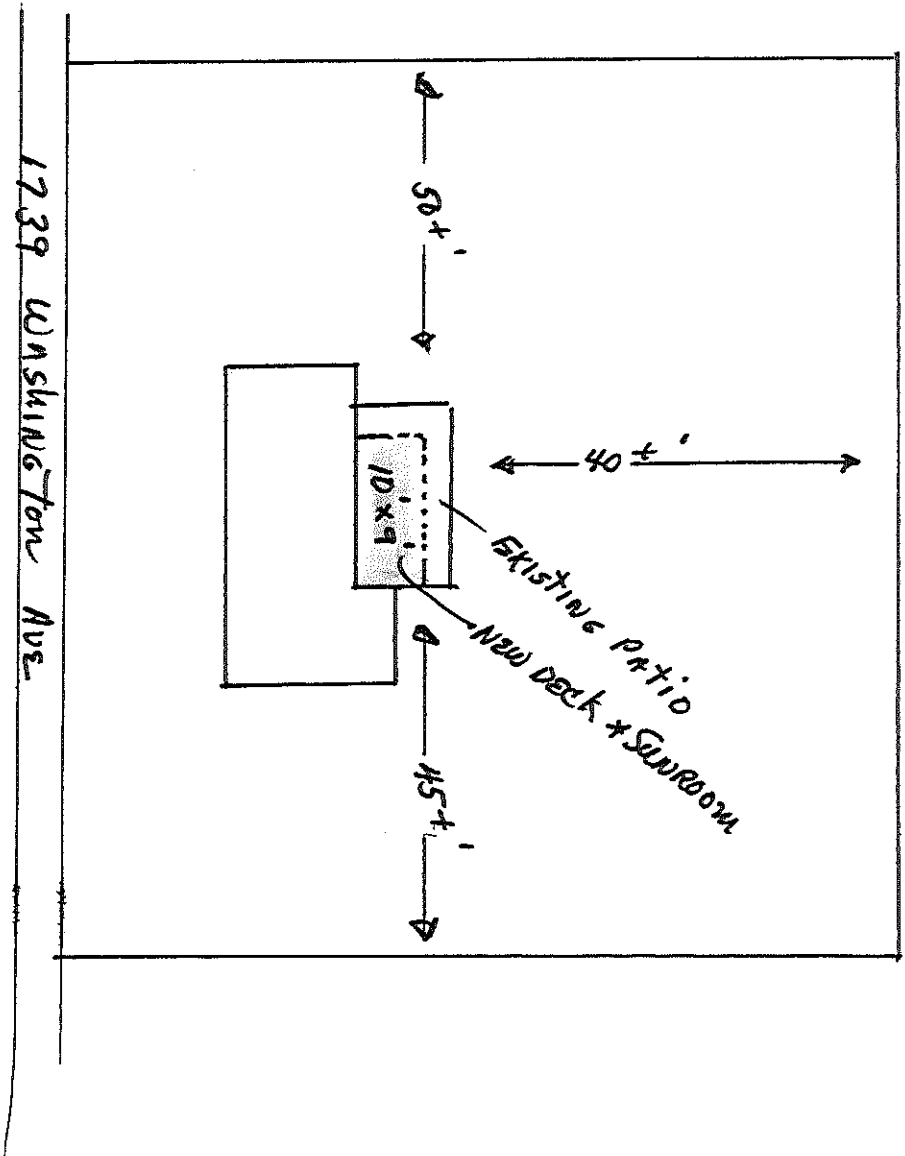

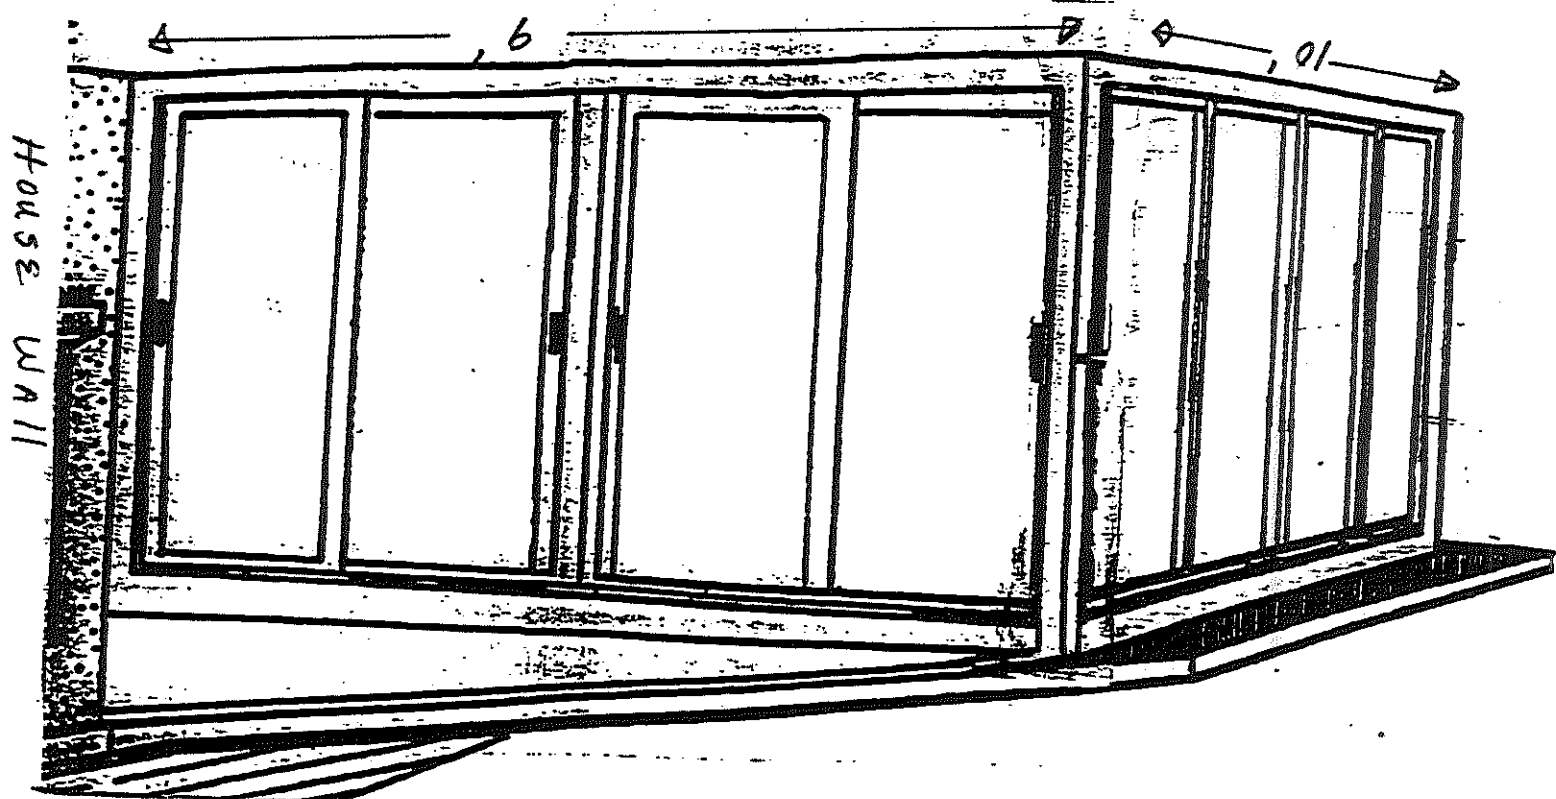

CAROLINE COMKEY
1739 WASHINGTON AVE
PORTLAND ME

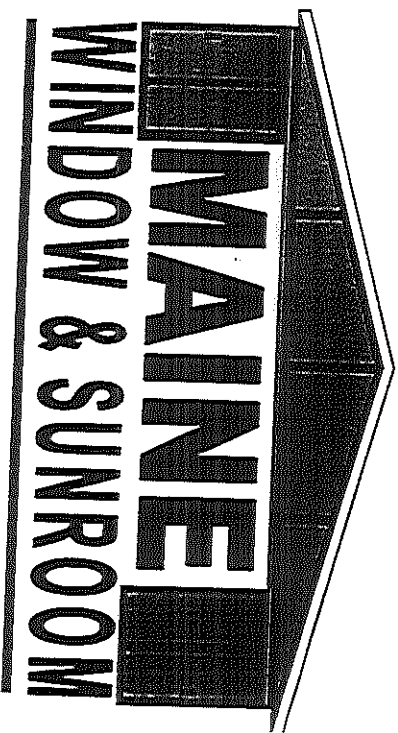

DATE: 5-15-98

JOB NAME & ADDRESS:

Caroline Conley

1739 Washington st

Portland Me

I, Caroline Conley

, hereby authorize Maine Window & Sunroom to act as my agent to acquire a building permit for my home improvement project.

Caroline Conley
Signature

TABLE 22-1 **CONFORMABLE STRENGTH VALUES FOR 3" THICK HONEYCOMB PANELS AND ATTACHING EXTRUSIONS**

PHYSICAL PROPERTIES OF 3" THICK HONEYCOMB PANELS AND ATTACHING EXTRUSIONS⁽¹⁾

COMPONENT	MATERIAL	SIZE / PROPERTIES	STRENGTH
FACING	1. A.S.T.M. 3003 H194	WIDTH = 31.5" x 0.04" THICKNESS = 0.024" x 0.001" DENSITY = 1685.0 PCF COEF. TH. EXP. = 0.000019	1. TENSILE ULTIMATE STRENGTH = 27,000-32,000 PSI 2. TENSILE ULTIMATE STRENGTH = 33,000-41,000 PSI 3. TENSILE ULTIMATE STRENGTH = 35,000-38,000 PSI STRETCHATION 1% TO 3%
	2. A.S.T.M. 3003 H194 ALUMINIUM ALLOY		
CORE	HONEYCOMB 99% PULP PAPER 1. 11% AIR RESIN CONTENT 2. 10% AIR RESIN CONTENT	WIDTH = 36.0" x 0.05" THICKNESS = 0.02" x 0.01" CELL SIZE = 0.275" x 0.18" DENSITY = 1,760.18 PCF COEF. TH. EXP. = 0.000019 ABSORPTION = 3%	1. COMPRESSIVE ULT. STRENGTH (CORE) = 31.17 PSI 1. COMPRESSIVE ULT. STRENGTH (WALL) = 20.28 PSI 1. SHEAR ULTIMATE STRENGTH (V) = 57.51 PSI 1. SHEAR ULTIMATE STRENGTH (H) = 20.28 PSI
ADHESIVE	MORTAR & CURING, ONE PART, 100% SOLIDS, NONVOLATILES, TYPE II UNSATURATED ADHESIVE	DENSITY = 88.8 PCF	FLEXURAL YIELD STRENGTH (U. AL-HO) = 892 PSI FLEXURAL YIELD STRENGTH (V. AL-HO) = 588 PSI
EXTRUSIONS	A.S.T.M. 6063 T4	A-FRAME SUPPORT PANEL WIDTHEN H, U, C, P, CHINA WELLS CORNER POST THERMAL BREAK, HANGER	TENSILE ULTIMATE STRENGTH = 30,000 PSI TENSILE YIELD STRENGTH = 25,000 PSI COMPRESSIVE YIELD STRENGTH = 28,000 PSI SHEAR ULTIMATE STRENGTH = 19,000 PSI SHEAR YIELD STRENGTH = 14,000 PSI BEARING ULTIMATE STRENGTH = 82,000 PSI BEARING YIELD STRENGTH = 40,000 PSI MODULUS OF ELASTICITY = 10,100,000 PSI
PANEL	HONEYCOMB BANDWICH PANEL	WIDTH = 35.9" x 0.1" THICKNESS = 3.0" x 0.01" K-FACTOR = 4	STRENGTH CHARACTERISTICS TABULATED BELOW FLAME SPREAD INDEX = 40 SMOKE DEVELOPMENT INDEX = 315

TRANSVERSE LOAD TABLE FOR 3" THICK HONEYCOMB PANELS⁽¹⁾

LOAD DESCRIPTION	ROOF LOADS (LOAD FOR PANEL SPANS)	
	8 FT 10 FT	12 FT 14 FT
ULT. TRANSVERSE LOAD/REDUCTION OF SAFETY		
1. ROOF LOAD AT ULTIMATE TRANSVERSE LOAD/1.0	170	140
2. ROOF LOAD AT ULTIMATE TRANSVERSE LOAD/2.0	85	70
3. ROOF LOAD AT ULTIMATE TRANSVERSE LOAD/3.0	61	56
4. ROOF LOAD AT ULTIMATE TRANSVERSE LOAD/5.0	37	42
DEFLECTION LOADS		
5. ROOF LOAD AT PANEL DEFLECTION OF SPAN/10	117	102
6. ROOF LOAD AT PANEL DEFLECTION OF SPAN/120	91	81
7. ROOF LOAD AT PANEL DEFLECTION OF SPAN/180	62	54
		20

SEE NOTES ON PAGE 2.1.10

Applicant: William Sargent

Date: 6/3/98

Address: 1739 W. Ashford Ave

C.B.L.: 372-A-9

CHECK-LIST AGAINST ZONING ORDINANCE

Date - Existing

Zone Location - R-3

Interior or corner lot -

Proposed Use/Work - Construct 3 Seasons Patio on Deck 9' x 10'

Sewage Disposal -

- Lot Street Frontage -

Front Yard - W/A

Rear Yard - 25' req - 40' ± shown

Side Yard - 8' req - 50' ± shown

Projections -

Width of Lot -

Height - 1 Story shown

Lot Area -

Lot Coverage/ Impervious Surface -

Area per Family -

Off-street Parking -

Loading Bays -

Site Plan -

Shoreland Zoning/ Stream Protection -

Flood Plains -

W/A

W/A

City of Portland, Maine
IN THE CITY COUNCIL

Unrecorded - 11-19-01
Tab 30 11-19-01

**ORDER ESTABLISHING THE COST PER BAG
OF BLUE CITY TRASH BAGS**

ORDERED, pursuant to Section 12-18(d) of the Portland City Code, the cost of blue city trash bags shall be as follows:

Size	Cost
15 Gallon	.445 each
30 Gallon	.89 each

Costs are effective January 1, 2002.

Postponed: 11/19/01
Passage 12/3/01 9-0