

City of Portland, Maine - Building or Use Permit Application

389 Congress Street, 04101 Tel: (207) 874-8703, Fax: (207) 874-8716

Permit No: 08-0969	Issue Date: 8/7/08	CBL: 372 A020001
-----------------------	-----------------------	---------------------

Location of Construction: 23 SMITH FARM LN	Owner Name: PIACENTINI CHRISTOPHER G	Owner Address: 23 SMITH FARM LN	Phone:
Business Name:	Contractor Name: Builders Insulation/ Builders Installe	Contractor Address: 515 Riverside Industrial Parkw Portlan	Phone 2078786600
Lessee/Buyer's Name	Phone:	Permit Type: HVAC	Zone:

Past Use: Duplex - Unit #8	Proposed Use: Duplex - Unit#8 install a Kingsman direct vent fireplace	Permit Fee: \$40.00	Cost of Work: \$1,200.00	CEO District: 5
-------------------------------	---	------------------------	-----------------------------	--------------------

FIRE DEPT: <input type="checkbox"/> Approved <input type="checkbox"/> Denied	INSPECTION: Use Group: <i>D-3</i> Type: <i>SB</i> <i>IMC-2003</i> <i>NADA-254</i> Signature: <i>CL 8/7/08</i>
--	---

Proposed Project Description:
install a Kingsman direct vent fireplace

Signature: _____ Date: _____


PEDESTRIAN ACTIVITIES DISTRICT (P.A.D.)

Action: Approved Approved w/Conditions Denied

Signature: _____ Date: _____

Permit Taken By: ldobson	Date Applied For: 08/07/2008	Zoning Approval	
-----------------------------	---------------------------------	------------------------	--

<ol style="list-style-type: none"> This permit application does not preclude the Applicant(s) from meeting applicable State and Federal Rules. Building permits do not include plumbing, septic or electrical work. Building permits are void if work is not started within six (6) months of the date of issuance. False information may invalidate a building permit and stop all work.. 	Special Zone or Reviews <input type="checkbox"/> Shoreland <input type="checkbox"/> Wetland <input type="checkbox"/> Flood Zone <input type="checkbox"/> Subdivision <input type="checkbox"/> Site Plan Maj <input type="checkbox"/> Minor <input type="checkbox"/> MM <input type="checkbox"/>	Zoning Appeal <input type="checkbox"/> Variance <input type="checkbox"/> Miscellaneous <input type="checkbox"/> Conditional Use <input type="checkbox"/> Interpretation <input type="checkbox"/> Approved <input type="checkbox"/> Denied	Historic Preservation <input checked="" type="checkbox"/> Not in District or Landmark <input type="checkbox"/> Does Not Require Review <input type="checkbox"/> Requires Review <input type="checkbox"/> Approved <input type="checkbox"/> Approved w/Conditions <input type="checkbox"/> Denied
	Date: <i>CL 8/7/08</i>	Date: <i>8/7/08</i>	Date: <i>8/7/08</i>

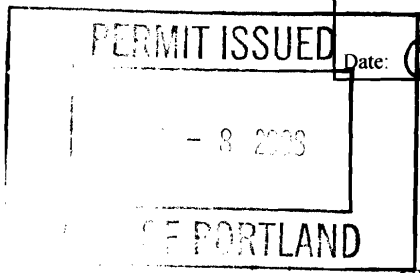

CERTIFICATION


I hereby certify that I am the owner of record of the named property, or that the proposed work is authorized by the owner of record and that I have been authorized by the owner to make this application as his authorized agent and I agree to conform to all applicable laws of this jurisdiction. In addition, if a permit for work described in the application is issued, I certify that the code official's authorized representative shall have the authority to enter all areas covered by such permit at any reasonable hour to enforce the provision of the code(s) applicable to such permit.

SIGNATURE OF APPLICANT	ADDRESS	DATE	PHONE
RESPONSIBLE PERSON IN CHARGE OF WORK, TITLE		DATE	PHONE



FILL IN AND SIGN WITH INK

APPLICATION FOR PERMIT HEATING OR POWER EQUIPMENT

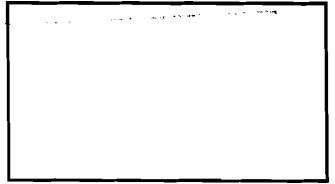

To the INSPECTOR OF BUILDINGS, PORTLAND, ME.

The undersigned hereby applies for a permit to install the following heating, cooking or power equipment in accordance with the Laws of Maine, the Building Code of the City of Portland, and the following specifications:

Location / CBL 1815 Washington Ave #8 Use of Building Home Date 8/7/08
Name and address of owner of appliance Davis Const. 50. Portland

Installer's name and address Builders Installed Products
515 Riverside End Pkwy. Portland Telephone 878-6600

Location of appliance:

- Basement
- Floor
- Attic
- Roof

Type of Fuel:

- Gas
- Oil
- Solid

Appliance Name: Kingsman

U.L. Approved Yes No

Will appliance be installed in accordance with the manufacture's installation instructions? Yes No

IF NO Explain: _____

The Type of License of Installer:

- Master Plumber # _____
- Solid Fuel # _____
- Oil # _____
- Gas # PNT-3025
- Other _____

Type of Chimney:

Masonry Lined
Factory built _____

Metal
Factory Built U.L. Listing # _____

Direct Vent
Type Flex/Horizontal UL# _____

Type of Fuel Tank

- Oil
- Gas

Size of Tank N/A

Number of Tanks _____

Distance from Tank to Center of Flame _____ feet.

Cost of Work: \$ 1200⁰⁰

Permit Fee: \$ 40⁰⁰

Approved

Approved with Conditions

Fire: _____
Ele.: _____
Bldg.: _____

See attached letter or requirement

[Signature]
Inspector's Signature

8/7/08
Date Approved

Signature of Installer Bill Rue

City of Portland, Maine - Building or Use Permit

389 Congress Street, 04101 Tel: (207) 874-8703, Fax: (207) 874-8716

Permit No: 08-0969	Date Applied For: 08/07/2008	CBL: 372 A020001
------------------------------	--	----------------------------

Location of Construction: 23 SMITH FARM LN unit#8	Owner Name: PIACENTINI CHRISTOPHER G	Owner Address: 23 SMITH FARM LN	Phone:
Business Name:	Contractor Name: Builders Insulation/ Builders Installe	Contractor Address: 515 Riverside Industrial Parkw Portlan	Phone (207) 878-6600
Lessee/Buyer's Name	Phone:	Permit Type: HVAC	

Proposed Use: Duplex - Unit#8 install a Kingsman direct vent fireplace	Proposed Project Description: install a Kingsman direct vent fireplace
--	--

Dept: Zoning	Status: Approved	Reviewer: Chris Hanson	Approval Date: 08/07/2008	Ok to Issue: <input checked="" type="checkbox"/>
Note:				
Dept: Building	Status: Approved with Conditions	Reviewer: Chris Hanson	Approval Date: 08/07/2008	Ok to Issue: <input checked="" type="checkbox"/>
Note:				
1) The heating appliance/stove shall be installed, maintained and operated in accordance with the terms of the listing.				
2) The installation must comply with the State of Maine Gas Regulations.				
3) Installation shall comply with 2003 International Mechanical Code and State of Maine Oil and Solid Fuel Board Laws and Rules				

City of Portland, Maine - Building or Use Permit

389 Congress Street, 04101 Tel: (207) 874-8703, Fax: (207) 874-8716

Permit No: 08-0969	Date Applied For: 08/07/2008	CBL: 372 A020001
------------------------------	--	----------------------------

Location of Construction: 23 SMITH FARM LN unit#8	Owner Name: PIACENTINI CHRISTOPHER G	Owner Address: 23 SMITH FARM LN	Phone:
Business Name:	Contractor Name: Builders Insulation/ Builders Installe	Contractor Address: 515 Riverside Industrial Parkw Portlan	Phone (207) 878-6600
Lessee/Buyer's Name	Phone:	Permit Type: HVAC	

Proposed Use: Duplex - Unit#8 install a Kingsman direct vent fireplace	Proposed Project Description: install a Kingsman direct vent fireplace
--	--

Dept: Zoning	Status: Approved	Reviewer: Chris Hanson	Approval Date: 08/07/2008	Note:	Ok to Issue: <input checked="" type="checkbox"/>
Dept: Building	Status: Approved with Conditions	Reviewer: Chris Hanson	Approval Date: 08/07/2008	Note:	Ok to Issue: <input checked="" type="checkbox"/>
1) The heating appliance/stove shall be installed, maintained and operated in accordance with the terms of the listing. 2) The installation must comply with the State of Maine Gas Regulations. 3) Installation shall comply with 2003 International Mechanical Code and State of Maine Oil and Solid Fuel Board Laws and Rules					



CITY OF PORTLAND, MAINE
Department of Building Inspection

Certificate of Occupancy

LOCATION 34 SMITH FARM LANE CBL 372 A020001

Issued to Piacentini Christopher G /Davis Construction Date of Issue 10/31/2008

This is to certify that the building, premises, or part thereof, at the above location, built — altered — changed as to use under Building Permit No. 06-1477, has had final inspection, has been found to conform substantially to requirements of Zoning Ordinance and Building Code of the City, and is hereby approved for occupancy or use, limited or otherwise, as indicated below.

PORTION OF BUILDING OR PREMISES

SINGLE FAMILY UNIT 8

APPROVED OCCUPANCY

RESIDENTIAL CONDO
USE GROUP R-3, TYPE 5B
IRC 2003

Limiting Conditions: None

This certificate supersedes
certificate issued

Approved:

10/31/08
.....
(Date)

Christopher G. Piacentini
.....
Inspector

Robert A. Poirier
.....
Inspector of Buildings

Notice: This certificate identifies lawful use of building or premises, and ought to be transferred from owner to owner when property changes hands. Copy will be furnished to owner or lessee for one dollar.

Installation Instructions

Models ZDV6000, ZDV3320

Listed Certified for USA. and Canada

ZDV6000N, ZDV6000LP certified to: ANSI 21.88b-2003, CSA 2.33b-2003, CGA 2.17-M91, CSA P.4.1-02.
Acceptable for installation in Manufactured Housing (Mobile Homes) except as original equipment.

ZDV3320N, ZDV3320LP are certified to: ANSI Z21.50a-2000 CSA 2.22a-2000, CGA 2.17-M91, CSA P.4.1-02.



“Zero Clearance” Direct Vent Gas Fireplace

Read this complete manual before beginning installation.
These instructions must be kept with the unit for future reference.

FOR YOUR SAFETY

Do not store or use gasoline or other flammable vapors and liquids in the vicinity of this or any other appliance.

What To Do If You Smell Gas

- Do not try to light any appliance.
- Extinguish any open flame.
- Do not touch any electrical switch.
- Do not use any phone in your building.
- Immediately call your gas supplier from a neighbour's phone.
- If you can not reach your gas supplier, call the fire department.



KINGSMAN INDUSTRIES
A Division of R-Co. Inc.
2340 Logan Avenue
Winnipeg, Manitoba, Canada R2R 2V3
Ph: (204) 632-1962

Warning: Improper installation, alteration, service or maintenance can cause property damage, personal injury or loss of life. Refer to this manual. Installation and service must be performed by a qualified installer, service agency or the gas supplier.

Clearance to Combustibles and Mantel Clearances

Clearance to Combustibles

Back (from Standoffs)	0 inches/0 mm
Side (from standoffs)	0 inches/0 mm
Floor	0 inches/0 mm
Top (from standoffs)	0 inches/0 mm
Top of 90 degree bend in Minimum Enclosure of 60 inches	6 inches/152.5 mm / Kingsman Vent Systems
Top of 90 degree bend in Enclosure over 60 inches	2 1/2 inches/64 mm / Kingsman Vent Systems
Top of Horizontal Pipe	1 1/2 inches/38mm / Kingsman Vent Systems
Side & Bottom of Horizontal Pipe	1 inch/25.5mm / Kingsman Vent Systems
Vertical Vent Pipe	1 inch/25.5mm / Kingsman Vent Systems
Vertical Vent Pipe	1 1/4 inch/32mm / Simpson DuraVent Systems

(NOTE -Floor) if installing the appliance directly on carpeting or other combustible materials other than wood flooring, the appliance shall be installed on a metal or wood panel, the full width and depth of the appliance. Carpet may extend 1/2 inch above the floor of appliance.

Note: See Mantel Chart

Mantels

Depending on the depth of the fireplace mantel, it may be installed higher or lower from the top of the fireplace opening. See drawings for proper installation height of your combustible mantel. Non-combustible mantels may be installed at any height above the fireplace opening.

Non combustible materials such as brick, tile, etc. can extend up to or over the front face of the fireplace (NO PORTION OF GRILL AREA OR DOOR AREAS CAN BE COVERED).


Combustible material can extend flush to unit up to the top, bottom and sides of fireplace to stand-offs.

For COMBUSTIBLE materials extending in front of fireplace consult (Mantel and Mantel Leg Drawings).

If slim line brass surround is used, brick, tiles or other NON-COMBUSTIBLE materials may extend past the front of unit giving a recessed appearance. For COMBUSTIBLE materials extending in front of fireplace consult (Mantel and Mantel Leg Drawings).


If wide brass surround is used finish materials must be flush with front of unit.

Note: When using paint or lacquer to finish the mantel, such paint or lacquer must be heat resistant (250°F) to prevent discoloration.

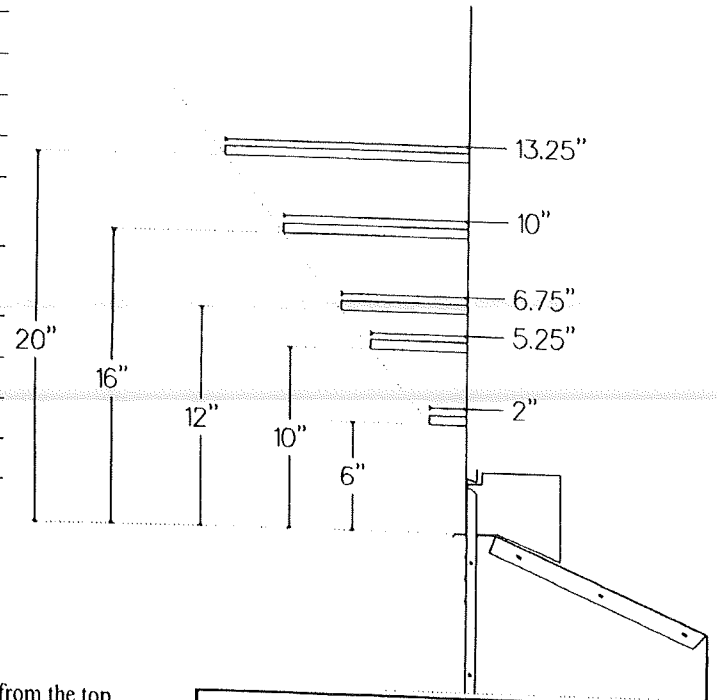

Note when using SIMPSON DURAVENT ADAPTER (ZDVDF) the fireplace clearances from the back standoff is one inch, thus increasing the framing depth to 15".

Warning: Combustible objects must not be placed on a non-combustible mantel unless the non-combustible mantel meets the minimum height and width requirements for a combustible mantel.

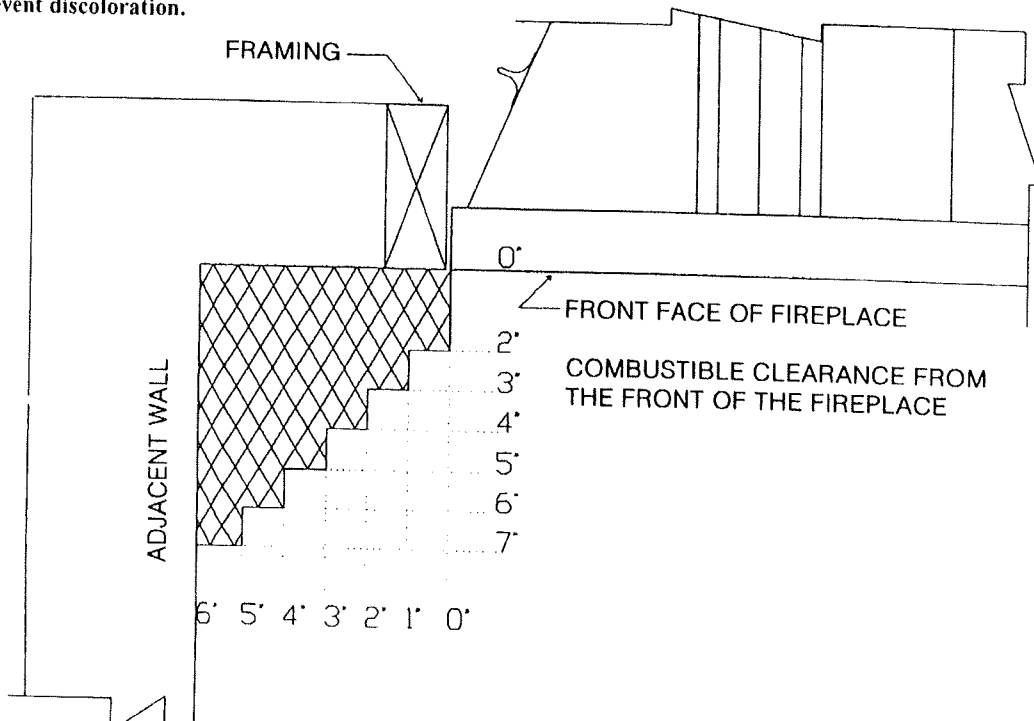


Fan Kit Installation

Automatic On/Off Thermostat Controlled Fan Kit (Part # Z33FK)


Note: Fan to be located on right hand side of fireplace as per drawing

1. Open the lower front access cover.
2. The sensor (thermo-disc) needs to be secured under the firebox. Screws are factory installed with washers, make sure washers are used as spacers between bottom of firebox and thermo-disc mount.
3. Insert the two (2) #8x1/2 screws provided with the fan into the holes in the side of the fireplace opposite the gas line entry. Mount the fan using the keyhole slots in the fan body.
4. Install a junction box (type to except three prong plug) on the inside wall of the access area opposite the fan. Large holes are provided to allow wiring to enter the access area on the left of the unit. Connect the power, sensor and variable speed wall switch as shown in the wiring diagram.
5. Close lower access cover.
6. Turn the wall switch on (clockwise). Turn the fireplace on. Once the sensor unit reaches operating temperature in approximately 10 to 15 minutes the fan will turn on. The fan can be switched off, if desired, by turning the wall switch fully counter-clockwise.
7. To set the minimum fan speed, if desired, remove the variable speed switch from the wall mount. Turn the variable speed wall controller to its minimum setting (fully clockwise). Use the set screw on the side of the variable speed controller to increase or decrease the minimum fan speed. (It may be desirable to lower minimum fan speed to decrease the sound level created by the fan.) Reinstall switch into wall mount and cover with face plate.

OLD STYLE

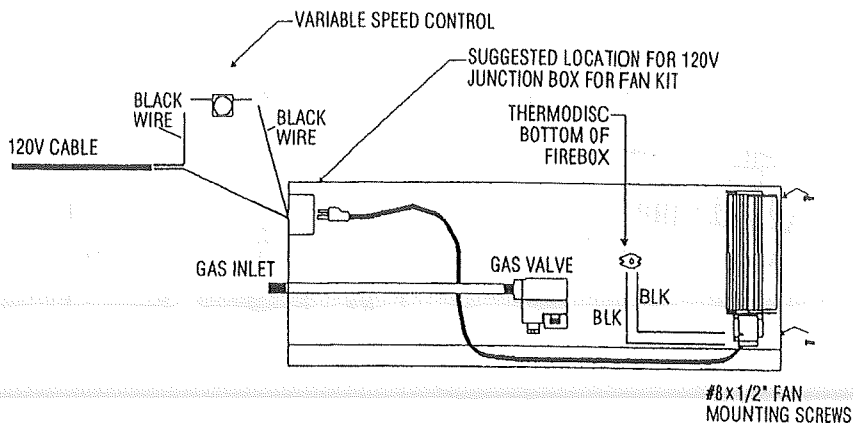

NEW STYLE

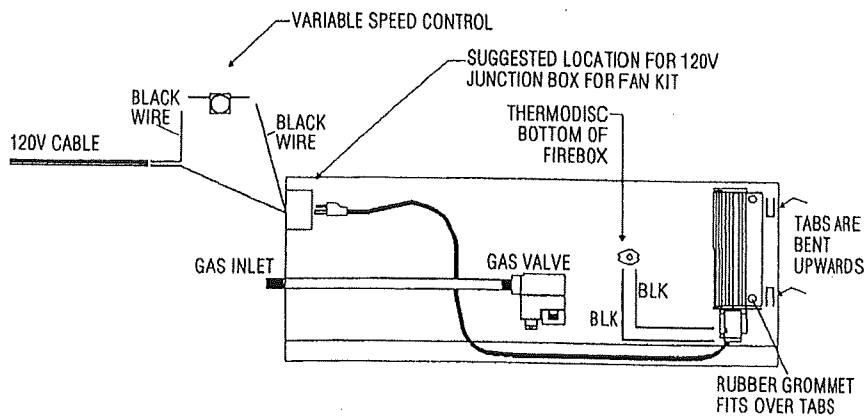


Electrical Services

All optional fan kits are equipped with a 120V, 60Hz blower.

Note: All electric connections are to be made in accordance with CSA Standard C22.1 - Canadian Electrical Code part I or with the National Electrical Code, ANSI/NFPA 70 (latest addition) and/or in accordance with local codes.

Caution: Should this fan require servicing, the power supply must be disconnected.

Vent Termination

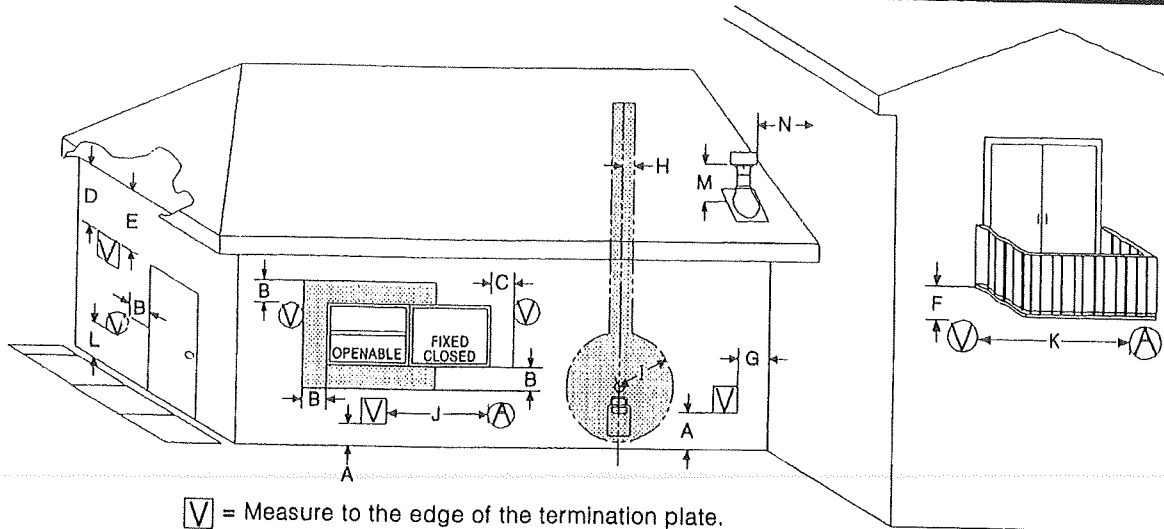

☐V = Measure to the edge of the termination plate.

⊙V = Measure to the edge of the round termination.

☐V Vent Terminal

⊙ Air Supply

☐ Area Where Terminal Not Permitted.

- A - Clearance above grade, veranda, porch, deck, or balcony 12 inches (30cm) minimum.^{1,2}
- B - Clearance to window or door that may be opened. 12 inches (30cm) minimum for appliances 100 000 Btuh (30 kW) and lower, in Canada. 9 inches, (23cm) for appliances 50 000 Btuh and lower, in USA.
- C - Clearance to permanently closed window minimum 12 inches (30cm) recommended to prevent condensation on window, in Canada. 9 inches, (23cm) for appliances 50 000 Btuh and lower, in USA.
- D - Vertical clearance to ventilated soffit located above the termination within a horizontal distance of 2 feet (60cm) from the center line of the termination. 18 inches (46cm) minimum.³
- E - Clearance to unventilated soffit 12 inches (30cm) minimum.
- F - Clearance under veranda, porch, deck or balcony 12 inches, (30cm) minimum.⁴ US,
- G - Clearance from a perpendicular inside wall or outer corner to the edge of the vent terminal plate is 3" (minimum).
- H - Clearance to each side of center line extended above meter/regulator assembly 3 feet (91cm) within a height 15 feet (4.5m) above the meter/regulator assembly.
- I - Clearance to service regulator vent outlet 3 feet (91cm) minimum.¹ US,
- J - Clearance to non-mechanical air supply inlet to building or the combustion air inlet to any other appliance: In Canada, 6 inches (15cm) for appliances ≤10,000 Btuh (3kW), 12 inches, (30cm) minimum for appliances >10,000 Btuh (3kW) and ≤100,000 Btuh (30kW), 36 inches (91cm) for appliances >100,000 Btuh (30kW). In the USA, 6 inches (15cm) for appliances ≤10,000 Btuh (3kW), 9 inches (23cm) for appliances >10,000 Btuh (3kW) and ≤50,000 Btuh (15kW), 12 inches (30cm) for appliances >50,000 Btuh (15kW).
- K - Clearance to a mechanical air supply inlet 6 feet (1.8m) minimum.¹, in Canada. In USA, 3 feet (91cm) above if within 10 feet, (3m) horizontally.
- L - Clearance above paved sidewalk or a paved driveway located on public property 7 feet (2.1m) minimum.³
- M - Clearance above highest point of exit on roof 18 inches (45cm).
- N - Clearance to perpendicular wall 24 inches (60 cm). (Recommended to prevent re-circulation of exhaust products. For additional requirements check local codes.)

NOTE: Clearances are to the edge of terminal plate, add 6-3/4" to clearances to arrive at center line.

NOTE: Local Codes or Regulations may require different clearances.

Termination

It is imperative that the vent termination be located observing the minimum clearances as shown. There must not be any obstruction such as bushes, garden sheds, fences, decks or utility buildings within 24" from the front of the termination plate.

Do not locate termination where excessive snow or ice build-up may occur. Be sure to check vent termination area after snow falls and clear to prevent accidental blockage of venting system. When using snow blowers, make sure snow is not directed towards vent termination area.

General Venting Information

The gas fireplace is approved to be vented either through the side wall or vertically through the roof.

This appliance is approved with Kingsman flex vent system and also approved for use with Simpson Duravent Direct Vent System (model DV-GS series), and AmeriVent Direct Vent Pipe System.

Kingsman flex vent system can be used with Simpson Duravent Direct Vent termination's (model DV-GS series).

When using Simpson Duravent or AmeriVent Direct Vent pipe a Kingsman/Duravent adapter must be used.

ONLY VENTING COMPONENTS SPECIFICALLY APPROVED AND LABELED FOR THIS FIREPLACE MAY BE USED.

Venting terminal shall not be recessed into a wall or siding.

<p>Minimum clearance to combustibles on venting</p> <p>Vertical 1" with Kingsman Vent System</p> <p>1 1/4" with Simpson Duravent Systems</p> <p>Top of Horizontal Pipe 1 1/2"</p> <p>Top of 90 degree bend in Minimum Enclosures of 50 1/2-56 1/2" is 2 1/2" with insulation Sleeve</p> <p>Top of 90 degree bend in enclosure over 56 1/2" -60" is 4 1/2" without insulation sleeve.</p> <p>Top of 90 degree bend in enclosures over 60" is 2 1/2" without insulation sleeve.</p> <p>See page 7 and 8.</p>
--

- 1 - In accordance with the current *CSA B149.1, Natural Gas and Propane Code.*
- 2 - In accordance with the current *ANSI Z223.1/NFPA 54, National Fuel Gas Code.*
- 3 - A vent shall not terminate directly above a sidewalk or paved driveway that is located between two single family dwellings and serves both dwellings.
- 4 - Permitted only if veranda, porch, deck, or balcony is fully open on a minimum of two sides beneath the floor.
- 5 - Clearance in accordance with local installation codes and the requirements of the gas supplier.

Venting Routes And Components

Since it is very important that the vent system maintain its balance between the combustion air intake and the flue gas exhaust, certain limitations as to vent configurations apply and must be strictly adhered to.

The table showing the relationship between vertical and horizontal side wall venting will help to determine the various vent lengths.

The maximum horizontal run with the 90 degree bend at the fireplace flue outlet is 4 ft/122cm (Figure #1). The maximum horizontal run is 20 ft (6.1 m) when the vertical run is 7 ft/2.1m (Figure #2). Note: 1/4" vertical rise is required for every 12" of horizontal run.

The maximum number of 45 degree bends per side wall installation is two (2) in the horizontal run and then you must reduce the length of the horizontal by 18 inches for each 45 degree bend.



The maximum vertical run is 40 ft/12.2 meters.

Special Note: For each 45 degree bend installed in the horizontal run, the length of the horizontal run must be reduced by 18" (45cm). This does not apply if the 45 degree bends are installed on the vertical part of the vent system.

Example: If according to the table, the length of the horizontal run is 10 feet, and two 45 degree bends are required, the horizontal run length must be reduced to 7 feet.

2 additional 90° bends or equals are allowed. The horizontal run must be reduced by 36" per each 90° bend, or 18" per each 45° bend.

Important: Always locate the fireplace in such a way that a minimum of offsets and/or horizontal runs are required. 1/4" vertical rise is required for every 12" horizontal run.

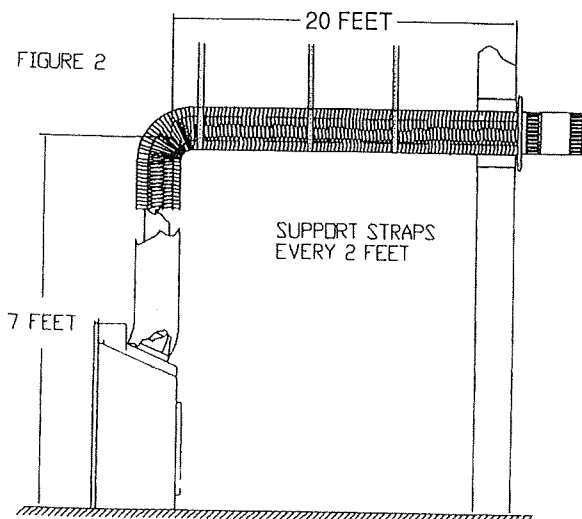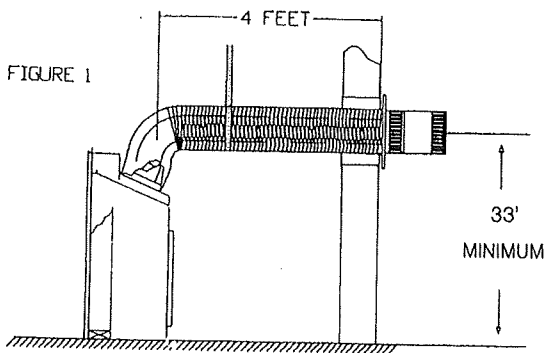

How To Use The Vent Table

1. Determine the height of the system and the number of bends required.
2. Having determined the vertical distance determine the maximum horizontal section allowed.
3. Vent table has been established for 90° horizontal/vertical runs. With use of flex pipe distance not having 90° bends will not fall into vent table standards. See Fig. B.


Venting Table From Bottom of Fireplace

for venting to a maximum of 40 ft. (12.2 meters)


Total Vertical		Max Total Horizontal	
Feet	Meters	Feet	Meters
4	1.2	5	1.5
5	1.5	8	2.4
6	1.8	12	3.7
7	2.1	20	6.1
8	2.4	20	6.1
9	2.7	20	6.1
10	3.0	20	6.1
11	3.4	20	6.1
12	3.7	20	6.1
13	4.0	20	6.1
14	4.3	20	6.1
15	4.6	20	6.1
16	4.9	20	6.1
17	5.2	20	6.1
18	5.5	20	6.1
19	5.8	20	6.1
20	6.1	20	6.1
25	7.5	15	4.6
30	9	10	3.0
40	12.2	0	0

Example A:

If the vertical dimension from the floor of the fireplace is 6ft, the horizontal run to the wall flange of the vent termination must not exceed 12ft.

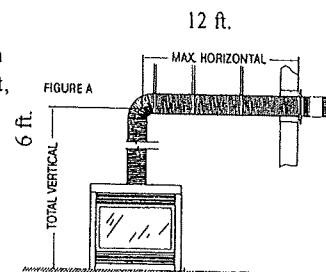

NOTE: The final location of the fireplace must be such that the horizontal vent dimensions fall within those stated on the graph. The Maximum Vertical vent run is 40ft. (12.2 meters).

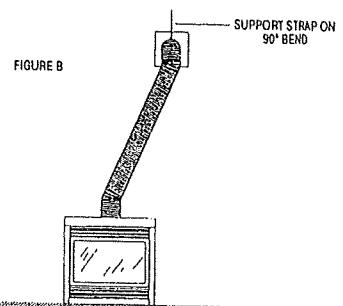

Important: Minimum clearance between vent pipes and combustible materials is 1 inch (25mm).

It is recommended for Propane Horizontal Installations that the venting should be a minimum of one foot vertical off the flue before the elbow on any horizontal runs of one foot or greater. This allows for cleaner combustion and greatly reduces carboning and cleaning of glass. (Does not apply to Back Flue Models).

General Vent Installation Information

This gas appliance is approved to be vented either through the side wall or vertically through the roof. Only Kingsman venting kits and components specifically approved and LABELED for this stove may be used. This appliance is also approved for use with Simpson-DuraVent Direct Vent system, Model DV-GS Series, and Ameri-Vent Direct Vent Pipe System.

SIMPSON DURAVENT OR AMERI-VENT

When using Simpson DuraVent or AmeriVent pipe a DuraVent adapter must be used (part # ZDVDFFA for fireplaces). Follow installation instructions provided by Simpson DuraVent for installation of pipe and adhere to the clearance to combustibles provided in this manual. Apply a bead of Mill Pac high temp sealant to all joints of pipes, adapters and termination as recommended.

Flex Pipe Venting

Flex pipe is shipped in unexpanded length. When installing pipe expand the lengths. Pipe can be expanded to twice their lengths e.g. 4ft. to 8ft. Fully expand pipe and cut off excess.

Do not use more than 2 couplers to extend short pipes. Single sections are preferred in an installation attaching at the fireplace and termination.

Place the spring spacers provided approximately every two feet to stabilize 4" flex in the center of 7" flex. When forming bends place spring in bend or before and after. (See Fig. 1).

Horizontal runs require support metal straps every 2 feet. In off set installation support straps should be used to stabilize pipe.

Expand 4" and 7" flex pipe to the point that the 7" protrudes approximately 2 to 3 inches past outer wall and the 4" flex protrudes approximately 2 to 3 inches past the 7" flex. See Fig. 1. Attach the 4" pipe to the termination first and secure with sealant and screws then attach the 7" flex to the termination with caulking and screws. Termination may then be moved back to the outer wall and attached to home screwing into the framing. Silicone around termination to waterproof. If siding shield is going to be used attach this using same attaching hole as the top of termination after termination has been caulked for water proofing.

Use Hi Temp Sealant

Apply a bead of mill pac high temp sealant to all joints and use four screws to secure each pipe at fireplace, termination and any joint if joining any sections of pipe.

FRAMING DIMENSION


Combustible Wall

Cut a 11" hole through exterior wall and frame as shown below.

Non combustible Wall

Cut or drill 8" or 204mm diameter hole.

FIGURE 1

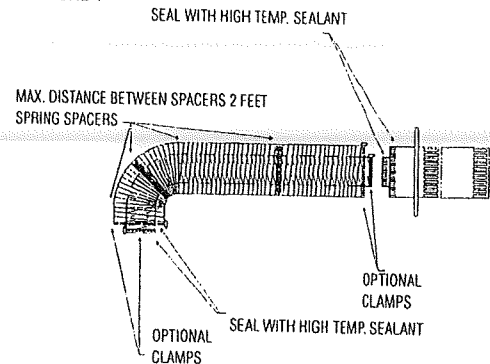

NOTE: It is critical to the proper and safe operation of this fireplace that on all connections the inner liner and the outer casing are both caulked with liberal amounts of sealant. Do not use any kind of tape or silicone other than that recommended in this manual. Mill Pac Sealant

Installation Of Side Wall Venting

1. The minimum distance from the bottom of fireplace to centre of vent is 32 inch (81 cm) (See Figure 1). Cut a hole through the wall allowing for a 11" x 11" (inside diameter) in combustible walls for wall thimble or an 8" diameter hole in a non-combustible wall (See Figure 2).
2. Note clearance to combustible above 90 degree bend in low profile enclosures 43" (inches) to 60" (inches) is 6" (inches) to the bend, in enclosures 60" (inches) and greater 2 1/2" (inches) to bend
3. Select the approximate vent length, precise measurements are not needed as your flex pipe can be expanded to twice its shipped length for ease of installation.
4. To install wall thimble centre over 11" x 11" (inch) framing from both sides of wall and secure. Route flex vent pipe through wall thimble (See Figure 1).
5. Before joining pipes, apply a bead of high temperature sealant (Mill Pac) to end of pipe. First attach the four inch (4") flue pipe to the vent termination with sealant, and secure with 4 screws provided. At this time make sure the spacer springs are attached to the (4") flex pipe as required. Then attach the seven inch (7") pipe by the same method.
6. Mount vent termination and seal to wall using caulking around the wall thimble to weather proof. After installing the vent termination, double check to make sure the pipe extends properly through wall thimble and into vent termination.
7. Before joining pipes to fireplace flue, apply a bead of high temperature sealant (Mill Pac) to end of pipe. First attach the four inch (4") flue pipe to fireplace with Mill Pac sealant to the flue pipe and secure with 4 screws provided. At this time verify that the spacer springs are attached properly to the (4") flex pipe as required. Then attach the seven inch (7") pipe by the same method.
8. Support horizontal pipes every two (2) feet (61 cm) with metal strap bands. Re-check fireplace to make sure it is levelled and properly positioned and secured.
9. Support vertical pipes to maintain a minimum of 1" or greater clearance to combustibles with metal strapping bands.

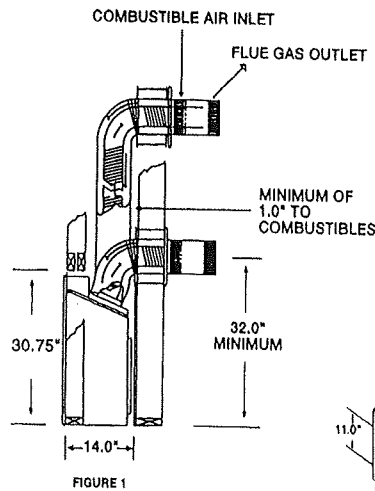


FIGURE 1

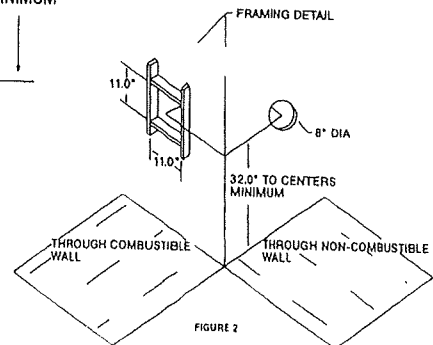


FIGURE 2

Note when using SIMPSON DURAVENT ADAPTER (ZDVDFFA) the fireplace clearances from the back standoff is one inch, thus increasing the framing depth to 15".

PLUMBING APPLICATION

Department of Health and Human Services
Division of Environmental Health

PROPERTY ADDRESS

Town or Plantation: Portland
 Street: 1815 Washington 708
 Subdivision Lot #: _____

PROPERTY OWNERS NAME

Last: Smith Farm LLC First: _____

Applicant Name: Darting Plumbing & Heating Inc

Mailing Address of Owner/Applicant (If Different): 27 Vantage Ave Portland ME 04103

Owner/Applicant Statement

I certify that the information submitted is correct to the best of my knowledge and understand that any falsification is reason for the Local Plumbing Inspectors to deny a Permit.

Signature of Owner/Applicant: _____ Date: 5-21-08

PORTLAND PERMIT # 10636 TOWN COPY
 Date Permit Issued: 5/21/08 \$ 1174 If Double Fee Charged
 L.P.I. # 3601
 Local Plumbing Inspector Signature: _____
2008 8139

Caution: Inspection Required

I have inspected the installation authorized above and found it to be in compliance with the Maine Plumbing Rules.

Local Plumbing Inspector Signature: _____ Date Approved: _____

PERMIT INFORMATION

This Application is for

- 1. NEW PLUMBING
- 2. RELOCATED PLUMBING

Type of Structure To Be Served:

- 1. SINGLE FAMILY DWELLING
- 2. MODULAR OR MOBILE HOME
- 3. MULTIPLE FAMILY DWELLING
- 4. OTHER - SPECIFY _____

Plumbing To Be Installed By:

- 1. MASTER PLUMBER
- 2. OIL BURNERMAN
- 3. MFG'D. HOUSING DEALER/MECHANIC
- 4. PUBLIC UTILITY EMPLOYEE
- 5. PROPERTY OWNER

LICENSE # 671601

Hook-Up & Piping Relocation Maximum of 1 Hook-Up	Column 2 Type of Fixture		Column 1 Type of Fixture	
	Number	Type of Fixture	Number	Type of Fixture
HOOK-UP: to public sewer in those cases where the connection is not regulated and inspected by the local Sanitary District. OR HOOK-UP: to an existing subsurface wastewater disposal system.	012	Hosebib / Sillcock	014	Bathtub (and Shower)
	01	Floor Drain	1	Shower (Separate)
OR PIPING RELOCATION: of sanitary lines, drains, and piping without new fixtures.	1	Urinal	012	Sink
	1	Drinking Fountain	016	Wash Basin
OR TRANSFER FEE [\$6.00]	1	Indirect Waste	016	Water Closet (Toilet)
	1	Water Treatment Softener, Filter, etc.	012	Clothes Washer
OR TRANSFER FEE [\$6.00]	1	Grease / Oil Separator	012	Dish Washer
	1	Roof Drain	012	Garbage Disposal
OR TRANSFER FEE [\$6.00]	1	Bidet	1	Laundry Tub
	1	Other: _____	012	Water Heater
	Fixtures (Subtotal) Column 2		216	Fixtures (Subtotal) Column 1
			12	Fixtures (Subtotal) Column 2
			28	Total Fixtures
				Fixture Fee
				Transfer Fee
				Hook-Up & Relocation Fee
			174	Permit Fee (Total)

SEE PERMIT FEE SCHEDULE FOR CALCULATING FEE

\$4940

174
10
184

PLUMBING APPLICATION

Department of Health and Human Services
Division of Environmental Health

PROPERTY ADDRESS

Town or Plantation: Portland
 Street: 1815 Washington Ave 3-14
 Subdivision Lot #:

PROPERTY OWNERS NAME

Last: Smith Farm LLC First:

Applicant Name: Dartny Plumbing & Heating Inc
 Mailing Address of Owner/Applicant (If Different): 27 Hannah Ave Portland, ME 04103

Owner/Applicant Statement

I certify that the information submitted is correct to the best of my knowledge and understand that any falsification is reason for the Local Plumbing Inspectors to deny a Permit.

Signature of Owner/Applicant: _____ Date: 5-21-08

372-A-20

PORTLAND PERMIT # 10637 TOWN COPY

Date Permit Issued: 5/21/08 \$ 174 If Double Fee Charged

Local Plumbing Inspector Signature: _____ L.P.I. # 360

2008 8190

Caution: Inspection Required

I have inspected the installation authorized above and found it to be in compliance with the Maine Plumbing Rules.

Local Plumbing Inspector Signature: _____ Date Approved: _____

PERMIT INFORMATION

This Application is for 1. <input checked="" type="checkbox"/> NEW PLUMBING 2. <input type="checkbox"/> RELOCATED PLUMBING	Type of Structure To Be Served: 1. <input type="checkbox"/> SINGLE FAMILY DWELLING 2. <input type="checkbox"/> MODULAR OR MOBILE HOME 3. <input checked="" type="checkbox"/> MULTIPLE FAMILY DWELLING 4. <input type="checkbox"/> OTHER - SPECIFY _____	Plumbing To Be Installed By: 1. <input checked="" type="checkbox"/> MASTER PLUMBER 2. <input type="checkbox"/> OIL BURNERMAN 3. <input type="checkbox"/> MFG'D. HOUSING DEALER/MECHANIC 4. <input type="checkbox"/> PUBLIC UTILITY EMPLOYEE 5. <input type="checkbox"/> PROPERTY OWNER LICENSE # <u>07160</u>
---	--	--

Hook-Up & Piping Relocation Maximum of 1 Hook-Up	Number	Column 2 Type of Fixture	Number	Column 1 Type of Fixture
<input type="checkbox"/> HOOK-UP: to public sewer in those cases where the connection is not regulated and inspected by the local Sanitary District. OR <input type="checkbox"/> HOOK-UP: to an existing subsurface wastewater disposal system.	<u>012</u>	Hosebib / Sillcock	<u>014</u>	Bathtub (and Shower)
		Floor Drain	<u>1</u>	Shower (Separate)
<input type="checkbox"/> PIPING RELOCATION: of sanitary lines, drains, and piping without new fixtures.		Urinal	<u>012</u>	Sink
		Drinking Fountain	<u>016</u>	Wash Basin
OR <input type="checkbox"/> TRANSFER FEE [\$6.00]		Indirect Waste	<u>016</u>	Water Closet (Toilet)
		Water Treatment Softener, Filter, etc.	<u>012</u>	Clothes Washer
		Grease / Oil Separator	<u>012</u>	Dish Washer
		Roof Drain	<u>012</u>	Garbage Disposal
		Bidet	<u>1</u>	Laundry Tub
		Other: _____	<u>012</u>	Water Heater
		Fixtures (Subtotal) Column 2	<u>216</u>	Fixtures (Subtotal) Column 1
			<u>12</u>	Fixtures (Subtotal) Column 2
			<u>28</u>	Total Fixtures
				Fixture Fee
				Transfer Fee
				Hook-Up & Relocation Fee
			<u>174</u>	Permit Fee (Total)

SEE PERMIT FEE SCHEDULE FOR CALCULATING FEE

4940

174
110
184

TO: Inspections Department

FROM: Philip DiPierro, Development Review Coordinator

DATE: October 29, 2008

RE: C. of O. for 1815 Washington Ave., Smith's Farm, Unit #8
(Id#2005-0133) (CBL 372 A 020001)

After visiting the site, I have the following comments:

Incomplete Site work will be finished as part of the overall subdivision development:

At this time, **I recommend issuing a permanent Certificate of Occupancy for Unit #8 only.**

Cc: Barbara Barhydt, Development Review Services Manager
Inspection Services Manager
File: Urban Insight

ELECTRICAL PERMIT

City of Portland, Me.



W/O 3442738

To the Chief Electrical Inspector, Portland Maine:
 The undersigned hereby applies for a permit to make electrical installations
 in accordance with the laws of Maine, the City of Portland Electrical Ordinance,
 National Electrical Code and the following specifications:

Date _____
 Permit # 2008 4461
 CBL# 372-A-20

LOCATION: 1815 Washington Ave #8 METER MAKE & # _____
 CMP ACCOUNT # 441-181-8232-001 OWNER David Construction
 TENANT _____ PHONE # _____

							TOTAL EACH FEE	
OUTLETS	50	Receptacles	30	Switches	4	Smoke Detector	.20	
FIXTURES	20	Incandescent	6	Fluorescent		Strips	.20	
SERVICES		Overhead	✓	Underground		TTL AMPS <u>100 Amp</u>	<800	15.00
		Overhead		Underground			>800	25.00
Temporary Service		Overhead		Underground		TTL AMPS		25.00
								25.00
METERS	/	(number of)						1.00
MOTORS		(number of)						2.00
RESID/COM		Electric units						1.00
HEATING		oil/gas units		Interior		Exterior		5.00
APPLIANCES	/	Ranges		Cook Tops		Wall Ovens		2.00
		Insta-Hot		Water heaters	2	Fans		2.00
	/	Dryers	/	Disposals	/	Dishwasher		2.00
		Compactors		Spa	/	Washing Machine		2.00
		Others (denote)						2.00
MISC. (number of)		Air Cond/win						3.00
		Air Cond/cent				Pools		10.00
		HVAC		EMS		Thermostat		5.00
		Signs						10.00
		Alarms/res						5.00
		Alarms/com						15.00
		Heavy Duty(CRKT)						2.00
		Circus/Carnv						25.00
		Alterations						5.00
		Fire Repairs						15.00
		E Lights						1.00
		E Generators						20.00
	PANELS	/	Service	/	Remote		Main	
TRANSFORMER		0-25 Kva						5.00
		25-200 Kva						8.00
		Over 200 Kva						10.00
							TOTAL AMOUNT DUE	
MINIMUM FEE/COMMERCIAL 55.00							MINIMUM FEE	45.00

CONTRACTORS NAME T.A. Napolitano MASTER LIC. # 7765
 ADDRESS PO Box 2301 50 Port Me LIMITED LIC. # _____
 TELEPHONE 799-0538

SIGNATURE OF CONTRACTOR [Signature]

*City of Portland, Maine
Inspections Division
Inspection Schedule by Date*

*2112-818
for*

Appointment Date Between 1/1/2006 And 10/31/2008

Time	Inspector	Type	Address	Contact	Census Parcel/AppID	Phone	
Date 11/09/2006							
6:00 AM	Chris Hanson	Footings/Setbacks	Prmt	1815 WASHINGTON AVE	372 A020001		
Comments: 899-5985 Lou Inspected Footings 11/20 poured CSH will send letter from surveyor					AppID: 61477	Status:	Score:
Outcome:							
Date 11/20/2006							
	Chris Hanson	Foundation/Backfill	Prmt	1815 WASHINGTON AVE	372 A020001		
Comments: Call Gary Smith @ 776-3627 slabs, needs insulation inspected Footings 1+2 5=6 walls 1=2 4 =5 Backfill 5=6					AppID: 61477	Status:	Score:
Outcome:							
Date 11/27/2006							
	Chris Hanson	Inspection	Prmt	1815 WASHINGTON AVE	372 A020001		
Comments: Footings for unit 3+4					AppID: 61477	Status:	Score:
Outcome:							
	Chris Hanson	Footings/Setbacks	Prmt	1815 WASHINGTON AVE	372 A020001		
Comments: Req around noon Call Lou @ 899-5985					AppID: 61477	Status:	Score:
Outcome:							
Date 11/28/2006							
2:00 PM	Chris Hanson	Plumbing Only	Plumb	1815 WASHINGTON AVE	372 A020001		
Comments: Underground plumbing Timothy 329-6186 Unit 5/6 Pressure test to be on by 1:00pm Water test OK to Pour Units 1+2 walls ok to pour					AppID: 20068423	Status:	Score:
Outcome:							
Date 11/30/2006							
8:00 AM	Chris Hanson	Plumbing Only	Prmt	1815 WASHINGTON AVE	372 A020001		
Comments: Under slab plumbing Ken Austin 776-9184 Unit 5+6 Plumbing under slab ok to pour and backfill unit 3+4 CSH 11/30					AppID: 61477	Status:	Score:
Outcome:							
Date 12/04/2006							

City of Portland, Maine
Inspections Division
Inspection Schedule by Date

Appointment Date Between 1/1/2006 And 10/31/2008

Time	Inspector	Type	Address	Contact	Census Parcel/AppID	Phone	
	Chris Hanson	Foundation/Backfill	Prmt 1815 WASHINGTON AVE		372 A020001		
Comments: OK to backfill insulation and walls plumbing not ready CSH 12/04/2006					AppID: 61477	Status:	Score:
Outcome:							
Date 12/05/2006							
	Chris Hanson	Plumbing Only	Prmt 1815 WASHINGTON AVE		372 A020001		
Comments: under slab per concrete placement 776-9814					AppID: 61477	Status:	Score:
Outcome:							
Date 01/05/2007							
	Tom Markley	Electrical Service	ElcPe 1815 WASHINGTON AVE		372 A020001		
Comments: Call Tim 831-1031 req. earliest possible appt.					AppID: 20074019	Status:	Score:
Outcome:							
Date 01/10/2007							
6:00 AM	Chris Hanson	Close-in/Elec./Plmb./Framing	Prmt 1815 WASHINGTON AVE		372 A020001		
Comments: Tim Napolitano 831-1031 UNIT #6 NOT READY FOR CLOSE-IN CSH 1/10/07					AppID: 61477	Status:	Score:
Outcome:							
Date 01/11/2007							
6:00 AM	Chris Hanson	Close-in/Elec./Plmb./Framing	Prmt 1815 WASHINGTON AVE		372 A020001		
Comments: Tim Napolitano 831-1031 UNIT #5 called davis construction about inspection scheduling CSH 1/11/07 Unit 36 OK to close MUST LOWER EGRESS WINDOW IN 1ST FLOOR BEDROOM TO 44"CSH 1/11/2007 Unit #5 not ready for inspection!					AppID: 61477	Status:	Score:
Outcome:							
6:00 AM	Jon Rioux	Close-in/Elec./Plmb./Framing	Prmt 1815 WASHINGTON AVE		372 A020001		
Comments: Tim Napolitano 831-1031 UNIT #5 called davis construction about inspection scheduling CSH 1/11/07 Unit 36 OK to close MUST LOWER EGRESS WINDOW IN 1ST FLOOR BEDROOM TO 44"CSH 1/11/2007 Unit #5 not ready for inspection!					AppID: 61477	Status:	Score:
Outcome:							
Date 01/12/2007							

**City of Portland, Maine
Inspections Division
Inspection Schedule by Date**

Appointment Date Between 1/1/2006 And 10/31/2008

Time	Inspector	Type	Address	Contact	Census Parcel/AppID	Phone	
2:00 PM	Tom Markley	Close-in/Elec./Plmb./Framing Prmt	1815 WASHINGTON AVE		372 A020001		
Comments: close-in for unit 5 only plumbing and electrical ok can close in unit					AppID: 0	Status:	Score:
Outcome:							
Date 01/23/2007							
6:00 AM	Tom Markley	Electrical Only	1815 WASHINGTON AVE		372 A020001		
Comments: Tim 7990538					AppID: 20074064	Status:	Score:
Outcome:							
Date 04/19/2007							
6:00 AM	Chris Hanson	Certificate of Occupancy/Final Prmt	1815 WASHINGTON AVE		372 A020001		
Comments: 899-5985 Lou Units 5 & 6 OK TO ISSUE					AppID: 61477	Status:	Score:
Outcome:							
Date 05/18/2007							
	Chris Hanson	Close-in/Elec./Plmb./Framing Prmt	1815 WASHINGTON AVE		372 A020001		
Comments: Call Lou @ 899-5985 req afternoon insp. Units 3+4 OK to close in plumbing tests 5# and 75# Final on unit 5+6 OK need letter from Phil D					AppID: 61477	Status:	Score:
Outcome:							
Date 06/18/2007							
11:30 AM	Michael Collins	Electrical Service	1815 WASHINGTON AVE	Tim A. Napolitano	372 A020001	(207) 799-0538	
Comments: Tim 799-0538					AppID: 20074064	Status:	Score:
Outcome:							
11:30 AM	Michael Collins	Electrical Service	1815 WASHINGTON AVE	Tim A. Napolitano	372 A020001	(207) 799-0538	
Comments: 799-0538 Tim					AppID: 20074063	Status:	Score:
Outcome:							
Date 09/14/2007							

City of Portland, Maine
Inspections Division
Inspection Schedule by Date

Appointment Date Between 1/1/2006 And 10/31/2008

Time	Inspector	Type	Address	Contact	Census Parcel/AppID	Phone	
	Tammy Munson	Certificate of Occupancy/Final Prmt	1815 WASHINGTON AVE		372 A020001		
Comments:	UNITS 3,4,5 & 6 C of O Call Lou @ 899-5985. TWO FAMILY DWELLING UNITS. NO BEAR REQUIRED.				AppID: 61477	Status:	Score:
Outcome:							
Date 01/30/2008							
6:00 AM	Chris Hanson	Close-in/Elec./Plmb./Framing Prmt	1815 WASHINGTON AVE		372 A020001		
Comments:	Lou 899-5985				AppID: 61477	Status:	Score:
Outcome:							
Date 02/01/2008							
6:00 AM	Chris Hanson	Close-in/Elec./Plmb./Framing Prmt	1815 WASHINGTON AVE		372 A020001		
Comments:	ok TO CLOSE-IN				AppID: 61477	Status:	Score:
Outcome:							
Date 02/08/2008							
	Chris Hanson	Close-in/Elec./Plmb./Framing Prmt	1815 WASHINGTON AVE		372 A020001		
Comments:	Lous 899-5985				AppID: 61477	Status:	Score:
Outcome:							
	Jon Rioux	Close-in/Elec./Plmb./Framing Prmt	1815 WASHINGTON AVE		372 A020001		
Comments:	Lous 899-5985				AppID: 61477	Status:	Score:
Outcome:							
Date 03/26/2008							
6:00 AM	Tammy Munson	Certificate of Occupancy/Final Prmt	1815 WASHINGTON AVE		372 A020001		
Comments:	899-5985 Lou UNIT #1 ONLY				AppID: 61477	Status:	Score:
Outcome:							
Date 03/27/2008							
6:00 AM	Tom Markley	Certificate of Occupancy/Final Prmt	1815 WASHINGTON AVE		372 A020001		
Comments:	899-5985 Lou UNIT #1 ONLY - follow up - please check for hammer arrester and plug for garbage disposal				AppID: 61477	Status:	Score:
Outcome:							

City of Portland, Maine
Inspections Division
Inspection Schedule by Date

Appointment Date Between 1/1/2006 And 10/31/2008

Time	Inspector	Type		Address	Contact	Census Parcel/AppID	Phone		
Date 04/25/2008									
	Tom Markley	Certificate of Occupancy/Final	Prmt	23 SMITH FARM LN		372 A020001			
Comments:	Unit #2, Closing is Wednesday 30th will need C of O at closing. Request AM. Lou Tirado 899-5985					AppID:	61477	Status:	Score:
Outcome:									
6:00 AM	Tom Markley	Footings/Setbacks	Prmt	1815 WASHINGTON AVE	Davis Construction	372 A020001	(207) 799-1936		
Comments:	756-0637 Fred - Units 15 & 16					AppID:	61477	Status:	Score:
Outcome:									
Date 04/30/2008									
	Tom Markley	Footings/Setbacks	Prmt	23 SMITH FARM LN		372 A020001			
Comments:	Unit 9 and 10. Lou 899-5985					AppID:	61477	Status:	Score:
Outcome:									
Date 05/07/2008									
6:00 AM	Tom Markley	Footings/Setbacks	Prmt	23 SMITH FARM LN		372 A020001			
Comments:	Units 7 & 8 - 899-5985 Lou					AppID:	61477	Status:	Score:
Outcome:									
Date 05/12/2008									
6:00 AM	Tom Markley	Plumbing Only	Plumb	23 SMITH FARM LN		372 A020001			
Comments:	Underground Units 15 & 16 329-1686 Timothy					AppID:	20088129	Status:	Score:
Outcome:									
Date 05/22/2008									
6:00 AM	Tom Markley	Plumbing Only	Plumb	23 SMITH FARM LN		372 A020001			
Comments:	Sub slab 329-6186 Timothy					AppID:	20088139	Status:	Score:
Outcome:									
Date 05/23/2008									

City of Portland, Maine
Inspections Division
Inspection Schedule by Date

Appointment Date Between 1/1/2006 And 10/31/2008

Time	Inspector	Type		Address	Contact	Census Parcel/AppID	Phone		
6:00 AM	Tom Markley	Plumbing Only	Plumb	23 SMITH FARM LN		372 A020001			
Comments: Sub slab 329-6186 Timothy						AppID: 20088140	Status:	Score:	
Outcome:									
Date 05/28/2008									
6:00 AM	Tom Markley	Plumbing Only	Plumb	23 SMITH FARM LN		372 A020001			
Comments: Sub slab - Timothy 329-6186						AppID: 20088143	Status:	Score:	
Outcome:									
Date 06/17/2008									
	Tammy Munson	Foundation/Rebar	Prmt	23 SMITH FARM LN		372 A020001			
Comments: Foundation inspection for units 7 through 14. Carlos or Lou - 899-5985						AppID: 61477	Status:	Score:	
Outcome:									
Date 06/26/2008									
6:00 AM	Tom Markley	Close-in/Elec./Plmb./Framing	Prmt	23 SMITH FARM LN		372 A020001			
Comments: 939-1213 Carlos Unit 15						AppID: 61477	Status:	Score:	
Outcome:									
Date 07/10/2008									
	Chris Hanson	Inspection	Prmt	23 SMITH FARM LN		372 A020001			
Comments: Meter inspection OK #15&16 Unit 16 needs some framing issues corrected and fire rate behind ref supply box--party wall--deck on rear needs frost protection --protect h2o line and wire in kitchen prior to pouring concrete.						AppID: 61477	Status:	Score:	
Outcome:									
6:00 AM	Chris Hanson	Close-in/Elec./Plmb./Framing	Prmt	23 SMITH FARM LN		372 A020001			
Comments: Unit 16 Close in Tim 799-0538						AppID: 61477	Status:	Score:	
Outcome:									
6:00 AM	Chris Hanson	Electrical Service	ElcPe	23 SMITH FARM LN		372 A020001			
Comments: Unit 16 OK to call-in						AppID: 20084412	Status:	Score:	
Outcome:									

**City of Portland, Maine
Inspections Division
Inspection Schedule by Date**

Appointment Date Between 1/1/2006 And 10/31/2008

Time	Inspector	Type		Address	Contact	Census Parcel/AppID	Phone		
6:00 AM	Chris Hanson	Electrical Service	ElcPe	23 SMITH FARM LN		372 A020001			
Comments: Tim 799-0538 unit15 ok CALLED -IN						AppID: 20084411	Status:	Score:	
Outcome:									
Date 07/14/2008									
	Chris Hanson	Close-in/Elec./Plmb./Framing	Prmt	23 SMITH FARM LN		372 A020001			
Comments: close-in for unit#16, Lou 899-5985 OK to close-in CSH						AppID: 61477	Status:	Score:	
Outcome:									
Date 07/16/2008									
6:00 AM	Chris Hanson	Electrical Service	ElcPe	23 SMITH FARM LN		372 A020001			
Comments: Units 12, 11, 16. 15, 8, 7 Tim 831-1031 OK Called lannie to call in						AppID: 20084465	Status:	Score:	
Outcome:									
Date 07/29/2008									
	Chris Hanson	Electrical Only	ElcPe	23 SMITH FARM LN		372 A020001			
Comments: Scott 318-7957 Panel						AppID: 20084465	Status:	Score:	
Outcome:									
	Chris Hanson	Electrical Only	ElcPe	23 SMITH FARM LN		372 A020001			
Comments: Scott 318-7957 panel						AppID: 20084467	Status:	Score:	
Outcome:									
Date 07/30/2008									
	Chris Hanson	Electrical Only	ElcPe	23 SMITH FARM LN		372 A020001			
Comments: Scott 318-7957						AppID: 20084411	Status:	Score:	
Outcome:									
Date 08/07/2008									
	Chris Hanson	Close-in/Elec./Plmb./Framing	Prmt	23 SMITH FARM LN		372 A020001			
Comments: Rough-in for Unit#7 and #11.						AppID: 61477	Status:	Score:	
Outcome:									

City of Portland, Maine
Inspections Division
Inspection Schedule by Date

Appointment Date Between 1/1/2006 And 10/31/2008

Time	Inspector	Type		Address	Contact	Census Parcel/AppID	Phone
Date 08/12/2008							
2:00 PM	Chris Hanson	Close-in/Elec./Plmb./Framing	Prmt	23 SMITH FARM LN		372 A020001	
Comments: UNITS 7 8 & 11						AppID: 61477	Status:
Outcome:						Score:	
Date 08/14/2008							
6:00 AM	Tom Markley	Certificate of Occupancy/Final	Prmt	23 SMITH FARM LN		372 A020001	
Comments: C of O unit 15 Not ready issue w/ guard rail fixtures not set site work not ready						AppID: 61477	Status:
Outcome:						Score:	
6:00 AM	Tom Markley	Close-in/Elec./Plmb./Framing	Prmt	23 SMITH FARM LN		372 A020001	
Comments: UNIT #8						AppID: 61477	Status:
Outcome:						Score:	
6:00 AM	Chris Hanson	Certificate of Occupancy/Final	Prmt	23 SMITH FARM LN		372 A020001	
Comments: C of O unit 15 Not ready issue w/ guard rail fixtures not set site work not ready						AppID: 61477	Status:
Outcome:						Score:	
6:00 AM	Chris Hanson	Close-in/Elec./Plmb./Framing	Prmt	23 SMITH FARM LN		372 A020001	
Comments: UNIT #8						AppID: 61477	Status:
Outcome:						Score:	
Date 08/19/2008							
6:00 AM	Chris Hanson	Plumbing Only	Plumb	23 SMITH FARM LN		372 A020001	
Comments: 329-6186 Tim						AppID: 20088139	Status:
Outcome:						Score:	
6:00 AM	Chris Hanson	Electrical Service	ElcPe	23 SMITH FARM LN		372 A020001	
Comments:						AppID: 20084464	Status:
Outcome:						Score:	
Date 08/20/2008							

**City of Portland, Maine
Inspections Division
Inspection Schedule by Date**

Appointment Date Between 1/1/2006 And 10/31/2008

Time	Inspector	Type	Address	Contact	Census Parcel/AppID	Phone	
	Chris Hanson	Certificate of Occupancy/Final Prmt	23 SMITH FARM LN		372 A020001		
Comments: Unit 15 final Not ready					AppID: 61477	Status:	Score:
Outcome:							
Date 08/21/2008							
9:30 AM	Chris Hanson	Certificate of Occupancy/Final Prmt	23 SMITH FARM LN		372 A020001		
Comments: unit 15 OK to issue					AppID: 61477	Status:	Score:
Outcome:							
Date 09/03/2008							
2:30 PM	Chris Hanson	Close-in/Elec./Plmb./Framing Prmt	23 SMITH FARM LN		372 A020001		
Comments: Tim Flarety 671 3682					AppID:	Status:	Score:
Outcome:							
Date 09/05/2008							
	Chris Hanson	Certificate of Occupancy/Final Prmt	23 SMITH FARM LN		372 A020001		
Comments: Final for Unit 16, Tim 671-3682. Not ready---- site work ----driveway Need sign off from phil					AppID: 61477	Status:	Score:
Outcome:							
Date 09/09/2008							
2:30 PM	Chris Hanson	Certificate of Occupancy/Final Prmt	23 SMITH FARM LN		372 A020001		
Comments: Tim Flarety 671-3682 Unit 16 OK to issue W/ cond about site work till 10/01/08					AppID: 61477	Status:	Score:
Outcome:							
Date 09/18/2008							
1:30 PM	Michael Collins	Electrical Service	ElcPe	23 SMITH FARM LN	372 A020001		
Comments: Maggie 799-0538					AppID: 20084463	Status:	Score:
Outcome:							
1:30 PM	Michael Collins	Electrical Service	ElcPe	23 SMITH FARM LN	372 A020001		
Comments: Maggie 799-0538					AppID: 20084458	Status:	Score:
Outcome:							

City of Portland, Maine
Inspections Division
Inspection Schedule by Date

Appointment Date Between 1/1/2006 And 10/31/2008

Time	Inspector	Type		Address	Contact	Census Parcel/AppID	Phone
1:30 PM	Michael Collins	Electrical Service	ElcPe	23 SMITH FARM LN		372 A020001	
Comments: Maggie 799-0538						AppID: 20084460	Status:
Outcome:						Score:	
1:30 PM	Michael Collins	Electrical Service	ElcPe	23 SMITH FARM LN		372 A020001	
Comments: Maggie 799-0538						AppID: 20084459	Status:
Outcome:						Score:	
1:30 PM	Michael Collins	Electrical Service	ElcPe	23 SMITH FARM LN		372 A020001	
Comments: Service - Maggie 207-799-0538						AppID: 20084466	Status:
Outcome:						Score:	
1:30 PM	Michael Collins	Electrical Service	ElcPe	23 SMITH FARM LN		372 A020001	
Comments: Maggie 799-0538						AppID: 20084464	Status:
Outcome:						Score:	
Date 09/19/2008							
	Chris Hanson	Close-in/Elec./Plmb./Framing	Prmt	23 SMITH FARM LN		372 A020001	
Comments: Tim - Rough-in. Unir 12. 671-3681						AppID: 61477	Status:
Outcome:						Score:	
Date 09/26/2008							
6:00 AM	Mike Menario	Certificate of Occupancy/Final	Prmt	23 SMITH FARM LN		372 A020001	
Comments: Unit #7 671-3682 Tim						AppID: 61477	Status:
Outcome:						Score:	
Date 10/21/2008							
	Tammy Munson	Certificate of Occupancy/Final	Prmt	23 SMITH FARM LN		372 A020001	
Comments: C of O Tim - 232-0157						AppID: 61477	Status:
Outcome:						Score:	

City of Portland, Maine
Inspections Division
Inspection Schedule by Date

Appointment Date Between 1/1/2006 And 10/31/2008

Time	Inspector	Type	Address	Contact	Census Parcel/AppID	Phone			
6:00 AM	Tammy Munson	Certificate of Occupancy/Final Prmt	23 SMITH FARM LN		372 A020001				
Comments: follow up on c of o - not ready this am Tim @ 671-3682					AppID: 61477		Status:		Score:
Outcome:									
Date 10/23/2008									
	Chris Hanson	Certificate of Occupancy/Final Prmt	23 SMITH FARM LN		372 A020001				
Comments: Unit 13 Tim 671-3682 C of O Not ready moved to 10/24/2008					AppID: 61477		Status:		Score:
Outcome:									
Date 10/24/2008									
	Chris Hanson	Certificate of Occupancy/Final Prmt	23 SMITH FARM LN		372 A020001				
Comments: Unit # 8, Tim Flaherty 671-3682					AppID: 61477		Status:		Score:
Outcome:									
Date 10/27/2008									
	Chris Hanson	Inspection Prmt	23 SMITH FARM LN		372 A020001				
Comments: Unit 8 Cof O Tim F 671-3682 Needs to change winder stair to meet 7 3/4 " max rise and add handrail also need phil to sign off CSH					AppID: 61477		Status:		Score:
Outcome:									

Appointments Reported: 70