JOB NO	MODEL NUMBER	DRAWN BY	SCHEMATIC TYPE
1986426	SC-211110FP		INSTALL
	JOB NAME: First Lutheran Church	DATE: 3/3/2014	DWG NO: ECP #1-1

DESCRIPTION OF OPERATION:
220V 1 Phase w/ 1 Exhaust Fan, 1 Supply Fan, Exhaust on in Fire, Lights out in Fire, Fan(s) On/Off Thermostatically Controlled. Room temperature sensor shipped loose for field installation.

BREAKER PANEL TO HOOD CONTROL PANEL

Responsibility: Electrician

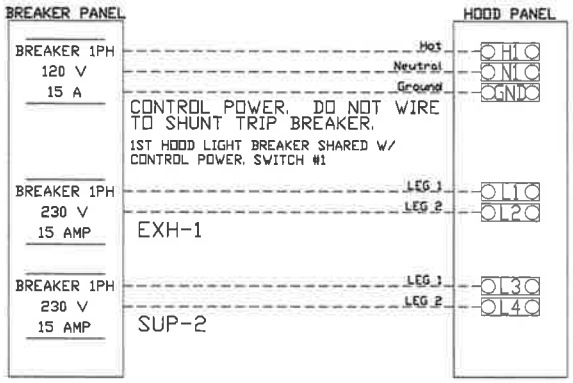

HOOD CONTROL PANEL TO FANS / MUA

Responsibility: Electrician

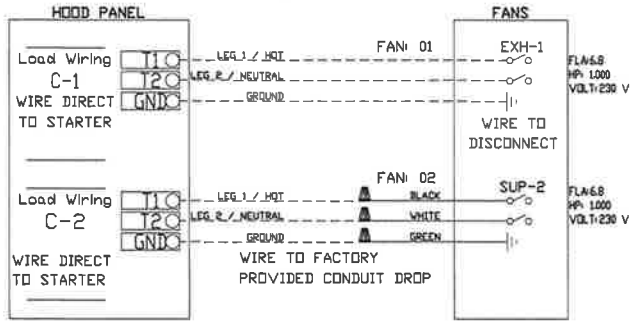

HOOD CONTROL PANEL TO ACCESSORY ITEMS

Responsibility: Electrician

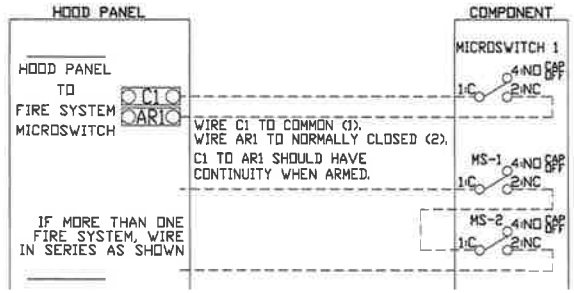

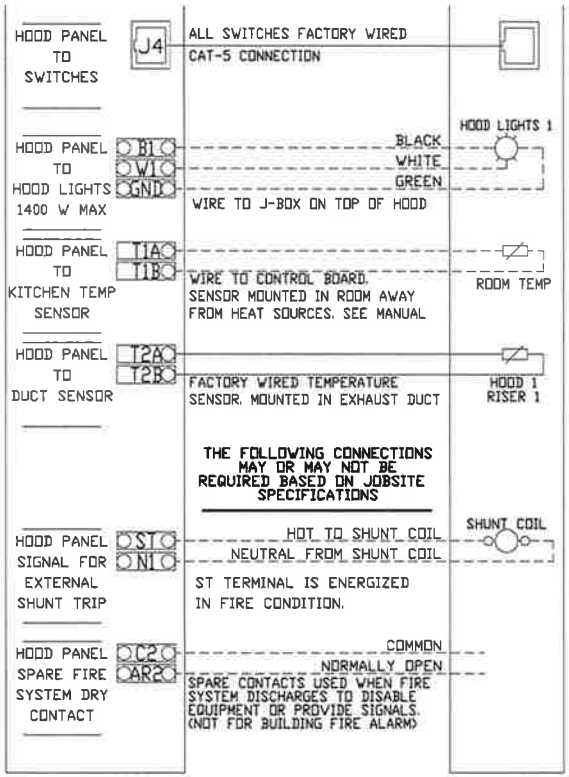

First Lutheran Church Page 14 Electrical