BENNETT ENGINEERING MECHANICAL • ELECTRICAL (207) 865-9475

DIC


WHIPPLE

CALLENDER

ARCHITECTS

PORTLAND, ME 04103 P 207.775.2696 F 207.775.3631 www.whipplecallender.com

- SELF CONTAINED EMERGENCY LIGHT W/2 HEADS DUAL-LITE (LED) MODEL LZ25-03L, 25 WATTS FOR 90 MINUTES, COLOR BY ARCHITECT
- EXTERIOR REMOTE HEAD DUAL-LITE (LED) MODEL No OCRD 1203L COLOR BY ARCHITECT
- INTERIOR REMOTE HEAD DUAL-LITE (LED) MODEL LZR-S-x-03L COLOR BY ARCHITECT
- EXIT LIGHT FIXTURE, UNSWITCHED, DUAL-LITE LX-U-R-W-E OR APPROVED EQUAL
- EXIT/ EMERGENCY LIGHT COMBO, DUAL-LITE No EVCU-R-D4-IOR APPROVED EQUAL COLOR BY ARCHITECT
- FACE FIRE ALARM CONTROL PANEL WITH DEDICATED TELEPHONE JACK ANN FIRE ALARM ANNUNCIATOR PANEL
- FIRE DEPARTMENT KNOX BOX, COORDINATE LOCATION WITH LOCAL FIRE DEPARTMENT
- FIRE ALARM AUDIO/VISUAL, MOUNT 6'-8"AFF, NUMBER DENOTES CANDELA RATING. "MH" DENOTES MINIHORN, "CL" DENOTES CEILING MOUNTED. NO DESIGNATION EQUALS 75cd
- F FIRE ALARM PULL STATION, MOUNT 48"AFF
- 15 SD FIRE ALARM VISUAL STROBE ONLY, FLUSH MOUNT 6'-8" AFF, NUMBER DENOTES CANDELA RATINGS. "CL" DENOTES CEILING MOUNTED
- 135° SYSTEM CONNECTED FIXED TEMPERATURE HEAT DETECTOR
- SMOKE DETECTOR, PHOTOELECTRIC TYPE, SYSTEM CONNECTED.
- SMOKE DETECTOR, PHOTOELECTRIC TYPE, SYSTEM CONNECTED. "ER" DENOTES ELEVATOR RECALL
- P SPRINKLER SYSTEM FLOW SWITCH SUPPLIED BY SPRINKLER CONTRACTOR WIRED BY EC, VERIFY LOCATIONS WITH
- ☐ SPRINKLER SYSTEM TAMPER SWITCH SPRINKLER CONTRACTOR.

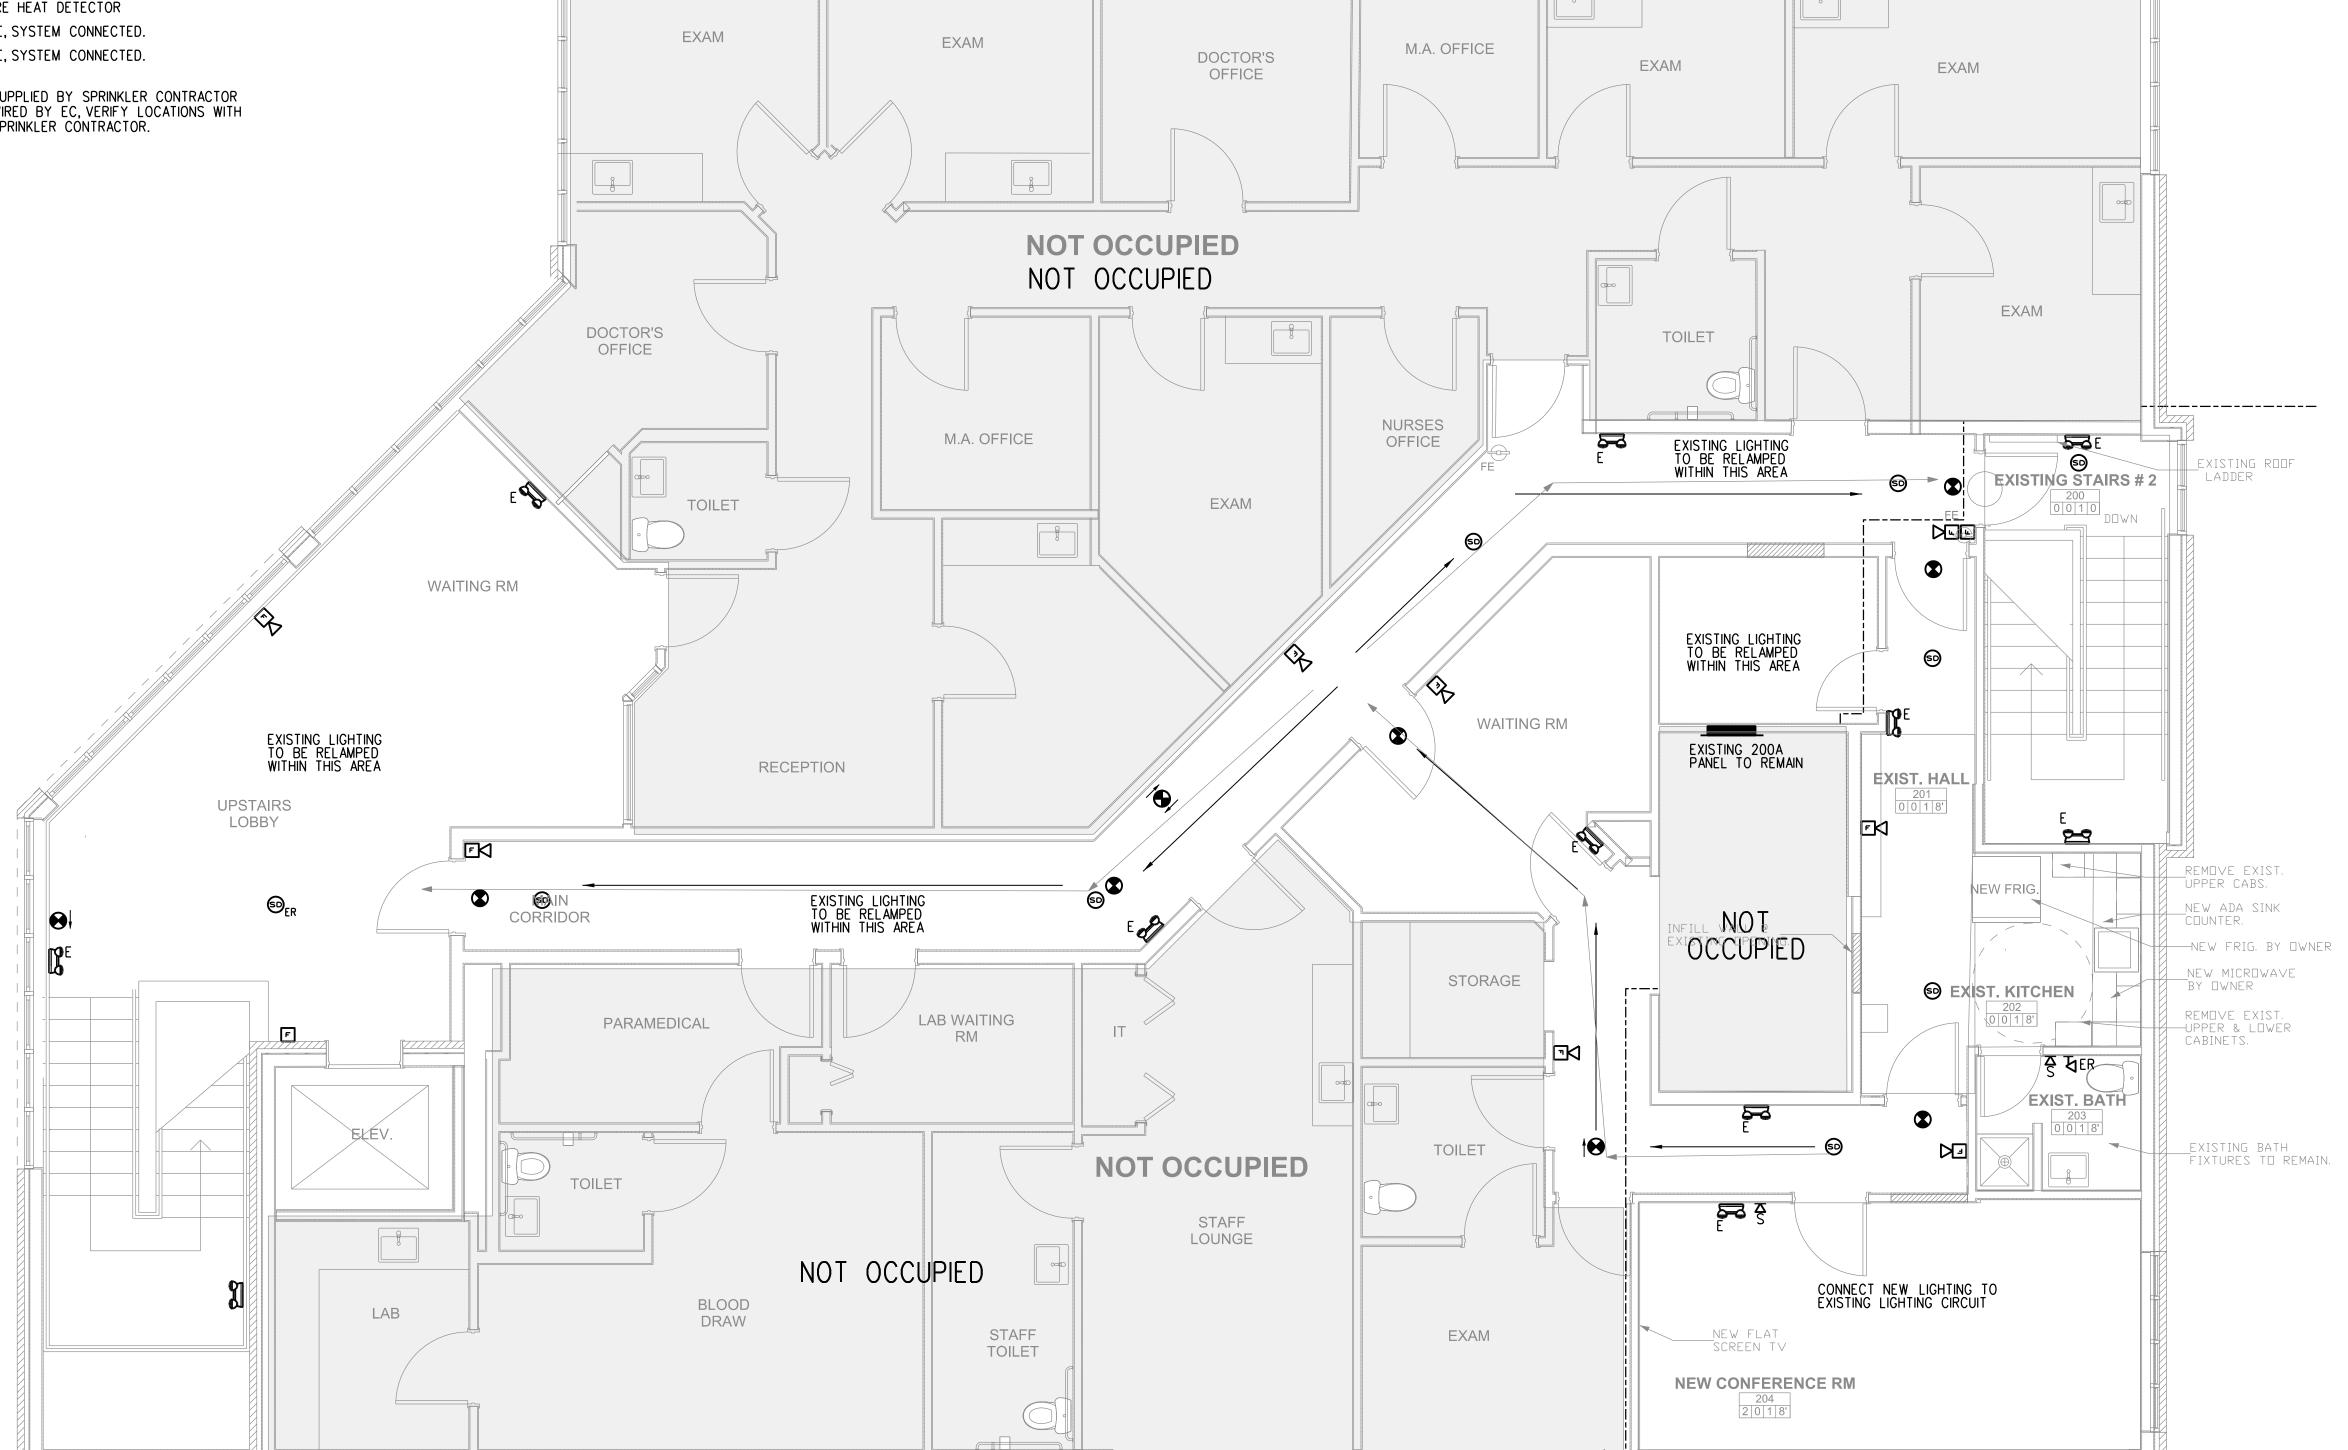

PLAN

ISSUED FOR PERMIT 3-6-2017 REVISED 4-13-2017

LS2.2

4/13/17

LAZ

PMC

SECOND FLOOR LIFE SAFETY

#Pln

SECOND FLOOR LIFE SAFETY PLAN SCALE: 1/4'' = 1'-0''