


- NOTES:
- EXACT MOUNTING DETAILS TO BE DETERMINED AT JOBSITE BY OTHERS.
 - CALCULATIONS MAY SHOW THE EFFECT OF SHADOWING CAUSED BY BUILDINGS AND OBJECTS WITHIN THE CALCULATED SPACE OR IN THE SITE AREA.
 - READINGS SHOWN ARE INITIAL HORIZONTAL FOOTCANDLES ON A FLAT SITE UNLESS OTHERWISE INDICATED.
 - THIS CALCULATION IS BASED ON LIMITED INFORMATION SUPPLIED BY OTHERS TO SWANEY LIGHTING ASSOCIATES AND STANDARD ASSUMPTIONS OF THE SPACE AND/OR SITE.
 - CONFORMANCE TO CODES AND OTHER LOCAL REQUIREMENTS AS DETERMINED BY THE AHJ ARE THE RESPONSIBILITY OF THE OWNER AND/OR THE OWNER'S REPRESENTATIVE.
 - THIS LAYOUT DRAWING MUST BE COORDINATED WITH THE SITE LOCATION FOR CORRECT FIXTURE ORIENTATION.
 - CHECK GRAPHIC SCALE. DOCUMENTS PRINTED OR PLOTTED FROM ELECTRONIC FILES MAY OCCUR AT OTHER THAN THE DESIRED OR ASSUMED GRAPHIC SCALES. IT IS THE RESPONSIBILITY OF THE RECIPIENT TO VERIFY THAT THE PRINTED OR PLOTTED-TO-SCALE DRAWING IS PRINTED TO SCALE.

Calculation Summary

Label	Avg	Max	Min	Avg/Min	Max/Min
PARKING	0.61	1.2	0.2	3.05	6.00
PROP LINE	0.06	0.1	0.0	N.A.	N.A.
SITE	0.12	1.2	0.0	N.A.	N.A.

Luminaire Schedule (note fixture catalogue numbers are not complete)

Type	Symbol	Qty	Lum. Lumens	LLF	Lum. Watts	Description
C4B	[Symbol]	2	2115	0.900	38	CL1S-16L-3K-4-BC

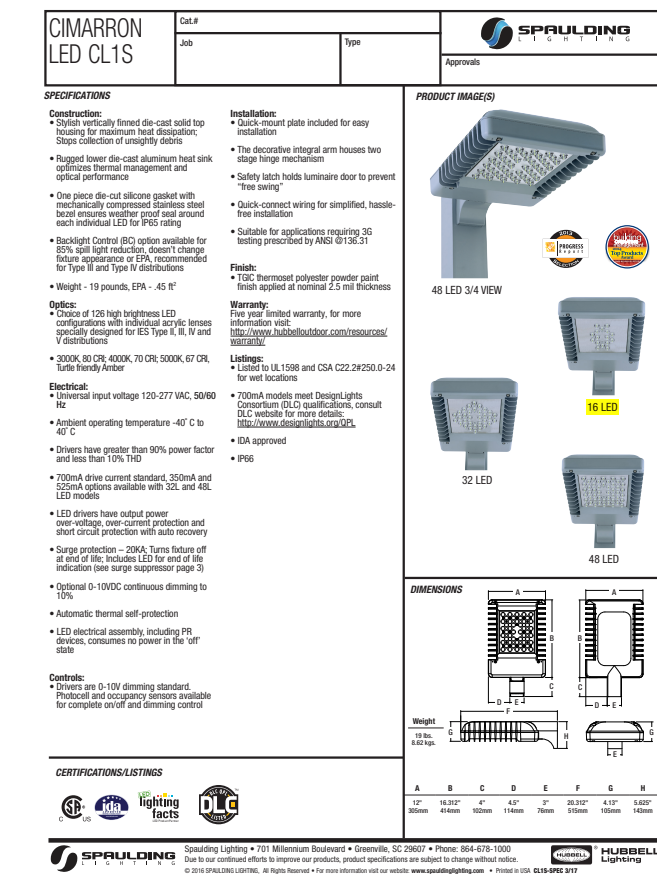


MECHANICAL INFORMATION

ITEM	DESCRIPTION	QUANTITY	UNIT	PRICE	TOTAL
1	C4B	2	EA	19.00	38.00

MECHANICAL INFORMATION (continued)

ITEM	DESCRIPTION	QUANTITY	UNIT	PRICE	TOTAL
2	2 NEW EXTERIOR LIGHT POLES	2	EA	12.50	25.00

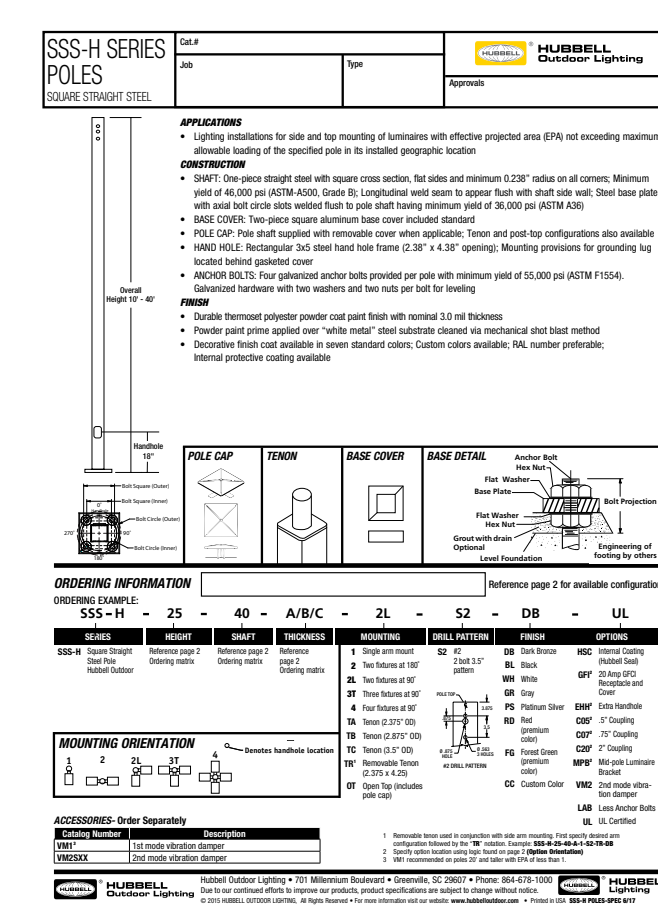

MECHANICAL INFORMATION (continued)

ITEM	DESCRIPTION	QUANTITY	UNIT	PRICE	TOTAL
3	13 PARKING SPACES IN EASEMENT FOR 117 AUBURN STREET BUILDING	13	EA	1.50	19.50

1 SITE PLAN- EXTERIOR LIGHTS PHOTOMETRICS
SCALE: 1" = 20'

MEDICAL OFFICES FOR
NEW ENGLAND FOOT & ANKLE
SPECIALISTS
RENOVATIONS TO
117 AUBURN STREET
PORTLAND, MAINE 04103

WHIPPLE CALLENDER ARCHITECTS
136 PLEASANT AVE.
PORTLAND, ME 04103
P 207.775.2696
F 207.775.3631
www.whipplecallender.com

DATE	DESCRIPTION
2-28-2017	ISSUED FOR STATE FIRE PERMIT
3-4-2017	ISSUED FOR PERMIT W/ SURVEY
4-6-2017	REVISION #1
4-10-2017	REVISION #2
4-25-2017	REVISION #3
5-1-2017	SECOND FLOOR TENANT FIT-UP
7-17-2017	EXTERIOR SIGNAGE & LIGHTING

DATE: 7/17/17
CHECKED BY: AEC
DRAWN BY: CLL
JOB: NEF

SHEET TITLE:
PARKING LOT LIGHTING
E0.1

THIS DRAWING IS AN INSTRUMENT OF SERVICE AND SHALL REMAIN THE PROPERTY OF WHIPPLE CALLENDER ARCHITECTS. IT SHALL NOT BE USED FOR ANY OTHER PURPOSE THAT FOR WHICH IT IS SPECIFICALLY FURNISHED.