

DISPLAY THIS CARD ON PRINCIPAL FRONTAGE OF WORK



CITY OF PORTLAND BUILDING PERMIT

This is to certify that PAUL B II WOODS

Located At 59 BARTLEY AVE

Job ID: 2012-10-5290-HVAC

CBL: 378- A-060-001

has permission to Viessmann Vitoden 200 Heating System provided that the person or persons, firm or corporation accepting this permit shall comply with all of the provisions of the Statutes of Maine and of the Ordinances of the City of Portland regulating the construction, maintenance and use of the buildings and structures, and of the application on file in the department.

Notification of inspection and written permission procured before this building or part thereof is lathed or otherwise closed-in. 48 HOUR NOTICE IS REQUIRED.

A final inspection must be completed by owner before this building or part thereof is occupied. If a certificate of occupancy is required, it must be

Fire Prevention Officer



Code Enforcement Officer / Plan Reviewer

THIS CARD MUST BE POSTED ON THE STREET SIDE OF THE PROPERTY

PENALTY FOR REMOVING THIS CARD


City of Portland, Maine - Building or Use Permit Application

389 Congress Street, 04101 Tel: (207) 874-8703, FAX: (207) 8716

Job No: 2012-10-5290-HVAC	Date Applied: 10/26/2012	CBL: 378- A-060-001	
Location of Construction: 59 BARTLEY AVE	Owner Name: PAUL B WOODS	Owner Address: 59 BARTLEY AVE PORTLAND, ME 04103	Phone:
Business Name:	Contractor Name: S. P. PLUMBING & HEATING INC.	Contractor Address: 120 THADEUS ST , SUITE 8, SOUTH PORTLAND, ME 04106	Phone: 775-7277
Lessee/Buyer's Name:	Phone:	Permit Type: HVAC	Zone: R-2
Past Use: Single Family Dwelling	Proposed Use: Same: Single Family Dwelling - to install Viessmann Vitodens 200 heating system	Cost of Work: \$10,000.00	CEO District:
		Fire Dept: <input type="checkbox"/> Approved <input type="checkbox"/> Denied <input checked="" type="checkbox"/> N/A	Inspection: Use Group: R-3 Type: HVAC
		Signature: 	Signature: 
Proposed Project Description: Viessmann Vitoden 200 Heating System		Pedestrian Activities District (P.A.D.)	
Permit Taken By: Gayle		Zoning Approval	

SCANNED

1. This permit application does not preclude the Applicant(s) from meeting applicable State and Federal Rules.
2. Building Permits do not include plumbing, septic or electrical work.
3. Building permits are void if work is not started within six (6) months of the date of issuance. False informatin may invalidate a building permit and stop all work.

Special Zone or Reviews	Zoning Appeal	Historic Preservation
<input type="checkbox"/> Shoreland	<input type="checkbox"/> Variance	<input checked="" type="checkbox"/> Not in Dist or Landmark
<input type="checkbox"/> Wetlands	<input type="checkbox"/> Miscellaneous	<input type="checkbox"/> Does not Require Review
<input type="checkbox"/> Flood Zone	<input type="checkbox"/> Conditional Use	<input type="checkbox"/> Requires Review
<input type="checkbox"/> Subdivision	<input type="checkbox"/> Interpretation	<input type="checkbox"/> Approved
<input type="checkbox"/> Site Plan	<input type="checkbox"/> Approved	<input type="checkbox"/> Approved w/Conditions
<input type="checkbox"/> Maj <input type="checkbox"/> Min <input type="checkbox"/> MM	<input type="checkbox"/> Denied	<input type="checkbox"/> Denied
Date: OK 10/26/12	Date:	Date: 

CERTIFICATION

I hereby certify that I am the owner of record of the named property, or that the proposed work is authorized by the owner of record and that I have been authorized by the owner to make this application as his authorized agent and I agree to conform to all applicable laws of this jurisdiction. In addition, if a permit for work described in the appication is issued, I certify that the code official's authorized representative shall have the authority to enter all areas covered by such permit at any reasonable hour to enforce the provision of the code(s) applicable to such permit.

SIGNATURE OF APPLICANT ADDRESS DATE PHONE

RESPONSIBLE PERSON IN CHARGE OF WORK, TITLE DATE PHONE

BUILDING PERMIT INSPECTION PROCEDURES

Please call 874-8703 or 874-8693 (ONLY)

or email: buildinginspections@portlandmaine.gov

With the issuance of this permit, the owner, builder or their designee is required to provide adequate notice to the city of Portland Inspections Services for the following inspections. Appointments must be requested 48 to 72 hours in advance of the required inspection. The inspection date will need to be confirmed by this office.

- **Please read the conditions of approval that is attached to this permit!! Contact this office if you have any questions.**
- **Permits expire in 6 months. If the project is not started or ceases for 6 months.**
- **If the inspection requirements are not followed as stated below additional fees may be incurred due to the issuance of a "Stop Work Order" and subsequent release to continue.**

The project cannot move to the next phase prior to the required inspection and approval to continue, REGARDLESS OF THE NOTICE OF CIRCUMSTANCES.

IF THE PERMIT REQUIRES A CERTIFICATE OF OCCUPANCY, IT MUST BE PAID FOR AND ISSUED TO THE OWNER OR DESIGNEE BEFORE THE SPACE MAY BE OCCUPIED.



PORTLAND MAINE

Strengthening a Remarkable City, Building a Community for Life • www.portlandmaine.gov

Director of Planning and Urban Development
Jeff Levine

Job ID: 2012-10-5290-HVAC

Located At: 59 BARTLEY AVE

CBL: 378- A-060-001

Conditions of Approval:


Building

The installation must comply with the State of Maine gas regulations.



FILL IN AND SIGN WITH INK

APPLICATION FOR PERMIT HEATING OR POWER EQUIPMENT

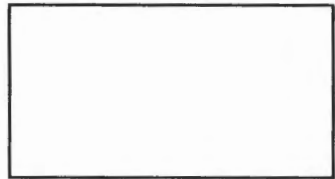

2012 10 5290 66

P-2
378-A-60

To the INSPECTOR OF BUILDINGS, PORTLAND, ME.

The undersigned hereby applies for a permit to install the following heating, cooking or power equipment in accordance with the Laws of Maine, the Building Code of the City of Portland, and the following specifications:

Location / CBL 59 Bartley Use of Building Res. Date 10/26/12
 Name and address of owner of appliance Mr Paul Woods 59 Bartley Ave
Portland, ME
 Installer's name and address S.P. Plumbing & Heating Inc 120 Thaddeus St. Suite
8 So. Portland, ME 04106 Telephone 875-7277

Location of appliance:

- Basement
- Floor
- Attic
- Roof

Type of Fuel:

- Gas
- Oil
- Solid

Appliance Name: VIESSMANN Vitodens 200
 U.L. Approved Yes No

Will appliance be installed in accordance with the manufacture's installation instructions? Yes No

IF NO Explain: _____

The Type of License of Installer:

- Master Plumber # _____
- Solid Fuel # _____
- Oil # _____
- Gas # PNT 1383
- Other _____

Type of Chimney:

- Masonry Lined
Factory built _____
- Metal
Factory Built U.L. Listing # _____
- Direct Vent
Type DVC

Type of Fuel Tank

- Oil
- Gas

Size of Tank N/A

Number of Tanks N/A

Distance from Tank to Center of Flame N/A feet.

Cost of Work: \$ 10,000.00

Permit Fee: \$ _____

RECEIVED
 OCT 26 2012
 Dept. of Building Inspections
 City of Portland Maine

Approved

Fire: _____
 Ele.: _____
 Bldg.: _____

Approved with Conditions

- See attached letter or requirement

Signature of Installer [Signature] Inspector's Signature _____ Date Approved _____

White - Inspection Yellow - File Pink - Applicant's Gold - Assessor's Copy



PORTLAND MAINE

Strengthening a Remarkable City, Building a Community for Life • www.portlandmaine.gov

Receipts Details:

Tender Information: Check , BusinessName: S.P. Plumbing & Heating, Inc., Check Number: 13950

Tender Amount: 120.00

Receipt Header:

Cashier Id: gguertin

Receipt Date: 10/26/2012

Receipt Number: 49725

Receipt Details:

Referance ID:	8553	Fee Type:	BP-Constr
Receipt Number:	0	Payment Date:	
Transaction Amount:	120.00	Charge Amount:	120.00
Job ID: Job ID: 2012-10-5290-HVAC - Viessmann Vitoden 200 Heating System			
Additional Comments: S.P Plumbing & Heating, Inc			


Thank You for your Payment!

Gas-fired wall-mounted condensing boiler
Standard heating boiler 25 to 230 MBH
Combi heating boiler 25 to 91 MBH
Multi-boiler installation 344 to 920 MBH

VIESSMANN

VITODENS 200

Innovative. Highest efficiency. Reliable.

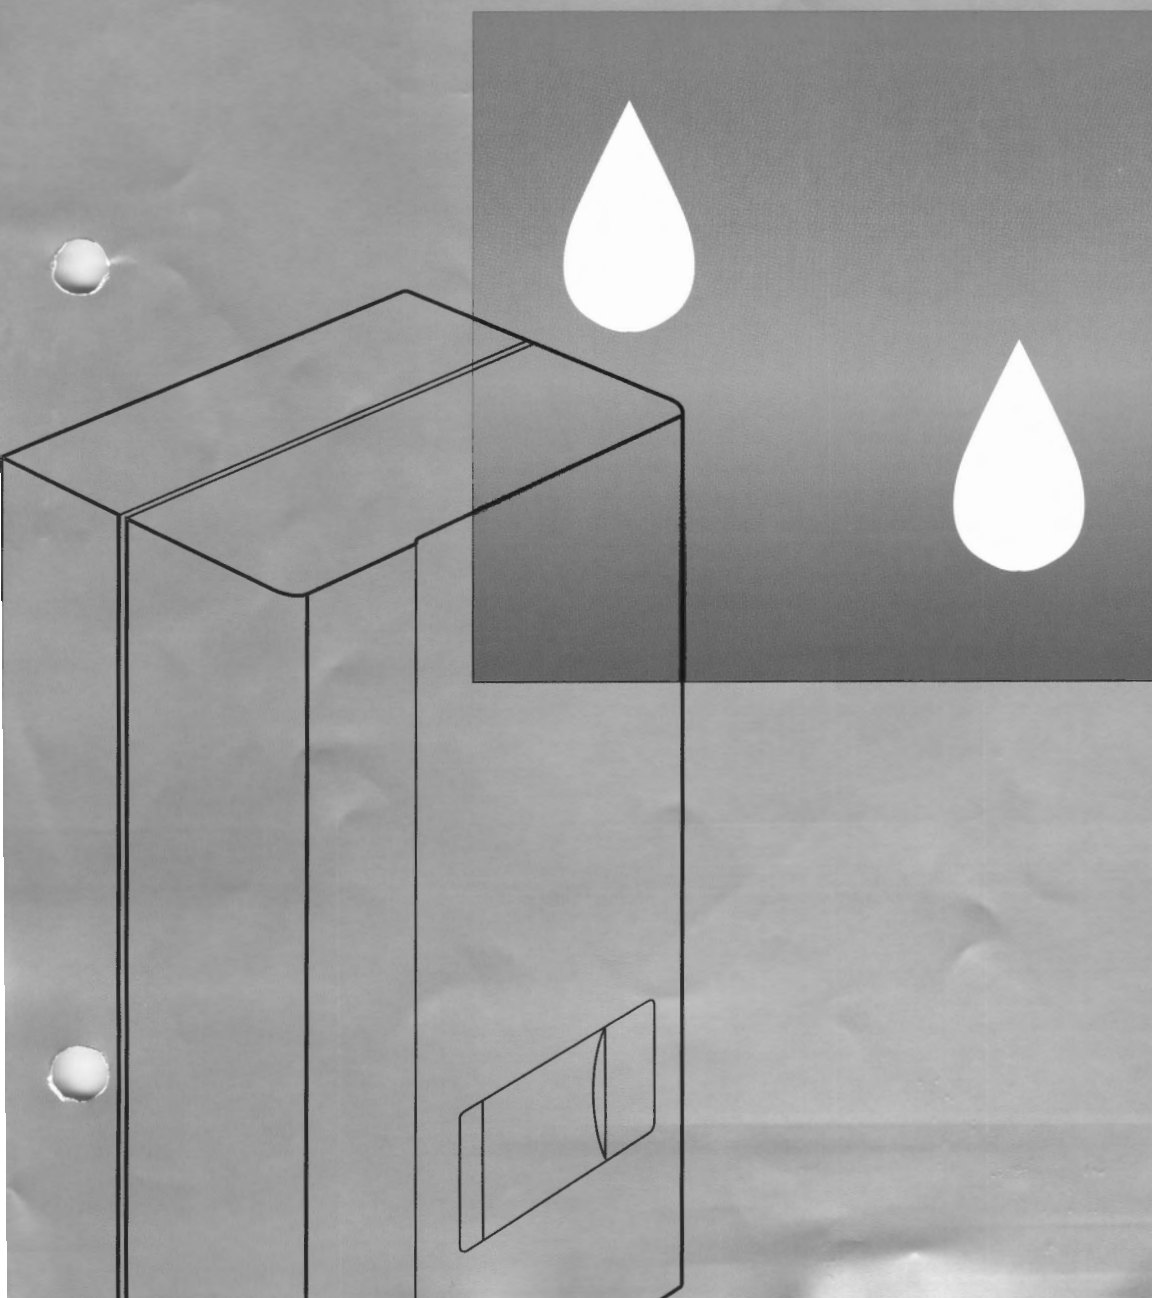

VITODENS 200

Maximize fuel efficiency and minimize your annual heating cost! This high-tech wall-mounted condensing boiler is economical, extremely reliable and compact – and it's unparalleled in the heating industry. Here is why...

Now with **95.2% A.F.U.E.**
Qualifies for federal tax credit in the U.S.

VISSMANN

Viessmann Manufacturing Company Inc.
750 McMurray Road
Waterloo, ON • N2V 2G5 • Canada
Tel.: (519) 885-6300 Fax: (519) 885-0887
www.viessmann.ca

Viessmann Manufacturing Company (U.S.) Inc.
45 Access Road
Warwick, RI • 02886 • U.S.A.
Tel.: (401) 732-0667 Fax: (401) 732-0590
www.viessmann-us.com



The benefits at a glance:

■ **Highest efficiency** of up to 98% with full modulation and 95.2% A.F.U.E. on all models.

■ **Maximum reliability**
High-alloy stainless steel (SA240 316 Ti) Inox-Radial heat exchanger constructed in compliance with CSA B51 and ASME Section IV.

■ **Protect the environment**
Extremely low emissions with modulating MatriX-compact gas burner.
NO_x: 8.9 ppm (air-free)
CO: 5.5 ppm (air-free)

■ **Compact, lightweight design.**
Zero clearance to combustibles. Limited space is not an issue.

■ **Clean, esthetically pleasing** appearance for installation anywhere in your living area.


■ **Extremely quiet** operation; quieter than most refrigerators.

■ **Smart burner technology**
Factory calibrated, self-adjusting burner. **No adjusting in the field, reduced operating cost.**

■ **Powerful and user-friendly** outdoor reset control, built-in and prewired with diagnostic system. Controls multi-temperature space heating and DHW systems.

■ **Reliable DHW production two ways:**
– Combi model features an integrated DHW Quick System. No DHW tank required.
– Unlimited DHW supply with a stand-alone DHW tank with any other Vitodens 200.


■ **Multiple venting options**
– Horizontal or vertical sealed combustion coaxial vent system (factory supplied).




Inox-Radial heat exchanger surface



MatriX-compact gas burner



Powerful and user-friendly control

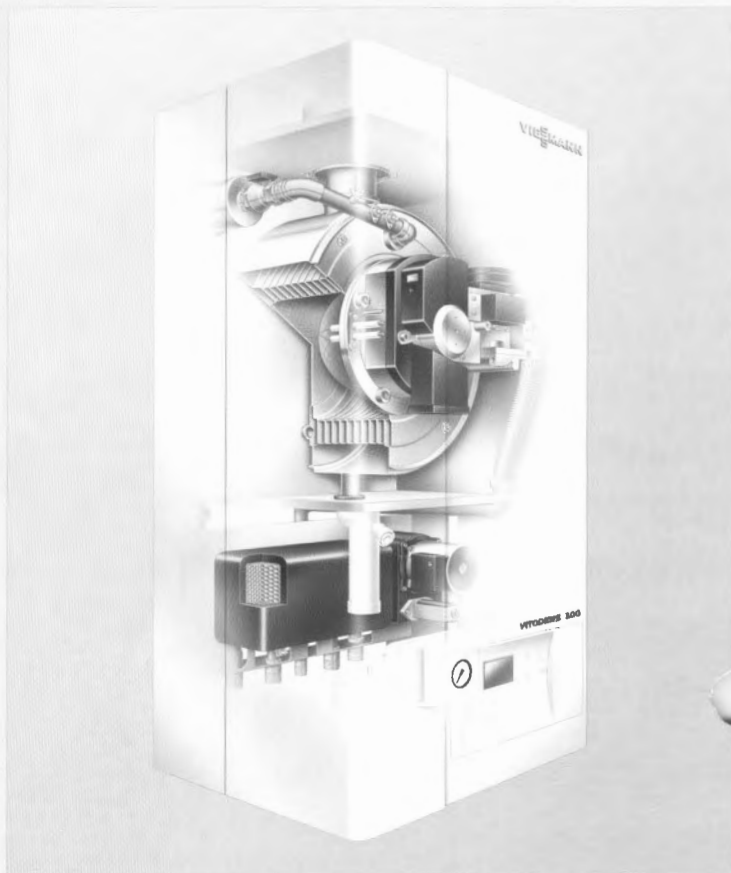

- Horizontal, vertical or hybrid sealed combustion double-pipe vent system (field supplied).
- Horizontal or vertical single-wall vent system (field supplied).


■ **Multi-boiler installation**
Models WB2-44 and -60 can be combined to a maximum of 4. **Ideal for light commercial applications.**

■ **One version for all elevation levels** (0–10 000 ft./0–3048 m).

■ **Fast, simple conversions** to natural or propane gas.



VITODENS 200	WB2	6-24C	6-24	8-32	11-44	15-60
Rated input range (NG)	MBH	25-91	25-91	37-124	55-172	80-230
Rated input range (LP)	MBH	25-81	25-81	37-112	55-155	80-214
Depth	inches	16	16	16	21¼	21¼
Width	inches	19¾	19¾	19¾	23½	23½
Height	inches	35½	35½	35½	35½	35½

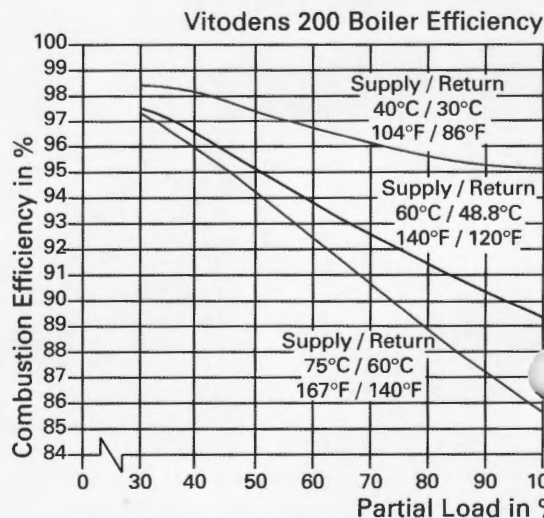

Technical information subject to change without notice.