

AquaSAFE™ FIRE SAFETY SYSTEM

Uponor 5925 148th Street West

Apple Valley, MN 55124 800-321-4739

Job Name : GRABARZ RESIDENCE - Two Head Calculation (H.22 & H.24)

Drawing : RESIDENTIAL Location : 25 HAVERTYS WAY PORTLAND ME 04101

Remote Area : 1

Contract : 121109-42L

Data File

: 121109-42L Grabaz Residence.wx2

Source of Information: CONTRACTOR

L

Y

```
HYDRAULIC DESIGN INFORMATION SHEET
Name - GRABARZ RESIDENCE
                                                                 Date - 11/15/12
Location - PORTLAND ME 04101
Building - RESIDENTIAL
                                                       System No. - 1
Contractor - RSD PLUMB & HTG
                                                       Contract No. - 121109-42L
Calculated By - BRENT KOTULA SET IV Construction: (X) Combustible ( ) Non-Combustible
                                                       Drawing No. - 1
                                                            Ceiling Height 8
OCCUPANCY - RESIDENTIAL
S
    Type of Calculation: ( )NFPA 13 Residential
                                                     ( )NFPA 13R
                                                                    (X) NFPA 13D
Y
    Number of Sprinklers Flowing: ()1
                                            (X) 2
                                                     ()4
                                                          ( )
S
    ( )Other
\mathbf{T}
    ( )Specific Ruling
                                            Made by
                                                                   Date
\mathbf{E}
     Listed Flow at Start Point - 13
Μ
                                                                System Type
Listed Pres. at Start Point - 9.14 Psi
                                                 (X) Wet
                                                                () Dry
     MAXIMUM LISTED SPACING
                               16 x 16
                                                     ( ) Deluge
                                                                   ( ) PreAction
Ε
     Domestic Flow Added
                                                      Sprinkler or Nozzle
                                          Gpm
S
     Additional Flow Added
                                          Gpm
                                                Make RELIABE-ASSEMBLIES Model AFC43
I
     Elevation at Highest Outlet - 117
                                                Size 3/8
                                          Feet
                                                                  K-Factor 4.3
G
                                                Temperature Rating 165
N
Calculation
              Gpm Required 26.0983
                                       Psi Required 50.17
                                                              At Ref Pt STR
Summary
              C-Factor Used:
                                       Overhead 150
                                                               Underground 150
W
    Water Flow Test:
                                    Pump Data:
                                                            Tank or Reservoir:
    Date of Test - x
                                                          Cap.
Α
                                   Rated Cap.
T
    Time of Test
                   - x
                                   @ Psi
                                                          Elev.
                   - 52
E
    Static (Psi)
                                  Elev.
    Residual (Psi) - 47
R
                                  Other
                                                                Well
Flow (Gpm)
               - 300
                                                      Proof Flow Gpm
    Elevation
                    - 91
Р
    Location: STREET
Р
```

Uponor GRABARZ RESIDENCE - Two Head Calculation (H.22 & H.24)

2 11/15/2012

Page Date

26.0983 11.261 26.0983 50.166 Demand:
D1 - Elevation
D2 - System Flow
D2 - System Pressure
Hose (Adj City)
Hose (Demand)
D3 - System Demand : 9 City Water Supply:
C1 - Static Pressure : 52
C2 - Residual Pressure: 47
C2 - Residual Flow : 300 ß 5 Р 120 R 110 E 100 150 140 130 U 70 S 90 s 80 R 60 E 50 30 20 9 4

Computer Programs by Hydratec Inc. Route 111 Windham N.H. USA 03087

450

400

350

300 FLOW (N ^ 1.85)

250

200

150

100

50

Uponor GRABA	Uponor GRABARZ RESIDENCE - Two Head Calculation (H.22 & H.24)	ad Calc	ulation	(H.22	& H.24)													Page Date	(1) ~	} 1/15/2012	12
Fitting Abbre	Fitting Legend Abbrev. Name	7%	%		1,7	178	2	21/2	3	31/2	4	5	9	8	10	12	14	16	18	20	24
m @ K H D 글 갖	90' Standard Elbow Generic Gate Valve CPVC Coupling Tee - Run 90' Flow thru Tee UnAdjusted Fitting Aquapex Tee - Branch Aquapex Tee - Run	0 0 - 0 -	0 4 - - 0	00-40	o ← ← o ← o 4	48-52	20	00777700	C1 2 2 1 2 1 2 2 1 2 2 1 2 2 1 2 2 1 2	8107700	0 + 50 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0	7 7 7 7 7 7 7 7 7 7 7 7 7 7 7 7 7 7 7	4 c 0 c c 0 c c c c c c c c c c c c c c	18 0 0 0 0 0	22 5 0 0 0 0	27 6 0 0 0 0 0	35 7 7 1 1 0	40 0 0 0 0 0	45 0 0 0 0 0 0	50 11 101 0	61 0 0 0 0

Diameter Units Inches
Length Units Feet
Flow Units US Gallons per Minute
Pressure Units Pounds per Square Inch

Uponor

GRABARZ RESIDENCE - Two Head Calculation (H.22 & H.24)

Page Date

4 11/15/2012

911	DDI	v	A AI	ΔI	VSIS
-347		. r .	41 IV.	<i>-41</i>	7.71.7

Node at Source	Static Pressure	Residual Pressure	Flow	Available Pressure	Total Demand	Required Pressure
STR	52.0	47	300.0	51.945	26,1	50.166

NODE ANALYSIS

Node Tag	Elevation	Node Type	Pressure at Node	Discharge at Node	Notes
H.24	117.0	4.3	9.28	13.1	
H.22	117.0	4.3	9.14	13.0	
H.1	108.0		24.26		
H.2	108.0		24.29		
T.28	108.0		24.22		
H.3	108.0		24.18		
T.27	108.0		24.22		
M.31	108.0		24.27		
T.25	108.0		24.08		
H.4	108.0		24.26		
T.30	108.0		24.71		
H.5	108.0		24.29		
H.15	99.0		30.21		
H.6	108.0		24.38		
H.11	99.0		30.16		
H.8	108.0		24.45		
H.7	108.0		23.88		
T.33	99.0		30.54		
T.34	99.0		30.45		
T.35	99.0		30.46		
M.32	99.0		30.46		
H.10	99.0		30.37		
T.36	99.0		30.41		
T.37	99.0		30.37		
H.9	99.0		30.37		
H.12	117.0		16.43		
H.16	117.0		15.77		
H.14	117.0		15.42		
H.13	117.0		16.41		
H.17	99.0		30.28		
H.20	99.0		30.37		
T.38	117.0		15.57		
H.19 H.18	99.0 117.0		30.37		
			19.49		
T.29 M.41	108.0		23.84 19.71		
WI.41 H.21	117.0 117.0		14.69		
H.23	117.0		13.24		
п.23 S.1	95.0		35.36		
MTR	91.0		45.12		
STR	91.0		50.17		
JII	01.0		JU. 17		

Uponor GRABARZ RESIDENCE - Two Head Calculation (H.22 & H.24)

Page 5 Date 11/15/2012

Hyd.	Qa	Dia.	Fitting	Pipe	Pt	Pt	
Ref. Point	Qt	"C" Pf/Ft	or Eqv. Ln.	Ftng's Total	Pe Pf	Pv Pn	****** Notes *****
				T Otto			
H.24	4.22	0.475	1T 1.219	23.000	9.279		K Factor = 4.30
to M.41	4.22	150.0 0.2298	21U 21.0 0.0	22.369 45.369	0.0 10.427		Vel = 7.64
1011	0.0	0.2230	0.0	40,000	10.721		Vei 7.04
11.00	4.22				19.706		K Factor = 0.95
H.22 to	2.73	0.475 150.0	42U 42.0 0.0	19.000 42.300	9.140 0.0		K Factor = 4.30
H.14	2.73	0.1025	0.0	61.300	6.284		Vel = 4.94
	0.0 2.73				15.424		K Factor = 0.70
H.1	0.15	0.475	42U 42.0	16.000	24.261		
to H.2	0.15	150.0 0.0005	0.0 0.0	42.300 58.300	0.0 0.029		Vel = 0.27
11.2	0.0	0.0000	0.0	30.300	0.023		Vei - 0.27
	0.15				24.290		K Factor = 0.03
T.28 to	-0.23	0.475 150.0	1Utr 1.0 1R 1.0	11.000 23.150	24.215 0.0		
H.3	-0.23	-0.0011	21U 21.0	34.150	-0.037		Vel = 0.42
H.3	0.53	0.475	1Utr 1.0	3.000	24.178		
to T.26	0.3	150.0 0.0017	21U 21.0 1R 1.0	23.150 26.150	0.0 0.045		Vel = 0.54
	0.0 0.30				24.223		K Factor = 0.06
T.27	-0.29	0.475	1Utr 1.0	5.000	24.225		K Factor = 0.00
to		150.0	1R 1.0	23.150	0.0		
H.3	-0.29 0.0	-0.0017	21U 21.0	28.150	-0.047		Vel = 0.53
	-0.29				24.178		K Factor = -0.06
M.31	-0.30	0.475	1T 1.219	25.000	24.269		
to T.26	-0.3	150.0 -0.0017	1R 1.0 0.0	2.219 27.219	0.0 -0.046		Vel = 0.54
	0.0						
TOF	-0.30	0.475	41.145 0.0	00.000	24.223		K Factor = -0.06
T.25 to	0.46	0.475 150.0	1Utb 2.0 1R 1.0	22.000 24.150	24.084 0.0		
H.1	0.46	0.0038	21U 21.0	46.150	0.177		Vel = 0.83
	0.0 0.46				24.261		K Factor = 0.09
M.31	0.17	0.475	1T 1.219	11.000	24.269		111 40101 0.00
0	0.17	150.0	21U 21.0	22.369	0.0		Val - 0.24
H.2	0.17 0.0	0.0006	0.0	33.369	0.021		Vel = 0.31
	0.17				24.290		K Factor = 0.03
H.3	-0.82	0.475 150.0	1Utr 1.0 21U 21.0	7.000 23.150	24.178 0.0		
o T.29	-0.82	-0.0111	1R 1.0	30.150	-0.335		Vel = 1.48
	0.0 -0.82				23.843		K Factor = -0.17

Final Calculations - Hazen-Williams

Uponor GRABARZ RESIDENCE - Two Head Calculation (H.22 & H.24)

Page 6 Date 11/15/2012

Hyd. Ref.	Qa	Dia. "C"	Fitting or	Pipe Ftng's	Pt Pe	Pt Pv	****** Notes *****
Point	Qt	Pf/Ft	Eqv. Ln.	Total	Pf	Pn	1000
H.4 to	-0.23	0.475 150.0	21U 21.0 1R 1.0	22.000 22.150	24.262 0.0		
T.28	-0.23	-0.0011	0.0	44.150	-0.047		Vel = 0.42
	0.0 -0.23				24.215		K Factor = -0.05
H.4	-0.02	0.475	42U 42.0	12.000	24.262		
to	0.00	150.0	0.0	42.300	0.0		
H.1	-0.02 0.0	0.0	0.0	54.300	-0.001		Vel = 0.04
	-0.02				24.261		K Factor = 0
T.30	23.53	1.054	1Utr 4.0	13.000	24.709		
to	00.50	150.0	0.0	4.000	3.898		M-1 0.05
T.33	23.53 0.0	0.1136	0.0	17.000	1.932		Vel = 8.65
	23.53				30.539		K Factor = 4.26
T.30	-6.66	0.862	1Utb 17.0	1.000	24.709	,	
to		150.0	0.0	14.000	0.0		
M.31	<u>-6.66</u>	-0.0293	0.0	15.000	-0.440		Vel = 3.66
	0.0 -6.66				24.269		K Factor = -1.35
H.5	0.03	0.475	42U 42.0	15.000	24.288		
to		150.0	0.0	42.300	0.0		
H.2	0.03	0.0	0.0	57.300	0.002		Vel = 0.05
	0.0 0.03				24.290		K Factor = 0.01
M.31	-0.11	0.475	1T 1.219	5.000	24.269	***************************************	
to		150.0	21U 21.0	22.369	0.0		
H.4	-0.11	-0.0003	0.0	27.369	-0.007		Vel = 0.20
	0.0 -0.11				24.262		K Factor = -0.02
T.27	0.29	0.475	1R 1.0	16.000	24.225		1(1000)
to		150.0	21U 21.0	22.150	0.0		
H.5	0.29	0.0017	0.0	38.150	0.063		Vel = 0.53
	0.0 0.29				24.288		K Factor = 0.06
H.4	0.14	0.475	42U 42.0	19.000	24.262		
to		150.0	0.0	42.300	0.0		
H.5	0.14	0.0004	0.0	61.300	0.026		Vel = 0.25
	0.0 0.14				24.288		K Factor = 0.03
T.25	-0.46	0.475	1R 1.0	30.000	24.084		40.01
to		150.0	21U 21.0	22.150	0.0		
H.7	-0.46	-0.0038	0.0	52.150	-0.200		Vel = 0.83
	0.0 -0.46				23 884		K Factor - 0.00
H.15	-0. 40 -1.21	0.475	42U 42.0	39.000	23.884 30.209	***************************************	K Factor = -0.09
to	·· 1. Z 1	150.0	0.0	42.300	-3.898		
H.8	-1.21	-0.0228	0.0	81.300	-1.857		Vel = 2.19

Uponor GRABARZ RESIDENCE - Two Head Calculation (H.22 & H.24)

Page 7 Date 11/15/2012

Hyd. Ref.	Qa	Dia. "C"	Fittin O	r	Pipe Ftng's	Pt Pe	Pt Pv	****** Notes *****
Point	Qt	Pf/Ft	Eqv.	Ln.	Total	Pf	Pn	
	0.0							
	-1.21					24.454		K Factor = -0.24
M.31	-0.62	0.475	1T	1.219	36.000	24.269		
to H.7	-0.62	150.0 -0.0066	21U	21.0 0.0	22.369 58.369	0.0 -0.385		Vel = 1.12
	0.0	0.0000		0.0	00.000	0.000		VOI — 1.12
	-0.62		*********		,	23.884		K Factor = -0.13
H.6	-0.29	0.475	42U		30.000	24.375		
o H.1	-0.29	150.0 -0.0016		0.0 0.0	42.300 72.300	0.0 -0.114		Vel = 0.53
11.1	0.0	0.0010		0.0	12.000	0.1113		VOI
	-0.29					24.261		K Factor = -0.06
H.11	-1.36	0.475	42U	42.0	25.000	30.165		
ю Н.6	-1.36	150.0 -0.0281		0.0 0.0	42.300 67.300	-3.898 -1.892		Vel = 2.46
	0.0	0.0201		0.0	0,,000	1,002		V 01 A. 10
	-1.36				•••	24.375		K Factor = -0.28
H.8	-0.36	0.475	42U	42.0	27.000	24.454		
o H.2	-0.36	150.0 -0.0024		0.0 0.0	42.300 69.300	0.0 -0.164		Vel = 0.65
	0.0			0.0	00.000	0,101		
	-0.36					24.290		K Factor = -0.07
H.6	-0.39	0.475	21U	21.0	16.000	24.375		
o M.31	-0.39	150.0 -0.0028	1T	1.219 0.0	22.369 38.369	0.0 -0.106		Vel = 0.71
	0.0				····			
	-0.39		***************************************			24.269		K Factor = -0.08
H.8	-0.45	0.475 150.0	21U 1T	21.0 1.219	29.000 22.369	24.454 0.0		
o M.31	-0.45	-0.0036	11	0.0	51.369	-0.185		Vel = 0.81
	0.0					***************************************		
	-0.45					24.269		K Factor = -0.09
H.8	-0.41	0.475 150.0	42U	42.0 0.0	12.000 42.300	24.454 0.0		
o H.5	-0.41	-0.0031		0.0	54.300	-0.166		Vel = 0.74
	0.0							
	-0.41					24.288		K Factor = -0.08
H.7 o	0.68	0.475 150.0	42U	42.0 0.0	20.000 42.300	23.884 0.0		
о Н.6	0.68	0.0079		0.0	62.300	0.491		Vel = 1.23
	0.0							
	0.68	4				24.375		K Factor = 0.14
T.33 o	26.10	1.054 150.0	1T	2.44 0.0	20.000 2.440	30.539 1.732		
S.1	26.1	0.1377		0.0	2.440	3.090		Vel = 9.60
-	0.0							
	26.10					35.361		K Factor = 4.39

Final Calculations - Hazen-Williams

Uponor GRABARZ RESIDENCE - Two Head Calculation (H.22 & H.24)

Page 8 Date 11/15/2012

Hyd.	Qa	Dia.	Fitting	Pipe	Pt	Pt	
Ref.		"C"	or	Ftng's	Pe	Pv	****** Notes *****
Point	Qt	Pf/Ft	Eqv. Ln.	Total	Pf	Pn	
T.33	-2.57	0.862	1Utb 17.0	1.000	30.539		
D N.E. 200	0.57	150.0	0.0	14.000	0.0		17.1
M.32	-2.57	-0.0050	0.0	15.000	-0.075		Vel = 1.41
	0.0 -2.57				30.464		K Factor = -0.47
T.34	0.42	0.475	1Utr 1.0	1.000	30.450		
o M.32	0.42	150.0 0.0033	1R 1.0 1T 1.219	3.219 4.219	0.0 0.014		Vel = 0.76
IVI.OZ	0.0	0.0000	11 1.213	4.213	0.014		VEI - 0.70
	0.42				30.464		K Factor = 0.08
T.34	-0.42	0.475	1R 1.0	2.000	30.450		
0 Ll 0	0.40	150.0	21U 21.0 0.0	22.150	0.0		\/ol== 0.70
H.9	-0.42 0.0	-0.0032	<u> </u>	24.150	-0.077	***************************************	Vel = 0.76
	-0.42				30.373		K Factor = -0.08
T.35	0.29	0.475	1Utr 1.0	2.000	30.455		
o M.32	0.29	150.0 0.0017	1R 1.0 1T 1.219	3.219	0.0		\/o1 = 0.52
M.32	-0.67	0.475	1T 1.219 1T 1.219	5.219 11.000	0.009 30.464		Vel = 0.53
0	-0.07	150.0	21U 21.0	22.369	0.0		
H.10	-0.38	-0.0027	0.0	33.369	-0.090		Vel = 0.69
	0.0 -0.38				30.374		K Factor = -0.07
T.36	0.60	0.475	1Utr 1.0	5.000	30.413		
0		150.0	1R 1.0	3.219	0.0		
M.32	0.6	0.0062	1T 1.219	8.219	0.051		Vel = 1.09
	0.0 0.60				30.464		K Factor = 0.11
T.37	0.01	0.475	1Utr 1.0	3.000	30.373		
)	0.04	150.0	1R 1.0	23.150	0.0		V-1 - 0.00
H.9	0.01 0.0	0.0	21U 21.0	26.150	0.0		Vel = 0.02
	0.01				30.373		K Factor = 0
H.11	0.61	0.475	21U 21.0	24.000	30.165	***************************************	
) M	0.04	150.0	1T 1.219	22.369	0.0		V. 1 4 40
M.32	0.61	0.0064	0.0	46.369	0.299		Vel = 1.10
	0.0 0.61				30.464		K Factor = 0.11
H.9	0.01	0.475	1Utr 1.0	17.000	30.373		
כ		150.0	21U 21.0	23.150	0.0		
Т.40	0.01	0.0	1R 1.0	40.150	0.0		Vel = 0.02
	0.0 0.01				30.373		K Factor = 0
H.9	-0.42	0.475	42U 42.0	24.000	30.373		
כ		150.0	0.0	42.300	0.0		
H.11	-0.42 0.0	-0.0031	0.0	66.300	-0.208		Vel = 0.76

Uponor GRABARZ RESIDENCE - Two Head Calculation (H.22 & H.24)

Page 9 Date 11/15/2012

Hyd. Ref.	Qa	Dia. "C"	Fitting or	Pipe Ftng's	Pt Pe	Pt Pv	****** Notes *****
Point	Qt	Pf/Ft	Eqv. Ln.	Total	Pf	Pn	11000
H.15 o	0.36	0.475 150.0	42U 42.0 0.0	24.000 42.300	30.209 0.0		
H.10	0.36	0.0025	0.0	66.300	0.165		Vel = 0.65
	0.0 0.36				30.374		K Factor = 0.07
T.36	-0.60	0.475	1R 1.0	11.000	30.413		
0	0.0	150.0	21U 21.0	22.150	0.0		\/al = -4.00
H.15	-0.6 0.0	-0.0062	0.0	33.150	-0.204		Vel = 1.09
	-0.60				30.209		K Factor = -0.11
H.12	-1.05	0.475	42U 42.0	15.000	16.432		
o H.14	-1.05	150.0 -0.0176	0.0 0.0	42.300 57.300	0.0 -1.008		Vel = 1.90
Π. 14	0.0	-0.0170	0.0	57.300	-1.006		Vei - 1.30
	-1.05				15.424		K Factor = -0.27
H.16	0.75	0.475	1Utr 1.0	17.000	15.772		
O T 00	0.75	150.0	21U 21.0	23.150	0.0		V-I 4.00
T.39	0.75 0.0	0.0093	1R 1.0	40.150	0.374		Vel = 1.36
	0.75				16.146		K Factor = 0.19
H.14	0.51	0.475	1Utr 1.0	9.000	15.424		
0	0.54	150.0	21U 21.0	23.150	0.0		
T.38	0.51 0.0	0.0046	1R 1.0	32.150	0.149		Vel = 0.92
	0.51				15.573		K Factor = 0.13
H.13	-0.75	0.475	21U 21.0	6.000	16.407		
0		150.0	1R 1.0	22.150	0.0		1/1 100
T.39	-0.75	-0.0093	0.0	28.150	-0.261		Vel = 1.36
	0.0 -0.75				16.146		K Factor = -0.19
H.16	0.88	0.475	42U 42.0	10.000	15.772		
0		150.0	0.0	42.300	0.0		
H.12	0.88	0.0126	0.0	52.300	0.660		Vel = 1.59
	0.0 0.88				16.432		K Factor = 0.22
H.13	0.15	0.475	42U 42.0	11.000	16,407		
D		150.0	0.0	42.300	0.0		
H.12	0.15	0.0005	0.0	53.300	0.025		Vel = 0.27
	0.0 0.15				16.432		K Factor = 0.04
H.14	1.17	0.475	42U 42.0	4.000	15.424		111 40(0) - 0.07
0		150.0	0.0	42.300	0.0		
H.13	1.17	0.0212	0.0	46.300	0.983		Vel = 2.12
	0.0 1.17				16.407		K Factor = 0.29
H.17	-0.33	0.475	42U 42.0	11.000	30.275		N I AULUI - U.Z3
)	0.00	150.0	0.0	42.300	0.0		
H.11	-0.33	-0.0021	0.0	53.300	-0.110		Vel = 0.60

Final Calculations - Hazen-Williams

Uponor
GRABARZ RESIDENCE - Two Head Calculation (H.22 & H.24)

Page 10 Date 11/15/2012

Hyd. Ref.	Qa	Dia. "C"	Fitting or	Pipe Ftng's	Pt Pe	Pt Pv	****** Notes *****
Point	Qt	Pf/Ft	Eqv. Ln.	Total	Pf	Pn	
						· · · · · · · · · · · · · · · · · · ·	
	0.0 -0.33				30.165		K Factor = -0.06
H.20	0.01	0.475	42U 42.0	30.000	30.373		
to H.10	0.01	150.0 0.0	0.0 0.0	42.300 72.300	0.0 0.001		Vel = 0.02
	0.0 0.01				30.374		K Factor = 0
T.38	0.51	0.475	1R 1.0	21.000	15.573		N actor - 0
to	0.01	150.0	21U 21.0	22.150	0.0		
H.16	0.51	0.0046	0.0	43.150	0.199		Vel = 0.92
	0.0 0.51				15.772		K Factor = 0.13
H.17	-0.25	0.475	42U 42.0	11.000	30.275		
to H.15	-0.25	150.0 -0.0012	0.0 0.0	42.300	0.0 -0.066		\/o! = 0.45
11.13	0.0	-0.0012	0.0	53.300	-0.000		Vel = 0.45
	-0.25				30.209		K Factor = -0.05
M.32	-0.27	0.475	1T 1.219	41.000	30.464		
to H.20	-0.27	150.0 -0.0014	21U 21.0 0.0	22.369 63.369	0.0 -0.091		Vel = 0.49
11.20	0.0	-0.0014	0.0	03.303	-0.031	<u> </u>	VCI - 0.43
	-0.27				30.373		K Factor = -0.05
H.19	0.29	0.475	21U 21.0	28.000	30.374		
to T.35	0.29	150.0 0.0016	1R 1.0 0.0	22.150 50.150	0.0 0.081		Vel = 0.53
1.00	0.0	0.0010	0.0	90.100	0,001		VCI 0.00
	0.29				30.455		K Factor = 0.05
H.19	0.0	0.475	42U 42.0	37.000	30.374		
to H.10	0.0	150.0 0.0	0.0 0.0	42.300 79.300	0.0 0.0		Vel = 0
11.10	0.0	<u> </u>	0.0	70.000	0.0		VC1 - 0
····	0.0				30.374		K Factor = 0
H.18	-2.08	0.475	42U 42.0	7.000	19.487		
to H.12	-2.08	150.0 -0.0620	0.0 0.0	42.300 49.300	0.0 -3.055		Vel = 3.77
11.12	0.0	0.0020		70.000	0.000		VCI = 0.17
	-2.08				16.432		K Factor = -0.51
H.7	-1.76	0.475	42U 42.0	36.000	23.884		
to H.13	-1.76	150.0 -0.0457	0.0 0.0	42.300 78.300	-3.898 -3.579		Vel = 3.19
11.10	0.0	0.0-101	0.0	70.000	-0.010		VGI - 0.10
	-1.76			····	16.407		K Factor = -0.43
T.37	-0.01	0.475	1R 1.0	38.000	30.373		
to H.20	-0.01	150.0 0.0	21U 21.0 0.0	22.150 60.150	0.0 0.0		Vel = 0.02
- 11-000	0.0	<u> </u>		JU. 100			70, 0.02
	-0.01				30.373		K Factor = 0

Uponor GRABARZ RESIDENCE - Two Head Calculation (H.22 & H.24)

Page 11 Date 11/15/2012

Hyd. Ref.	Qa	Dia. "C"	Fitting or	Pipe Ftng's	Pt Pe	Pt Pv	****** Notes *****
Point	Qt	Pf/Ft	Eqv. Ln.	Total	Pf	Pn	
T.29	-0.82	0.475	1R 1.0	19.000	23.843		
o H.18	-0.82	150.0 -0.0111	21U 21.0 0.0	22.150 41.150	-3.898 -0.458		Vel = 1.48
	0.0 -0.82				19.487		K Factor = -0.19
M.41	0.63	0.475	1T 1.219	10.000	19.706		
0 LI 40	0.62	150.0	21U 21.0	22.369	0.0		Mal = - 4.44
H.18 H.18	0.63 -1.26	-0.0068 0.475	0.0 1T 1.219	32.369 10.000	-0.219 19.487		Vel = 1.14
П. 10 0	-1.20	150.0	21U 21.0	22.369	0.0		
M.41	-0.63	0.0068	0.0	32.369	0.219		Vel = 1.14
	0.0 -0.63				19.706		K Factor = -0.14
H.19	-0.01	0.475	21U 21.0	19.000	30.374		
O T 40	0.04	150.0	1R 1.0	22.150	0.0) /-l =
T.40	-0.01 0.0	0.0	0.0	41.150	-0.001		Vel = 0.02
	-0.01				30.373		K Factor = 0
M.41	16.86	1.054	0.0	18.000	19.706		
) T 00	40.00	150.0	0.0	0.0	3.898		
T.30	16.86 0.0	0.0614	0.0	18.000	1.105		Vel = 6.20
	16.86				24.709		K Factor = 3.39
H.16	-1.11	0.475	42U 42.0	13.000	15.772		
0	4 4 4	150.0	0.0	42.300	0.0		
H.21	-1.11	-0.0195	0.0	55.300	-1.079		Vel = 2.01
	0.0 -1.11				14.693		K Factor = -0.29
H.17	0.29	0.475	42U 42.0	17.000	30.275		777 40101 0.20
ס		150.0	0.0	42.300	0.0		
H.20	0.29	0.0017	0.0	59,300	0.098		Vel = 0.53
	0.0 0.29				30.373		K Factor = 0.05
H.19	-0.29	0.475	42U 42.0	20.000	30.374		141 &0.00
)		150.0	0.0	42.300	0.0		
H.17	-0.29	-0.0016	0.0	62.300	-0.099		Vel = 0.53
	0.0 -0.29				30.275		K Factor = -0.05
M.41	3.98	0.475	1T 1.219	29.000	19.706		11 40(0)0.00
)		150.0	21U 21.0	22.369	0.0		
H.22	3.98	-0.2057	0.0	51.369	-10.566		Vel = 7.21
H.22	-7.96	0.475	1T 1.219	29.000 22.369	9.140		
o M.41	-3.98	150.0 0.2057	21U 21.0 0.0	22.369 51.369	0.0 10.566		Vel = 7.21
	0.0						
	-3.98				19.706		K Factor = -0.90
	2.94	0.475	21U 21.0	26.000	14.693		
H.21)	2.54	150.0	1T 1.219	22.369	3.898		

Final Calculations - Hazen-Williams

26.1

0.0 26.10 0.0470

1G

0.562

STR

Uponor Page 12 GRABARZ RESIDENCE - Two Head Calculation (H.22 & H.24) Date 11/15/2012 Hyd. Fitting Ρt Pt Qa Dia. Pipe Ref. "C" Ftng's Рe Pv ***** **** or Notes Point Qt Pf/Ft Eqv. Ln. Total Ρf Pn 0.0 2.94 24.269 K Factor = 0.60 H.23 3.43 0.475 21U 21.0 19.000 13.241 to 150.0 1T 1.219 22.369 0.0 M.41 3.43 0.1563 41.369 6.465 0.0 Vel = 6.21 0.0 3.43 19.706 K Factor = 0.77H.21 -1.360.475 42U 42.0 9.000 14.693 to 150.0 0.0 42.300 0.0 H.23 -1.36-0.02830.0 51.300 -1.452Vel = 2.460.0 -1.36 13.241 K Factor = -0.37H.22 2.31 0.475 42U 42.0 9.140 12,000 to 150.0 0.0 42.300 0.0 H.23 2.31 0.0755 54.300 0.0 4.101 Vel = 4.180.0 2.31 13.241 KFactor = 0.63H.24 42U 2.69 0.475 42.0 12.000 9.279 150.0 0.0 42.300 0.0 to H.21 2.69 0.0997 0.0 54.300 5.414 Vel = 4.870.0 2.69 14.693 K Factor = 0.70H.24 2.48 0.475 42U 42.0 9.279 4.000 150.0 0.0 42.300 0.0 to H.23 2.48 0.0856 0.0 46.300 3.962 Vel = 4.490.0 2.48 13.241 K Factor = 0.68M.31 -3.71 1.219 0.475 1T 39.000 24.269 21U 21.0 22.369 to 150.0 -3.898 H.24 -3.71 -0.1807 0.0 61.369 -11.092 Vel = 6.720.0 -3.719.279 K Factor = -1.22S.1 26.10 1.054 2E 2.44 5.000 35.361 0.0 to 150.0 2.440 8.732 * Fixed loss = 7 26.1 0.1378 MTR 0.0 7.440 1.025 Vel = 9.601.314 1E 2.247 **MTR** 0.0 100.000 45.118 150.0 4.495 to 1T 7.304 0.0

107.304

5.048

50.166

Vel = 6.18

K Factor = 3.68



June 6, 2012

Dear Professional Partner:

We are pleased to announce that the vast majority of our engineered polymer (EP) fittings as well as our larger-diameter Uponor AquaPEX® (up to 2") are now listed to UL 1821 and ULC/ORD-C199P for use in AquaSAFETM Residential Fire Sprinkler Systems.

This listing allows even more efficiency and alternatives in AquaSAFE™ designs, providing the most comprehensive offering of both EP fittings and larger-dimension PEX for multipurpose residential fire sprinkler systems.

The following table offers an overview of all the Uponor products now listed to UL 1821 and ULC/ORD-C199P. For a comprehensive list of part numbers and part descriptions, refer to the following two pages.

Item	1/2"	3/411	1"	11/4"	11/2"	2"
Uponor AquaPEX Tubing, White	Χ	X	Χ	х	х	X
ProPEX Rings	Χ	Χ	Χ	X	Х	X
EP Couplings	X	X	X	X	Х	X
EP Elbows	X	X	X	X	Х	X
EP Tees	X	X	X	X	X	X
EP Reducing Tees	X	X	X	X	Х	X
EP Plugs	X	X	X	X	X	X
Male Adapters	N/A	X	X	X	Х	X
Female Adapters	N/A	Χ	Χ	X	X	X
Sweat Adapters	N/A	X	X	X	Х	Х

X = Existing listing

X = New listing

If you have further questions, please feel free to contact me at 800.321.4739, ext. 5387 or jayson.drake@uponor.com.

Best regards,

Jayson Drake

Director of Plumbing and Fire Safety

Uponor North America

Uponor, Inc.5925 148th Street West
Apple Valley, MN 55124
Tel: (800) 321-4739
Fax: (952) 891-2008

Web: www.uponor-usa.com

Uponor Ltd. 2000 Argentia Road Plaza 1, Suite 200 Mississauga, ON L5N 1W1 Tel: (888) 994-7726

Fax: (800) 638-9517 Web: www.uponor.ca



The following items are now listed to UL 1821 and ULC/ORD-C199P for use in Uponor AquaSAFE™ residential fire protection systems. For additional product and pricing information, refer to the Uponor Product Catalog online at www.uponorpro.com.

Part No.	Part Description
Tubing	
Multiple	1¼" Uponor AquaPEX White
Multiple	1½" Uponor AquaPEX White
Multiple	2" Uponor AquaPEX White
ProPEX Rin	ngs
Q4691250	11/4" ProPEX Ring
Q4691500	1½" ProPEX Ring
Q4682000	2" ProPEX Ring
Couplings	
Q4775050	ProPEX EP Coupling, 1/2" PEX x 1/2" PEX
Q4775075	ProPEX EP Coupling, 1/2" PEX x 3/4" PEX
Q4777510	ProPEX EP Coupling, 3/4" PEX x 1" PEX
Q4777575	ProPEX EP Coupling, 3/4" PEX x 3/4" PEX
Q4771010	ProPEX EP Coupling, 1" PEX x 1" PEX
Q4771307	ProPEX EP Coupling, 1-1/4" PEX x 3/4" PEX
Q4771310	ProPEX EP Coupling, 1-1/4" PEX x 1" PEX
Q4771313	ProPEX EP Coupling, 1-1/4" PEX x 1-1/4" PEX
Q4771507	ProPEX EP Coupling, 1-1/2" PEX x 3/4" PEX
Q4771510	ProPEX EP Coupling, 1-1/2" PEX x 1" PEX
Q4771513	ProPEX EP Coupling, 1-1/2" PEX x 1-1/2" PEX
Q4771515	ProPEX EP Coupling, 1-1/2" PEX x 1-1/4" PEX
Q4772015	ProPEX EP Coupling, 2" PEX x 1-1/2" PEX
Q4772020	ProPEX EP Coupling, 2" PEX x 2" PEX
Elbows	
Q4760500	ProPEX EP Elbow, 1/2" PEX x 1/2" PEX
Q4760750	ProPEX EP Elbow, 3/4" PEX x 3/4" PEX
Q4761000	ProPEX EP Elbow, 1" PEX x 1" PEX
Q4761250	ProPEX EP Elbow, 1-1/4" PEX x 1-1/4" PEX
Q4761500	ProPEX EP Elbow, 1-1/2" PEX x 1-1/2" PEX
Q4762000	ProPEX EP Elbow, 2" PEX x 2" PEX
Tees	
Q4755050	ProPEX EP Tee, 1/2" PEX x 1/2" PEX x 1/2" PEX
Q4757575	ProPEX EP Tee, 3/4" PEX x 3/4" PEX x 3/4" PEX
Q4751010	ProPEX EP Tee, 1" PEX x 1" PEX x 1" PEX
Q4751313	ProPEX EP Tee, 1-1/4" PEX x 1-1/4" PEX x 1-1/4" PEX
Q4751515	ProPEX EP Tee, 1-1/2" PEX x 1-1/2" PEX x 1-1/2" PEX
Q4752000	ProPEX EP Tee, 2" PEX x 2" PEX x 2" PEX

Uponor North America

Uponor, Inc.

5925 148th Street West Apple Valley, MN 55124 Tel: (800) 321-4739 Fax: (952) 891-2008

Web: www.uponor-usa.com

Uponor Ltd.

2000 Argentia Road Plaza 1, Suite 200 Mississauga, ON L5N 1W1

Tel: (888) 994-7726 Fax: (800) 638-9517 Web: www.uponor.ca

uponor

Reducing Te	ees
Q4755575	ProPEX EP Reducing Tee, 1/2" PEX x 1/2" PEX x 3/4" PEX
Q4757550	ProPEX EP Reducing Tee, 3/4" PEX x 3/4" PEX x 1/2" PEX
Q4757555	ProPEX EP Reducing Tee, 3/4" PEX x 1/2" PEX x 1/2" PEX
Q4757557	ProPEX EP Reducing Tee, 3/4" PEX x 1/2" PEX x 3/4" PEX
Q4757710	ProPEX EP Reducing Tee, 3/4" PEX x 3/4" PEX x 1" PEX
Q4751150	ProPEX EP Reducing Tee, 1" PEX x 1" PEX x 1/2" PEX
Q4751175	ProPEX EP Reducing Tee, 1" PEX x 1" PEX x 3/4" PEX
Q4751311	ProPEX EP Reducing Tee, 1-1/4" PEX x 1" PEX x 3/4" PEX
04751317	ProPEX EP Reducing Tee, 1-1/4" PEX x 1" PEX x 1" PEX
Q4751331	ProPEX EP Reducing Tee, 1-1/4" PEX x 1-1/4" PEX x 1" PEX
Q4751337	ProPEX EP Reducing Tee, 1-1/4" PEX x 1-1/4" PEX x 3/4" PEX
Q4751511	ProPEX EP Reducing Tee, 1-1/2" PEX x 1" PEX x 1" PEX
Q4751517	ProPEX EP Reducing Tee, 1-1/2" PEX x 1" PEX x 3/4" PEX
Q4751531	ProPEX EP Reducing Tee, 1-1/2" PEX x 1-1/4" PEX x 1" PEX
Q4751533	ProPEX EP Reducing Tee, 1-1/2" PEX x 1-1/4" PEX x 1-1/4" PEX
Q4751537	ProPEX EP Reducing Tee, 1-1/2" PEX x 1-1/4" PEX x 3/4" PEX
Q4751551	ProPEX EP Reducing Tee, 1-1/2" PEX x 1-1/2" PEX x 3/4" PEX
Q4751553	ProPEX EP Reducing Tee, 1-1/2" PEX x 1-1/2" PEX x 1-1/4" PEX
Q4751557	ProPEX EP Reducing Tee, 1-1/2" PEX x 1-1/2" PEX x 1" PEX
Q4751751	ProPEX EP Reducing Tee, 1" PEX x 3/4" PEX x 1" PEX
Q4751775	ProPEX EP Reducing Tee, 1" PEX x 3/4" PEX x 3/4" PEX
Q4752051	ProPEX EP Reducing Tee, 2" PEX x 1-1/2" PEX x 1" PEX
Q4752053	ProPEX EP Reducing Tee, 2" PEX x 1-1/2" PEX x 1-1/4" PEX
Q4752055	ProPEX EP Reducing Tee, 2" PEX x 1-1/2" PEX x 1-1/2" PEX
Q4752210	ProPEX EP Reducing Tee, 2" PEX x 2" PEX x 1" PEX
Q4752213	ProPEX EP Reducing Tee, 2" PEX x 2" PEX x 1-1/4" PEX
Q4752215	ProPEX EP Reducing Tee, 2" PEX x 2" PEX x 1-1/2" PEX
Q4752275	ProPEX EP Reducing Tee, 2" PEX x 2" PEX x 3/4" PEX
Q4752575	ProPEX EP Reducing Tee, 2" PEX x 1-1/2" PEX x 3/4" PEX
Plugs	THOLER EL Reddellig 100/ E TEXX E TEXX O/ L TEX
Q4350500	ProPEX EP Plug, 1/2" PEX
Q4350750	ProPEX EP Plug, 3/4" PEX
Q4351000	ProPEX EP Plug , 1" PEX
04351250	ProPEX EP Plug, 1-1/4" PEX
Q4351500	ProPEX EP Plug, 1-1/2" PEX
Q4352000	ProPEX EP Plug, 2" PEX
Male Adapte	
LF4521313	ProPEX LF Brass Male Threaded Adapter, 1-1/4" PEX x 1-1/4" NPT
LF4521515	ProPEX LF Brass Male Threaded Adapter, 1-1/2" PEX x 1-1/2" NPT
_F4522020	ProPEX LF Brass Male Threaded Adapter, 2" PEX x 2" NPT
Female Ada	
_F4571313	ProPEX LF Brass Female Threaded Adapter, 1-1/4" PEX x 1-1/4" NPT
LF4571515	ProPEX LF Brass Female Threaded Adapter, 1-1/2" PEX x 1-1/2" NPT
_F4572020	ProPEX LF Brass Female Threaded Adapter, 2" PEX x 2" NPT
Sweat Adapt	
LF4511313	ProPEX LF Brass Sweat Adapter, 1-1/4" PEX x 1-1/4" Copper
LF4511515	ProPEX LF Brass Sweat Adapter, 1-1/2" PEX x 1-1/2" Copper
LF4512020	ProPEX LF Brass Sweat Adapter, 2" PEX x 2" Copper

Uponor North America

Uponor, Inc.5925 148th Street West
Apple Valley, MN 55124
Tel: (800) 321-4739
Fax: (952) 891-2008

Web: www.uponor-usa.com

Uponor Ltd. 2000 Argentia Road Plaza 1, Suite 200 Mississauga, ON L5N 1W1 Tel: (888) 994-7726 Fax: (800) 638-9517

Web: www.uponor.ca



Uponor AquaPEX® White

Submittal Information Revision D: July 6, 2010

Project Information	
Job Name:	
Location:	Part No. Ordered:
Engineer:	Date Submitted:
Contractor:	Submitted By:
Manufacturer's Representative:	Approved By:

Technical Data

Material:

Crosslinked polyethylene PEX-a Engel Method; PEX 5006

Standard Grade Hydrostatic Ratings (PPI):

200°F (93°C) at 80 psi 180°F (82°C) at 100 psi 73.4°F (23°C) at 160 psi

1/2", 3/4", and 1" AquaPEX® White only: 120°F (49°C) at 130 psi

Linear Expansion Rate:

1.1"/10°F (12°C)/100'

Product Information and Application Use

Uponor AquaPEX White is tubing used for hot and cold domestic potable water distribution, residential fire safety and radiant heating systems containing no ferrous corrodible components or where ferrous components are isolated from the tubing.



1	Description	Part Number	I.D. (A)	O.D. (B)	Weight
	1/4" Uponor AquaPEX White, 100-ft. coil	F1040250	0.241"	0.375"	4.0 lbs.
	3/8" Uponor AquaPEX White, 400-ft. coil	F1090375	0.350"	0.500"	20.0 lbs.
	3/8" Uponor AquaPEX White, 1,000-ft. coil	F1120375	0.350"	0.500"	44.0 lbs.
	½" Uponor AquaPEX White, 100-ft. coil*	F1040500	0.475"	0.625"	6.0 lbs.
	1/2" Uponor AquaPEX White, 300-ft. coil*	F1060500	0.475"	0.625"	18.0 lbs.
	½" Uponor AquaPEX White, 1,000-ft. coil*	F1120500	0.475"	0.625"	54.0 lbs.
	5/8" Uponor AquaPEX White, 300-ft. coil	F1060625	0.574"	0.750"	28.0 lbs.
	5/8" Uponor AquaPEX White, 1000-ft. coil	F1120625	0.574"	0.750"	86.0 lbs.
	34" Uponor AquaPEX White, 100-ft. coil*	F1040750	0.671"	0.875"	10.0 lbs.
	3/4" Uponor AquaPEX White, 300-ft. coil*	F1060750	0.671"	0.875"	34.0 lbs.
	3/4" Uponor AquaPEX White, 500-ft. coil*	F1100750	0.671"	0.875"	54.0 lbs.
	1" Uponor AquaPEX White, 100-ft. coil*	F1041000	0.862"	1.125"	20.0 lbs.
	1" Uponor AquaPEX White, 300-ft. coil*	F1061000	0.862"	1.125"	56.0 lbs.
	1" Uponor AquaPEX White, 500-ft. coil*	F1101000	0.862"	1.125"	93.0 lbs.
	11/4" Uponor AquaPEX White, 100-ft. coil	F1061250	1.054"	1.375"	34.0 lbs.
	11/4" Uponor AquaPEX White, 300-ft. coil	F1021250	1.054"	1.375"	106.0 lbs.
	11/2" Uponor AquaPEX White, 100-ft. coil	F1061500	1.244"	1.625"	44.0 lbs.
	11/2" Uponor AquaPEX White, 300-ft. coil	F1021500	1.244"	1.625"	133.0 lbs.
	2" Uponor AquaPEX White, 100-ft. coil	F1062000	1.629"	2.125"	68.2 lbs.
	2" Uponor AquaPEX White, 200-ft. coil	F1052000	1.629"	2.125"	136.4 lbs.
	2" Uponor AquaPEX White, 300-ft. coil	F1022000	1.629"	2.125"	204.6 lbs.
	3" Uponor AquaPEX White, 100-ft. coil	F1063000	2.400"	3.125"	128.0 lbs.
	3" Uponor AquaPEX White, 350-ft. coil	F1023000	2.400"	3.125"	442.0 lbs.

Installation

Approved fittings are $ProPEX^{\otimes}$ fittings¹ for sizes $\frac{3}{6}$ " through 2" AquaPEX. Use WIPEXTM fittings for 3" AquaPEX. Refer to the Uponor Professional Plumbing Installation Guide, Radiant Floor Heating Installation Handbook or AquaSAFETM Residential Fire Sprinkler Installation Guide for more information.

Standards	Codes	Listings	
CSA B137.5; ASTM F876; ASTM F877; ASTM F1960; ASTM-E84; ASTM-E119/UL 263	IPC; UPC; NSPC; NPC of Canada	*½", ¾", 1" UL 1821; *ULC/ORD - C 199 P; IAPMO; CSA; HUD; WARNOCK ITS; UL; ICC; ANSI/NSF 14- and 61-certified; AWWA C904²; CAN/ULC S102 diameter and smaller; Canada: 1" diameter and smaller)	
Related Applications		Contact Information	
PEX-a Plumbing Systems Radiant Heating and Cooling Syste AquaSAFE Fire Safety Systems	ems	Uponor, Inc. 5925 148 th Street West Apple Valley, MN 55124 USA Phone: (800) 321-4739 Fax: (952) 891-2008 www.uponor-usa.com	Uponor Ltd. 2000 Argentia Rd., Plaza 1, Ste. 200 Mississauga, ON L5N 1W1 CANADA Phone: (888) 994-7726 Fax: (800) 638-9517 www.uponor.ca

¹ProPEX[®] is a registered trademark of Uponor, Inc. ProPEX[™] is a trademark of Uponor Ltd.

² This listing is for ³/₄" AquaPEX tubing and larger.

Print Stream on Tubing	Explanation
UPONOR AquaPEX	Brand Name
PEX 5006	ASTM F2023 Testing I/A/W ASTM F876
½ IN	Tubing Size (Example: '½")
SDR9	Standard Dimensional Ratio of 9
⑥ B137.5 POTABLE	Potable Water Listing by CSA
• ® = 130PSI 120° F (49° C) UL1821	Rating I/A/W UL 1821 (1/2", 1/4" and 1" only)
ULC-ORD C199P ¹	Canadian Rating I/A/W UL1821 and C199P
■ ASTM F876/F877/F2023	ASTM Tubing Standards Listed by NSF
ASTM F1960/F2080/F1807	ASTM Fitting Standards Listed by NSF
₹.	IAPMO Reports 3558, 3960
ICC ESR-1099	ICC Evaluation Services Report ESR-1099
ICC ESR1529	ICC Evaluation Services Report ESR 1529
HUD MR1269d	HUD Material Release Report 1269d
WHI-LISTED CAN/US FS25/SD50	Warnock Hersey Listing for 25/50 Plenum Rating
160PSI 73.4°F (23°C)/100PSI 180°F (82°C)/80PSI 200°F (93°C)	Hydrostatic Ratings from PPI in Accordance with ASTM F876
UPONOR PEX-a TUBING	Type of Crosslinking (PEX-a)
UN04950127²	Manufacturing Code to Audit Material Source
xxxxxx ^a	Footage Marker in Increments of 3' (three feet)

Table 1-1: Print Stream Identification

ProPEX® Sprinkler **Adapters and Fittings**

Uponor offers sprinkler adapter fittings specifically designed for the AquaSAFE Fire Safety system. These fittings feature ProPEX connections and a standard 1/2" NPT outlet for connecting fire sprinklers.

Table 1-2 shows the required tubing length needed to approximate the equivalent pressure resistance of the different types of Uponor ProPEX fittings.

Calculated Equivalent Tubing Length

Fitting Type	Tubin	g Size
Tee - Run	2'	2'
Tee - 90°	6'	6'
90° Elbow	5'	6'
Coupling	2,	2'

Table 1-2: Pressure Resistance (Fittings/Tubing)

¹ For ½-inch tubing only ² USA, Material Type, Extruder No., Year, Month, Day ³ Footage marking in increments of three feet (3')



ProPEX Lead-free (LF) Brass Fire Sprinkler Adapter Tee

Submittal Information Revision A: Nov. 20, 2009

Project Information	
Job Name:	
Location:	Part No. Ordered:
Engineer:	Date Submitted:
Contractor:	Submitted By:
Manufacturer's Representative:	Approved By:


Technical Data

Material:

C69300 Brass

Product Information and Application Use

Designed for use with ¾" or 1" Uponor AquaPEX® tubing, the ProPEX® Lead-free Brass Fire Sprinkler Adapter Tee connects fire sprinklers to the Uponor residential AquaSAFE™ Looped multipurpose fire safety system, which combines fire sprinklers with a home's potable cold-water plumbing system. Use Uponor ProPEX fittings for the connections.

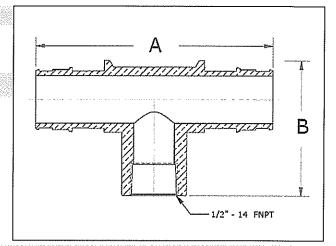

✓	Description	Part Number	Α	В	Weight
	ProPEX LF Brass Fire Sprinkler Adapter Tee, 1" PEX x 1" PEX x 1 ½" FNPT	LF7701010	4.09"	2.325"	0.62 lbs.
	ProPEX LF Brass Fire Sprinkler Adapter Tee, 34 " PEX x 34 " PEX x $1/2$ " FNPT	LF7707575	3.62"	2.325"	0.64 lbs.
11.106998999999		en a sea Casa de en ra Grez este Antaren da decesión in en en en en el	where the factorial and the employed disc.	s stankingstations til til den at lede husben.	a warning and recovery whose property and

Installation

Use the appropriate Uponor ProPEX Ring for the tubing. Install the tee using the Fire Sprinkler Adapter Mounting Bracket (A7750700) and Fire Sprinkler Adapter Push-on Nut (F7000005). For more information, refer to the Uponor AquaSAFE Looped System Installation Guide.

Related Products

A7750700: Fire Sprinkler Adapter Mounting Bracket, ¾" and 1"

F7000005: Fire Sprinkler Adapter Push-on Nut

Standards

CAN/CSA B137.5; ASTM F877; ASTM F1960; UL 1821; ULC/ORD - C199P

Codes

IPC; UPC; NSPC; IRC; IMC; NPC of Canada

Listings

ANSI/NSF 14- and 61-certified; ICC ESR 1099; HUD MR 1269; IAPMO

Related Applications

PEX-a Plumbing Systems AquaSAFE Fire Safety Systems

Contact Information

Uponor, Inc. 5925 148th Street West Apple Valley, MN 55124 USA Phone: (800) 321-4739 Fax: (952) 891-2008 www.uponor-usa.com Uponor Ltd. 2000 Argentia Rd., Plaza 1, Ste. 200 Mississauga, ON L5N 1W1 CANADA Phone: (888) 994-7726 Fax: (800) 638-9517 www.uponor.ca

¹ProPEX[®] is a registered trademark of Uponor, Inc. ProPEX[™] is a trademark of Uponor Ltd.



Fire Sprinkler Adapter Mounting Bracket

Submittal Information Revision A: Nov. 17, 2009

Project Information		
Job Name:		
Location:	Part No. Ordered:	***************************************
Engineer:	Date Submitted:	
Contractor:	Submitted By:	
Manufacturer's Representative:	Approved By:	


Technical Data

Material:

1050 Annealed (spheroidized) spring steel

Product Information and Application Use

Uponor's Fire Sprinkler Adapter Mounting Bracket is designed to rigidly mount ProPEX[®] Lead-free Brass Fire Sprinkler Adapter Tees (LF7701010 and LF7707575) in Uponor AquaSAFE[™] multi-purpose residential fire sprinkler systems.¹

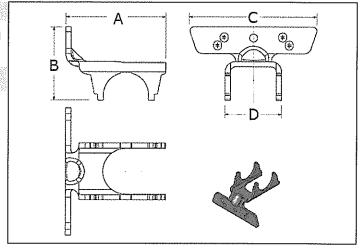

√	Description	Part Number	Α	В	C	D	Weight
	Fire Sprinkler Adapter Mounting Bracket, ¾" and 1"	A7750700	2.48"	1.84"	3.16"	1.42"	0.21 lbs.

Installation

Attach the sprinkler-mounting bracket or sprinkler adapter to the structure with two $#10 \times 11/2$ " Pan Head, Full Thread Screws (F7001500) or equivalent. Refer to the sprinkler plan mounting details for correct placement of brackets and adapters, taking into account the ceiling type and sprinkler model. When installing adapter tee into bracket, use Fire Sprinkler Adapter Push-on Nut (F7000005). For more information, refer to the Uponor AquaSAFE Looped System Installation Guide.

Related Products

LF7701010: ProPEX Brass Fire Adapter Tee, 1" PEX x 1" PEX x ½" FNPT LF7707575: ProPEX Brass Fire Adapter Tee, 34" PEX x 34" PEX x 12" FNPT LF7707575: ProPEX Brass Fire Adapter Tee, 14" PEX x 14" PEX

Standards

UL1821; ULC/ORD - C199P (for use with brass sprinkler adapter tees)

Codes

N/A

Listings

N/A

Related Applications

PEX-a Plumbing Systems AquaSAFE Fire Safety Systems

Contact Information

Uponor, Inc. 5925 148th Street West Apple Valley, MN 55124 USA Phone: (800) 321-4739 Fax: (952) 891-2008 www.uponor-usa.com Uponor Ltd. 2000 Argentia Rd., Plaza 1, Ste. 200 Mississauga, ON L5N 1W1 CANADA Phone: (888) 994-7726 Fax: (800) 638-9517 www.uponor.ca

¹ProPEX[®] is a registered trademark of Uponor, Inc. ProPEX™ is a trademark of Uponor Ltd.



ProPEX® Fire Sprinkler Adapter

Submittal Information Revision B: March 17, 2009

Project Information		
Job Name:		
Location:	Part No. Ordered:	***************************************
Engineer:	Date Submitted:	
Contractor:	Submitted By:	
Manufacturer's Representative:	Annroved By:	***


Technical Data

Material:

300 Series Stainless Steel

Product Information and Application Use

Use the ProPEX® Fire Sprinkler Adapter in conjunction with the appropriate sprinkler to provide a multi-purpose residential fire sprinkler system¹. For residential applications, the system is installed with the cold-potable portion of the Uponor plumbing system. Make connections with Uponor ProPEX fittings. These fittings are designed for use only with 34" or 1" AquaPEX® White tubing in the Uponor AQUASAFE® Looped System.

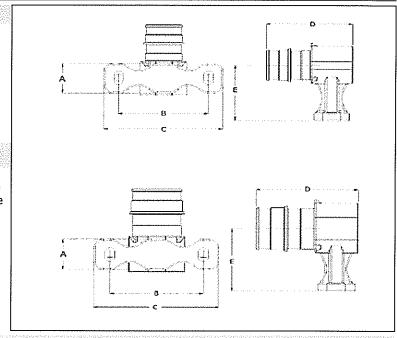

✓ Description	Part Number	Α	В	° C	D	E	Weight
ProPEX Fire Sprinkler Adapter, ¾" PEX x ½" FNPT	Q7517550	0.75"	1.88"	2.50"	1.82"	1.41"	0.268 lbs.
ProPEX Fire Sprinkler Adapter, 1" PEX x 1/2" FNPT	Q7511050	0.75"	1.88"	2.50"	2.06"	1.54"	0.408 lbs.

Installation

Use appropriate ProPEX Ring for connecting the tubing. Refer to the AquaPEX Installation Handbook or the Uponor AQUASAFE® Installation Guide for additional information.

Standards

CAN/CSA B137.5; ASTM F877; ASTM F 1960

Codes

IPC; UPC; NSPC; IRC; IMC; NPC of Canada

Listings

ANSI/NSF 14- and 61-certified; U.P. Code; ICC ESR 1099; HUD MR 1269; UL 1821; ULC/ORD - C 199 P

Related Applications

PEX-a Plumbing Systems AQUASAFE Fire Safety Systems

Contact Information

Uponor, Inc. 5925 148th Street West Apple Valley, MN 55124 USA Phone: (800) 321-4739

Fax: (952) 891-2008 www.uponor-usa.com Uponor Ltd.

2000 Argentia Rd., Plaza 1, Ste. 200 Mississauga, ON L5N 1W1 CANADA

Phone: (888) 994-7726 Fax: (800) 638-9517 www.uponor.ca



ProPEX® Fire Sprinkler Adapter Elbow

Submittal Information Revision B: March 17, 2009

Kev	151011	Ь.	March	1/,	200	=
Pro	TACI	.20	nform	1211	On	

1 Toject zimormation		
Job Name:		
Location:	Part No. Ordered:	
Engineer:	Date Submitted:	31 - 3
Contractor:	Submitted By:	
Manufacturer's Representative:	Approved By:	


Technical Data

Material:

300 Series Stainless Steel

Product Information and Application Use

Use the ProPEX® Fire Sprinkler Adapter Elbow in conjunction with the appropriate sprinkler to provide a multipurpose residential fire sprinkler system¹. The system is installed with the cold-potable portion of the Uponor plumbing system for residential applications. Make connections using Uponor ProPEX fittings. The fittings are designed for use only with ¾" or 1" AquaPEX® White tubing in the Uponor AQUASAFE® Looped System.

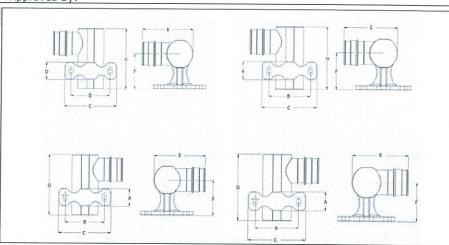

✓ Description	Part Number	A	В	С	D	Е	F	Weight
ProPEX Fire Sprinkler Adapter Right Elbow, ¾" PEX x ½" FNPT	Q7537550	2.25"	1.95"	1.41"	2.25"	1.95"	1.41"	0.410 lbs.
ProPEX Fire Sprinkler Adapter Right Elbow, 1" PEX x 1/2" FNP	Q7531050	2.63"	2.43"	1.54"	2.63"	2.43"	1.54"	0.783 lbs.
ProPEX Fire Sprinkler Adapter Left Elbow, ¾" PEX x ½" FNPT	Q7547550	2.25"	1.95"	1.41"	2.25"	1.95"	1.41"	0.410 lbs.
ProPEX Fire Sprinkler Adapter Left Elbow, 1" PEX x 1/2" FNPT	Q7541050	2.63"	2.43"	1.54"	2.63"	2.43"	1.54"	0.783 lbs.

Installation

Use appropriate ProPEX Ring when connecting the tubing. Refer to the AquaPEX Installation Handbook or the Uponor AQUASAFE Installation Guide for additional information.

Standards

CAN/CSA B137.5; ASTM F877; ASTM F1960

Codes

IPC; UPC; NSPC; IRC; IMC; NPC of Canada

Listings

ANSI/NSF 14- and 61-certified; ICC ESR 1099; HUD MR 1269; IAPMO 3558; UL 1821; ULC/ORD - C 199 P

Related Applications

PEX-a Plumbing Systems AQUASAFE Fire Safety Systems

Contact Information

Uponor, Inc. 5925 148th Street West Apple Valley, MN 55124 USA Phone: (800) 321-4739 Fax: (952) 891-2008 www.uponor-usa.com Uponor Ltd. 2000 Argentia Rd., Plaza 1, Ste. 200 Mississauga, ON L5N 1W1 CANADA Phone: (888) 994-7726 Fax: (800) 638-9517

www.uponor.ca

¹ProPEX® is a registered trademark of Uponor, Inc. ProPEX™ is a trademark of Uponor Ltd.



ProPEX® Ring

Submittal Information Revision B: April 13, 2011

ICCVISION	D. Apri	115, 2011
Project	Infor	mation

Job Name:

Location:

Engineer:

Contractor:

Manufacturer's Representative:

Part No. Ordered:

Date Submitted:

Submitted By:

Approved By:

Technical Data

Material:

PEX-a (Engel Method)

Density:

926 to 940 kg/m³

Degree of Crosslinking:

70% to 89%

Product Information and Application Use

Manufactured from PEX-a material, Uponor ProPEX $^{\circledcirc}$ Rings are required to make a proper ProPEX connection. Red print on the rings indicates hot lines. The $\frac{1}{2}$, $\frac{3}{4}$ and 1" ProPEX Ring with Stop includes a leading edge chamfer and stop edge.



1	Description	Part Number	Length	i.d.	o.d.	Weight
	ProPEX Ring, 3/8"	Q4690302	0.54"	0.49"	0.74"	0.005 lbs.
	ProPEX Ring with Stop, 1/2" (red print)	Q4690511	0.63"	0.63"	0.87"	0.006 lbs.
	ProPEX Ring with Stop, 1/2"	Q4690512	0.63"	0.63"	0.87"	0.006 lbs.
	ProPEX Ring, 5%"	Q4680625	0.79"	0.75"	1.00"	0.008 lbs.
	ProPEX Ring with Stop, ¾"	Q4690756	0.87"	0.88"	1.13"	0.012 lbs.
	ProPEX Ring, 1"	Q4681000	1.10"	1.13"	1.42"	0.020 lbs.
	ProPEX Ring with Stop, 1"	Q4691000	1.10"	1.13"	1.42"	0.020 lbs.
	ProPEX Ring, 11/4"	Q4681250	1.35"	1.38"	1.66"	0.030 lbs.
	ProPEX Ring, 1½"	Q4681500	1.61"	1.63"	1.91"	0.040 lbs.
	ProPEX Ring, 2"	Q4682000	1.97"	2.14"	2.61"	0.133 lbs.

Installation

Square cut the Uponor ProPEX tubing. Remove excess material. Slide the ProPEX Ring over the end of the tubing (maximum 1 / $_{15}^{\circ}$ " over-hang). When using the 1 / $_{15}^{\circ}$ " ProPEX Ring with stop edge, slide the ring on (i.e., chamfered edge first) until the end of the tubing contacts the stop edge. Expand tubing and ring. Rotate tool a quarter turn after each expansion to prevent the formation of grooves. Remove the expansion tool and fully seat the tubing and ring against the shoulder of the fitting. You should make ProPEX connections at temperatures above 5°F /-15°C. For more information, refer to the AquaPEX® Professional Plumbing Installation Handbook, AquaSAFETM Fire Safety Installation Guide or the Uponor Radiant Installation Handbook.

Standards

ASTM F1960

Codes

IPC; UPC; NSPC; NPC of Canada

Listings

UL 1821 (1/2", 3/4" and 1"); ULC/ORD - C 199 P (1/2", 3/4" and 1"); HUD MR 1269; ICC ESR 1099; ANSI/NSF 14- and 61-certified

Related Applications

PEX-a Plumbing Systems Radiant Heating and Cooling Systems AquaSAFE Fire Safety Systems

Contact Information

Uponor, Inc. 5925 148th Street West Apple Valley, MN 55124 USA Phone: (800) 321-4739 Fax: (952) 891-2008 www.uponor-usa.com Uponor Ltd.
2000 Argentia Road, Plaza 1, Suite 200
Mississauga, ON L5N 1W1 CANADA
Phone: (888) 994-7726
Fax: (800) 638-9517
www.uponor.ca

¹ProPEX[®] is a registered trademark of Uponor, Inc. ProPEX[™] is a trademark of Uponor Ltd.



ProPEX® Lead-free (LF) Brass Sweat Adapter

Submittal Information Revision A: Jan. 20, 2010

Project Information	
Job Name:	
Location:	Part No. Ordered:
Engineer:	Date Submitted:
Contractor:	Submitted By:
Manufacturer's Representative:	Approved By:


Technical Data

Material:

C69300 Brass

Product Information and Application Use

ProPEX® Lead-free Brass Sweat Adapters transition Uponor PEX tubing to copper pipe.¹ Adapters are approved for use in hot and cold potable water systems, hydronic radiant heating systems and the AquaSAFE™ Residential Fire Safety System. These adapters are safe for direct burial in soil.



✓	Description	Part Number	Α	В	C	Weight
	ProPEX LF Brass Sweat Adapter. 3%" PEX x 1/2" Copper	LF4513850	1.32"	0.721"	0.50" CU	0.08 lbs.
	ProPEX LF Brass Sweat Adapter, 1/2" PEX x 1/2" Copper	LF4515050	1.44"	0.750"	0.50" CU	0.08 lbs.
	ProPEX LF Brass Sweat Adapter, 1/2" PEX x 3/4" Copper	LF4515075	1.63"	0.989"	0.75" CU	0.16 lbs.
	ProPEX LF Brass Sweat Adapter, ¾" PEX x ½" Copper	LF4517550	1.67"	1.070"	0.50" CU	0.16 lbs.
4	ProPEX LF Brass Sweat Adapter, ¾" PEX x ¾" Copper*	LF4517575	2.04"	1.070"	0.75" CU	0.30 lbs.
	ProPEX LF Brass Sweat Adapter, ¾" PEX x 1" Copper	LF4517510	2.17"	1.258"	1.00" CU	0.31 lbs.
	ProPEX LF Brass Sweat Adapter, 1" PEX x 1" Copper*	LF4511010	2.40"	1.345"	1.00" CU	0.30 lbs.
	ProPEX LF Brass Sweat Adapter, 14" PEX x 14" Copper	LF4511313	2.63"	1.640"	1.25" CU	0.50 lbs.
	ProPEX LF Brass Sweat Adapter, 11/2" PEX x 11/2" Copper	LF4511515	2.75"	1.875"	1.50" CU	0.50 lbs.
	ProPEX LF Brass Sweat Adapter, 2" PEX x 2" Copper	LF4512020	3.53"	3.00"	2.00" CU	2.00 lbs.
\$20 WARREST	USS SECTION DE LA CONTRESE DEL CONTRESE DE LA CONTRESE DEL CONTRESE DE LA CONTRESE DEL CONTRESE DEL CONTRESE DE LA CONTRESE DE LA CONTRESE DEL CONTRESE DEL CONTRESE DE LA CONTRESE DEL CONTRESE DE LA CONTRESE DEL CONTRESE DE LA CONTRESE DEL CONTRESE DE LA CONTR	koet alkoet dalage korrespension dala na .	e status diseases stati da se d	e-Cat Asambiae nasawa	at anaptin protestining materialisation, upon	mentioner and control and control

Installation

Use the appropriate Uponor ProPEX Ring for the tubing (sold separately). Do not solder within 18 inches of the ProPEX Fitting. Refer to AquaPEX[®] Professional Plumbing Installation Guide, Radiant Floor Heating Installation Handbook or AquaSAFE™ Residential Fire Sprinkler Installation Guide for additional information.

Standards

CAN/CSA B137.5; ASTM F877; ASTM F1960

Codes

IPC; UPC; NSPC; NPC of Canada

Listings

HUD MR 1269; ICC ESR 1099; ANSI/NSF 14- and 61-certified; U.P. Code, Annex G; *UL 1821; *ULC/ORD C199P

Related Applications

PEX-a Plumbing Systems Uponor Residential Fire Safety Systems Radiant Heating and Cooling Systems Snow and Ice Melting Systems Permafrost Protection Systems Turf Conditioning Systems

Contact Information

Uponor, Inc. 5925 148th Street West Apple Valley, MN 55124 USA Phone: (800) 321-4739 Fax: (952) 891-1409 www.uponor-usa.com Uponor Ltd. 2000 Argentia Rd., Plaza 1, Ste. 200 Mississauga, ON L5N 1W1 CANADA Phone: (888) 994-7726 Fax: (800) 638-9517 www.uponor.ca



ProPEX® Lead-free (LF) Brass Female Threaded Adapter

Submittal Information Revision A: Jan. 20, 2010

Project Information	
Job Name:	
Location:	Part No. Ordered:
Engineer:	Date Submitted:
Contractor:	Submitted By:
Manufacturer's Representative:	Approved By:


Technical Data

Material:

C69300 Brass

Product Information and Application Use

The ProPEX[®] Lead-free Brass Female Threaded Adapter connects Uponor PEX tubing to female NPT threads.¹ Use these fittings in hot and cold domestic potable water systems or in any radiant heating system. One end of the adapter is manufactured with the Uponor ProPEX Fitting for connections to Wirsbo hePEX™ tubing or Uponor AquaPEX[®] tubing. The other end of the adapter connects to copper. These adapters are safe for direct burial in soil.

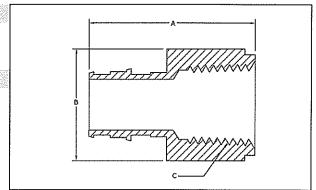

/	Description	Part Number	Α	В	C	Weight
	ProPEX LF Brass Female Threaded Adapter, 1/2" PEX x 1/2" NPT	LF4575050	1.57"	1" HEX	1/2" NPT	0.20 lbs.
	ProPEX LF Brass Female Threaded Adapter, ½" PEX x ¾" NPT	LF4575075	1.75"	1 ³ / ₁₅ " HEX	¾" NPT	0.40 lbs.
	ProPEX LF Brass Female Threaded Adapter, ¾" PEX x ¾" NPT*	LF4577575	1.87"	1%" HEX	34" NPT	0.20 lbs.
	ProPEX LF Brass Female Threaded Adapter, 34 " PEX \times 1" NPT	LF4577510	2.21"	11/2" HEX	1" NPT	0.40 lbs.
	ProPEX LF Brass Female Threaded Adapter, 1" PEX $ imes$ 1" NPT	LF4571010	2.44"	1½" HEX	1" NPT	0.45 lbs.
	ProPEX LF Brass Female Threaded Adapter, 1¼" PEX x 1¼" NPT	LF4571313	2.57"	2" HEX	1¼" NPT	1.00 lbs.
	ProPEX LF Brass Female Threaded Adapter, 1½" PEX x 1½" NPT	LF4571515	2.75"	21/2" HEX	1½" NPT	2.20 lbs.
	ProPEX Brass Female Threaded Adapter, 2" PEX x 2" NPT	LF4572020	3.53"	3" HEX	2" NPT	2.20 lbs.

Installation

ProPEX Tool and ProPEX Rings (sold separately) are required for connecting the PEX tubing. For more information, refer to the AquaPEX Professional Plumbing Installation Guide or the Radiant Floor Heating Installation Handbook.

Standards

CAN/CSA B137.5; ASTM F877; ASTM F1960

Codes

IPC; UPC; NSPC; NPC of Canada

Listings

ANSI/NSF 14- and 61-certified; ICC ESR 1099; HUD MR 1269; U.P. Code, Annex G; *UL 1821; *ULC/ORD C199P

Related Applications

PEX-a Plumbing Systems Radiant Heating and Cooling Systems Snow and Ice Melting Systems Permafrost Protection Systems Turf Conditioning Systems

Contact Information

Uponor, Inc. 5925 148th Street West Apple Valley, MN 55124 USA Phone: (800) 321-4739 Fax: (952) 891-1409 www.uponor-usa.com Uponor Ltd. 2000 Argentia Rd., Plaza 1, Ste. 200 Mississauga, ON L5N 1W1 CANADA Phone: (888) 994-7726 Fax: (800) 638-9517

www.uponor.ca

¹ProPEX[®] is a registered trademark of Uponor, Inc. ProPEX[™] is a trademark of Uponor Ltd.



ProPEX® Lead-free (LF) Brass Male Threaded Adapter

Submitted Thiornation					
Revision	A:	Jan.	28,	2010	

Project Information	
Job Name:	
Location:	Part No. Ordered:
Engineer:	Date Submitted:
Contractor:	Submitted By:
Manufacturer's Penrecentative	Ammond Dur


Technical Data

Material:

C69300 Brass

Product Information and Application Use

ProPEX® Lead-free Male Threaded Adapters connect Uponor PEX tubing to male NPT threads. 1 These adapters are safe for direct burial in soil.

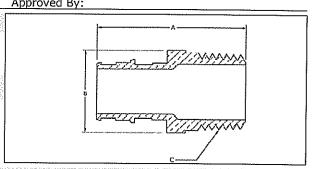

V	Description	Part Number	Α	В	С	Weight
	ProPEX LF Brass Male Threaded Adapter, ¾" PEX x ½" NPT	LF4523850	1.62"	%" HEX	1∕2" NPT	0.11 lbs.
V	ProPEX LF Brass Male Threaded Adapter, $1/2$ " PEX x $1/2$ " NPT	LF4525050	1.73"	%" HEX	1/2" NPT	0.32 lbs.
e dandistratury and dand area	ProPEX LF Brass Male Threaded Adapter, $1/2$ " PEX x $3/4$ " NPT	LF4525075	1.78"	11⁄8" HEX	¾" NPT	0.18 lbs.
- Constitution of the Cons	ProPEX LF Brass Male Threaded Adapter, 34 " PEX x 34 " NPT*	LF4527575	2.02"	11/8" HEX	34" NPT	0.20 lbs.
Of the state of th	ProPEX LF Brass Male Threaded Adapter, 34 " PEX x 1" NPT*	LF4527510	2.22"	1%" HEX	1" NPT	0.35 lbs.
	ProPEX LF Brass Male Threaded Adapter, 1" PEX x 34 " NPT	LF4521075	2.25"	1¼" HEX	34" NPT	0.30 lbs.
	ProPEX LF Brass Male Threaded Adapter, 1" PEX x 1" NPT*	LF4521010	2.46"	13/8" HEX	1" NPT	0.44 lbs.
	ProPEX LF Brass Male Threaded Adapter, 1¼" PEX x 1¼" NPT	LF4521313	2.72"	1¾" HEX	1¼" NPT	0.75 lbs.
	ProPEX LF Brass Male Threaded Adapter, 1½" PEX x 1½" NPT	LF4521515	3.00"	2¼" HEX	11/2" NPT	0.80 lbs.
	ProPEX Brass Male Threaded Adapter, 2" PEX \times 2" NPT	LF4522020	3.86"	21/2" HEX	2" NPT	1.90 lbs.

Installation

ProPEX Tool and ProPEX Rings (sold separately) are required for connecting the PEX tubing. Refer to the AquaPEX® Professional Plumbing Installation Guide or Radiant Floor Heating Installation Handbook for additional information.

Standards

CAN/CSA B137.5; ASTM F877; ASTM F1960

Codes

IPC; UPC; NSPC; NPC of Canada

Listings

ANSI/NSF 14- and 61-certified; HUD MR 1269; ICC ESR 1099; IAPMO 3558; U.P. Code, Annex G; *UL 1821; *ULC/ORD C199P

Related Applications

PEX-a Plumbing Systems Radiant Heating and Cooling Systems Snow and Ice Melting Systems Permafrost Protection Systems Turf Conditioning Systems

Contact Information

Uponor, Inc. 5925 148th Street West Apple Valley, MN 55124 USA Phone: (800) 321-4739 Fax: (952) 891-1409 www.uponor-usa.com

Uponor Ltd.

2000 Argentia Rd., Plaza 1, Ste. 200 Mississauga, ON L5N 1W1 CANADA

Phone: (888) 994-7726 Fax: (800) 638-9517 www.uponor.ca

¹ProPEX® is a registered trademark of Uponor, Inc. ProPEX™ is a trademark of Uponor Ltd.



ProPEX® Lead-free (LF) Brass Coupling

Submittal Information Revision A: Jan. 28, 2010

Project Information		
Job Name:		www
Location:	Part No. Ordered:	
Engineer:	Date Submitted:	
Contractor:	Submitted By:	
Manufacturer's Representative:	Approved By:	


Technical Data

Material

C69300 Brass

Product Information and Application Use

ProPEX® Lead-free Brass Couplings are available for use in hot and cold domestic potable water systems. 1 Also approved for use in any radiant heating system. The coupling features the Uponor ProPEX Fitting for connections to Wirsbo hePEX™ tubing or Uponor AquaPEX® tubing. Couplings are safe for direct burial in soil.

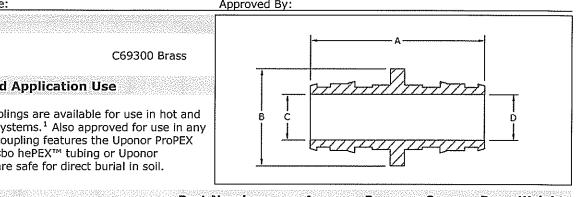

Yes	Description	Part Number	. A	В	C	D !	Weight
	ProPEX LF Brass Coupling, 3%" PEX x 1/2" PEX	LF4543850	1.42"	0.740"	0.398"	0.280"	0.05
and the second	ProPEX LF Brass Coupling, 1/2" PEX x 1/2" PEX*	LF4545050	1.54"	0.740"	0.398"	N/A	0.07
Invation (trade)	ProPEX LF Brass Coupling, ¾" PEX x ¾" PEX*	LF4547575	2.02"	1.187"	0.595"	N/A	0.13
	ProPEX LF Brass Coupling, ¾" PEX x 1" PEX*	LF4547510	2.25"	1.345"	0.795"	0.595"	0.16
	ProPEX LF Brass Coupling, 1" PEX x 1" PEX*	LF4541010	2.49"	1.345"	0.818"	N/A	0.20

Installation

ProPEX Tool and ProPEX Rings (sold separately) are required for connecting the PEX tubing. Use the appropriately sized Uponor ProPEX Ring for tubing connections. For more information, refer to the AquaPEX Professional Plumbing Installation Guide, the AquaSAFETM Residential Fire Sprinkler Installation Guide or the Radiant Floor Heating Installation Handbook.

Standards

CAN/CSA B137.5; ASTM F877; ASTM F1960

Codes

IPC; UPC; NSPC; NPC of Canada

Listinas

IAMPO 3558; HUD MR 1269; ICC ESR 1099; NSF 14- and 61-certified; U.P. Code, Annex G; *UL 1821; *ULC/ORD C199P

Related Applications

PEX-a Plumbing Systems Uponor Residential Fire Safety Systems Radiant Heating and Cooling Systems Snow and Ice Melting Systems Permafrost Protection Systems Turf Conditioning Systems

Contact Information

Uponor, Inc. 5925 148th Street West Apple Valley, MN 55124 USA Phone: (800) 321-4739 Fax: (952) 891-2008

www.uponor-usa.com

Uponor Ltd.

2000 Argentia Rd., Plaza 1, Ste. 200 Mississauga, ON L5N 1W1 CANADA

Phone: (888) 994-7726 Fax: (800) 638-9517 www.uponor.ca

¹ProPEX[®] is a registered trademark of Uponor, Inc. ProPEX[™] is a trademark of Uponor Ltd.



ProPEX® Brass Elbow

Submittal Information Revision B: March 17, 2009


		rmati	

Job Name:		
Location:	Part No. Ordered:	***************************************
Engineer:	Date Submitted:	
Contractor:	Submitted By:	***************************************
Manufacturer's Representative:	Approved By:	

Technical Data

Material:

B16 Copper Alloy UNS C36000

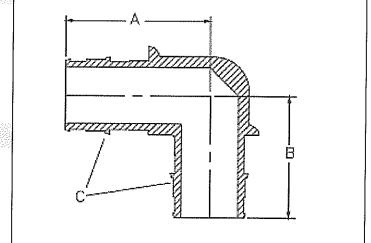

Product Information and Application Use

The brass ProPEX® Elbow is available for use in hot and cold domestic potable water systems, and in the AQUASAFE® Residential Fire Safety systems. Also approved for use in any hydronic heating and AquaPEX® plumbing systems, each end of the elbow is manufactured with the ProPEX fitting for connections to hePEX $^{\text{TM}}$ or any AquaPEX tubing.

✓	Description P	Part Number	Α	В	C	Weight
	ProPEX Brass Elbow, 1/2" PEX x 1/2" PEX*	Q4710500	1.45"	1.48"	0.500"	0.10 lbs.
	ProPEX Brass Elbow, 5%" PEX x 5%" PEX	Q4710625	1.77"	1.57"	0.625"	0.15 lbs.
	ProPEX Brass Elbow, ¾" PEX x ¾" PEX*	Q4710750	2.04"	1.75"	0.750"	0.20 lbs.
	ProPEX Brass Elbow, 1" PEX x 1" PEX*	Q4711000	2.61"	2.28"	1.000"	0.30 lbs.
	ProPEX Brass Elbow, 2" PEX x 2" PEX	Q4712000	4.66"	4.36"	2.000"	2.20 lbs.
1.00069069		continued voltable ration is an allowing error concern course				

Installation

Use appropriate ProPEX Ring for connecting the tubing. Refer to the AquaPEX Installation Handbook, the Radiant Floor Installation Handbook or the Uponor AQUASAFE® Installation Guide for additional information.

Standards

CAN/CSA B137.5; ASTM F877; ASTM F 1960

Codes

IPC; UPC; NSPC; NPC of Canada

Listings

ANSI/NSF 14- and 61-certified; U.P. Code; ICC ESR 1099; HUD MR 1269; *UL 1821; *ULC/ORD C199P

Related Applications

PEX-a Plumbing Systems AQUASAFE Fire Safety Systems Uponor Radiant Floor heating Systems

Contact Information

Uponor, Inc. 5925 148th Street West Apple Valley, MN 55124 USA Phone: (800) 321-4739 Fax: (952) 891-2008 www.uponor-usa.com

Uponor Ltd.
2000 Argentia Rd., Plaza 1, Ste. 200
Mississauga, ON L5N 1W1 CANADA
Phone: (888) 994-7726
Fax: (800) 638-9517
www.uponor.ca

¹ProPEX[®] is a registered trademark of Uponor, Inc. ProPEX[™] is a trademark of Uponor Ltd.



Submittal Information Revision B: Jan. 28, 2010

Project Information	
Job Name:	
Location:	Part No. Ordered:
Engineer:	Date Submitted:
Contractor:	Submitted By:
Manufacturer's Representative	Approved By:

Technical Data

Material:

C69300 Brass

Product Information and Application Use

Uponor's ProPEX® Lead-free Brass Tees are ideal for use in hot and cold domestic potable water systems.1

This product is approved for use in the AquaSAFE™ Residential Fire Safety System. Also approved for any hydronic heating system application.

Each end of the ProPEX LF Brass Tee is manufactured with the Uponor ProPEX Fitting for connections to Wirsbo hePEX[™] or Uponor AquaPEX® tubing. This product is safe for direct burial in soil.



√	Description	Part Number	Length	Width	Weight
	ProPEX LF Brass Tee, 1/2" PEX x 1/2" PEX x 1/2" PEX	LF4705050	2.52"	1.45"	0.20 lbs.
	Propex LF Brass Tee, 34 " PEX x 34 " PEX x 34 " PEX	LF4707575	3.27"	1.93"	0.40 lbs.
	ProPEX LF Brass Tee, 1" PEX x 1" PEX x 1" PEX	LF4701010	4.09"	2.42"	0.40 lbs.

Installation

ProPEX Tool and ProPEX Rings (sold separately) are required for connecting the PEX tubing. Do not solder within 18 inches of the ProPEX connection. Refer to the AquaPEX Professional Plumbing Installation Guide, AquaSAFE Homeowner Handbook or Radiant Floor Heating Installation Handbook for additional information.

Standards

CSA B137.5; ASTM F877; ASTM F1960

Codes

IPC; UPC; NSPC; NPC of Canada

Listings

IAPMO 3558; ANSI/NSF 14- and 61-certified; HUD MR 1269; ICC ESR 1099; UL 1821; ULC/ORD C 199P; U.P. Code, Annex G

Related Applications

PEX-a Plumbing Systems Uponor Residential Fire Safety Systems Radiant Heating and Cooling Systems

Contact Information

Uponor, Inc. 5925 148th Street West Apple Valley, MN 55124 USA Phone: (800) 321-4739 Fax: (952) 891-2008

www.uponor-usa.com

Uponor Ltd. 2000 Argentia Rd., Plaza 1, Ste. 200 Mississauga, ON L5N 1W1 CANADA

Phone: (888) 994-7726 Fax: (800) 638-9517 www.uponor.ca



ProPEX® Lead-free (LF) Brass Reducing Tee

Submittal Information Revision B: Jan. 28, 2010

Project Information	
Job Name:	
Location:	Part No. Ordered:
Engineer:	Date Submitted:
Contractor:	Submitted By:
Manufacturer's Representative:	Approved By:

Technical Data


Material:

C69300 Brass

Product Information and Application Use

Uponor's ProPEX® LF Brass Reducing Tee makes diverting connections for Uponor PEX tubing in supply and return mains.¹ This product is available for use in hot and cold domestic potable water systems, in any hydronic heating system and in the AquaSAFETM Residential Fire Safety System. Uponor manufactures each end of the tee with the ProPEX Fitting for easy connections to Wirsbo hePEXTM or Uponor AquaPEX® tubing. This product is safe for direct burial in soil.

Note: Branch size is listed last in the part description.

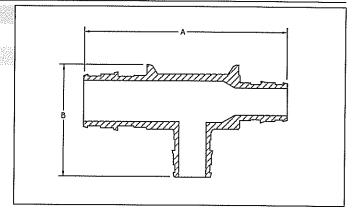

✓	Description	Part Number	Α	В	Weight
	ProPEX LF Brass Reducing Tee, ¾" PEX x ¾" PEX x ½" PEX	LF4707550	3.27"	1.69"	0.40 lbs.
	ProPEX LF Brass Reducing Tee, 34 " PEX x 34 " PEX x 1" PEX	LF4707710	3.62"	2.42"	0.50 lbs.
	ProPEX LF Brass Reducing Tee, 1" PEX x 34 " PEX x 34 " PEX	LF4701775	3.86"	2.18"	0.30 lbs.
	ProPEX LF Brass Reducing Tee, 1" PEX x ¾" PEX x 1" PEX	LF4701751	3.86"	2.42"	0.40 lbs.
	ProPEX LF Brass Reducing Tee, 1" PEX x 1" PEX x 1½" PEX	LF4701150	4.09"	1.95"	0.40 lbs.
L l	ProPEX LF Brass Reducing Tee, 1" PEX x 1" PEX x 34" PEX	LF4701175	4.09"	2.18"	0.40 lbs.
Ins	tallation				

ProPEX Tool and ProPEX Rings (sold separately) are required for connecting PEX tubing. Refer to the AquaPEX Professional Plumbing Installation Guide, the AquaSAFE Residential Fire Sprinkler Installation Guide or the Radiant Floor Heating Installation Handbook for additional information.

Standards

CAN/CSA B137.5; ASTM F877; ASTM F1960

Codes

IPC; UPC; NSPC; NPC of Canada

Listings

IAPMO 3558; ANSI/NSF 14- and 61-certified; HUD MR 1269; ICC ESR 1099; UL 1821; ULC/ORD C 199P; U.P. Code, Annex G

Related Applications

PEX-a Plumbing Systems
Uponor Residential Fire Safety Systems
Radiant Heating and Cooling Systems
Snow and Ice Melting Systems
Permafrost Protection Systems
Turf Conditioning Systems

Contact Information

Uponor, Inc. 5925 148th Street West Apple Valley, MN 55124 USA Phone: (800) 321-4739 Fax: (952) 891-2008 www.uponor-usa.com Uponor Ltd. 2000 Argentia Rd., Plaza 1, Ste. 200 Mississauga, ON L5N 1W1 CANADA Phone: (888) 994-7726

Fax: (800) 638-9517 www.uponor.ca

¹ProPEX[®] is a registered trademark of Uponor, Inc. ProPEX[™] is a trademark of Uponor Ltd.



1" Branch Manifold with 1/2" ProPEX® Lead-free (LF) Outlets

Submittal Information Revision A: Jan. 28, 2010

Project Information		
Job Name:		
Location:	Part No. Ordered:	
Engineer:	Date Submitted:	
Contractor:	Submitted By:	
Manufacturer's Representative:	Approved By:	

Technical Data

Material:

Type L Copper; C69300 Brass

Maximum Temperature (no pressure):

320°F (160°C)

Maximum Working

Temperature/Pressure:

210°F at 150 psi (99°C at 10 bar)

Maximum Flow Rate at 5 fps:


12.8 gpm

Maximum Flow Rate at 8 fps:

20.5 gpm

Product Information and Application Use

The Uponor 1" Copper Branch Manifold with $\frac{1}{2}$ " ProPEX® Lead-free outlets is used for hot and cold domestic potable water distribution systems. The manifold has a 1" copper sweat fitting adapter supply connection. All outlets are configured with $\frac{1}{2}$ " ProPEX Lead-free brass connections.

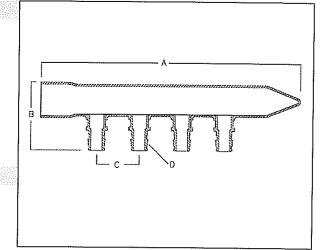

✓ Description	Part Number	Α	В	С	D	Weight
1" Branch Manifold with 1/2" ProPEX LF outlets, 4 outlets	LF2801050	8.95"	2.40"	1.50"	1/2"	0.80 lbs.
1" Branch Manifold with 1/2" ProPEX LF outlets, 6 outlets	LF2811050	11.95"	2.40"	1.50"	1/2"	1.10 lbs.
1" Branch Manifold with 1/2" ProPEX LF outlets, 8 outlets	LF2821050	14.95"	2.40"	1.50"	1/2*1	1.40 lbs.
1" Branch Manifold with 1/2" ProPEX LF outlets, 10 outlets	LF2831050	17.95"	2.40"	1.50"	1/2"	1.70 lbs.
1" Branch Manifold with ½" ProPEX LF outlets, 12 outlets	LF2841050	20.95"	2.40"	1.50"	1/2"	1.90 lbs.
(i di ka Kapada katangan		000000000000000000	1941 verti Arranda disedi	Norwal State (State)	Colorida esta con esta con con

Installation

Use any product designed to mount 1" copper pipe as a mounting bracket. Any bend within 6 inches of the ProPEX connection to the manifold requires the use of a Tube Talon (F7050750) or Bend Support (A5110500 and A5150500). Refer to the AquaPEX® Professional Plumbing Installation Guide or the AquaSAFETM Residential Fire Sprinkler Installation Guide for additional information.

Standards

CAN/CSA B137.5; ASTM F877; ASTM F1960

Codes

IPC; UPC; NSPC; NPC of Canada

Listings

UL 1821; ULC/ORD - C 199P; ICC ESR 1099; ANSI/NSF 14- and 61-certified; IAPMO; U.P. Code, Annex G

Related Applications

PEX-a Plumbing Systems Uponor Residential Fire Safety Systems Radiant Heating and Cooling Systems

Contact Information

Uponor, Inc. 5925 148th Street West Apple Valley, MN 55124 USA Phone: (800) 321-4739 Fax: (952) 891-2008

Uponor Ltd. 2000 Argentia Rd., Plaza 1, Ste. 200 Mississauga, ON L5N 1W1 CANADA Phone: (888) 994-7726

Fax: (800) 638-9517 www.uponor.ca

¹ProPEX[®] is a registered trademark of Uponor, Inc. ProPEX[™] is a trademark of Uponor Ltd.

		* *
		•

Bulletin 140 Rev. J

RFC Residential Sprinkler Design and Installation Guide Model F1 Res and

Bulletin 140 Rev. J







49/49LL, 58/58LL & 76 Recessed Pendent / F1



Recessed Pendent / FP 49/49LL, 58/58LL & 76 F1 Res 30/30LL,



Res 44/44L





F1 Res 30/30LL, 49/49LL, 58/58LL & 76 CCP Pendent F1 Res 44/44LL SWC 43/43LL, 49/49LL RFC 30/30L

Recessed HSW/F2 F1 Res 44/44LL

& 58/58LL

Sprinkler Model and Type	Sprinkler Identification Number	Reliable Bulletin Number
F1 Res 30/30LL Pendent F1 Res 30/30LL Recessed Pendent/F1 F1 Res 30/30LL Concealed Pendent/CCP F1 Res 30/30LL Concealed Pendent/CCP	R3511 RA3311	Horizontal Ceilings – 135, 033
F1 Res 49/49LL Pendent F1 Res 49/49LL Recessed Pendent/F1 F1 Res 49/49LL Recessed Pendent/FP F1 Res 49/49LL Recessed Pendent/CCP F1 Res 49/49LL Concealed Pendent/CCP	R3516, RA3316	Horizontal Ceilings – 135, 033 Sloped Ceilings - 035
F1 Res 58/58LL Pendent F1 Res 58/58LL Recessed Pendent/F1 F1 Res 58/58LL Recessed Pendent/FP F1 Res 58/58LL Concealed Pendent/CCP	R3513, RA3313	Horizontal Ceilings - 135, 033
RFC 30/30LL, 43/43LL & 49/49LL Concealed Pendent	RA0611, RA0612, RA0616, RA3211, RA3212, RA3216	Horizontal Cellings – 006, 032 Sloped Cellings – 035
RFC 56 Concealed Pendent	RA0914	Horizontal Ceilings – 009
F1 Res 44/44LL Horizontal Sidewall F1 Res 44/44LL Recessed Horizontal Sidewall	R3531, RA3331	Horizontal Ceilings – 135, 033 Sloped Ceilings - 035
F1 Res 44/44LL SWC Concealed Horizontal Sidewall	R3531, RA3331	Horizontal Ceilings - 135,033
F1 Res 58/58LL Horizontal Sidewall F1 Res 58/58LL Recessed Horizontal Sidewall/F2	R3533, RA3335	Horizontal Ceilings - 135, 033
F1 Res 76 PendentF1 Res 76 Recessed Pendent/F1 F1 Res 76 Recessed Pendent/FP F1 Res 76 Concealed Pendent/CCP	R7618	Horizontal Ceilings – 135, 176

Model F1 Res and Model RFC Residential Sprinklers

General

ble environment, providing escape time for occupants. tial sprinklers improve life safety by maintaining a tenaby NFPA 13, Installation of Sprinkler Systems. Fast recies Up to and Including Four Stories in Height; and for lation of Sprinkler Systems for Residential Occupansponse and high wall wetting characteristics of residenthe residential portions of any occupancy as permitted Dwellings and Manufactured Homes; NFPA 13R, Instal-Installation of Sprinkler Systems for One-and Two-Family dance with the following NFPA standards: NFPA 13D, pipe residential sprinkler systems designed in accorthermal element and are intended for use in only wet-Reliable residential sprinklers utilize a fast response

or where buildings are of mixed use where residential is of building or occupancy should be protected with resisprinklers in accordance with NFPA 13. tions of such buildings with residential or quick response not the predominant occupancy, protect residential por-Where buildings are greater than four stories in height, occupancies up to and including four stories in height. use as an option to NFPA 13 only in those residential cordance with NFPA 13R. NFPA 13R is appropriate for dential sprinklers in accordance with NFPA 13, or in acfactured homes. Residential portions of any other type hazards only in one-and two-family dwellings and manu-NFPA 13D is appropriate for protection against fire

tions, information based on NFPA 13 is used. sprinkler systems does not exist for particular applicatechnical bulletins. Where documentation for residential mentioned standards, manufacturer's instructions, and density of 0.05 gpm/ft², in accordance with the above-Model F1/Res and RFC Residential Sprinklers shown in Table A, which are cULus Listed to provide a minimum This document provides design guidelines for the

tion for guidance and approval result in the impairment of sprinkler integrity and proper local jurisdictional requirements. Failure to comply may guidelines governing such an installation. The Reliable Model F1/Res and RFC residential sprinklers described and experienced with automatic sprinkler system design and installation. Several criteria may apply to a signed and installed by competent individuals trained these instances, consult the Authority Having Jurisdicwith the recommendations of NFPA 13, 13D, or 13R. In signs which cannot be fully sprinklered in accordance type architecture, there will be some compartment deoperation. Because of the various features of residential Protection Association (NFPA), and with any additional with the latest published standards of the National Fire with this document manufacturer's recommendations, herein must be installed and maintained in compliance be familiar with the applicable codes, standards, and given installation and the designer and/or installer must Residential fire sprinkler systems should only be de-

> matic sprinkler systems. tems, for guidance on testing and maintenance of autoand Maintenance of Water-Based Fire Protection Systection system and associated devices in proper operating condition. Refer to NFPA 25, Inspection, Testing, The owner is responsible for maintaining their fire pro-

Approvals

ments. bulletins, and this installation guide. tion, the information in the Reliable residential sprinkler as modified by the individual UL 1626 listing informafor residential sprinklers contained in the current NFPA 4/12 (18.4°) and 8/12 (33.7°) pitch. The design criteria ceilings (where applicable) having maximum slopes of with a maximum slope of 2/12 (9.4°) pitch, and sloped cULus Listed for installation on both horizontal ceilings flows, and pressures. Reliable residential sprinklers are in the specific listings, with specific approved spacing, of unobstructed construction, unless otherwise noted cULus Listed for installation under smooth, flat ceilings writers Laboratories (UL) 1626, Standard for Residential and tested in accordance with the latest Edition of Underapplicable codes, standards, and jurisdictional requireresidential sprinkler installations for compliance with all ing Jurisdiction (AHJ) must make final approval for all Sprinklers for Fire Protection Service. Typically, they are 13D, 13R, and 13 Standards must be followed except All Reliable residential sprinklers have been designed The Authority Hav-

mation provided in the technical bulletins referenced in except as modified by the individual cULus Listing infortained in the current NFPA Standards must be followed criterion is applicable to all editions of NFPA 13, 13R and quirement, the use of residential sprinklers meeting this common. Because this minimum density is a listing retype sprinklers, which exceed this minimum density, is tt2 density. Increased flow rates for horizontal sidewall flow rate may be greater than the calculated 0.05 gpm/ successfully pass the UL 1626 fire tests, the UL Listed to a 0.05 gpm/ft² density. In some cases, however, to rate over the specified coverage area corresponding rate, the manufacturer must use a minimum discharge 2002. When establishing a minimum cULus Listed flow for residential sprinklers manufactured after July 12, tion of UL 1626 is the new minimum density requirement Table A. The design criteria for residential sprinklers con-One of the most important revisions of the Third Edi-

Definitions

The following NFPA definitions are applicable to the terms used in this installation guide. Where terms are not included, refer to NFPA 13, NFPA 13D and NFPA 13R for official definitions:

Residential Sprinkler -- A type of fast-response sprinker that has a thermal element with an RTI of 50 (m-s) ½ or less, has been specifically tested for its ability to enhance survivability in the room of fire origin and listed for use in the protection of dwelling units. Residential sprinklers posses a fast response thermal element and produce a spray pattern that discharges water higher on the wall than a standard spray sprinkler.

<u>Dwelling</u> – Any building that contains not more than one or two dwelling units intended to be used, rented, leased, let or hired out to be occupied or that are occupied for habitation purposes.

<u>Dwelling Unit</u> – One or more rooms, arranged for the use of one or more individuals living together, as in a single housekeeping unit, that normally have cocking, living, saritary, and sleeping facilities. Dwelling units include hotel rooms, dorrnilory rooms, condominiums, apartments, and similar living units.

Compartment - A compartment is a space completely enclosed by walls and a ceiling. The compartment enclosure is permitted to have openings (in walls) to an adjoining space, provided that soffits or lintels along the ceiling over the compartment opening has a minimum depth of 8 in. (203mm) from the ceiling. In other words, areas such as hallways, stainwells, and rooms must be separated by beams, lintels or soffits 8 or more inches in depth to be considered single compartments.

Obstructed Construction – Panel construction and other construction where beams, trusses, or other members impede heat flow or water distribution in a manner that materially affects the ability of sprinklers to control or suppress a fire. See NFPA 13 Appendix for detailed explanations of this type of construction.

<u>Unobstructed Construction</u> — Construction where bearns, trusses, or other members do not impacte heat flow or water distribution in a manner that materially affects the ability of sprinklers to control or suppress a fire. This type of construction has the following features: (1) horizontal structural members that are not solid; (2) openings of the structural members are at least 70% of the cross sectional area; (3) depth of the structural members do not exceed the least dimension of the openings; or (4) the spacing of structural members exceeds 7.5.

feet on center. See NFPA 13 Appendix for detailed explanations of this type of construction.

Flat Ceiling - a continuous ceiling in a single plane.

Smooth Ceiling – A continuous ceiling free from significant irregularities, lumps or indentations.

Harizontal Ceiling - A ceiling that does not exceed a slope of 2/12 pitch (slope of 16.7% or 9.4°).

Stoped Ceiling – A ceiling exceeding a maximum stope of 2/12 (9.4°) pitch.

Installation Considerations

Residential sprinklers utilizing a glass bulb thermal element have orange protective caps and straps to provide temporary protection to the frangible glass bulb during shipping and installation.

- Do not install any bulb type sprinkler if the bulb is cracked or there is liquid missing from the bulb. While holding the sprinkler in the horizontal position, a small air bubble having an approximate diameter of 1/16° should be visible.
- sition, a small air bubble having an approximate diameter of 1/16" should be visible.

 b. The sprinkler is designed for installation with the protective strap in place using the appropriate
- spirikler wench.

 c. Sprinklers that are dropped during the installation process or that are installed on piping other than that in accordance with item "a" shall be replaced, including sprinklers with protective caps
- d. Protective caps and straps shall be removed only using means in accordance with the manufacturer's installation instructions. They are not to be left on the sprinkler after the sprinkler system is placed in service.
- Protective caps and straps shall be removed only
 when water supply is made available to the sprinkler for the purposes of fire protection and placed
 in service.
- A leak-tight ½" NPT sprinkler joint should be obtained with a maximum torque of 14 (t-lbs to 21 t-lbs. (approximately 2 turns past hand tight. Do not over tighten). Higher levels of torque may distort the sprinkler intel or bend the trame, causing leakage or impairment of the sprinkler.

Where applicable, escutcheon plates must be installed. Absence of an escutcheon plate, where there is an annular space between the ceiling and the spirinkler, may delay sprinkler operation in the event of a few first may delay sprinkler operation in the delay sprinkler operation additions to any first Never introduce any leaf storping additions to any first Never introduce any leaf storping additions to any first Never introduce any leaf storping additions to any first Never introduce any leaf storping additions to any first Never introduce any leaf storping additions to any first Never introduce any leaf storping addition to the storping

Never introduce any leak stopping additives to any fire sprinkler system.

> Residential sprinklers must be installed with the manufacturer's specified sprinkler wrench. Channel locks, crescent wrenches or anything other than the proper sprinkler wrench shall not be used.

Installing sprinklers in CPVC and copper piping systems require special considerations. Never install the sprinkler into the reducing fitting prior to attaching the reducing fitting to the system piping. When installing residential sprinklers or commercial sprinklers in a CPVC piping system, sprinklers must be installed only after the reducing fitting has been installed and the CPVC manufacturer's setting time for the primer and/or cement has passed. This is to ensure that the cement does not accumulate within the sprinkler. In copper piping systems, sprinklers must be installed only after the inside of the sprinkler drop and associated fittings have been wire-brushed to remove any residual flux. Residual flux can cause corrossion. Both of these conditions can impair and prevent proper sprinkler opperation.

System Design Criteria

Permitted Sprinklers for Residential Sprinkler Systems For NFPA 13D and 13R sprinkler systems, only listed residential sprinklers shall be used, with the following exceptions:

- Listed standard dry-pendent or dry sidewall sprinklers shall be permitted to be extended into unheated areas not intended for living purposes.
- Quick-response sprinklers shall be permitted to be used in mechanical closets.
- For NFPA 13R systems, listed quick-response sprinklers shall be permitted to be installed in dwelling units meeting the definition of a compartment where no more than four (4) sprinklers are located within the dwelling unit.

Non-residential sprinklers are to be installed in accordance with the criteria specified by NFPA 13.

Residential Sprinkler Positioning and Spacing Requirements

When locating residential sprinklers, consideration must be given to sensitivity, sprinkler spacing, obstructions to discharge, temperature rating, and proximity to heat sources.

Sprinkler Sensitivity - Deflector Positioning

Residential pendent sprinklers not listed with specific positioning criteria must be positioned so that the deflectors are within 1 in. to 4 in. (25.4 mm to 102 mm) from the ceiling. On flat, horizontal ceilings, Reliable Model F1 Res 49 pendent and recessed pendent sprinklers may also be positioned with the deflector 4" to 8" (102 mm to 203 mm) from the ceiling, in accordance with the listed flows and pressures shown in Bulletin 135. If located in

closets, it is permitted to install pendent sprinklers so that the deflector is within 12 inches (305 mm) of the ceiling. Residential sidewall sprinklers that have not been listed with specific positioning criteria must be positioned so that the deflectors are within 4 in. to 6 in. (102 mm to 152 mm) from the ceiling. Install sidewall sprinklers having listed positioning criteria in accordance with their listing. Under both horizontal and sloped ceilings, always align sprinkler deflectors so that the deflector is parallel with the plane of the ceiling surface.

Sprinkler Spacing Under Horizontal Ceilings

Several maximum coverage areas are used for residential sprinklers in accordance with minimum listed flows and pressures. The area of coverage must be equal to or greater than both the length and width of the hazard area. Residential sprinklers must be located not more than half the listed spacing nor less than 4" (102 mm) from walls. Adjacent sprinklers must be located no farther apart than the listed spacing; the minimum distance to prevent cold soldering, unless otherwise specified, is 8 feet (2.44 m).

When selecting an area of coverage, the suggested practice is to select one that can be adequately supplied by the available water supply, allowing for the installation of as few sprinklers as possible while observing disjuicelines pertaining to obstructions and spacing. After selection of an area of coverage, sprinklers must be spaced according to the criteria set forth in the NFPA standards and this document.

Sprinkler Spacing Under Sloped Ceilings

For installation under sloped ceilings, several maximum coverage areas are also provided, but at different minimum flows and pressures than those for horizontal ceilings. The spacing of sprinklers is measured along the slope when determining the distance off of walls and between sprinklers. Residential sprinklers may be to-cated no more than ½ the listed spacing nor less than 4° (102 mm) from the peak of the sloped ceiling. Residential sprinklers located at the highest elevation must not be located more than 3 feet (0.9 m) measured vertically down from the peak. Refer to Reliable Bulletin 035 for listed coverage areas, flow and pressure requirements, and positioning criteria for residential sprinklers installed under sloped ceilings.

Obstruction to Water Distribution

Hefer to Figures 1 through 13 for the location of sprine klers relative to obstructions. The discharge from resi1 dential sprinklers is directed radially outward and downy ward from the sprinkler. Sprinklers must be located
of such that there will not be any spaces shielded from
n distribution by walls, dividing partitions, or other dwell-

standard and/or the AHJ for guidance regarding these may be necessary unless the obstruction criteria consprinkler. Additional sprinklers beyond the obstruction sidered the maximum distance of coverage for a given tained herein can be met. Consult the appropriate NFPA tion pattern is obstructed, the obstruction is to be coning construction features. If the sprinkler water distribu-

els RFC30 (30LL), RFC43 (43LL), RFC49 (49LL) and the deflector drops below the ceiling is needed when RFC56, utilize a drop-down style deflector. The distance tom of an obstruction. These distance are as follows: determining the position of the deflector above the bot-Reliable flat plate concealed sprinklers, the Mod-

- Nonadjusted (cover plate flush to cup) 1/4" (22mm)
- At full (1/2") adjustment 3/4" (9.5mm)

Continuous and Noncontinuous Obstructions

ures 1, 2, 4, 5, 6, 7 and/or 13. beams, soffits, and long horizontal light fixtures. See Figtween sprinklers and continuous obstructions, such as A minimum distance is required to be maintained be-

of the ceiling fan's blade rotation in either direction. demonstrated that no adverse effects occur as a result obstruct ing fan motor housing is the primary element that can such as ceiling fans and certain light fixtures. The ceilbetween sprinklers and noncontinuous obstructions, A minimum distance is also required to be maintained the sprinkler discharge pattern. Testing has

there are two considerations; the amount of heat the struction, then the obstruction criteria must be applied, heat source is given in Table B. If the light is also an obminimum distance of a sprinkler relative to the light as a light gives off and the light fixture as an obstruction. The With regards to location of sprinklers near light fixtures,

> mum clear distance required shall be 362 (914mm) relative to the minimum distance required from Table B. For noncontinuous obstructions, apply the "four times the maximum dimension of the obstruction. The maxifrom the obstruction a minimum distance of four times tion on both sides. Sprinkters shall be positioned away struction, either over and under or around the obstructhe sprinkler can spray to at least two sides of the obrule" as provided in NFPA 13 where it is determined that

Temperature Ratings

ceed 100°F (38°C). Where ambient ceiling temperathe maximum ambient ceiling temperature will not exquire a higher temperature rated sprinkler: apply, unless higher expected ambient temperatures retemperature of 150°F (66°C). mediate temperature-rated residential sprinklers (175°F tures are expected to exceed 100°F (38°C), use inter-155°F [57°C]) are only permitted for installation where [79°C]), which can be exposed to a maximum ambient Ordinary temperature rated sprinklers (135°F [57°C] The following practices

- Sprinklers under glass or plastic skylights exposed temperature classification. to direct rays of the sun shall be of the intermediate
- of the intermediate temperature classification. Sprinklers in an unventilated concealed space un der insulated roof or in an unventilated attic shall be
- and light fixtures. The following minimum distances in accordance with NFPA 13D and 13R must be maintained as indicated in Table B. Residential sprinklers must be located so as to prewater heaters, furnaces and associated duct work, fireplaces, ovens, kitchen ranges, hot water pipes, sufficient distance away from heat sources such as mal heat sources. Sprinklers must be positioned a vent inadvertent operation due to exposure to nor-

Intermediate Residential Sprinklers Relative to Specific Heat Sources Table B - Minimum Distances for Ordinary and

Heat Source Side of open or Recossed freplace Front of recessed freplace Coal or wood-burning stove	Minimum Distance from Edge of Source to Ordinary Temperature Sprinkler (135°F or 155°F) in. (mm) 36 (914) 60 (1524) 42 (1667)	Minimum Distance Minimum Distance from Edge of Source to Intermediate Temporature Sprinkler (175%) in. (nm) 12 (305) 36 (914) 12 (305)
Side of open or Recessed fireplace	36 (914)	12 (305)
Front of racessed fireplace	60 (1524)	26 (914)
Coal or wood-burning stove	42 (1067)	12 (305)
Kitchen range	18 (457)	9 (229)
Wall oven	18 (457)	9 (229)
Hot air flues	18 (457)	9 (229)
Uninsulated heat ducts	18 (457)	9 (229)
Uninsulated hot water pipes	12 (305)	6 (152)
Side of ceiling or wall-mounted hot air diffusers	24 (607)	12 (305)
Front of wall-mounted hot air diffusers	36 (914)	18 (457)
Hot water heater or furnace	6 (152)	3 (76)
Light Fixture 0 W 250 W	6 (152)	2 (76)
250 W - 499 W	12 (305)	6 (152)

above. the respective bulletin, it is necessary to use the minienced in Table A, as a function of the maximum allowto NFPA 13R are given in the technical bulletins refercompartment, up to a maximum of two (2) sprinklers, that requires the greatest hydraulic demand. The cULus mum required flow for the next largest area, as shown coverage areas less than or between those indicated in able coverage area and temperature rating. For actual horizontal ceilings shall include all sprinklers within a Listed specific coverage criteria for systems designed The number of design sprinklers under flat, smooth

coverage criteria for a 16 ft x 16 ft (4.9 m x 4.9 m) covercoverage area of 15 ft x 15 ft (4.6 m x 4.6 m), the specific $m \times 4.2 m$) coverage area must be used. For an actual m), the specific coverage criteria for a 14 ft x 14 ft (4.2 age area must be used. for an actual coverage area of 12 ft x 14 ft (3.7 m x 4.2 For example, assuming the use of a pendent sprinkler,

the respective bulletin, it is necessary to use the minicoverage areas less than or between those indicated in enced in Table A, as a function of the maximum allowcompartment, up to a maximum of four (4) sprinklers, horizontal ceilings shall include all sprinklers within a mum required flow for the next largest area, as shown able coverage area and temperature rating. For actual to NFPA 13R are given in the technical bulletins referthat requires the greatest hydraulic demand. The cULus Listed specific coverage criteria for systems designed The number of design sprinklers under flat, smooth,

Hydraulic Design Requirements

by NFPA 13. Consult with the AHJ regarding the number of "design sprinklers" for these types of applications. ings qualifying as obstructed construction, as defined operating. where unusual conditions may result in more sprinklers ing at the minimum flow and pressure listed for singlehaving a pitch greater than 8/12 (33.7°) or beamed ceil lated than the minimum stated by the NFPA standards klers. More design sprinklers may need to be calcuflow requirements is provided for flowing multiple sprinidentical minimum flow rates. No reduction in minimum than one sprinkler, multiple sprinkler calculations are sprinkler operation. Where a compartment has more at the hydraulically most remote single sprinkler operatcalculations are required to verify adequate water supply flow rates for each specified coverage area. Hydraulic required, and each sprinkler must be calculated flowing Reliable residential sprinkler listings indicate minimum These conditions include sloped ceilings

required discharge from each of the four most hydraulieas being protected by the 4 sprinklers. The minimum most demanding sprinklers for the actual coverage ara minimum density of 0.1 gpm/ft² must be provided over following: cally demanding sprinklers shall be the greater of the the "design area" that includes the four (4) hydraulically For residential sprinkler systems designed to NFPA 13,

- The flow rates given in the Reliable Residential Sprinkler Technical Bulletins referenced in Table A next largest coverage area); or required to use the minimum required flow for the indicated in the respective technical bulletin, it is actual coverage areas less than or between those for NFPA 13D and 13R as a function of temperature rating and maximum allowable coverage area (for
- A minimum discharge density of 0.1 gpm/fl² applied over the "design area" consisting of the four most hydraulically demanding sprinklers for the maximum coverage area indicated in the technical bulletins referenced in Table A. al coverage area cannot be any greater than the sprinklers. The maximum dimension of the actuactual coverage areas being protected by the four

K-factors (K=5.6 and K=5.8) that will provide lower the required minimum 0.05 gpm/ft² density. Reliestablish the minimum required pressure using the cal bulletin is less than the calculated 0.1 gpm/ft2 residential sprinkler. If the flow stated in the technierage area in the technical bulletin for the specific gpm/ft² cULus Listed flow for the appropriate covquired flow. Compare this flow to the minimum 0.05 density to this area to determine the minimum rein accordance with NFPA 13, apply the 0.1 gpm/tt² termine the sprinkler protection area of coverage pressure demands for 0.1 gpm/ft² densities in NFPA able has available residential sprinklers with larger flow of individual residential sprinklers may exceed sprinkler K-factor. Note: In many cases the listed be used in the equation Q=K√P, solving for P, to density flow required, the .1 density flow must then Design Note: Using the A_s = S x L method to de-13 residential applications.

gpm (90.8 L/min) would be the minimum flow required for each design sprinkler. The corresponding pressure would be 24 psi (1.65 bar) the coverage area being considered would be 240 ft² (22.3 m²). Using an F1 Res 49 pendent sprinkler required would be 24 gpm (90.8 L). Therefore, 24 on a discharge density of 0.1 gpm/lt², the flow rate ft x 20 ft (6.1 m x 6.1 m) coverage area is 20 gpm @ If a room is 12 ft wide \times 20 ft long (3.6 m \times 6.1 m), (1"-4" ceiling-to-deflector distance), the flow for a 20 16.7 psi (75.7 L/min @ 1.14 bar). However, based

Example No. 2

If a room is 10 ft wide x 20 ft long (3.0 m x 6.1 m), the coverage area being considered would be 200 ft? (18.6 m?). Using an F1 Res 58 pendent sprinkler (1"-4" ceiling-to-deflector distance), the flow for a 20 ft x 20 ft (6.1 m x 6.1 m) coverage area is 22 gpm @ 14.4 psi (83.3 L/min @ 0.99 bar). Based on a discharge density of 0.1 gpmfit; the flow rate required would only be 20 gpm (75.7 L/min). However, the flow of 22 gpm must still be used as the minimum flow for each design sprinkler, since this is the minimum cullus Listed flow for this sprinkler at the 20 ft x 20 ft coverage area.

Example No. 3

For a situation where the coverage area per sprinkler is 16 it x 8 it (4.9 m x 2.4 m), or 128 it (11.9 m²), the F1 RES 44 HSW, having a temperature rating of 155°F (68°C) and positioned 4" to 6" (101 mm to 152 mm) below the ceiling, requires a minimum flow of 16 gpm @ 13.3 psi (60.6 L/min @ .92 bar) for a 16 it x 16 it (4.9 m x 4.9 m) coverage area Based on a minimum discharge of 0.1 gpm/lift, the flow rate needed would only be 12.8 gpm @ 10.2 psi (48.4 L/min @ 0.7 bar). However, the flow rate of 16 gpm (60.6 L/min) must still be used for each design sprinkler.

Sloped Ceilings

Specific UL Listed flows, pressures and coverage areas for sloped ceilings are provided in Reliable Bulletin 035. Refer to this bulletin for hydraulic design requirements. The number of design sprinches is the same as that specified for horizontal ceilings, with the exception of the Model F1Res 44 HSW. This sprinkler requires a minimum 3 sprinkler design in a compartment when discharging across the slope, as specified in Bulletin 035.

For systems designed to NFPA 13, 13D or 13R, where specific cilcus Listed flows for sloped ceilings are not required, consult with the AHJ regarding the number of "design sprinklers" for sloped ceilings having a pitch greater than 2 in 12 (9.4°). cllus Listed flows and pressures do not exist for sloped ceilings having a pitch greater than 8/12 (33.7°). Again, consult with the AHJ regarding the number of "design sprinklers" for these types of applications. Listed areas of coverage must correspond to ceiling slope, and spacing of sprinklers under sloped ceilings is measured along the slope when determining distance off of walls and between sprinklers.

Care and Maintenance


It is recommended that automatic sprinkler systems be inspected and maintained in accordance with the criteria set forth in NFPA 25, Inspection, Testing and Maintenance of Water-Based Fire Protection Systems by a qualified inspection service and maintenance of water-Based Fire Protection Systems by a qualified inspection service.

Do not clean the sprinklers with soap and water, detergents, armnonia, or any other cleaning fluid. Remove dust by using a soft brush or feather duster, or by gentle vacuuming with a soft bristle brush. Any sprinklers that have operated, been damaged or been painted outside of the factory shall be re-

placed with a new sprinkler. The new sprinkler shall have the same performance characteristics as the original sprinkler; that is the same temperature rating, nominal K-factor, coverage area, and the same or lower flow rate requirements.

Wet-pipe sprinkler systems must be maintained at a minimum temperature of 40°F (4°C). Exposure to freezing temperatures can damage system piping and residential sprinklers.

Do not hang anything from sprinklers or sprinkler piping. Do not put curtains, drapes or valences around sprinklers. Doing so will obstruct the discharge pattern of the sprinkler.

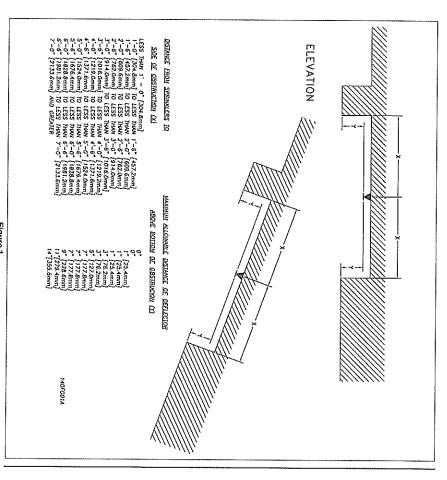

Position of sprinklers to avoid obstructions to discharge radially from pendent sprinklers.

.7

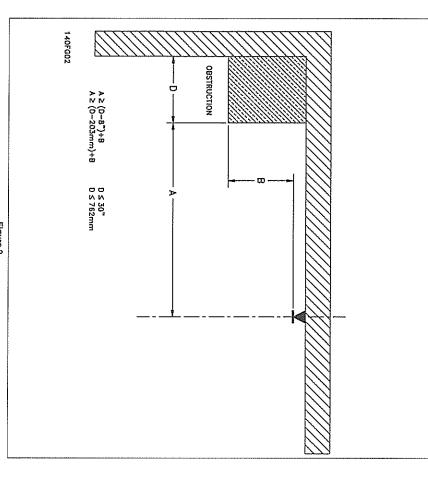


Figure 2
Positioning of pendent type sprinklers relative to obstructions against walls.

A - ACCEPTABLE CRAINS ANGLE 10" - 33.7"

B - ID TO DUC-MALT THE MANAGEM SPRINGER SPRINGER BELLETING RETERFORCE AN TABLE A) FOR THE COMPANIE AREA

CELLING ANGLE (A)

LECTROMARY ANGLE (A)

LECTROMARY SPRINGER SPACING (SEE TICHNOOL, BILLETING RETERFORCE) AN TABLE A) FOR THE COMPANIE AREA


CELLING ANGLE (A)


LECTROMARY ANGLE (A)

LE

Figure 3
Sprinkler spacing for pendent sprinklers located at the peak.

ဖွ

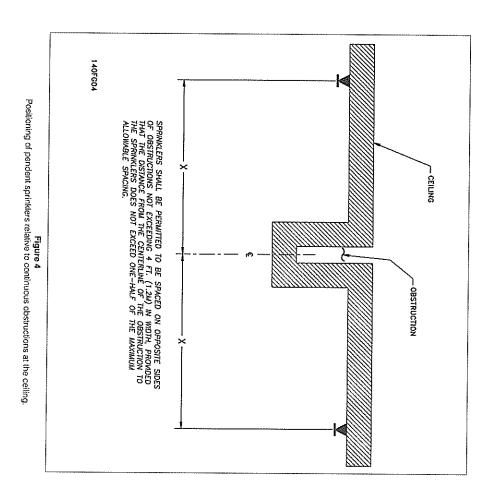

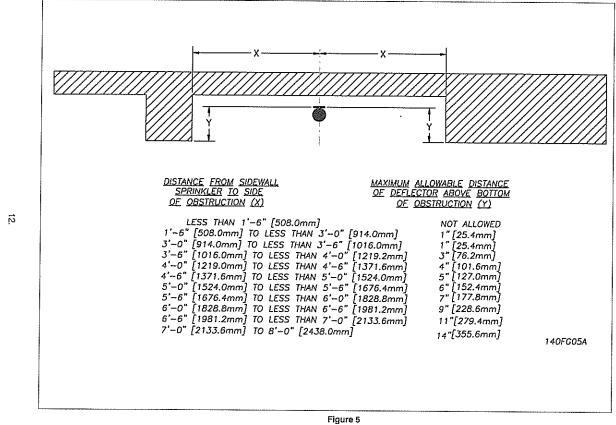



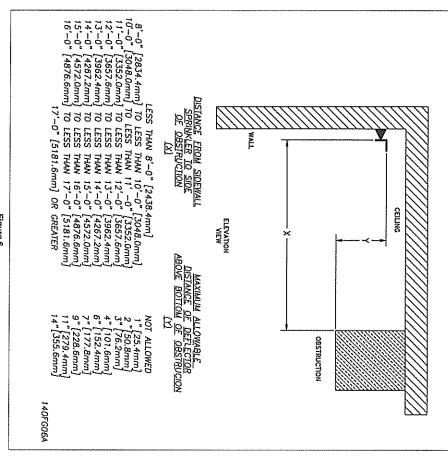


Figure 6
Positioning of sidewall sprinklers to avoid obstructions.


Figure 7
Positioning of HSW sprinklers relative to continuous obstructions along a wall.

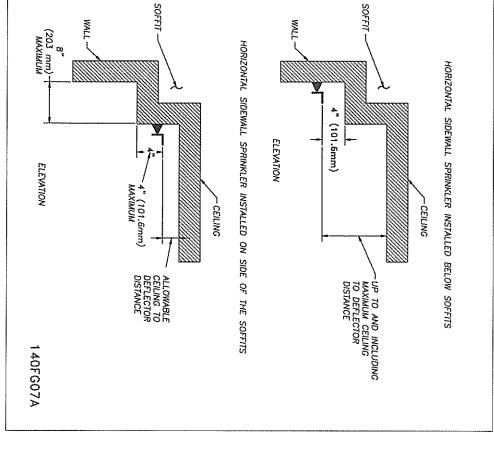

ಪ

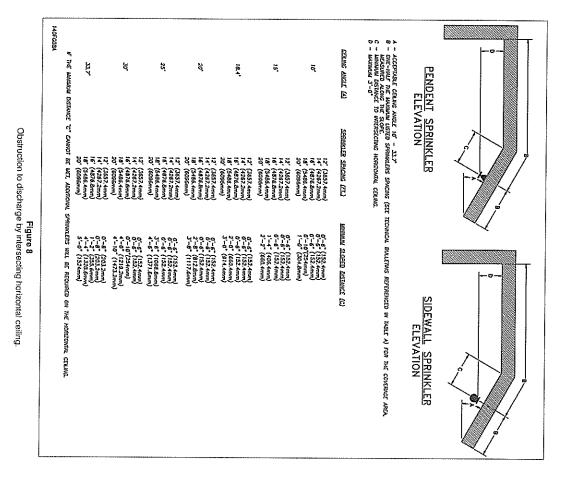

5

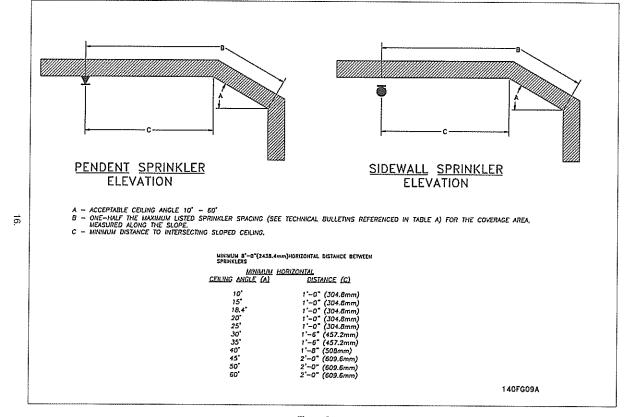

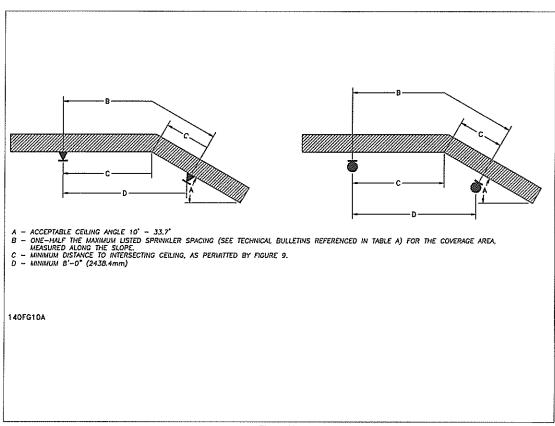


Figure 10 Minimum distance between sprinklers on intersecting ceilings.

EXCENT SPRINKER

PENDENT SPRIN

Figure 11

Non-symmetric sprinkler locations on opposing scopes.

<u>,</u>

17.

Figure 12 Single sprinkler coverage criteria for cathedral ceilings.



9

The Reliable Automatic Sprinkler Co., Inc. (900) 431-1588 Sales Offices (900) 484-6051 Sales Fax Corporate Offices vww.reliablesprinkler.com Internet Address

The equipment presented in this butletin is to be installed in accordance with the latest published Standards of the National Fire Protection Association, Factory Mutual Research Corporation, or other smilar equinations and also with the provisions of governmental codes or ordinances whenever applicable. Products mental codes or ordinances whenever applicable. Products mental codes of producted by Falsable have been proceding file and proporty for one 50 years, and are an activated and standard by the rinest highly qualified and reputable sprinkler contractors located throughout the United States, Canada and foreign countries.

BEAM **F1RES 49** F1RES49/F2 A - 0'-7" (177.8mm) MAXIMUM B - 7'-6" (2286mm) MINIMUM. C - 0'-8" (203.2mm) MAXIMUM. NOTE: CORE DRILLING OF STRUCTURAL OR LOAD BEARING BEAMS TO ALLOW THE INSTALLATION OF SPRINKLER DROPS REQUIRES APPROVAL OF A STRUCTURAL ENGINEER. 140FG13A

> Figure 13 Pendent sprinkler positioning for beamed ceiling.

(3)

EG. Printed in U.S.A. 09/11

P/N 9999970031



Model RFC30 (SIN RA0611) Model RFC43 (SIN RA0612) Model RFC49 (SIN RA0616) Residential Flat Concealed Sprinklers

A Residential Flat Concealed Sprinkler engineered for a minimum design density of 0.05 gpm/ft² with low GPM requirements.

Features

- 1. Very low water flow requirements.
- 2. ½" (13mm) Total adjustment.
- 3. Thread-On/Thread-Off or Push-On/Thread Off cover attachment option.
- 4. Smooth aesthetic ceiling profile.
- 5. Available in brass, chrome and black plated or painted finishes.

Listings & Approval

- 1. Listed by Underwriters Laboratories, and certified by UL for Canada (cULus)
- 2. NYC MEA 258-93-E

UL Listing Categories

Residential Automatic Sprinklers

UL Guide Number

VKKW

Product Description

Model RFC30, RFC43 and RFC49 Concealed Residential Sprinklers are fast response residential fusible solder link automatic sprinklers. Residential sprinklers differ from standard sprinklers primarily in their response time and water distribution patterns.

Model RFC30, RFC43 and RFC49 sprinklers discharge water in a hemispherical pattern below the sprinkler deflector. Residential distribution patterns are higher and generally contain a finer droplet size than standard sprinkler patterns.

The combination of speed of operation and high discharge pattern required for residential sprinklers has demonstrated, in fire testing, an ability for controlling residential fires, and thereby providing significant evacuation time for occupants.

The RFC30, RFC43 and RFC49 Sprinklers provide the best form of fire protection by combining an attractive appearance and ½" (13mm) of cover adjustment for ease of installation. The small diameter cover plate is easily and positively attached and blends into the ceiling, concealing





the most dependable fire protection available, an automatic sprinkler system.

The RFC30, RFC43 and RFC49 are UL Listed Residential Sprinklers to be installed in the residential portions of any occupancy in accordance with NFPA 13, 13R, & 13D.

The RFC30, RFC43 and RFC49 can reduce the need for precise cutting of drop nipples. The threaded cover plate assembly can be adjusted without tools to fit accurately against the ceiling. The fire protection system need not be shut down to adjust or remove the cover plate assembly.

Application and Installation

The RFC30, RFC43 and RFC49, for residential installations, use a 165°F (74°C) fusible solder link in a tuning fork style sprinkler frame with a drop-down deflector. This assembly is recessed into the ceiling and concealed by a flat cover plate. The cover plate is attached to the skirt, using 135°F (57°C) ordinary temperature classification solder. When the ceiling temperature rises, the solder holding the cover plate releases the cover allowing the deflector to drop into position and exposing the sprinkler inside to

ceiling temperature. The subsequent operation of the solder link opens the waterway and causes the deflector to drop into position to distribute the discharging water in a hemispherical pattern below the sprinkler deflector. Any adjustment of thread engagement between the cover plate and cup will assure that the drop-down deflector is properly located below the ceiling. The residential distribution pattern contains a finer droplet size than a standard sprinkler, and the pattern produces significantly higher wall wetting.

After a 25/8 inch diameter hole is cut in the ceiling, the sprinkler is to be installed with the Model FC Wrench. When installing a sprinkler, the wrench is first positioned into the sprinkler/cup assembly and around the hexagonal body of the sprinkler frame. The Wrench must bottom out against the cup in order to ensure proper, safe installation. The sprinkler is then tightened into the pipe fitting. When inserting or removing the wrench from the sprinkler/cup assembly, care should be taken to prevent damage to the sprinkler. DO NOT WRENCH ON ANY OTHER PART

OF THE SPRINKLER/CUP ASSEMBLY. MODEL RFC30, RFC43 AND RFC49 CONCEALED SPRINKLERS MUST BE INSTALLED ONLY WITH 135°F RATED COVERS.

Note: A leak tight ½" NPT (R1/2) sprinkler joint can be obtained with a torque of 8-18 ft-lbs (10,8 - 24,4 N-m). Do not tighten sprinklers over maximum recommended torque. It may cause leakage or impairment of the sprinklers.

Cover assemblies provide up to ½" (13mm) of adjustment. Turn the cover clockwise until the flange is in contact with the ceiling. For the push-on/thread-off option, the cover assembly is pushed onto the cup and final adjustment is made by turning the cover clockwise until the skirt flange makes full contact with the ceiling. Cover removal requires turning in the counter-clockwise direction.

In ceilings that have a plenum space above the sprinkler, the plenum space may have neutral or negative pressurization but must not be positively pressurized. Inspect all sprinklers after installation to ensure that the gap between the cover plate and ceiling and the 4 slots in the cup are all open and free from any air flow impediment.

Temperature Rating

Sprinkler	Cover Plate	Max. Ambient Temp.
165°F/74°C	135°F/57°C	100°F/38°C

Installation Data: RFC30 (SIN RA0611)

Thread Size K Factor inch (mm)	Sprinkler Spacing ft. (m)	Maximum Distance to Wall ft. (m)	Minimum Distance between sprinklers ft. (m)	Minimum Required Sprinkler Discharge		
				Flow gpm (Lpm)	Press. psi (bar)	
½" (15mm) ½" (15mm)	3.0 3.0	12 x 12 (3.6x3.6) 14 x 14 (4.3x4.3)	6 (1.83) 7 (2.13)	8 (2.43) 8 (2.43)	9 (34.1) 10 (37.8)	9.0 (0.62) 11 (0.76)

Note: 1 bar = 100 Kpa

Installation Data: RFC43 (SIN RA0612)

Thread Size K Factor inch (mm)	K Factor	Sprinkler	Maximum Distance to	Minimum Distance between	Minimum Required Sprinkler Discharge	
	Spacing ft. (m)	Wall ft. (m)	sprinklers ft. (m)	Flow gpm (Lpm)	Press. psi (bar)	
½" (15mm)	4.3	12 x 12 (3.6x3.6)	6 (1.83)	8 (2.43)	12 (45)	7.8 (0.54)
½" (15mm)	4.3	14 x 14 (4.3x4.3)	7 (2.13)	8 (2.43)	13 (49)	9.1 (0.63)
½" (15mm)	4.3	16 x 16 (4.9x4.9)	8 (2.43)	8 (2.43)	13 (49)	9.1 (0.63)
½" (15mm)	4.3	18 x 18 (5.5x5,5)	9 (2.74)	8 (2.43)	18 (68)	17.5 (1.21)
½" (15mm)	4.3	20 x 20 (6.0x6.0)	10 (3.05)	8 (2.43)	21 (79)	23.8 (1.64)

Note: 1 bar = 100 Kpa

Installation Data: RFC49 (RA0616)

Thread Size Inch (mm) K Factor	K Factor	Sprinkler Specing	Maximum Distance to	Minimum Distance between	Minimum Required Sprinkler Discharge	
	Spacing ft. (m)	Wall ft. (m)	sprinklers ft. (m)	Flow gpm (Lpm)	Press. psi (bar)	
½" (15mm)	4.9	12 x 12 (3.6x3.6)	6 (1.83)	8 (2.43)	13 (49)	7.0 (0.48)
½" (15mm)	4.9	14 x 14 (4.3x4.3)	7 (2.13)	8 (2.43)	13 (49)	7.0 (0.48)
½" (15mm)	4.9	16 x 16 (4.9x4.9)	8 (2.43)	8 (2.43)	13 (49)	7.0 (0.48)
½" (15mm)	4.9	18 x 18 (5.5x5.5)	9 (2.74)	8 (2.43)	17 (64.3)	12.0 (0.83)
½" (15mm)	4.9	20 x 20 (6.0x6.0)	10 (3.05)	8 (2.43)	20 (75.7)	16.7 (1.14)

Note: 1 bar = 100 Kpa

FOR SLOPED CEILING APPLICATIONS SEE RASCO BULLETIN 035.

Maintenance

Model RFC30, RFC43 and RFC49 Concealed Sprinklers should be inspected quarterly and the sprinkler system maintained in accordance with NFPA 25. Do not clean sprinklers with soap and water, ammonia or any other cleaning fluids. Remove dust by using a soft brush or gentle vacuuming. Remove any sprinkler cover plate assembly which has been painted (other than factory applied) or damaged in any way. A stock of spare sprinklers should be maintained to allow quick replacement of damaged or operated sprinklers. Prior to installation, sprinklers should be maintained in the original cartons and packaging until used to minimize the potential for damage to sprinklers that would cause improper operation or non-operation.

Model RFC30, RFC43 and RFC49 Residential Concealed Sprinkler Specification

Sprinklers shall be cULus Listed low flow residential concealed sprinklers with drop-down deflector and adjustable flat cover plate engineered for a minimum design density of 0.05 gpm/ft². Sprinkler frame and deflector shall be of bronze frame construction having a ½" NPT thread. Thermal element shall consist of an approved black-painted beryllium-nickel fusible solder link with symmetric lever mechanism, maintaining a Teflon-coated Belleville spring washer and machined brass cap water seal assembly containing no plastic parts. Sprinkler K-factor shall be nominal 3.0 (44), 4.3 (62.4), and 4.91 (70) having a $^5/_{16}$ ", $^3/_8$ " and $^7/_{16}$ " orifice. Temperature rating shall be Ordinary 165°F (74°C); cover plate temperature rating to be 135°F (57°C). Cover plate assembly shall

consist of a brass cover plate and copper alloy retainer flange allowing a ½" cover plate adjustment. Any secure engagement between the cover plate and the cup will assure that the drop-down deflector is properly located below the ceiling. A plastic protective cap shall be provided and factory installed inside the sprinkler cup to protect the drop-down sprinkler deflector from damage, which could occur during construction before the cover plate is installed. Standard cover finish: [Chrome] [White] [Specialty – specify]. Residential concealed sprinklers shall be Reliable Model RFC30, SIN RA0611 (Bulletin 006), Model RFC43, SIN RA0612 (Bulletin 006) or Model RFC49, SIN RA0616 (Bulletin 006).

Ordering Information Specify:

- 1. Sprinkler Model
- 2. Cover Plate Finish
- Thread-On or Push-On Feature

Cover Plate Finishes (1)


Standard Finishes

Chrome White

Special Application Finishes

Bright Brass Black Plating Black Paint Off White Satin Chrome

(1) Other colors and finishes available. Consult factory for details.
Note: Paint or any other coatings applied over the factory finish will void all approvals and warranties.

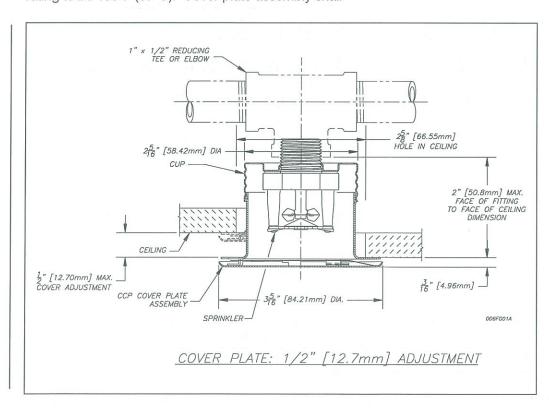



Reliable...For Complete Protection

Reliable offers a wide selection of sprinkler components. Following are some of the many precision-made Reliable products that guard life and property from fire around the clock.

- Automatic sprinklers
- Flush automatic sprinklers
- Recessed automatic sprinklers
- Concealed automatic sprinklers
- Adjustable automatic sprinklers
- Dry automatic sprinklers
- Intermediate level sprinklers
- Open sprinklers
- Spray nozzles
- Alarm valves
- Retarding chambers
- Dry pipe valves
- Accelerators for dry pipe valves
- Mechanical sprinkler alarms
- Electrical sprinkler alarm switches
- Water flow detectors

- Deluge valves
- Detector check valves
- Check valves
- Electrical system
- Sprinkler emergency cabinets
- Sprinkler wrenches
- Sprinkler escutcheons and guards
- Inspectors test connections
- Sight drains
- Ball drips and drum drips
- Control valve seals
- Air maintenance devices
- Air compressors
- Pressure gaugesIdentification signs
- Fire department connection

The equipment presented in this bulletin is to be installed in accordance with the latest published Standards of the National Fire Protection Association, Factory Mutual Research Corporation, or other similar organizations and also with the provisions of governmental codes or ordinances whenever applicable. Productsmanufactured and distributed by Reliable have been protecting life and property for over 90 years, and are installed and serviced by the most highly qualified and reputable sprinkler contractors located throughout the United States, Canada and foreign countries.

