

City of Portland, Maine – Building or Use Permit Application 389 Congress Street, 04101, Tel: (207) 874-8703, FAX: 874-8716

Location of Construction: 102 Stonecrest Dr		Owner: Milliken, Alan & Jane	Phone: 797-5138
Owner Address: SAA Field, ME 04103		Leasee/Buyer's Name:	Phone:
Contractor Name:		Address:	Phone:
Past Use: 1-1am	Proposed Use: 1-1am	COST OF WORK: \$ 81500 10,000	PERMIT FEE: \$ 15000 70.00
Proposed Project Description: Construct Garage as per plans/Pnd existing		FIRE DEPT. <input type="checkbox"/> Approved <input type="checkbox"/> Denied	INSPECTION: U Use Group 93 Type: 5B BOCA 93
		Signature: <i>[Signature]</i>	
Permit Taken By: Mary Gresik		PEDESTRIAN ACTIVITIES DISTRICT (P.A.D.)	
		Action: <input type="checkbox"/> Approved <input type="checkbox"/> Approved with Conditions <input type="checkbox"/> Denied	Signature: <i>[Signature]</i> Date: _____
Date Applied For: 11 Oct 94			

Permit No: **941102**

Permit Issued: **PERMIT ISSUED**
OCT 14 1994

Zone: **CITY OF PORTLAND**

Zoning Approval: _____

Special Zone or Reviews:

Shoreland
 Wetland
 Flood Zone
 Subdivision
 Site Plan maj minor mm

Zoning Appeal

Variance
 Miscellaneous
 Conditional Use
 Interpretation
 Approved
 Denied

PERMIT ISSUED WITH LETTER

CERTIFICATION

I hereby certify that I am the owner of record of the named property, or that the proposed work is authorized by the owner of record and that I have been authorized by the owner to make this application as his authorized agent and I agree to conform to all applicable laws of this jurisdiction. In addition, if a permit for work described in the application issued, I certify that the code official's authorized representative shall have the authority to enter all areas covered by such permit at any reasonable hour to enforce the provisions of the code(s) applicable to such permit

SIGNATURE OF APPLICANT: Janet Milliken ADDRESS: _____ DATE: 11 Oct 94 PHONE: _____

RESPONSIBLE PERSON IN CHARGE OF WORK, TITLE: _____ PHONE: _____

White-Permit Desk Green-Assessor's Canary-D.P.W. Pink-Public File Ivory Card-Inspector

Historic Preservation

Not in District or Landmark
 Does Not Require Review
 Requires Review

Action: Approved
 Approved with Conditions
 Denied

Date: 11 Oct 94

CEO DISTRICT *[Signature]*

COMMENTS

10-19-94 - Framing OK (see drawing → 26" x 25" ↓ up stairs above garage)

(Floor not poured) Garage Foundation in prior

11-17-94 - stairs completed, need guard & hand rails 2nd Floor above garage OK
garage railing needs to be 5/8 type x

1-19-95 - (no access)

7-27-95 (letter for Steel I-Beam & Hand rail up stairs
Close)

Inspection Record

Type	Date
Foundation: <u>In prior</u>	
Framing: <u>OK (stairs no complete)</u>	<u>10-19-94</u>
Plumbing: _____	_____
Final: _____	_____
Other: _____	_____

BUILDING PERMIT REPORT

DATE: 12/Oct/94 Address 102 Stone Crest DR.

REASON FOR PERMIT: To Construct a 24'x24' garage.

BLDG. OWNER: Jane/Alan MILLIKEN

CONTRACTOR: owner

APPROVED: *7, 9, 10, 11, 13, 14

PERMIT APPLICATE: 11

~~DENIED:~~ *15 *16 *18

CONDITION OF APPROVAL OR DENIAL:

1. Before concrete for foundation is placed, approvals from Public Works and Inspection Service must be obtained. (a 24 hour notice is required prior to inspection).
2. Precaution must be taken to protect concrete from freezing.
3. It is strongly recommended that a register land surveyor check all foundation forms before concrete is placed.
4. All vertical openings shall be enclosed with construction having a fire rating of at least one (1) hr., including fire doors with selfclosers.
5. Each apartment shall have access to (2) separate, remote and approved means of egress. A single exit is acceptable when its exits directly from the apartment to the building exterior with no communications to other apartment units.
6. The boiler shall be protected by enclosing with one (1) hour fire rated construction including fire doors and ceiling, or by providing automatic extinguishment. Sprinkler piping serving not more than six sprinklers may be connected to a domestic water supply system having a capacity sufficient to provide 0.15 gallons per minute, per square foot of floor throughout the entire area. An indication shut-off valve shall be installed in an accessible locations between the sprinkler and the connection to the domestic water supply. Minimum pipe size shall be 3/4 inch copper or 1 inch steel. Maximum coverage area of a residential sprinkler is 144 sq. ft. per sprinkler.
- * 7. Every sleeping room below the fourth story in buildings of Use Groups R and I-1 shall have at least one operable window or exterior door approved for emergency egress or rescue. The units must be operable from the inside opening without the use of special knowledge or separated tools. Where windows are provided as a means of egress or rescue , they shall have a sill height not more than 44 inches (1118mm) above the floor. All egress or rescue windows from sleeping room must have minimum net clear opening height dimension shall be 24 inches (610 mm). The minimum net clear opening width dimension shall be 20 inches (508 mm) and a minimum net clear opening of 5.7 sq.ft.
8. This permit does not preclude the applicant from obtaining any license needed from the City Clerk's office.

*9. All single and multiple station smoke detectors shall be of an approved type and shall be installed in accordance with the provisions of the building code 919.3.2 (BOCA National Building Code 1993), and NFPA 101 Chapter 18 & 19. (smoke detectors shall be installed and maintained at the following locations):

1. In the immediate vicinity of bedrooms;
2. In all bedrooms;
3. In each story within a dwelling unit, including basements.

*10. Private garages located beneath habitable rooms in occupancies in Use Group R-1, R-2, R-3 or I-1 shall be separated from adjacent interior spaces by fire partitions and floor/ceiling assembly which are constructed with not less than 1-hour fire resisting rating. Private garages attached side-by-side to rooms in the above occupancies shall be completely separated from the interior spaces and the attic area by means of 1/2 inch gypsum board or the equivalent applied to the garage side. (Chapter 4 section 407.0 of the BOCA/1993)

*11. Guardrails & Handrails - A guardrail system is a system of building components located near the open sides of elevated walking surfaces for the purpose of minimizing the possibility of an accidental fall from the walking surface to the lower level. Minimum height all Use Group 42", except Use Group R which is 36". In occupancies in Use Group A, B, H-4, I1, I-2 M and R and public garages and open parking structures, open guards shall have balusters or be of solid material such that a sphere with a diameter of 4" cannot pass through any opening. Guards shall not have an ornamental pattern that would provide a ladder effect.

12. All exit signs, lights and means of egress lighting shall be done in accordance with Chapter 10, section & subsections 1023. & 1024.0 of the City's building code. (The BOCA National Building Code/1993)

*13. Stair construction in Use Group R-3 & R-4 is a minimum of 9" tread and 8-1/4" maximum rise.


*14. Headroom in habitable space is a minimum of 7'6".

*15. The minimum headroom in all parts of a stairway shall not be less than 80 inches.

*16. All construction and demolition debris must be disposed at the City's authorized reclamation site. The fee rate is attached. Proof of such disposal must be furnished to the office of Inspection Services before final Certificate of Occupancy is issued or demolition permit is granted.

17. Section 25-135 of the Municipal Code for the City of Portland states "No person or utility shall be granted a permit to excavate or open any street or sidewalk from the time of November 15 of each year to April 15 of the following year".

18. The builder of a facility to which Section 4594-C of the Maine State Human Rights Act, Title 5 MRSA refers, shall obtain a certification from a design professional that the plans of the facility meet the standards of construction required by this section. Prior to commencing construction of the facility, the builder shall submit the certification to the Division of Inspection Services.

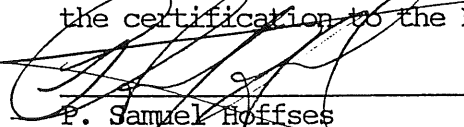
P. Samuel Hoffses
Chief of Inspections

/dmm 01/14/94(redo w/additions)

18. The proposed Steel Bean didn't have a statement of design attached with the plan or application. Please supply this office with this statement. Thank,
S/H-

102 STONECREST DR.
PORTLAND, ME


FOUNDATION IS 24' X 24'

14-433
WPA
10-12-94

RECEIVED

AUG 1 0 1987

DEPT. OF BUILDING INSPECTIONS
CITY OF PORTLAND

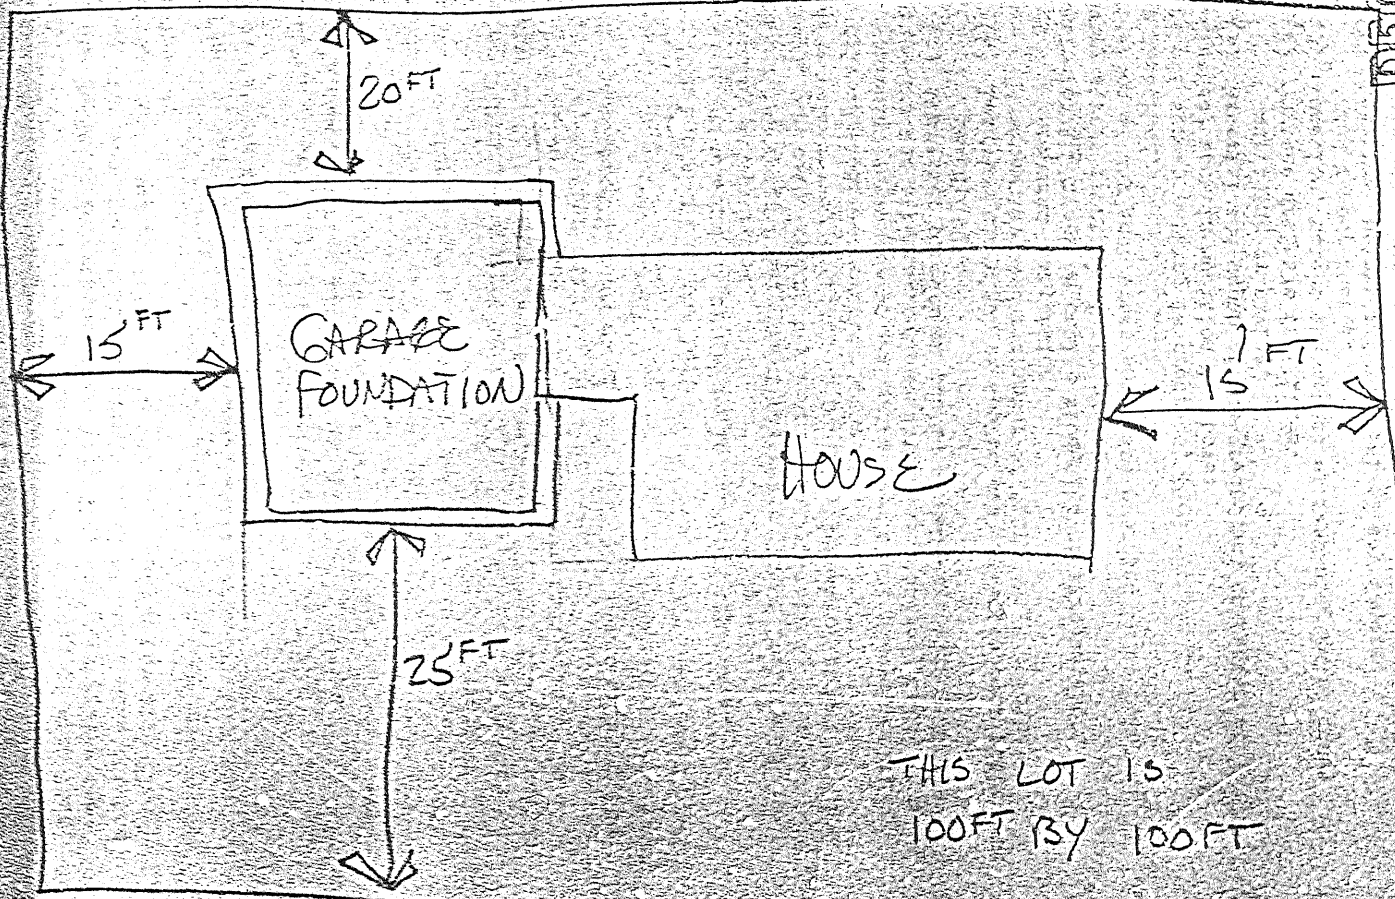

THIS LOT IS
100FT BY 100FT

