

Building Cross Section

Scale: 1"=10'


**Building has an existing pine post and beam frame. No structural modifications are being made.**

**Interior Walls:** 2x4 25 ga steel studs @16" O.C. with one layer 1/2" sheetrock each side

**Wet Walls:** 2x6 25 ga steel studs @ 16" O.C. with one layer 1/2" sheetrock each side

**Interior Load-Bearing Walls:** None

**NFPA 13-D sprinkler system:** Refer to plan designed by Dean & Allyn, Inc. (Included)

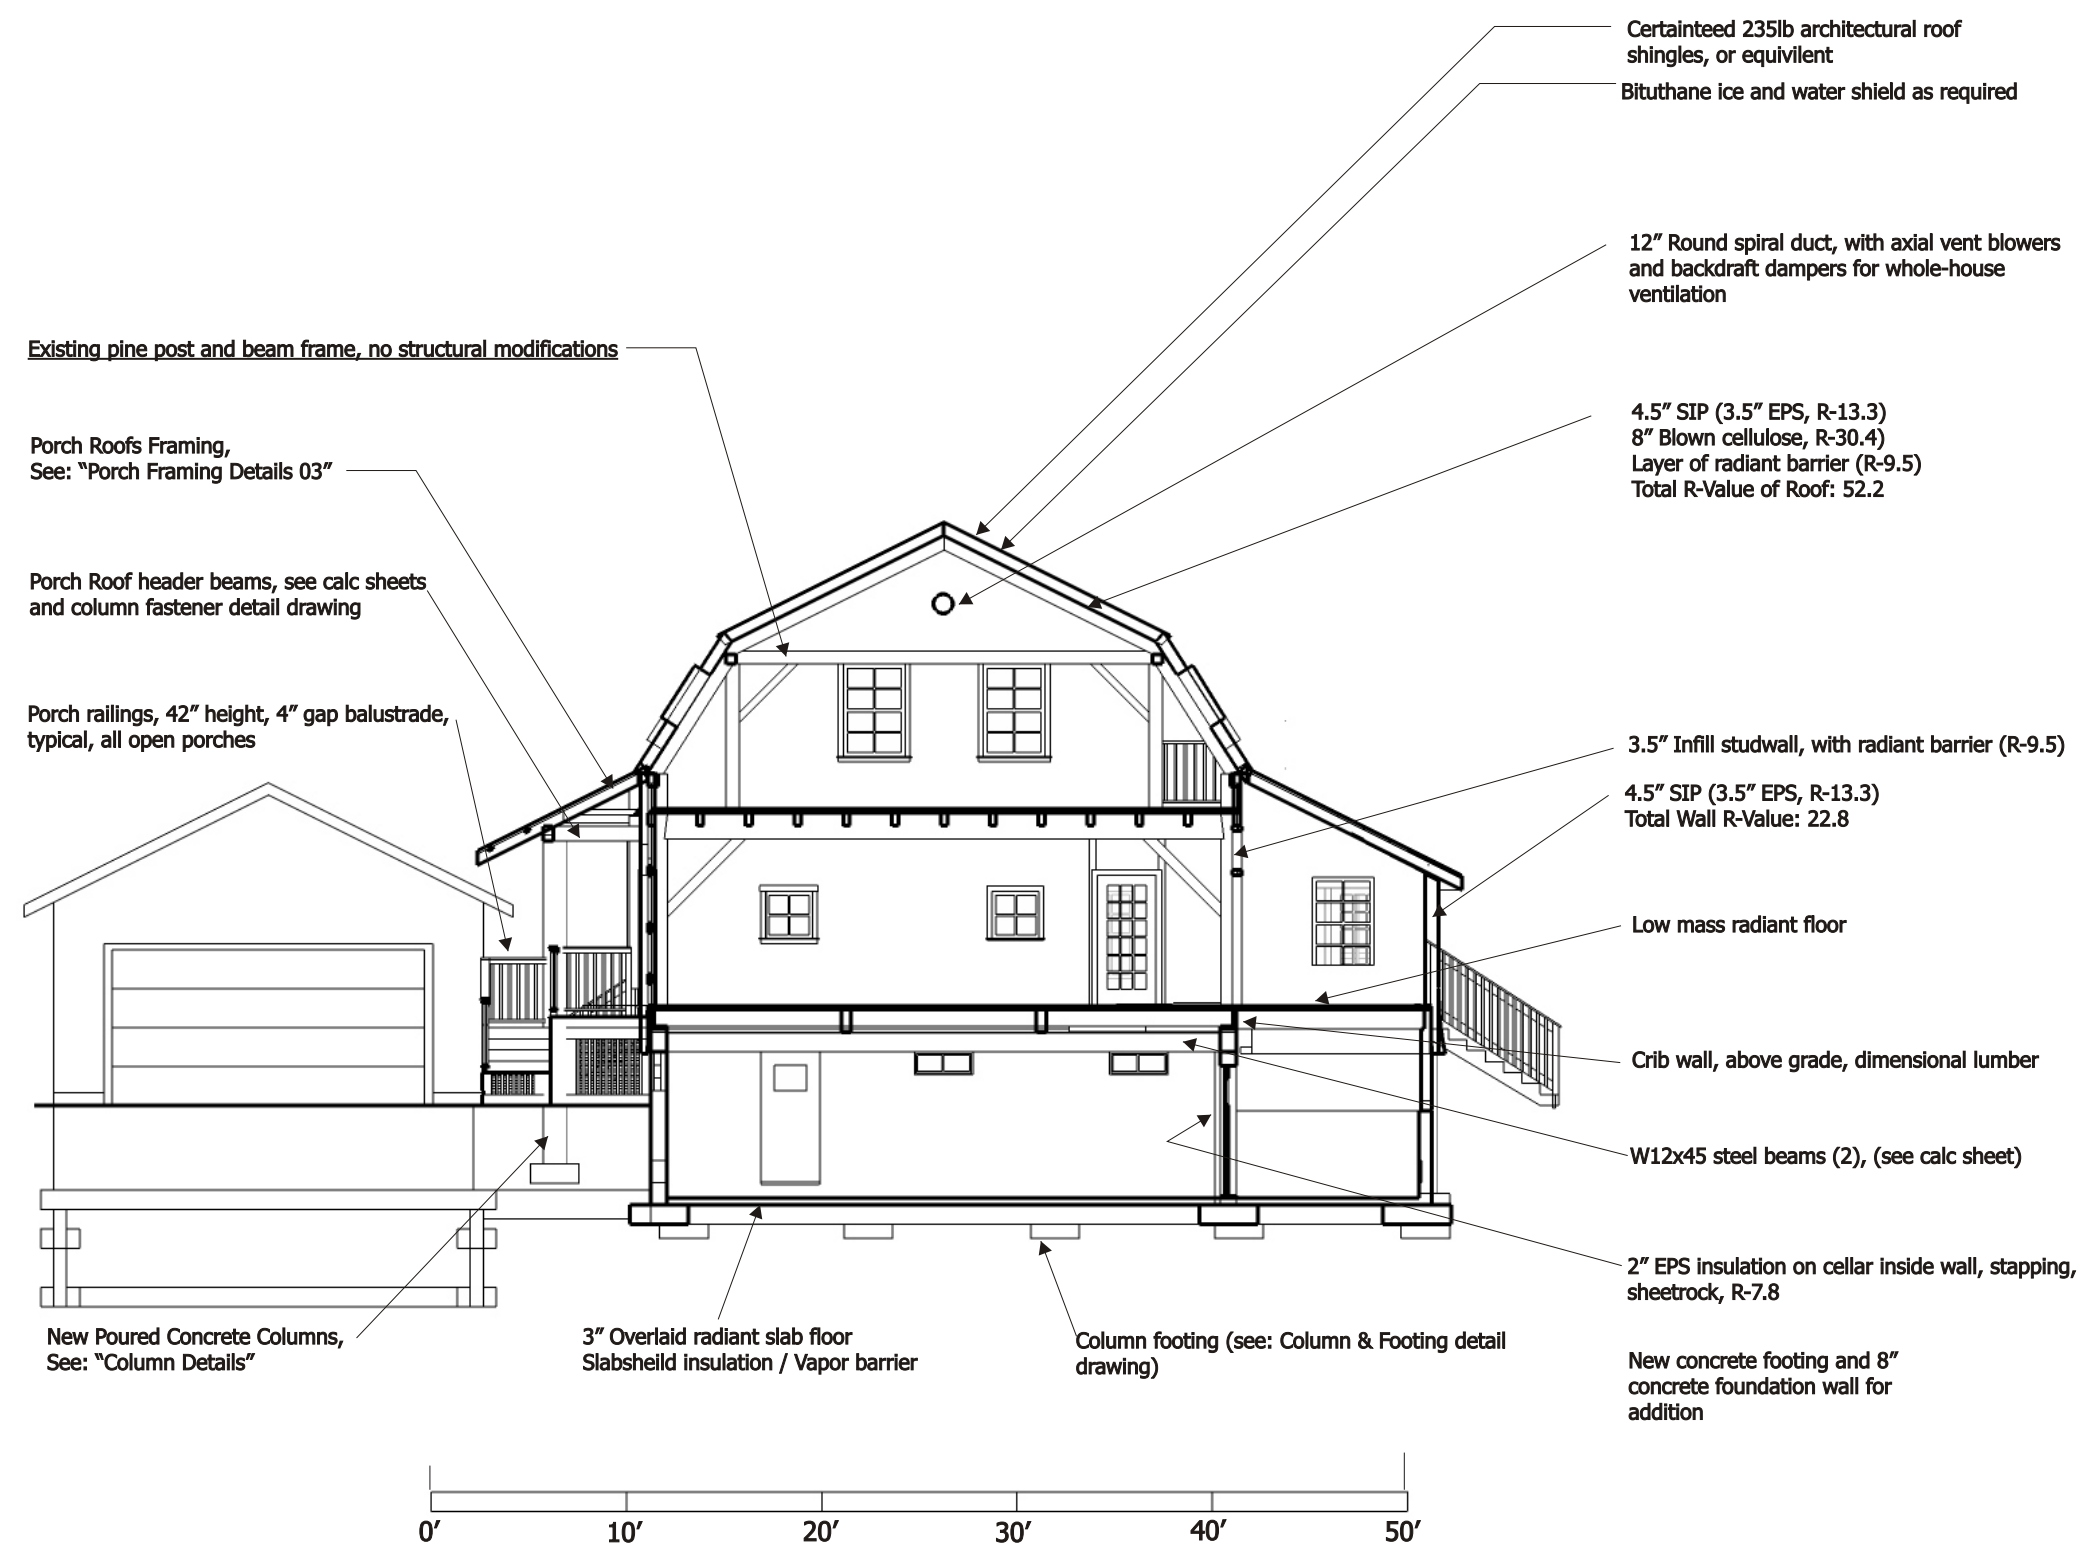

Revisions

| Date | Description |
|------|-------------|
|      |             |
|      |             |
|      |             |
|      |             |
|      |             |
|      |             |
|      |             |
|      |             |