
at

A.D.U.

ಶ

Residence

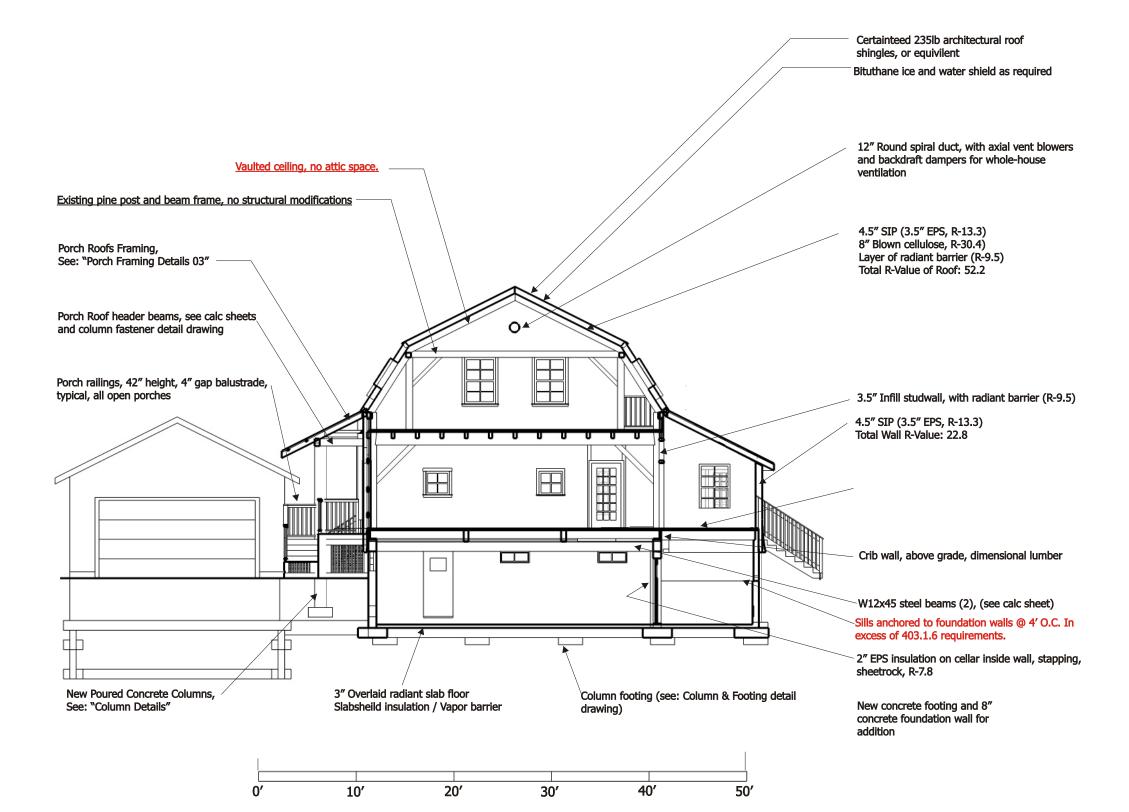

Building Cross Section



Scale: 1"=10'

Building has an existing pine post and beam frame. No structural modifications are being made.

Interior Walls: 2x4 25 ga steel studs @16" O.C. with one layer ½" sheetrock each side

Wet Walls: 2x6 25 ga steel studs @ 16" O.C. with one layer ½" sheetrock each side

Interior Load-Bearing Walls: None

NFPA 13-D sprinkler system: Refer to plan designed by Dean & Allyn, Inc. (Included)

Revisions

| Date | Description |
|-----------|--|
| 5.28.2014 | Added foundation anchoring note, clarified no attic space. |
| | |
| | |
| | |
| | |
| | |
| | |
| | |