


ALL DRAWINGS, PLANS, SKETCHES ETC. ARE PROVIDED TO OUR CLIENTS BASED UPON INFORMATION PROVIDED BY THE CLIENT AND DRAWN IN ACCORDANCE WITH COMMON BUILDING PRACTICES. NONE OF THE EMPLOYEES OF MORIN DRAFTING ARE REGISTERED ARCHITECTS, STRUCTURAL ENGINEERS OR PROFESSIONAL LAND SURVEYORS. ALL CODES SHALL BE REVIEWED AND APPROVED BY APPROPRIATE REGISTERED PROFESSIONAL. IF NOT, IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR OR OWNER. ALL NOTING, SPECIFICATIONS AND DIMENSIONS SHALL BE VERIFIED BY CLIENT AND/OR CONTRACTOR BEFORE WORK BEGINS. ALL DIMENSIONS SHALL BE BROUGHT TO THE ATTENTION OF MORIN DRAFTING AFTER REVIEW. IF PLANS ARE NOT VERIFIED BY CLIENT AND/OR CONTRACTOR BEFORE CONSTRUCTION BEGINS, MORIN DRAFTING SHALL BE HELD HARMLESS. IN ALL EVENTS DAMAGES SHALL BE LIMITED TO THE COST OF THE PLANS. MORIN DRAFTING ASSUMES NO LIABILITY FOR CONSTRUCTION DEFECTS, CHANGES AND/OR REVISIONS TO THE PLANS. ALL PLANS ARE THE PROPERTY OF MORIN DRAFTING.

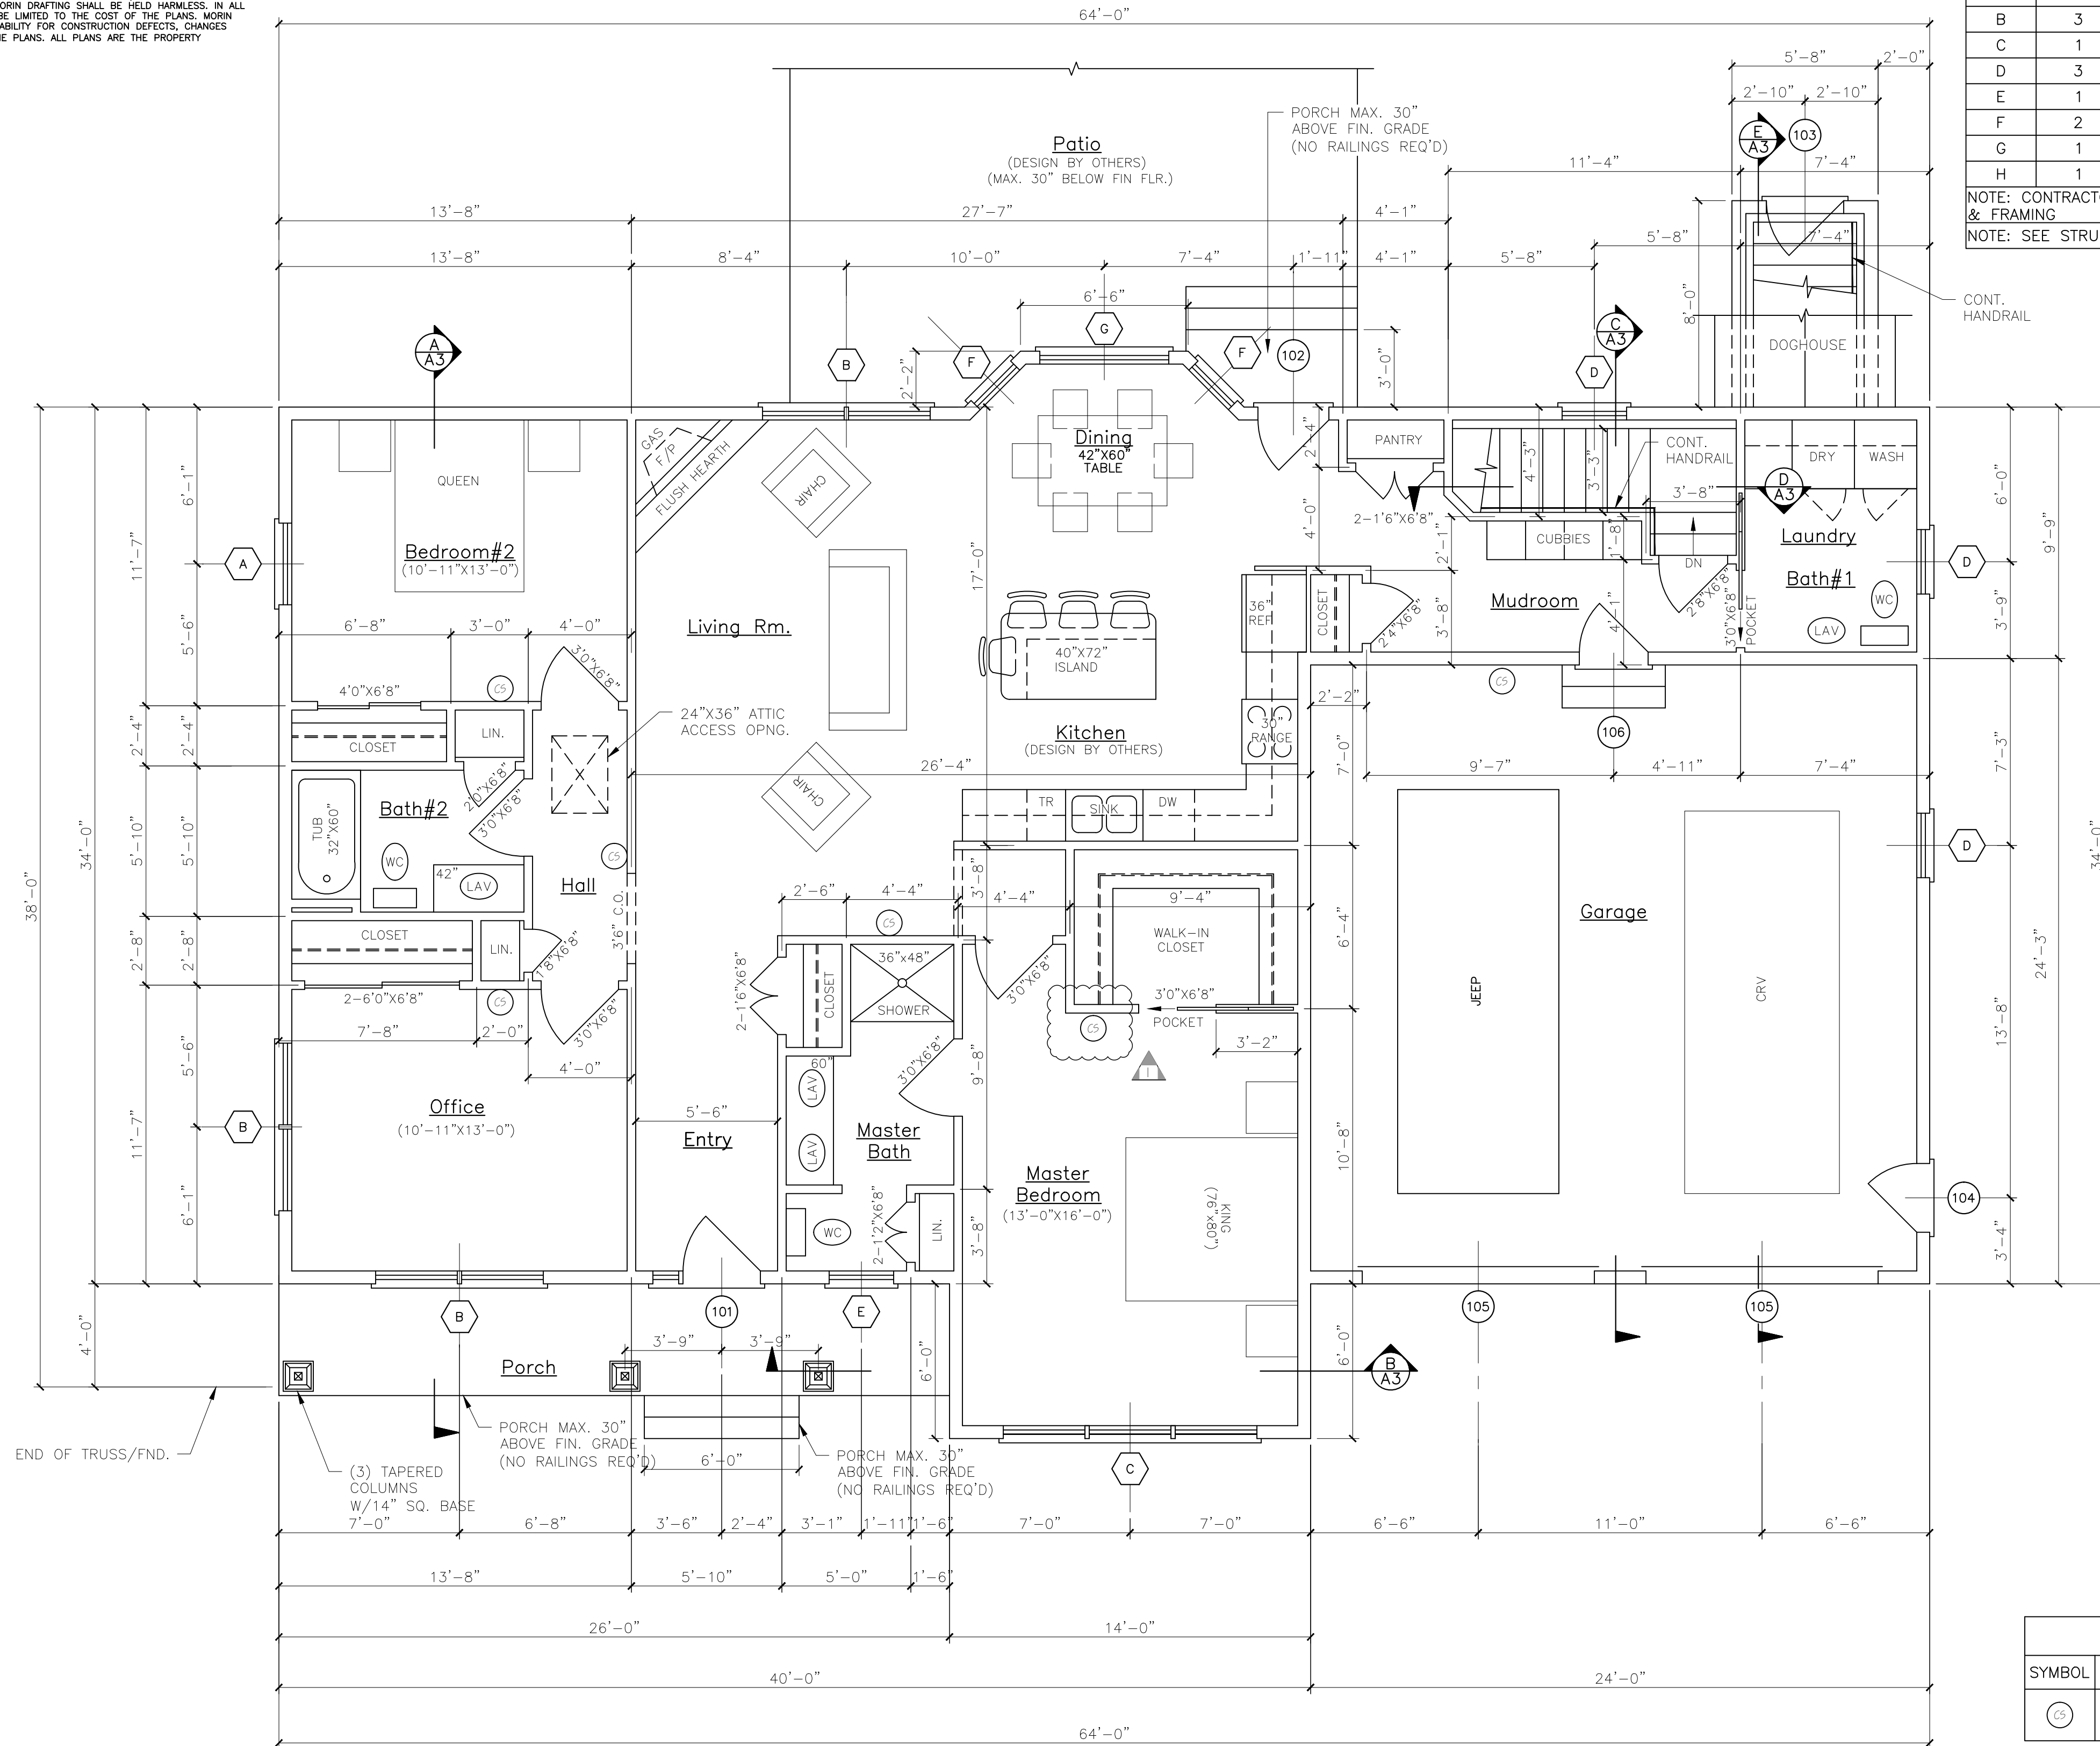

FIRST FLOOR PLAN
SCALE: 1/4"=1'-0" (TOTAL FINISHED SQ. 1702)

WINDOW SCHEDULE									
LTR.	QTY.	UNIT TYPE	UNIT NUMBER	R.O. SIZE (WxH)	GLAZING	EGRESS	MANUF.	REMARKS	
A	1	DOUBLE HUNG	TW3046	3'-2 1/8"x4'-8 7/8"	INSUL.	YES	ANDERSEN	TILT-WASH,400 SERIES	
B	3	DOUBLE HUNG	TW3046-2	6'-3 15/16"x4'-8 7/8"	INSUL.	YES	ANDERSEN	TILT-WASH,400 SERIES	
C	1	DOUBLE HUNG	TW3046-3	9'-5 3/4"x4'-8 7/8"	INSUL.	-	ANDERSEN	TILT-WASH,400 SERIES	
D	3	DOUBLE HUNG	TW2442	2'-6 1/8"x4'-4 7/8"	INSUL.	-	ANDERSEN	TILT-WASH,400 SERIES	
E	1	DOUBLE HUNG	TW24310	2'-6 1/8"x4'-0 7/8"	INSUL.	-	ANDERSEN	TILT-WASH,400 SERIES	
F	2	DOUBLE HUNG	TW2046	2'-2 1/8"x4'-8 7/8"	INSUL.	-	ANDERSEN	TILT-WASH,400 SERIES	
G	1	PICTURE	DHP41046	4'-11 7/8"x4'-8 7/8"	INSUL.	-	ANDERSEN	400 SERIES	
H	1	AWNING (FIXED)	A21	2'-0 5/8"x2'-0 5/8"	INSUL.	-	ANDERSEN	400 SERIES	

NOTE: CONTRACTOR SHALL VERIFY WINDOW UNIT NUMBERS, SIZES, GRILLE STYLES, AND ROUGH OPENINGS PER MANUFACTURER'S SPECIFICATIONS BEFORE ORDERING & FRAMING
NOTE: SEE STRUCTURAL DRAWINGS FOR HEADER SIZES


- CONSTRUCTION STANDARD NOTES:**
- (THE FOLLOWING NOTES ARE FOR INFORMATION USE ONLY. THEY SHOULD NOT BE INTERPRETED AS CODE OR VIEWED AS THE COMPLETE CODE. THE CONTRACTOR SHALL BE RESPONSIBLE FOR REVIEWING THE CITY ADOPTED CODE BEFORE ANY CONSTRUCTION BEGINS AND SHALL FULLY IMPLEMENT THE CODE DURING CONSTRUCTION.)
- STAIRS**
1. ALL STAIR SHALL COMPLY WITH THE CITY ADOPTED STAIR CODE. OPEN SIDES OF STAIRS WITH TOTAL RISE OF MORE THAN 30" ABOVE FLOOR OR GRADE SHALL HAVE GUARDS NOT LESS THAN 34" NOR MORE THAN 38" ABOVE SURFACE OF TREAD. OPENINGS BETWEEN BALUSTERS SHALL BE LESS THAN 4". GUARDS SHALL NOT BE CONSTRUCTED WITH HORIZONTAL RAILS OR ORNAMENTAL PATTERNS THAT RESULT IN A LADDER EFFECT.
 2. ALL PORCHES, BALCONIES, & DECKS AND RASSED SURFACES MORE THAN 30" ABOVE FLOOR OR GRADE SHALL HAVE GUARDS NOT LESS THAN 36" IN HEIGHT. OPENINGS BETWEEN BALUSTERS SHALL BE LESS THAN 4". GUARDS SHALL NOT BE CONSTRUCTED WITH HORIZONTAL RAILS OR ORNAMENTAL PATTERNS THAT RESULT IN A LADDER EFFECT.
 3. ALL STAIRS SHALL MAINTAIN A MINIMUM OF 36" IN CLEAR WIDTH AT ALL POINTS ABOVE. THE PERMITTED HANDRAIL HEIGHT AND BELOW THE REQUIRED HEADROOM HEIGHT. HANDRAILS SHALL NOT PROJECT MORE THAN 4.5" ON EITHER SIDE AND MAINTAIN MINIMUM CLEAR WIDTH AT AND BELOW THE HANDRAIL HEIGHT, INCLUDING TREAD AND LANDING. STAIR WIDTH SHALL NOT BE LESS THAN 31.5", WHERE A HANDRAIL IS INSTALLED ON ONE SIDE AND 27" WHERE HANDRAILS ARE ON BOTH SIDES. THE MIN. HEADROOM OF THE STAIRWAY SHALL NOT BE LESS THAN 6'-8" MEASURED VERTICALLY FROM THE SLOPED PLANE ADJOINING THE TREAD NOSING OR FROM SURFACE OF LANDING OR PLATFORM.
 4. THE MAXIMUM RISER HEIGHT SHALL BE 7 3/4" AND MINIMUM SHALL BE 4". THE MINIMUM TREAD DEPTH SHALL BE 10" (MEASURED FROM LEADING EDGE OF TREAD TO LEADING EDGE OF TREAD). A NOSING NOT BE LESS THAN 3/4" BUT NOT MORE THAN 1/4" SHALL BE REQUIRED ON TREADS WHERE THE DEPTH IS LESS THAN 11". OPENINGS IN RISERS SHALL NOT EXCEED 4". THE GREATEST TREAD DEPTH AND RISER HEIGHT WITHIN ANY FLIGHT OF STAIRS SHALL NOT EXCEED THE SMALLEST BY MORE THAN 3/8".
- SMOKE/CO ALARMS AND SPRINKLERS**
1. ALL ALARMS SHALL BE A COMBINATION SMOKE AND CO ALARMS AND SHALL BE LISTED IN ACCORDANCE WITH UL 217. THEY SHALL BE INSTALLED IN PROVISION TO THE CODE AND THE HOUSEHOLD FIRE WARNING EQUIPMENT PROVISIONS OF NFA 72. SMOKE ALARMS SHALL BE INSTALLED IN EACH SLEEPING ROOM AND SMOKE/CO ALARMS SHALL BE INSTALLED OUTSIDE EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS. ALSO ONE SHALL BE INSTALLED ON EACH ADDITIONAL STORY OF THE DWELLING, INCLUDING BASEMENT. IN NEW CONSTRUCTION SMOKE/CO ALARMS SHALL BE CONNECTED TO THE PRIMARY BUILDING POWER AND HAVE A BATTERY BACKUP.
2. THE ENTIRE STRUCTURE SHALL BE SPRINKLED IN COMPLIANCE WITH NFPA 13D, PER CITY CODE (NFPA 101 2009 ED.) WITH A NFPA 13R SPRINKLER SYSTEM DESIGNED AND INSTALLED BY A LICENSED SPRINKLER COMPANY.
- WINDOWS**
1. BASEMENTS AND EVERY SLEEPING ROOM SHALL HAVE AT LEAST ONE OPERABLE EMERGENCY ESCAPE AND RESCUE OPENING EXTENDING DIRECTLY TO THE OUTSIDE. EGRESS WINDOWS SHALL MEET NET OPENING REQUIREMENTS OF 5.0 SQ. FT. (GRADE FLOOR) AND 5.7 SQ. FT. (OTHER FLOORS) WITH A MIN. CLEAR OPENING HEIGHT OF 24". A MIN. CLEAR OPENING WIDTH OF 20" AND A MAXIMUM SILL HEIGHT OF 44".
 2. TEMPERED GLAZING SHALL BE INSTALLED IN THE FOLLOWING CONDITIONS:
 - GLAZING IN BATHROOMS WHERE IT IS LOWER THAN 60" FROM ANY VERTICAL SURFACE.
 - GLAZING LESS THAN 60" ABOVE ANY SURFACE, ADJACENT TO A DOOR WHERE THE NEAREST VERTICAL EDGE IS WITHIN A 24" ARC OF THE DOOR IN CLOSED POSITION.
 - GLAZING BOTTOM LESS THAN 24" ABOVE THE FLOOR.
 - GLAZING ENCLOSING STAIRWAY LANDINGS OR WITHIN 60" OF TOP & BOTTOM OF STAIRWAYS WHERE THE BOTTOM EDGE OF THE GLASS IS LESS THAN 60" ABOVE THE WALKING SURFACE.
 3. FALL PREVENTION CLIPS SHALL BE INSTALLED ON ALL WINDOW SILLS WHERE THE SILL IS LOCATED MORE THAN 72" ABOVE FINISH GRADE OR SURFACE BELOW, AND THE LOWEST PART OF THE CLEAR OPENING OF THE WINDOW IS LESS THAN 24" ABOVE FINISH FLOOR.
- INSULATION & VENTILATION**
1. COMPLY WITH MAINE UNIFORM BUILDING AND ENERGY CODE
LOCATION: CUMBERLAND COUNTY, MAINE
HDD: 7,000-8,400
MINIMUM INSULATION R-VALUES:
GLAZING: U=0.35 MINIMUM
SPRAYFOAM: R=6.0 MINIMUM
CEILING: R=49
WOOD FRAMED WALLS: R=21
WOOD FLOORS (OVER HEATED SPACE): R30
BASEMENT WALLS: R=15 CONTINUOUS OR 19 CAVITY
SLAB (HEATED SPACE): R-VALUE & DEPTH: R=10 TO 4 FT. PERIMETER
CRAWL SPACE: R=10 CONTINUOUS OR 13 CAVITY
 2. UNHEATED CRAWL SPACES SHALL HAVE VENTILATION OPENINGS OF A MINIMUM OF 1 SQ. FT. FOR EACH 150 SQ. FT. OF UNDER FLOOR AREA AND SHALL BE WITHIN 3'-0" OF EACH CORNER OF THE BUILDING. UNHEATED CRAWL SPACES SHALL HAVE A VAPOR RETARDER WITH 6" OVERLAPPED SEALED SEAMS AND EDGES THAT SHALL EXTEND UP 6" ON THE STEM WALLS WHICH SHALL BE ATTACHED AND SEALED. UNHEATED CRAWL SPACE SHALL HAVE A CONTINUOUSLY OPERATING MECHANICAL EXHAUST SYSTEM OR CONDITIONED AIR SUPPLY PER IRC CODE REQUIREMENTS.

LEGEND		
SYMBOL	DESCRIPTION	REMARKS
⊙	CO/SMOKE DETECTOR	

EXTERIOR DOOR SCHEDULE											
NO.	QTY.	SIZE (WxH)	TYPE	MANUFACTURER	MODEL NO.	STYLE	INSULATION	FIRE RATING	GLAZING	SWING	REMARKS
101	1	3'-0"x6'-8"	STEEL	-	-	3/4 VIEW	R7	-	INSUL.	SEE PLAN	(1) 12" SIDELIGHT
102	1	2'-9"x6'-8"	ATRIUM	ANDERSEN	FHW29611	FULL VIEW	R7	-	INSUL.	SEE PLAN	400 SERIES
103	1	3'-0"x6'-8"	STEEL	-	-	6 PANEL	R7	-	INSUL.	SEE PLAN	-
104	1	2'-8"x6'-8"	STEEL	-	-	9-LITE	R7	-	INSUL.	SEE PLAN	-
105	2	9'-0"x8'-0"	STEEL	-	-	O.H. DOOR	R7	-	INSUL.	-	STYLE SELECTED BY OWNER
106	1	3'-0"x6'-8"	STEEL	-	-	6 PANEL	R7	1 HR.	INSUL.	SEE PLAN	W/CLOSER

NOTE: CONTRACTOR SHALL SPECIFY HARDWARE PER BUILDING CODE REQUIREMENTS AND VERIFY TYPE WITH OWNER
NOTE: CONTRACTOR SHALL VERIFY DOOR QUANTITIES, SIZES, SWINGS, CODE REQUIREMENTS, & RGH. OPNGS. PER MANUFACTURER'S SPECIFICATIONS BEFORE ORDERING & FRAMING
NOTE: SEE FLOOR PLANS FOR INTERIOR DOOR SIZES, SWINGS, TYPES. CONTRACTOR SHALL VERIFY WITH OWNER PRIOR TO PLACING ORDER.

ISSUED FOR CONSTRUCTION
03-30-2016



THESE PLANS HAVE BEEN LICENSED TO THE CUSTOMER FOR USE IN CONSTRUCTION OF ONE BUILDING ONLY AND ARE SUBJECT TO THE CONDITIONS OF LICENSE ACCEPTED BY THE CUSTOMER. USE OF ANY PART OF THE PLANS BY ANY PARTY OTHER THAN THE CUSTOMER, EXCEPT ON LOAN BY THE CUSTOMER TO THIRD PARTIES NECESSARY TO ASSIST THE CUSTOMER IN USING THE PLANS, SUCH AS CONTRACTORS AND SUBCONTRACTORS, IS STRICTLY PROHIBITED. THE PLANS MAY NOT BE RE-USED OR COPIED IN WHOLE OR IN PART, WITHOUT WRITTEN PERMISSION FROM MORIN DRAFTING WHICH RETAINS COPYRIGHTS TO AND OWNERSHIP OF THE PLANS.

White Homes, Inc. 878-3361	
MORIN DRAFTING 318-1177	
DORLER RESIDENCE MORNINGSTAR LANE, PORTLAND, ME. (LOT NO. 3)	
FLOOR PLAN	
DRAWN: J. MORIN SCALE: 1/4"=1'-0" DATE: 05-22-2016 PLAN NO:	A2