


Job 1709075	Truss A01	Truss Type COMMON	Qty 15	Ply 1	Eldredge-Portland, ME
----------------	--------------	----------------------	-----------	----------	-----------------------

Beau Trusses, Boscaawen, NH 03303, Rick Greene

8.030 s Oct 5 2016 MiTek Industries, Inc. Fri Sep 15 15:25:34 2017 Page 1

ID:gm\_YvE8PIbZkfc9cw8dwhCye4p7-xILNa\_UTntuPVyJ7aQEYYXWTC71\_wiSA9?FiJhydMLF



Scale = 1:54.0

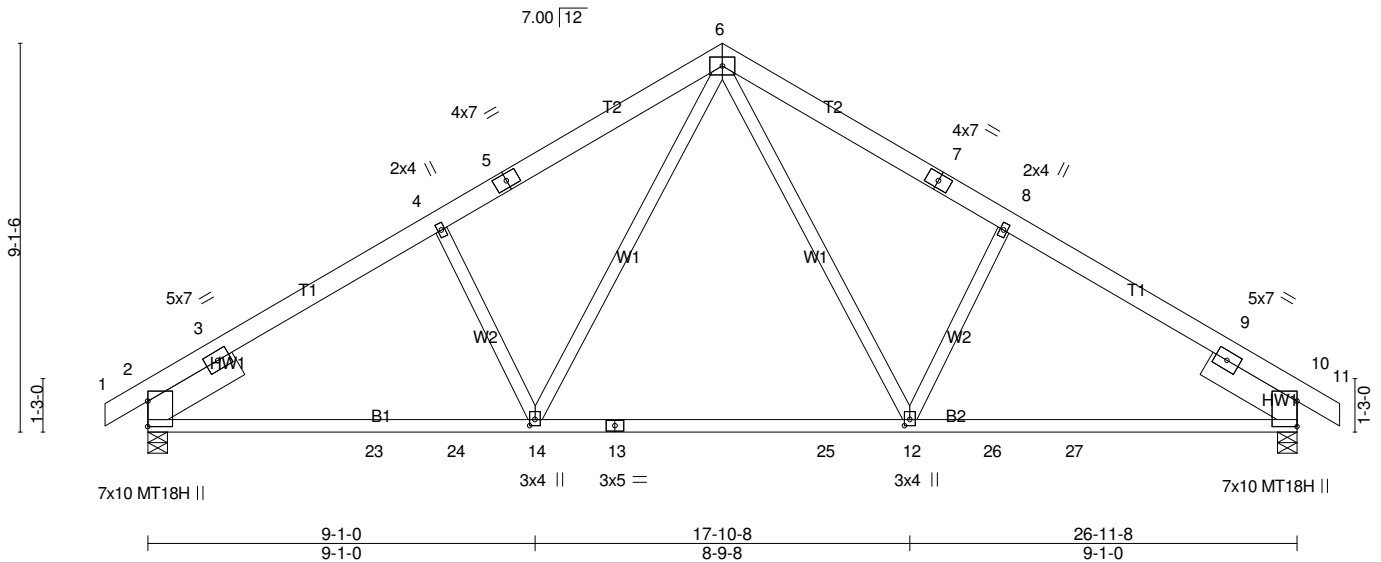


Plate Offsets (X,Y)-- [12:0-1-12,0-1-8], [14:0-1-12,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 46.2 (Ground Snow=60.0)	2-0-0 Plate Grip DOL 1.15 Lumber DOL 1.15	TC 0.70 BC 0.81 WB 0.67 Matrix-MS	in (loc) l/defl L/d Vert(LL) -0.31 12-14 >999 360 Vert(TL) -0.52 12-14 >626 240 Horz(TL) 0.11 10 n/a n/a	MT20 MT18H	197/144 197/144
TCDL 10.0 BCLL 0.0 * BCDL 10.0	Rep Stress Incr YES Code IBC2009/TPI2007			Weight: 136 lb	FT = 15%

**LUMBER-**  
 TOP CHORD 2x6 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x4 SPF No.2  
 SLIDER Left 2x8 SPF No.2 2-6-0, Right 2x8 SPF No.2 2-6-0

**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 3-2-2 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 7-4-5 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (lb/size) 2=1897/0-5-8 (min. 0-3-0), 10=1897/0-5-8 (min. 0-3-0)  
 Max Horz 2=-276(LC 6)  
 Max Uplift 2=-622(LC 8), 10=-622(LC 9)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-255/229, 3-4=-2396/756, 4-5=-2145/788, 5-6=-1968/819, 6-7=-1968/819,  
 7-8=-2145/789, 8-9=-2396/757, 9-10=-255/228  
 BOT CHORD 2-23=-628/1905, 23-24=-628/1905, 14-24=-628/1905, 13-14=-327/1402, 13-25=-327/1402,  
 12-25=-327/1402, 12-26=-509/1905, 26-27=-509/1905, 10-27=-509/1905  
 WEBS 6-12=-405/788, 8-12=-604/274, 6-14=-404/788, 4-14=-604/274


- NOTES-**
- 1) Wind: ASCE 7-05; 110mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; enclosed; MWFRS (low-rise) gable end zone; cantilever left and right exposed; end vertical left and right exposed; porch left and right exposed; Lumber DOL=1.33 plate grip DOL=1.33
  - 2) TCLL: ASCE 7-05; Pg= 60.0 psf (ground snow); Pf=46.2 psf (flat roof snow); Category II; Exp B; Partially Exp.; Ct=1.1
  - 3) Unbalanced snow loads have been considered for this design.
  - 4) This truss has been designed for greater of min roof live load of 17.0 psf or 1.00 times flat roof load of 46.2 psf on overhangs non-concurrent with other live loads.
  - 5) This truss has been designed for basic load combinations, which include cases with reductions for multiple concurrent live loads.
  - 6) All plates are MT20 plates unless otherwise indicated.
  - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 8) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 9) All bearings are assumed to be SPF No.2 .
  - 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=622, 10=622.
  - 11) This truss is designed in accordance with the 2009 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

Job 1709075	Truss A01GE	Truss Type COMMON SUPPORTED GAB	Qty 2	Ply 1	Eldredge-Portland, ME
					Job Reference (optional)

Beau Trusses, Boscawen, NH 03303, Rick Greene

8.030 s Oct 5 2016 MiTek Industries, Inc. Fri Sep 15 15:25:35 2017 Page 1  
ID:gm\_YvE8PibZkfc9cw8dwhCye4p7-PxvmoKV6YB0G76uK78ln5k2m7Xo1fP0KOf?Fr7ydMLE



Scale = 1:57.1

<b>LOADING</b> (psf)	<b>SPACING-</b>	<b>CSI.</b>	<b>DEFL.</b>	<b>PLATES</b>	<b>GRIP</b>
TCLL 46.2 (Ground Snow=60.0)	2-0-0	TC 0.18	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.12	Vert(LL) -0.00 18 n/r 180		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.33	Vert(TL) -0.00 18 n/r 120		
BCDL 10.0	Rep Stress Incr YES	Matrix-R	Horz(TL) 0.01 20 n/a n/a		
	Code IBC2009/TPI2007			Weight: 161 lb	FT = 15%

**LUMBER-**  
TOP CHORD 2x6 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.  
WEBS 1 Row at midpt 10-27

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** All bearings 26-11-8.  
(lb) - Max Horz 35=-320(LC 6)  
Max Uplift All uplift 100 lb or less at joint(s) 28, 30, 31, 32, 33, 26, 25, 24, 23, 22 except 35=-218(LC 6), 20=-141(LC 7), 34=-196(LC 7), 21=-146(LC 6)  
Max Grav All reactions 250 lb or less at joint(s) 34, 21 except 35=260(LC 13), 20=260(LC 14), 27=261(LC 2), 28=382(LC 13), 30=359(LC 13), 31=294(LC 3), 32=263(LC 1), 33=277(LC 13), 26=382(LC 14), 25=359(LC 14), 24=294(LC 4), 23=263(LC 1), 22=277(LC 14)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 8-9=-89/298, 9-10=-97/323, 10-11=-97/314, 11-12=-89/270  
WEBS 9-28=-342/65, 8-30=-319/113, 11-26=-342/61, 12-25=-319/114

- NOTES-**
- 1) Wind: ASCE 7-05; 110mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; enclosed; MWFRS (low-rise) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; porch left and right exposed; Lumber DOL=1.33 plate grip DOL=1.33
  - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - 3) TCLL: ASCE 7-05; Pg= 60.0 psf (ground snow); Pf=46.2 psf (flat roof snow); Category II; Exp B; Partially Exp.; Ct=1.1
  - 4) Unbalanced snow loads have been considered for this design.
  - 5) This truss has been designed for greater of min roof live load of 17.0 psf or 1.00 times flat roof load of 46.2 psf on overhangs non-concurrent with other live loads.
  - 6) This truss has been designed for basic load combinations, which include cases with reductions for multiple concurrent live loads.
  - 7) All plates are 1.5x4 MT20 unless otherwise indicated.
  - 8) Gable requires continuous bottom chord bearing.
  - 9) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
  - 10) Gable studs spaced at 2-0-0 oc.
  - 11) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 12) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 13) All bearings are assumed to be SPF No.2 .
  - 14) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 28, 30, 31, 32, 33, 26, 25, 24, 23, 22 except (jt=lb) 35=218, 20=141, 34=196, 21=146.
  - 15) This truss is designed in accordance with the 2009 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.


**LOAD CASE(S)** Standard

Job 1709075	Truss B01	Truss Type COMMON	Qty 12	Ply 1	Eldredge-Portland, ME
----------------	--------------	----------------------	-----------	----------	-----------------------


Beau Trusses, Boscawen, NH 03303, Rick Greene

8.030 s Oct 5 2016 MiTek Industries, Inc. Fri Sep 15 15:25:36 2017 Page 1

ID:gm\_YvE8PbZkfc9cw8dwhCye4p7-t7S8?gWkJU87kFTWWhrH0dybpJx?ROkLTdJkpNaydMLD



Scale = 1:68.9

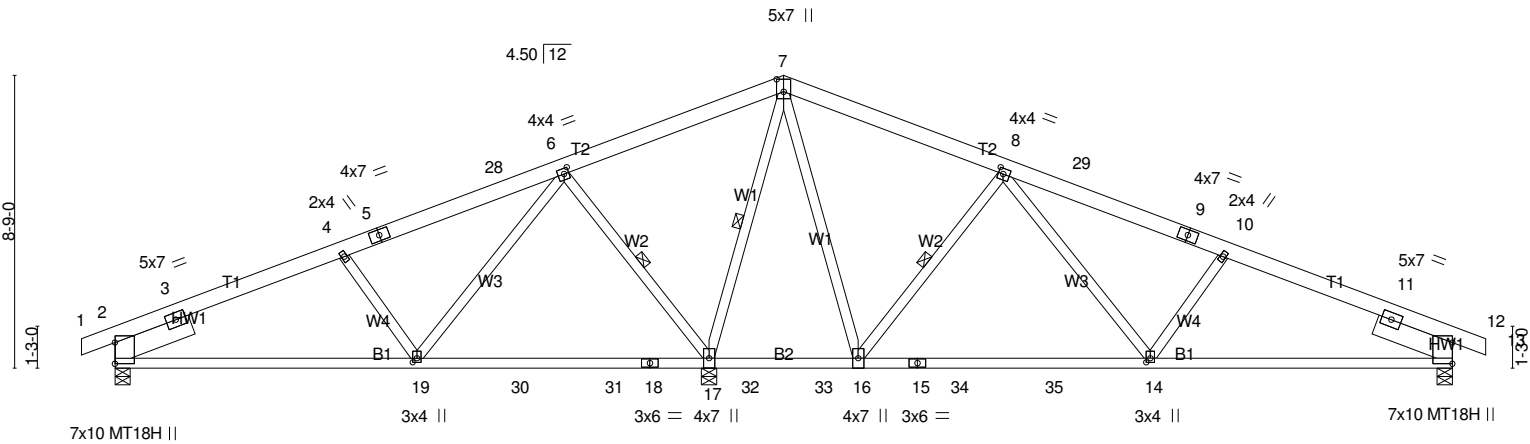

9-0-6	17-9-4	22-2-12	30-11-10	40-0-0
9-0-6	8-8-14	4-5-8	8-8-14	9-0-6

Plate Offsets (X,Y)-- [6:0-1-12,0-2-0], [7:0-4-8,0-2-8], [8:0-1-12,0-2-0], [14:0-1-8,0-1-8], [19:0-1-8,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 46.2 (Ground Snow=60.0)	2-0-0 Plate Grip DOL 1.15 Lumber DOL 1.15	TC 0.66 BC 0.68 WB 0.84 Matrix-MS	in (loc) l/defl L/d Vert(LL) -0.21 14-16 >999 360 Vert(TL) -0.42 14-16 >636 240 Horz(TL) 0.04 12 n/a n/a	MT20 MT18H	197/144 197/144
TCDL 10.0 BCLL 0.0 * BCDL 10.0	Rep Stress Incr YES Code IBC2009/TPI2007			Weight: 198 lb	FT = 15%

LUMBER-	BRACING-
TOP CHORD 2x6 SPF No.2 BOT CHORD 2x4 SPF No.2 WEBS 2x4 SPF No.2 SLIDER Left 2x8 SPF No.2 2-6-0, Right 2x8 SPF No.2 2-6-0	TOP CHORD Structural wood sheathing directly applied or 4-4-12 oc purlins. BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing. WEBS 1 Row at midpt 8-16, 7-17, 6-17

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (lb/size) 2=844/0-5-8 (min. 0-1-9), 17=3448/0-5-8 (min. 0-5-7), 12=1229/0-5-8 (min. 0-2-3)  
 Max Horz 2=120(LC 8)  
 Max Uplift 2=-338(LC 8), 17=-1038(LC 8), 12=-479(LC 9)  
 Max Grav 2=1003(LC 13), 17=3448(LC 1), 12=1397(LC 14)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-352/171, 3-4=-1012/337, 4-5=-754/278, 5-28=-637/289, 6-28=-494/304,  
 6-7=-189/1263, 7-8=-291/332, 8-29=-1346/609, 9-29=-1499/593, 9-10=-1606/585,  
 10-11=-1913/631  
 BOT CHORD 2-19=-341/948, 19-30=-525/241, 30-31=-525/241, 18-31=-525/241, 17-18=-525/241,  
 17-32=-474/280, 32-33=-474/280, 16-33=-474/280, 15-16=-144/975, 15-34=-144/975,  
 34-35=-144/975, 14-35=-144/975, 12-14=-483/1679  
 WEBS 7-16=-499/1400, 8-16=-1525/499, 8-14=-366/801, 10-14=-565/213, 7-17=-2372/641,  
 6-17=-1581/518, 6-19=-418/943, 4-19=-694/260

- NOTES-**
- 1) Wind: ASCE 7-05; 110mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; enclosed; MWFRS (low-rise) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; porch left and right exposed; Lumber DOL=1.33 plate grip DOL=1.33
  - 2) TCLL: ASCE 7-05; Pg= 60.0 psf (ground snow); Pf=46.2 psf (flat roof snow); Category II; Exp B; Partially Exp.; Ct=1.1
  - 3) Unbalanced snow loads have been considered for this design.
  - 4) This truss has been designed for greater of min roof live load of 19.5 psf or 1.00 times flat roof load of 46.2 psf on overhangs non-concurrent with other live loads.
  - 5) This truss has been designed for basic load combinations, which include cases with reductions for multiple concurrent live loads.
  - 6) All plates are MT20 plates unless otherwise indicated.
  - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 8) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 9) All bearings are assumed to be SPF No.2 .
  - 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=338, 17=1038, 12=479.
  - 11) This truss is designed in accordance with the 2009 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard


Job 1709075	Truss B01GE	Truss Type Common Supported Gable	Qty 1	Ply 1	Eldredge-Portland, ME
----------------	----------------	--------------------------------------	----------	----------	-----------------------

Beau Trusses, Boscawen, NH 03303, Rick Greene

8.030 s Oct 5 2016 MiTek Industries, Inc. Fri Sep 15 15:25:36 2017 Page 1

ID:gm\_YvE8PlbZkfc9cw8dwhCye4p7-t7S8?gWkJU87kFTWhrH0dybyx98Os8TdJkpNaydMLD

Job Reference (optional)



Scale = 1:67.7

Plate Offsets (X,Y)--	[6:0-4-8,0-4-8], [18:0-4-8,0-4-8], [32:0-3-8,0-3-0], [36:0-3-8,0-3-0]
-----------------------	---

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 46.2	2-0-0	TC 0.12	in (loc) l/defl L/d	MT20	197/144
(Ground Snow=60.0)	Plate Grip DOL 1.15	BC 0.06	Vert(LL) 0.00 22 n/r 180		
TCDL 10.0	Lumber DOL 1.15	WB 0.34	Vert(TL) -0.00 22 n/r 120		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-R	Horz(TL) 0.01 24 n/a n/a		
BCDL 10.0	Code IBC2009/TPI2007			Weight: 225 lb	FT = 15%

**LUMBER-**  
TOP CHORD 2x6 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.  
WEBS 1 Row at midpt 12-34

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** All bearings 40-0-0.  
(lb) - Max Horz 44=121(LC 8)  
Max Uplift All uplift 100 lb or less at joint(s) 44, 24, 35, 36, 37, 38, 39, 40, 41, 42, 33, 32, 31, 30, 29, 28, 27, 26, 25 except 43=-111(LC 8)  
Max Grav All reactions 250 lb or less at joint(s) 43, 25 except 44=279(LC 13), 24=279(LC 14), 34=266(LC 2), 35=380(LC 13), 36=372(LC 13), 37=371(LC 13), 38=333(LC 13), 39=289(LC 3), 40=263(LC 1), 41=256(LC 13), 42=274(LC 13), 33=380(LC 14), 32=372(LC 14), 31=371(LC 14), 30=333(LC 14), 29=289(LC 4), 28=263(LC 1), 27=256(LC 14), 26=274(LC 14)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-44=-261/78, 9-10=-58/256, 10-11=-59/284, 11-12=-63/302, 12-13=-63/297, 13-14=-59/268, 22-24=-261/66  
WEBS 11-35=-340/60, 10-36=-332/89, 9-37=-331/81, 8-38=-293/81, 13-33=-340/58, 14-32=-332/90, 15-31=-331/81, 16-30=-293/81

- NOTES-**
- 1) Wind: ASCE 7-05; 110mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; enclosed; MWFRS (low-rise) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; porch left and right exposed; Lumber DOL=1.33 plate grip DOL=1.33
  - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - 3) TCLL: ASCE 7-05; Pg= 60.0 psf (ground snow); Pf=46.2 psf (flat roof snow); Category II; Exp B; Partially Exp.; Ct=1.1
  - 4) Unbalanced snow loads have been considered for this design.
  - 5) This truss has been designed for greater of min roof live load of 19.5 psf or 1.00 times flat roof load of 46.2 psf on overhangs non-concurrent with other live loads.
  - 6) This truss has been designed for basic load combinations, which include cases with reductions for multiple concurrent live loads.
  - 7) All plates are 2x4 MT20 unless otherwise indicated.
  - 8) Gable requires continuous bottom chord bearing.
  - 9) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
  - 10) Gable studs spaced at 2-0-0 oc.
  - 11) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 12) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 13) All bearings are assumed to be SPF No.2 .

Continued on page 2

Job	Truss	Truss Type	Qty	Ply	Eldredge-Portland, ME
1709075	B01GE	Common Supported Gable	1	1	Job Reference (optional)

Beau Trusses, Boscawen, NH 03303, Rick Greene

8.030 s Oct 5 2016 MiTek Industries, Inc. Fri Sep 15 15:25:37 2017 Page 2  
 ID:gm\_YvE8PibZkfc9cw8dwhCye4p7-LJ0WC0XM4oG\_MP2iFZoFA987dKVN7JOdszUMw0ydMLC

**NOTES-**

- 14) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 44, 24, 35, 36, 37, 38, 39, 40, 41, 42, 33, 32, 31, 30, 29, 28, 27, 26, 25 except (jt=lb) 43=111.
- 15) This truss is designed in accordance with the 2009 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.


**LOAD CASE(S)** Standard

Job 1709075	Truss B02GE	Truss Type GABLE	Qty 1	Ply 1	Eldredge-Portland, ME
----------------	----------------	---------------------	----------	----------	-----------------------

Beau Trusses, Boscawen, NH 03303, Rick Greene

8.030 s Oct 5 2016 MiTek Industries, Inc. Fri Sep 15 15:25:37 2017 Page 1

ID:gm\_YvE8PlbZkfc9cw8dwhCye4p7-LJ0WC0XM4oG\_MP2iFZoFA986FKU67OqdszUMw0ydMLC



Scale = 1:26.0

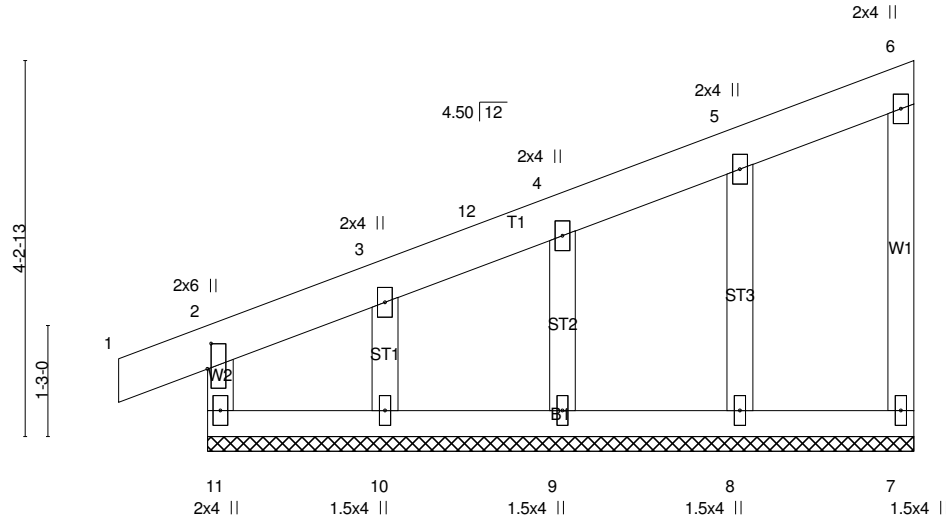


Plate Offsets (X,Y)-- [2:0-3-7,0-0-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 46.2 (Ground Snow=60.0)	2-0-0 Plate Grip DOL 1.15	TC 0.14	Vert(LL) -0.00	1	n/r	180	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.08	Vert(TL) -0.00	1	n/r	120		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.06	Horz(TL) 0.00	7	n/a	n/a		
BCDL 10.0	Code IBC2009/TPI2007	Matrix-R					Weight: 38 lb	FT = 15%

**LUMBER-**  
 TOP CHORD 2x6 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x4 SPF No.2  
 OTHERS 2x4 SPF No.2

**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
 MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** All bearings 7-11-8.  
 (lb) - Max Horz 11=196(LC 7)  
 Max Uplift All uplift 100 lb or less at joint(s) 11, 7, 9, 8 except 10=-123(LC 7)  
 Max Grav All reactions 250 lb or less at joint(s) 7, 10 except 11=274(LC 1), 9=323(LC 13), 8=331(LC 13)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-11=-257/43  
 WEBS 4-9=-284/79, 5-8=-289/66

- NOTES-**
- 1) Wind: ASCE 7-05; 110mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; enclosed; MWFRS (low-rise) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; porch left and right exposed; Lumber DOL=1.33 plate grip DOL=1.33
  - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - 3) TCLL: ASCE 7-05; Pg= 60.0 psf (ground snow); Pf=46.2 psf (flat roof snow); Category II; Exp B; Partially Exp.; Ct=1.1
  - 4) Unbalanced snow loads have been considered for this design.
  - 5) This truss has been designed for greater of min roof live load of 19.5 psf or 1.00 times flat roof load of 46.2 psf on overhangs non-concurrent with other live loads.
  - 6) This truss has been designed for basic load combinations, which include cases with reductions for multiple concurrent live loads.
  - 7) Gable requires continuous bottom chord bearing.
  - 8) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
  - 9) Gable studs spaced at 2-0-0 oc.
  - 10) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 11) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members.
  - 12) All bearings are assumed to be SPF No.2 .
  - 13) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 11, 7, 9, 8 except (jt=lb) 10=123.
  - 14) This truss is designed in accordance with the 2009 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard