

(2) 1 3/4" x 9 1/4" LEVEL 2 WOLMANIZED PSL

PROVIDE 48" x 12" x 12" DEEP CONCRETE PAD FOR SUPPORT OF DECK STAIRS. VERIFY LOCATION IN FIELD

ORIGINALLY PROPOSED DECK
- AMENDMENT TO PERMIT # 030900

74'-0"

OUTLINE OF SCREENED-IN PORCH ABOVE

OUTLINE OF DECK ABOVE.


DEPT. OF BUILDING INSPECTION
CITY OF PORTLAND, ME
MAR 2 2004

SEE TYPICAL SONO-TUBE DETAIL 2 ON SHEET A2 OF 7.

AMENDMENT TO ORIGINAL PERMIT # 030900

392 B 22

OUTLINE OF FOOTING BELOW

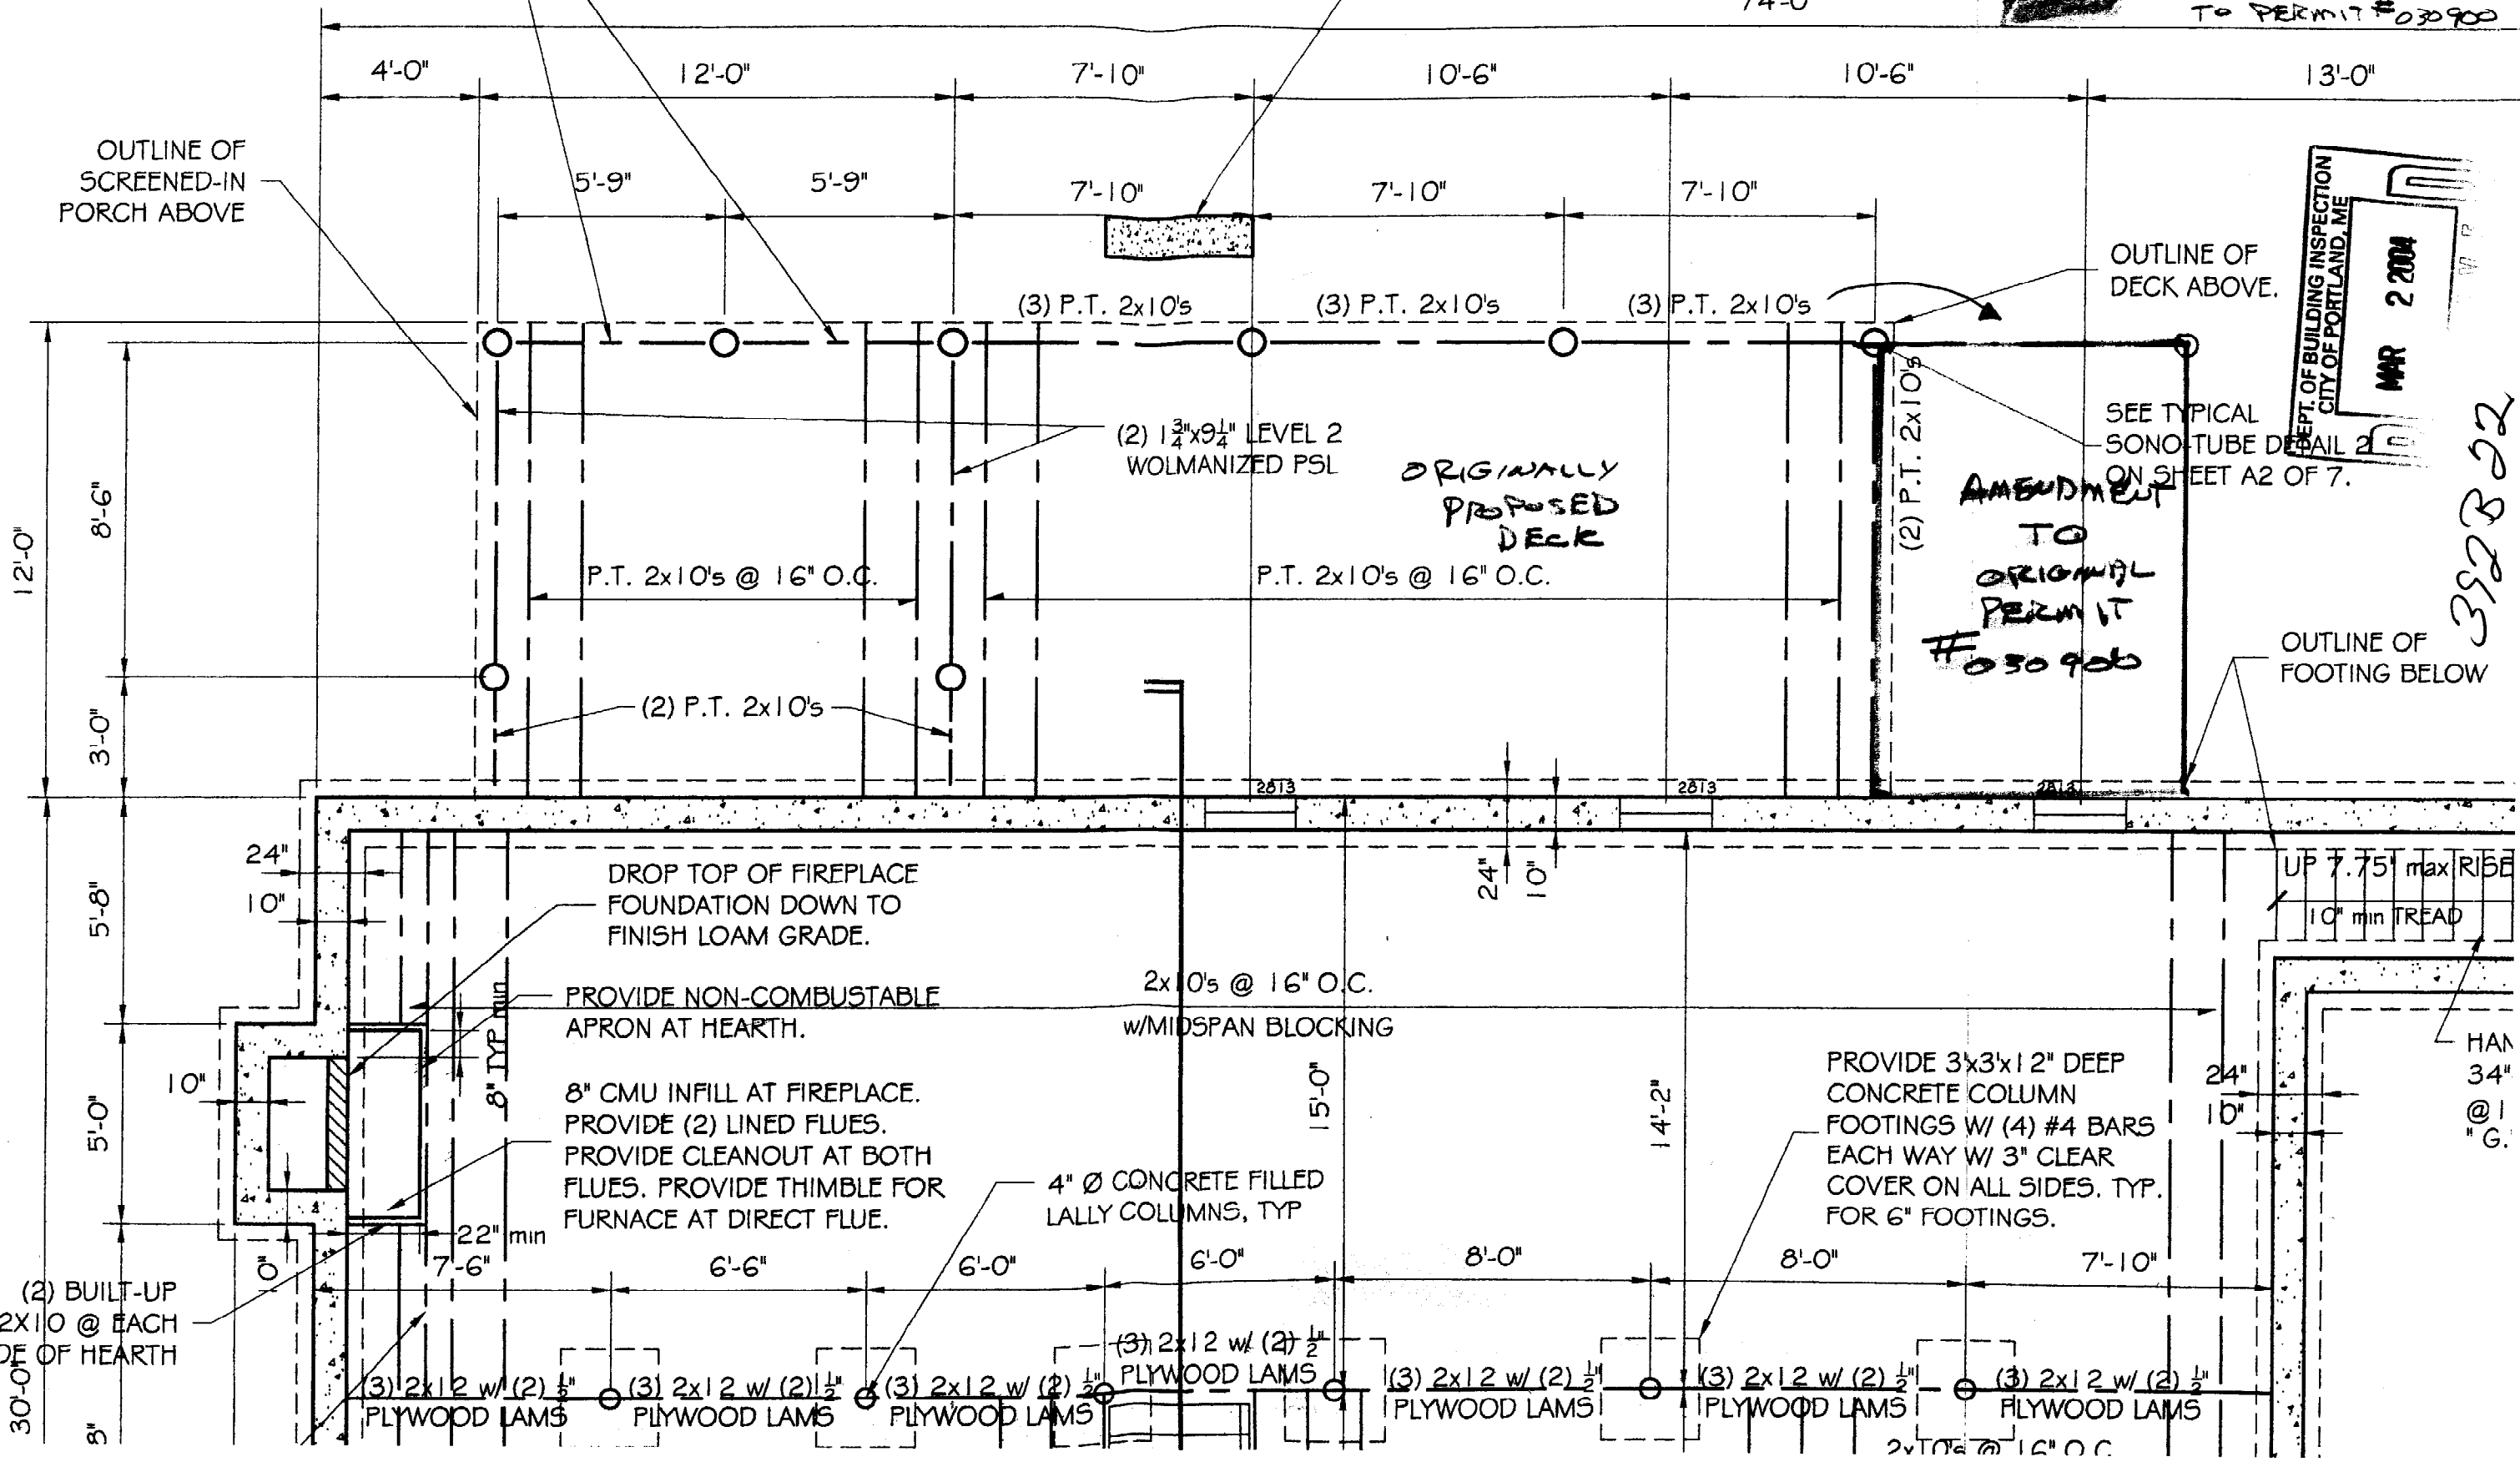

(2) BUILT-UP 2X10 @ EACH SIDE OF HEARTH

DROP TOP OF FIREPLACE FOUNDATION DOWN TO FINISH LOAM GRADE.

PROVIDE NON-COMBUSTABLE APRON AT HEARTH.

8" CMU INFILL AT FIREPLACE. PROVIDE (2) LINED FLUES. PROVIDE CLEANOUT AT BOTH FLUES. PROVIDE THIMBLE FOR FURNACE AT DIRECT FLUE.

4" Ø CONCRETE FILLED LALLY COLUMNS, TYP

PROVIDE 3x3x12" DEEP CONCRETE COLUMN FOOTINGS W/ (4) #4 BARS EACH WAY W/ 3" CLEAR COVER ON ALL SIDES. TYP. FOR 6" FOOTINGS.

(3) 2x12 w/ (2) 1/2" PLYWOOD LAMS
(3) 2x12 w/ (2) 1/2" PLYWOOD LAMS
(3) 2x12 w/ (2) 1/2" PLYWOOD LAMS
(3) 2x12 w/ (2) 1/2" PLYWOOD LAMS
(3) 2x12 w/ (2) 1/2" PLYWOOD LAMS
(3) 2x12 w/ (2) 1/2" PLYWOOD LAMS