


ROOF PLAN 1/4"=1'-0" **A**

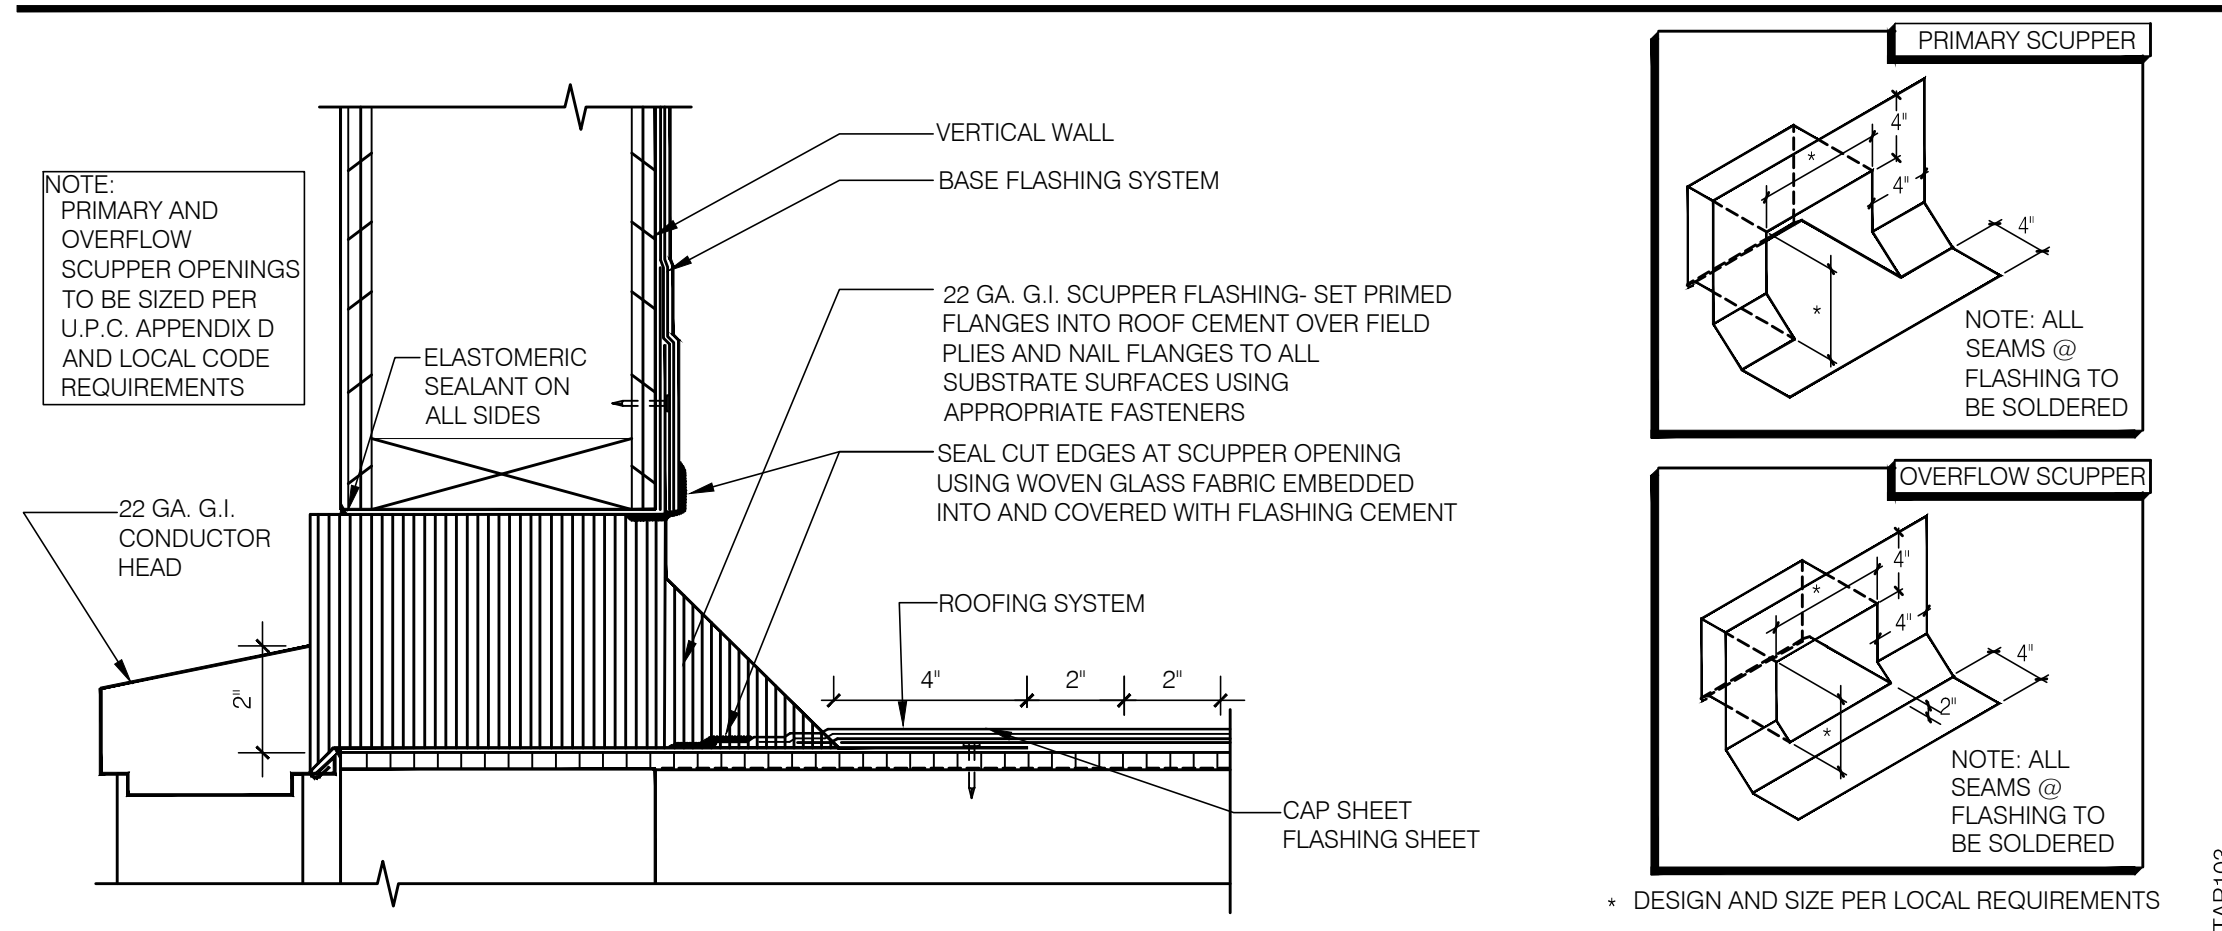

WATERPROOFING:
 A. PAINT UNDERSIDE OF PARAPET CAP FLASHING WITH FACTORY BONDED PAINT GRIP OR PRIMER.
 B. TOP NAILING AT PARAPET CAP FLASHING WILL NOT BE ACCEPTED.
 C. PENETRATIONS IN ROOFING MEMBRANE AND FLASHING SHALL ONLY BE MADE AS INDICATED ON THE DRAWINGS OR SPECS.
 D. SEE SPECIFICATIONS FOR SEALANT SPECS.
 E. ALL SHEET MTL FLASHING SHALL BE 22 GA MIN.

MISCELLANEOUS:
 A. ROOF PENETRATIONS CLOSER THAN 12" FROM ANOTHER WILL NOT BE ALLOWED.
 B. EXHAUST FANS MIN. 10'-0" AWAY FROM ALL AIR INTAKE / SUPPLY.
 C. LOCATE WALK-IN CONDENSERS ON ROOF ONLY IF REQUIRED BY CODE.

PRIMARY SCUPPER
 NOTE: ALL SEAMS @ FLASHING TO BE SOLDERED


OVERFLOW SCUPPER
 NOTE: ALL SEAMS @ FLASHING TO BE SOLDERED

* DESIGN AND SIZE PER LOCAL REQUIREMENTS

ROOF PLAN NOTES **E**

- 1 ROOFTOP UNIT. INSTALL PLUMB AND LEVEL.
 - 2 KITCHEN HOOD EXHAUST FAN. SEE SHEETS M3.0 & DETAIL 19/A6.0.
 - 3 RESTROOM EXHAUST FAN. SEE 18/A6.0.
 - 4 CANOPY. SEE SCOPE OF WORK.
 - 5 FRUITISTA MACHINE CONDENSER.
 - 6 ICE MACHINE CONDENSERS.
 - 7 WALK-IN COOLER / FREEZER CONDENSERS. SEE SCOPE OF WORK SHEET.
 - 8 EQUIPMENT PLATFORM. SEE DETAIL 15/A6.0.
 - 9 PIPE HOOD FOR UTILITIES. SEE DETAIL 9/A6.0.
 - 10 24" x 24" HINGED LOUVER. SEE DETAIL 8/A6.0.
 - 11 SCUPPER AND DOWNSPOUT. SEE DETAIL F.
 - 12 ALUMINUM SLAT WALL BY VENDOR. SEE SCOPE OF WORK.
 - 13 ALUMINUM VALANCE. SEE SCOPE OF WORK.
 - 14 CHANGE IN PARAPET ELEVATION SEE DETAIL 14/A6.4.
 - 15 ROOF CRICKET. SEE DETAIL 16/A6.0.
 - 16 NOT USED.
 - 17 ROOF LADDER.
 - 18 COORDINATE SIZE OF ROOF CURB AND NUMBER OF CONDENSING UNITS WITH WALK-IN COOLER/FREEZER MANUFACTURER.
 - 19 WASTE VENT THROUGH ROOF. THE TOP OF WASTE VENTS SHALL BE 12" HIGHER THAN THE CLOSEST PARAPET CAP U.N.O. OR NOT ALLOWED BY LOCAL JURISDICTION. SEE 12/A6.0 FOR FLASHING ASSEMBLY.
 - 20 NOT USED.
 - 21 "DURO-LAST" SINGLE PLY ROOF MEMBRANE OVER 1/2" EXTERIOR GRADE PLYWOOD OVER TRUSSES. INSTALL PER MANUFACTURERS SPECIFICATIONS.
 - 22 POWER / GAS / CONDENSATE ENTRY UNDER HVAC UNIT (PER HVAC MFR. SPECS.) REFER TO MECH. AND PLUMB DWGS. UTILITY ACCESS FROM WITHIN CURB - NO ROOF PENETRATIONS. DO NOT RUN ON ROOF SURFACE. SEE 13/P6.0.
 - 23 24X36 WALK MATS. SEE ROOF SPECS.
 - 24 MAINTAIN MFR'S ROOFTOP UNIT MAINTENANCE CLEARANCE.
 - 25 OUTSIDE AIR INTAKE FOR ROOFTOP UNIT. MAINTAIN MIN 10'-0" SEPARATION FROM PLUMBING VENTS, FLUES AND BUILDING EXHAUST.
 - 26 NOT USED.
 - 27 NOT USED.
 - 28 WATER HEATER INTAKE. SEE DETAIL 13/A6.0 FOR BRACING.
 - 29 WATER HEATER EXHAUST FLUE SHALL BE MIN. 6" HIGHER THAN INTAKE-MAINTAIN MIN. 10'-0" FROM NEAREST POINT OF RTU INTAKE. SEE DETAIL 13/A6.0 FOR BRACING.
 - 30 PAINTED METAL PARAPET CAP. SEE DETAIL 2 & 5/A6.0.
- KEY NOTES** **B**

MARK D. MCCLUGGAGE AIA, CCS
 1825 E. Douglas Wichita, KS 67211
 www.gimv.com
 Fax: (316) 265-5846
 MAINE LIC. # ARC02323

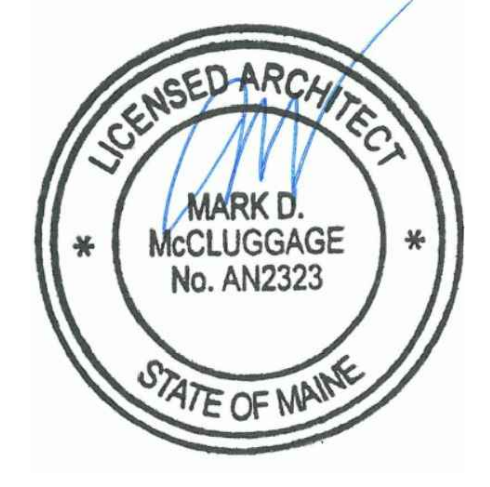

07/14/16

15034.000

CONTRACT DATE: 07.06.2016
 BUILDING TYPE: CONVERSION
 PLAN VERSION: FEBRUARY 2015
 SITE NUMBER: XXX-XXX
 STORE NUMBER: XXXXX

TACO BELL
 1363 WASHINGTON AVE.
 PORTLAND, ME



ROOF PLAN
A3.0

PLOT DATE: