


NOTE: GREEN GROUND WIRE REQUIRED IN ALL CONDUITS, SIZED PER N.E.C. REQUIREMENTS.

UNDER SLAB CONDUIT N.T.S. **17**

YES001

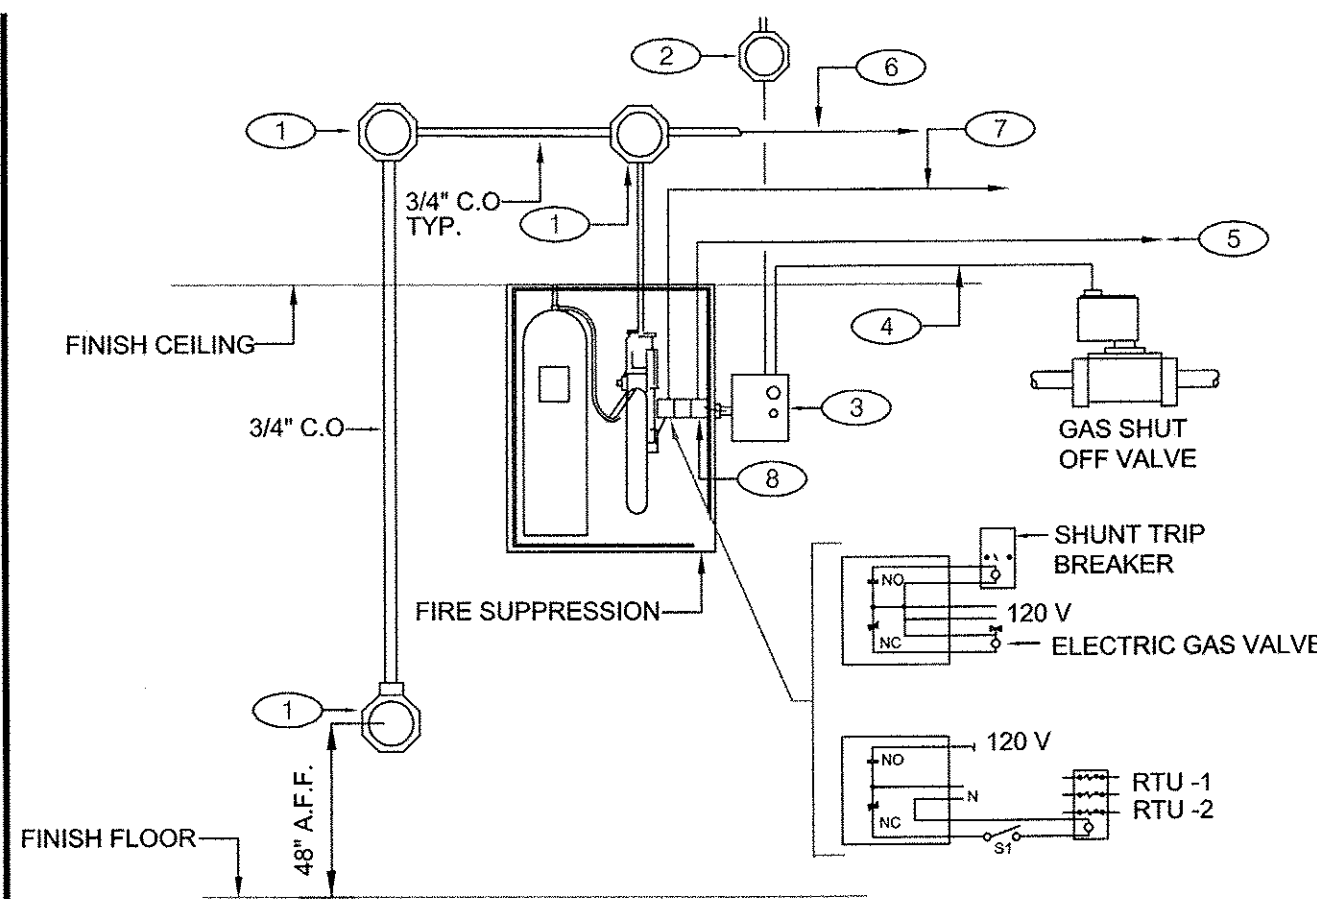



FIRE SUPPRESSION SYSTEM WIRING DIAGRAM N.T.S. **9**

GENERAL NOTES:

1. REFER TO SHEET M3.0


KEY NOTES:

- 1. PROVIDE 4\"/>
- 2. PROVIDE J-BOX, AND 110 V CIRCUIT. REFER TO EQUIPMENT SCHEDULE/FLOOR PLAN FOR CIRCUIT ASSIGNMENT. INTERCONNECT TO MANUAL RESET RELAY THROUGH MICROSWITCH.
- 3. MANUAL RESET RELAY FURNISHED WITH UNIT INSTALLED BY E.C.
- 4. PROVIDE 1/2\"/>
- 5. PROVIDE 1/2\"/>
- 6. CABLE AND CONNECTION TO FUSIBLE LINKS AT EXHAUST HOOD BY K.E.C.
- 7. PROVIDE INTERCONNECTION TO "SHUNT TRIP" BREAKER AT PANEL AND MICROSWITCH AT HOOD.
- 8. SLOT FOR SNAP ACTION MICRO-SWITCH. UP TO FOUR SWITCHES AVAILABLE FOR HOOK-UP.
SWITCH 1: GAS SHUT-OFF VALVE.
SWITCH 2: EXH/S.
SWITCH 3: SHUNT TRIP BREAKER IN ELE PANEL.

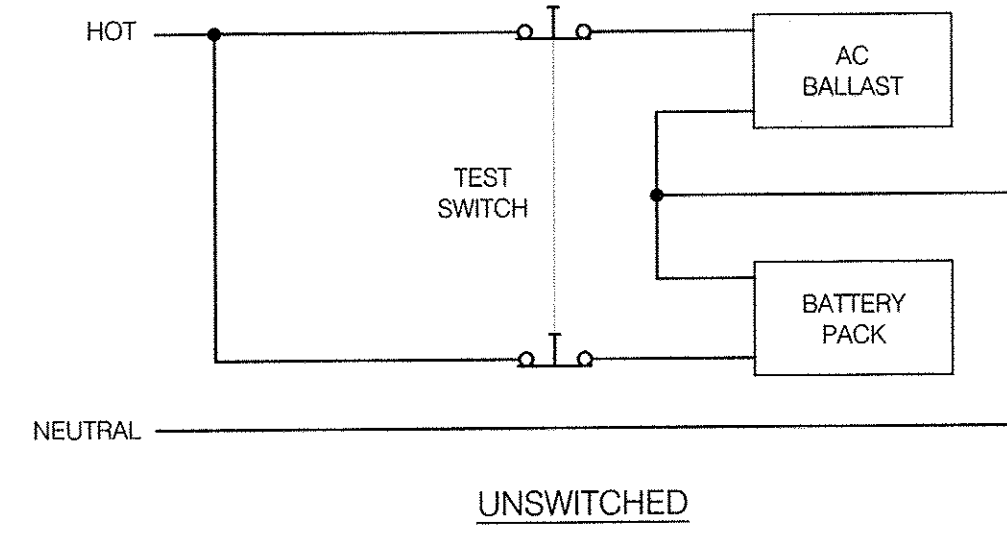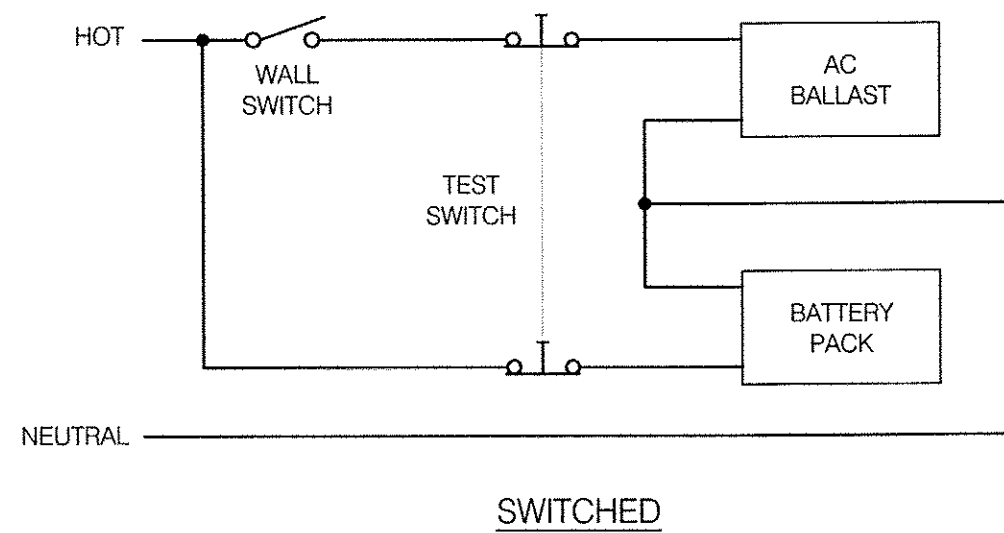


TYPICAL EMERGENCY BATTERY PACK DETAIL N.T.S. **10**

NOT USED N.T.S. **18**

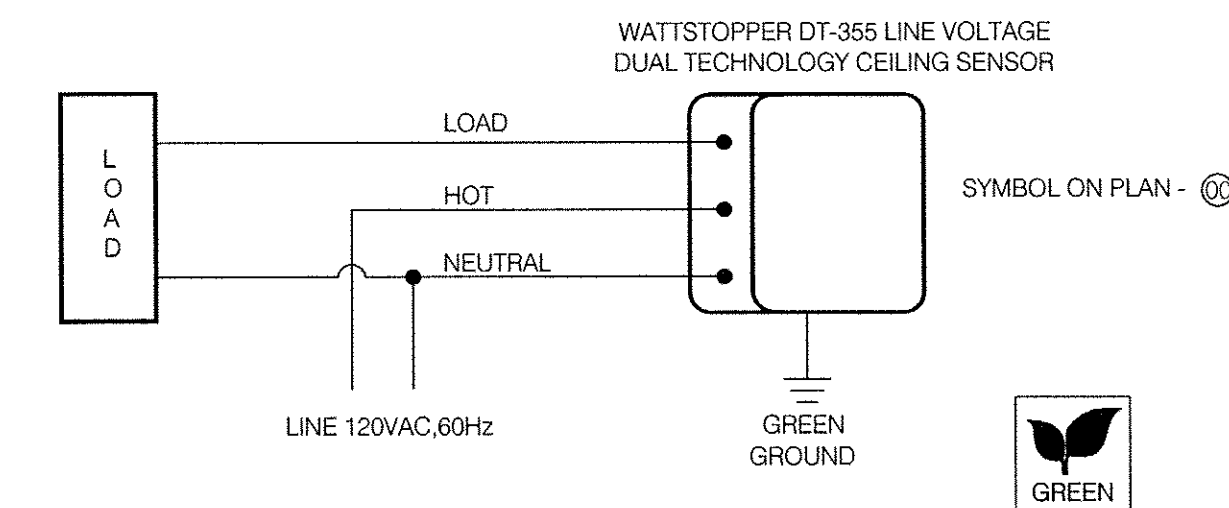


CEILING OCCUPANCY SENSOR WIRING DIAGRAM N.T.S. **2**

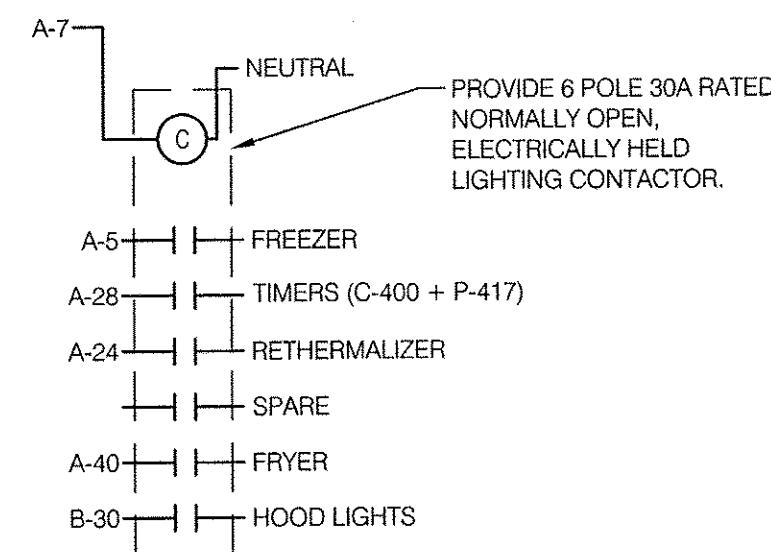

SEQUENCE OF OPERATION:
UPON ACTIVATION OF ANY HOOD FIRE SUPPRESSION SYSTEM RELAY, A RELAY IN THAT FIRE SUPPRESSION SYSTEM SHALL CAUSE THIS RELAY TO DEENERGIZE, THUS REMOVING POWER FROM ALL DEVICES CONNECTED TO EQUIPMENT LOCATED UNDER THE GREASE HOOD. EXHAUST FANS SHALL NOT BE AFFECTED BY THIS ACTION AND SHALL CONTINUE TO BE CONTROLLED AS INDICATED IN THE SEQUENCE OF OPERATIONS INDICATED IN DETAIL 2/E6.0.

SHUNT TRIP DETAIL N.T.S. **11**

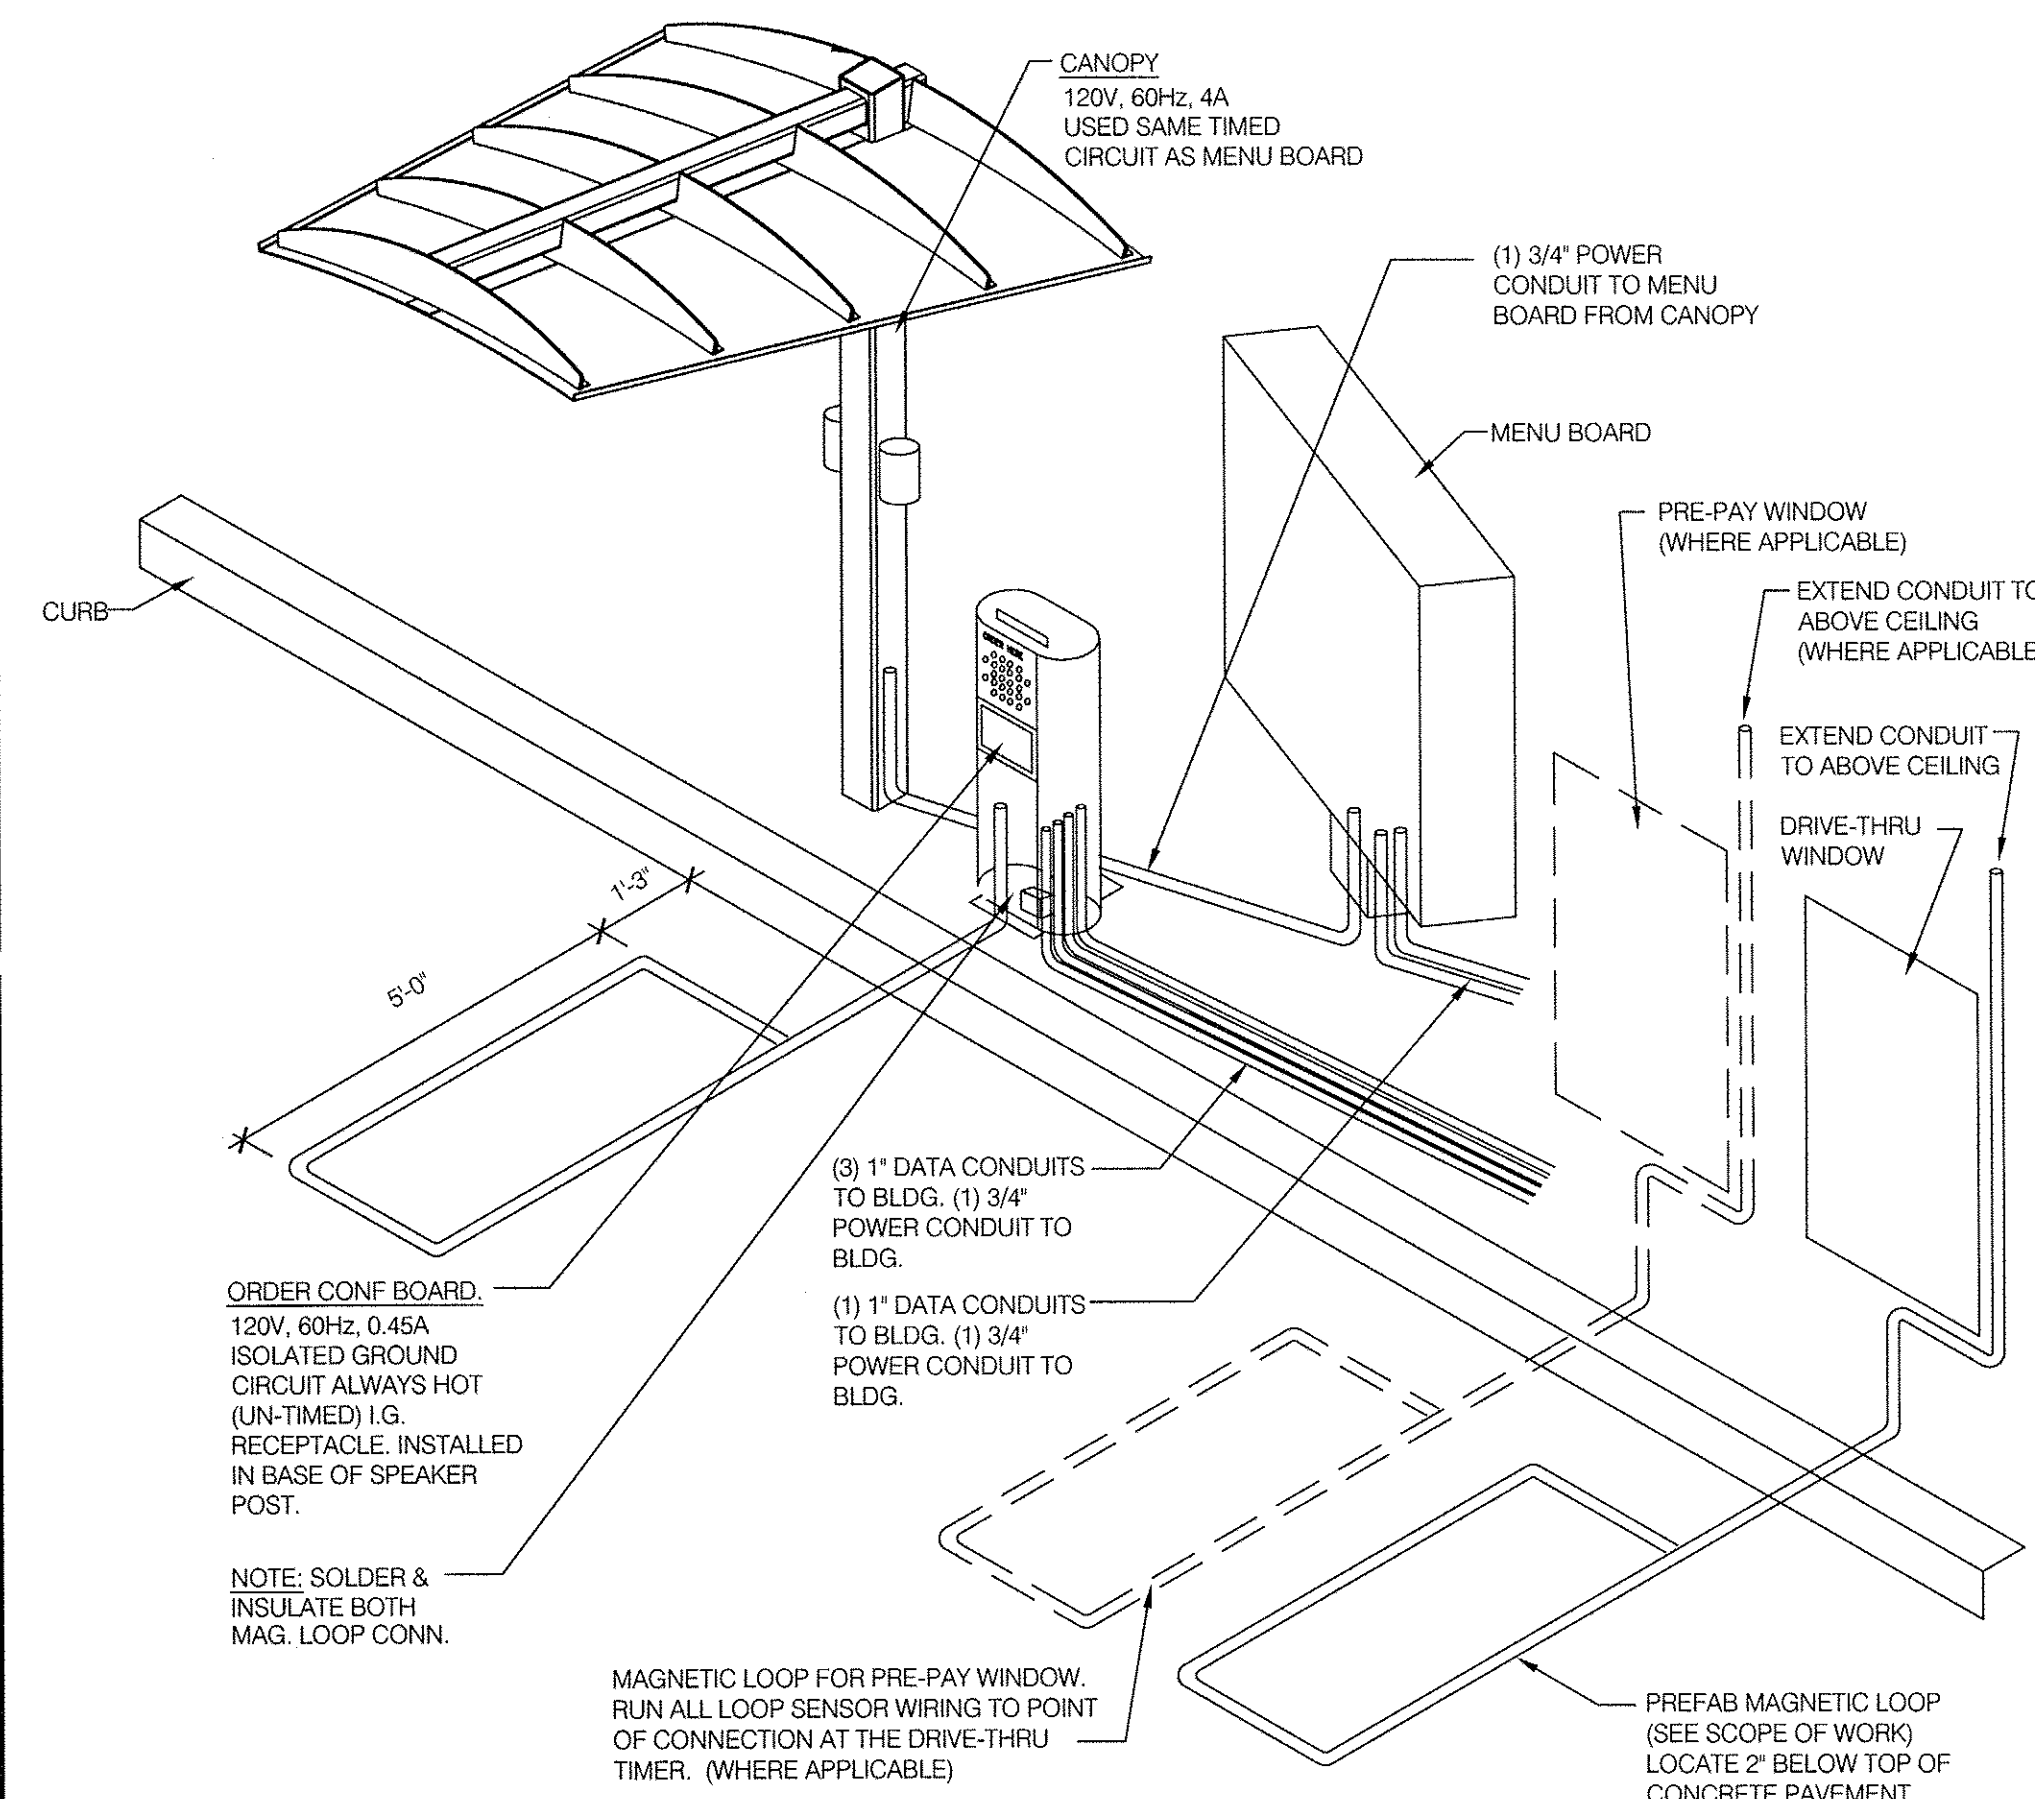

ORDER CONF BOARD.
120V, 60Hz, 0.45A
ISOLATED GROUND
CIRCUIT ALWAYS HOT
(UN-TIMED) I.G.
RECEPTACLE, INSTALLED
IN BASE OF SPEAKER
POST.

NOTE: SOLDER &
INSULATE BOTH
MAG. LOOP CONN.

MAGNETIC LOOP FOR PRE-PAY WINDOW.
RUN ALL LOOP SENSOR WIRING TO POINT
OF CONNECTION AT THE DRIVE-THRU
TIMER. (WHERE APPLICABLE)

PREFAB MAGNETIC LOOP
(SEE SCOPE OF WORK)
LOCATE 2\"/>


DRIVE-THRU COMMUNICATIONS ISOMETRIC N.T.S. **4**

NOT USED N.T.S. **20**

NOT USED N.T.S. **16**



NOT USED N.T.S. **12**

NOT USED N.T.S. **1**

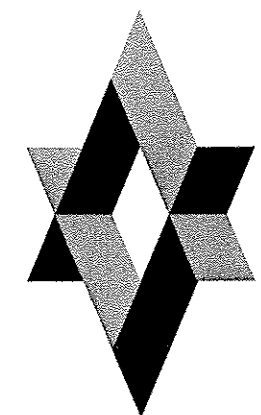

MARK D. MCCLUGGAGE AIA, CCS
1525 E. LINDSEY BLVD. SUITE 108 02111
PORTLAND, ME 04106
Tel: (310) 265-5687
Fax: (310) 265-5686
www.dmv.com
MAINE Lic. # PRC-2023

DEVITA
ATLANTA • GREENVILLE • RICHMOND
877.4.DEVITA • corp@devitainc.com
Devita & Associates, Inc. Project : 16002-30
Drawn By: RPB Checked By: RAG

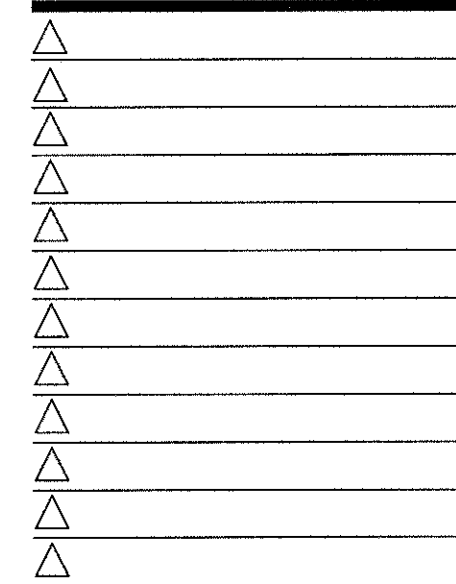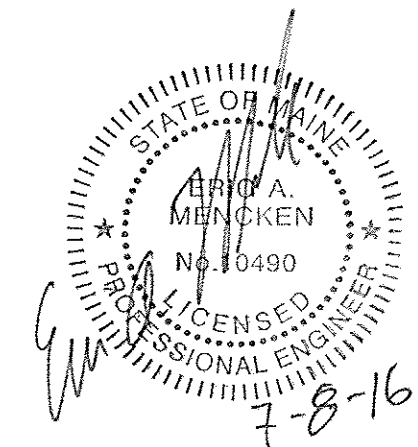

CONTRACT DATE: 07.06.2016
BUILDING TYPE: CONVERSION
PLAN VERSION: FEBRUARY 2015
SITE NUMBER: XXX-XXX
STORE NUMBER: XXXXX

TACO BELL
1363 WASHINGTON AVE.
PORTLAND, ME



**ELECTRICAL
DETAILS
E7.0**

PLOT DATE:

YES006A