




EASTERN FIRE PROTECTION

FIRE PROTECTION CONTRACTORS AND DESIGNERS

February 6, 2007

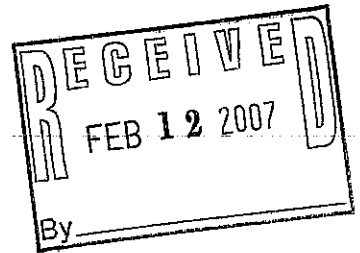

Peter Haber
Project Manager
Wright-Ryan Construction, Inc.
10 Danforth Street
Portland, ME 04101

RE: L.L. Bean Call Center
Portland, Maine
Fire Sprinkler Renovation

Dear Peter,

In reference to the L.L. Bean Call Center Project in Portland, Maine. The fire sprinkler renovation scope of work consisted of relocating and installing new sprinkler heads to accommodate the new floor plan. The existing lines, mains, control valves and alarm devices remained as is. All work was performed in compliance with N.F.P.A. #13, State and local codes.

The system is currently activated with sprinkler protection installed in all rooms and spaces that were part of this project.

Please note that activation and deactivation of the sprinkler system was performed by L.L. Bean Maintenance and security personnel.

If you have any questions or require any further information concerning this project, feel free to contact me.

Sincerely,

Will Flynt
Design Manager

EMI

P.O. Box 6807
Scarborough, ME 04070
Office: (207) 883-9595 ♦ Fax: (207) 883-9585

**ELECTRICAL
MAINTENANCE and
INSTALLATION**

Fax

To: Peter Haber**From:** Steve Stewart**Fax:** 773-5173**Date:** February 12, 2007**Phone:** 773-3625**Pages:** 4 Including cover**Re:** LL Bean Northport**CC:**

☐ **Urgent** ☒ **For Review** ☐ **Please Comment** ☐ **Please Reply** ☐ **Please Recycle**

Message:

Pete,

Here's the LL Bean Fire Alarm test report. If you need anything else please let me know.

Steve

Feb 12 07 08:40a

Cel

BBE

DIVISION, FL TO REORDER THIS FORM
PLEASE CALL (407) 322-8248

102

p.1

Fire Alarm System
Record of Completion

Name of protected property: LL Bean North Port Plaza
Address: Washington Ave Portland, Maine
Rep. of protected property (name/phone): _____
Authority having jurisdiction: _____
Address/telephone number: _____

Installer

Supplier

Service organization

Location of record (as-built) drawings

Location of owners manuals:

Location of test reports:

A contract, dated _____, for test and inspection in accordance with NFPA standard(s)
Contract No(s): _____ Effective date: _____ Expiration date: _____

System Software

(a) Operating System Software Revision Level(s): _____

(b) Application Software Revision Level(s): _____

(c) Revision Completed by: _____

(name)

(firm)

1. Type(s) of System or Service

____ NFPA 72, Chapter 6 - Local

If alarm is transmitted to location(s) off premises, list where received: _____

____ NFPA 72, Chapter 8 Remote Station

Telephone numbers of the organization receiving alarm:

Alarm: _____

Supervisory: _____

Trouble: _____

If alarms are retransmitted to public fire service communications center or others, indicate location and telephone number of the organization receiving alarm: _____

____ NFPA 72, Chapter 8 Proprietary

Telephone numbers of the organization receiving alarm:

Alarm: _____

Supervisory: _____

Trouble: _____

If alarms are retransmitted to public fire service communications center or others, indicate location and telephone number of the organization receiving alarm: _____

Indicate how alarm is retransmitted: _____

Installed 3-wheelock Audio/Visuals (only)
in New Conference Rooms

____ NFPA 72, Chapter 6 Central Station

Prime contractor: _____

Central station location;

Means of transmission of signals from the protected premises to the central station:

____ McCutlan

_____ Multiplex

_____ One-way radio

_____. Digital alarm communicator.

_____ Two-way radio

____ Others

Means of transmission of alarms to the public fire service communications center:

(a)

{b}

System Location:

_____ NFPA 72, Chapter 9 - Auxiliary

Indicate type of connection: ☐ Local energy ☐ Shunt ☐ Parallel telephone

Location of telephone number for receipt of signals:

2. Record of System Installation

(Fill out after installation is complete and wiring checked for opens, shorts, ground faults, and improper branching, but prior conducting operational acceptance tests.)

This system has been installed in accordance with the NFPA standards as shown below, was inspected by _____ on _____, includes the devices shown in 5 and 6; and has been in service since _____.

____ NFPA 72, Chapters 1 2 3 4 5 6 7 8 9 10 11 (circle all that apply)

____ NFPA 70, *National Electrical Code*, Article 760

____ Manufacturer's instructions

____ Other (specify):

Signed: _____

Date:

Organization:

3. Record of System Operation

Documentation in accordance with Inspection Testing Form, Figure 10.6.2.3, is attached.

All operational features and functions of this system were tested by LL Bean Security + Electrical Maintenance on 2/10/06, and found to be operating properly in accordance with the requirements of NEPA 72, Chapter 2, Part 2.2.2.

____ NFPA 72, Chapters 1 2 3 4 5 6 7 8 9 10 11 (circle all that apply)

____ NFPA 70, *National Electrical Code*, Article 760

____ Manufacturer's Instructions

____ Other (specify):

Signed:

Date:

Organization:

4. Signalling Line Circuits

Quantity and class of signaling line circuits connected to system (see NFPA 72, Table 6.6.1):

Quantity:

Style:

Class:

Feb 12 07 08:40a

Cel

102

p. 4

BBF

CHARGE FL. TO RECORD THIS FORM
PLEASE CALL (407) 322-7488

3-A/V only

7. Annunciator(s)

Number: _____ Type: _____ Location: _____

8. Alarm Notification Appliances and Circuits

NFPA 72, Chapter 6 - Emergency Voice/Alarm Service

Quantity of voice/alarm channels: _____ Single: _____ Multiple: _____

Quantity of speakers installed: _____ Quantity of speaker zones: _____

Quantity of telephones or telephone jacks included in system: _____

Quantity and class of notification appliance circuits connected to system (see NFPA 72, Table 6.7)

Quantity: _____ Style: _____ Class: _____

Types and quantities of notification appliances installed:

(a) Bells _____ With Visible _____

(b) Speakers _____ With Visible _____

(c) Horns 3 With Visible 3

(d) Chimes _____ With Visible _____

(e) Other: _____ With Visible _____

(f) Visual appliance without audible: _____

9. System Power Supplies

(a) Fire Alarm Control Unit: Nominal voltage: _____ Current rating: _____

Overcurrent protection: Type: _____ Current rating: _____ Location: _____

(b) Secondary (standby):

Storage battery: _____ Amp-hour rating _____

Calculated capacity to drive system, in hours: _____

Engine-driven generator dedicated to fire alarm system: _____

Location of fuel storage: _____

(c) Emergency system used as backup to primary power supply: _____

Emergency system described in NFPA 70, Article 700: _____

10. Comments:

Frequency of routine tests and inspections, if other than in accordance with the referenced NFPA Standard(s): _____

System deviations from the referenced NFPA standard(s) are: _____

(signed) for installation contractor/supplier

[Signature] Electrical Maintenance Installation (title) (date)

(signed) for alarm service company

LL Bon Security Department (title) (date)

(signed) for central station

Upon completion of the system(s) satisfactory test(s) witnessed (if required by the Authority Having Jurisdiction).

(signed) Representative of the Authority Having Jurisdiction (title) (date)

Reprinted with permission from NFPA 72, National Fire Alarm Code, Copyright © 2002, National Fire Protection Association, Quincy, MA 02269. This reprinted material is not the complete and official position of the NFPA on the referenced subject which is represented only by the standard in its entirety.

Distributed by:

AFAA - P.O. Box 951807
Fax—(407) 322-7488Lake Mary, FL 32795-1807 Phone—(407) 322-6288
Web—www.afaa.org e-mail: fire-alarm@afaa.org

Page 4 of 4