

HVAC GENERAL NOTES

- GENERAL NOTES APPLY TO ALL DRAWINGS.
- THIS PROJECT INVOLVES CONSTRUCTION INSIDE AN EXISTING STRUCTURE. CONTRACTORS, BY SUBMITTING A BID, ARE DEEMED TO BE COMPLETELY FAMILIAR WITH THE EXISTING CONDITION OF THE BUILDING AS IT INFLUENCES THE WORK DESCRIBED. ABSOLUTELY NO CLAIMS FOR EXTRA COMPENSATION WILL BE CONSIDERED FOR EXISTING CONDITIONS VISIBLE OR REASONABLY INFERRABLE FROM A CAREFUL EXAMINATION OF THE EXISTING BUILDING.
- THIS CONTRACTOR SHALL INSPECT THE EXISTING FIELD CONDITIONS AT THE SITE AND THE "AS-BUILT" BASE BUILDING CONTRACT DOCUMENTS PRIOR TO THE START OF ANY WORK TO DETERMINE WHAT EFFECT THE EXISTING CONDITIONS WILL HAVE ON HIS WORK. POTENTIAL PROBLEM AREAS SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT AND/OR ENGINEER IMMEDIATELY.
- THIS CONTRACTOR SHALL CONNECT HIS WORK TO VARIOUS EXISTING PIPING, DUCTWORK, AND CONTROL SYSTEMS IN THE BASE BUILDING. THE NEW WORK SHALL BE COMPATIBLE WITH THE EXISTING SYSTEMS. LOCATION OF EQUIPMENT OR THE ROUTING OF THE VARIOUS SYSTEMS AS WELL AS OPENINGS IN FLOOR SLABS OR WALLS SHALL BE GOVERNED BY THE EXISTING CONDITIONS AS THEY APPEAR IN THE FIELD OR ON THE "AS-BUILT" DRAWINGS.
- CARE SHALL BE TAKEN DURING THE INSTALLATION TO NOT DAMAGE OR INTERRUPT BUILDING SYSTEMS AND SERVICES THAT ARE ALREADY INSTALLED. DAMAGE TO SUCH SYSTEMS OR EQUIPMENT CAUSED BY THIS CONTRACTOR DURING INSTALLATION SHALL BE REPAIRED AND/OR REPLACED AT THIS CONTRACTOR'S EXPENSE TO THE COMPLETE SATISFACTION OF THE BUILDING OWNER.
- SHUTDOWN OF EXISTING SYSTEMS FOR CONNECTION TO EXISTING SERVICES SHALL BE COORDINATED WITH THE CONSTRUCTION MANAGER OR GENERAL CONTRACTOR AND BUILDING OWNER. THIS CONTRACTOR SHALL SUBMIT REQUESTS, WHERE THEY AFFECT THE OPERATION OF THE BUILDING SYSTEMS, AT LEAST ONE WEEK IN ADVANCE OF ANY REQUIRED SHUTDOWN. THE ACTUAL SHUTDOWN PERIOD SHALL BE AS SHORT AS POSSIBLE AND AT A TIME MUTUALLY AGREEABLE TO THE BUILDING OWNER AND THE CONSTRUCTION MANAGER/GENERAL CONTRACTOR.
- DRAWINGS ARE DIAGRAMMATIC, THEREFORE DETERMINE EXACT LOCATIONS OF SYSTEMS AND COMPONENTS IN FIELD.
- ALL WORK SHALL BE COORDINATED WITH ALL TRADES INVOLVED. OFFSETS IN PIPING AND DUCTS (INCLUDING DIVIDED DUCTS) AND TRANSITIONS AROUND OBSTRUCTIONS SHALL BE PROVIDED AT NO ADDITIONAL COST TO THE OWNER.
- VERIFY ALL EQUIPMENT CONNECTIONS WITH MANUFACTURER'S CERTIFIED DRAWINGS. VERIFY AND PROVIDE DUCT AND/OR PIPE TRANSITIONS TO FURNISHED EQUIPMENT. FIELD VERIFY AND COORDINATE ALL DIMENSIONS BEFORE FABRICATION.
- REFER TO ARCHITECTURAL REFLECTED CEILING PLANS FOR EXACT LOCATIONS OF AIR TERMINAL DEVICES.
- ALL MATERIALS AND EQUIPMENT UNLESS SPECIFICALLY INDICATED AS REUSED, SHALL BE NEW.
- DUCTWORK SHALL NOT RUN ALONG FULL HEIGHT PARTITIONS.
- ACCESS PANELS SHALL BE PROVIDED TO ALLOW FOR CLEANING OF COILS AND SERVICING OF DAMPERS, HEATERS, VALVES, AND ALL CONCEALED MECHANICAL EQUIPMENT.
- THE INSIDE OF ALL DUCTWORK VISIBLE THROUGH A GRILLE OR DIFFUSER SHALL BE PAINTED FLAT BLACK.
- EXISTING ROOM THERMOSTATS AND SENSORS SHALL BE PROTECTED DURING CONSTRUCTION AND RELOCATED AS INDICATED ON THE DRAWINGS. INSTALL NEW AND RELOCATED ROOM THERMOSTATS AND SENSORS 4 FEET AFF OR AS DIRECTED OTHERWISE BY ARCHITECT.
- WHEN SECTION OF DUCTWORK IS NOT LABELED FOR SIZE, THE LARGER SIZE INDICATED ON THE CONNECTED DUCT SHALL PREVAIL. SIZE OF DUCT RUN-OUTS TO DIFFUSER SHALL EQUAL DIFFUSER NECK SIZE.
- CONTRACTOR SHALL PROVIDE THE FOLLOWING SERVICES ON ALL EXISTING HVAC EQUIPMENT INDICATED TO BE REUSED: 1) FILTER CHANGES, 2) BALANCING, 3) LUBRICATION. CONTRACTOR SHALL REPORT ANY EQUIPMENT DEFICIENCIES FOUND TO THE ARCHITECT AND/OR ENGINEER.
- THE FIRE PROOFING OF THE BUILDING STRUCTURE IS NOT TO BE REMOVED FOR THE INSTALLATION OF HANGERS, SUPPORTS, DUCTWORK, ETC. IF FIRE PROOFING IS DAMAGED, IT SHALL BE REPAIRED AT THE EXPENSE OF THE TRADE.
- CONTRACTOR SHALL TEST AND CALIBRATE ALL CONTROLS AND VERIFY ALL ARE FULLY FUNCTIONAL AND SUBMIT DOCUMENTATION. SEE SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.
- CONTRACTOR SHALL PROVIDE AND SUBMIT DOCUMENTATION FOR TESTING AND BALANCING OF ALL AIR AND WATER SYSTEMS, DUCT AND PIPING PRESSURE AND LEAKAGE TESTS, OPERATING AND MAINTENANCE MANUALS, AND AS BUILT DRAWINGS. SEE SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.

HVAC SPECIFICATIONS

PART 1 - GENERAL

- GENERAL PROVISIONS: DRAWINGS ARE DIAGRAMMATIC AND INDICATE GENERAL ARRANGEMENT OF WORK IN CONTRACT.
- SCOPE: PERFORM WORK AND PROVIDE NEW MATERIAL AND EQUIPMENT AS SHOWN ON DRAWINGS AND AS SPECIFIED IN THIS SECTION OF THE SPECIFICATIONS. PROVIDE ALL COMPONENTS AND MATERIALS, WHETHER SPECIFICALLY SHOWN OR NOT, THAT ARE NECESSARY TO MAKE THE SYSTEM COMPLETE AND FULLY OPERATIONAL AS INTENDED IN THE CONSTRUCTION DOCUMENTS. WORK SHALL INCLUDE BUT NOT BE LIMITED TO: 1) THE DESIGN INTENT AS ILLUSTRATED ON THESE DRAWINGS AND 2) ALL TESTING AND CERTIFICATIONS NECESSARY FOR COMPLIANCE INCLUDING ANY REQUIRED REMEDIAL ACTIONS AND RETESTING DUE TO FAILURE.
- SITE VISIT: VISIT AND CAREFULLY EXAMINE SITE TO IDENTIFY EXISTING CONDITIONS THAT MAY AFFECT WORK OF THIS SECTION BEFORE SUBMITTING BID. NO EXTRA PAYMENT WILL BE ALLOWED FOR ADDITIONAL WORK CAUSED BY UNFAMILIARITY WITH SITE CONDITIONS THAT ARE VISIBLE OR READILY DISCOVERED BY AN EXPERIENCED OBSERVER.
- RELATED WORK: THE FOLLOWING WORK IS NOT INCLUDED IN THIS SECTION AND WILL BE PROVIDED UNDER OTHER SECTIONS: 1) TEMPORARY HEAT FOR USE DURING CONSTRUCTION AND TESTING UNLESS SPECIFICALLY NOTED IN OTHER SPECIFICATION SECTIONS, 2) PAINTING, EXCEPT AS SPECIFIED, 3) ELECTRICAL POWER WIRING TO ALL EQUIPMENT OTHER THAN AUTOMATIC TEMPERATURE CONTROL PANELS AND COMPONENTS, AND 4) DUCT MOUNTED SMOKE DETECTORS SHALL BE FURNISHED BY OTHERS FOR MOUNTING AND WIRING TO THE ATC SYSTEM UNDER THIS SECTION.
- CODES, STANDARDS, AUTHORITIES AND PERMITS: CODES, LAWS AND ORDINANCES PROVIDE A BASIS FOR THE MINIMUM INSTALLATION CRITERIA. THESE DRAWINGS AND SPECIFICATIONS ILLUSTRATE THE SCOPE REQUIRED FOR THIS PROJECT, WHICH MAY EXCEED MINIMUM CODE, LAW AND STANDARDS CRITERIA. GIVE NOTICES, FILE PLANS, OBTAIN PERMITS AND LICENSES, PAY FEES AND BACKCHARGES AND OBTAIN NECESSARY APPROVALS FROM AUTHORITIES HAVING JURISDICTION AS REQUIRED FOR THE EXECUTION OF ALL WORK ASSOCIATED WITH THIS PROJECT. ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE LATEST EDITIONS OF: 1) THE STATE BUILDING, ELECTRICAL, MECHANICAL, AND ENERGY CODES, 2) SMACNA, NFPA, ANSI/ASHRAE, ASME, UL AND NEMA STANDARDS, 3) ALL OTHER APPLICABLE CODES, REGULATIONS, STANDARDS AND LAWS OF LOCAL, STATE AND FEDERAL GOVERNMENT AND OTHER AUTHORITIES HAVING JURISDICTION, AND 4) APPLICABLE BASE BUILDING STANDARDS AND SPECIFICATIONS.
- INTERPRETATIONS OF DOCUMENTS: WHERE DRAWINGS OR SPECIFICATIONS DO NOT COINCIDE WITH MANUFACTURER'S RECOMMENDATIONS, OR ARE UNCLEAR AS TO INTENT, OR REQUIRED MATERIAL QUALITY, ADVISE THE ENGINEER IN WRITING BEFORE PROCEEDING WITH THE WORK. ALL COST FOR REWORK NECESSARY TO RESOLVE DISCREPANCIES SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR.
- REQUESTS FOR INFORMATION: ANY RFI FOR RESOLVING AN APPARENT CONFLICT OR UNCLARITY, OR A REQUEST FOR ADDITIONAL DETAIL, SHALL INCLUDE A SKETCH OR EQUIVALENT DESCRIPTION OF CONTRACTOR'S PROPOSED SOLUTION.
- SUBMITTALS: PROVIDE SPECIFIED ITEMS AND EQUIPMENT UNLESS "EQUAL" OR "APPROVED EQUAL" IS EXPLICITLY INDICATED ON THE DRAWINGS. DEVIATIONS TO SPECIFIED ITEMS SHALL BE AT THE SOLE RISK OF THE CONTRACTOR, WHO SHALL BE RESPONSIBLE FOR ALL ASSOCIATED CHANGES TO THIS AND OTHER TRADES. REVIEW OF THE SHOP DRAWINGS BY THE ENGINEER SHALL NOT ABSOLVE THE CONTRACTOR FROM MEETING THE FULL DESIGN INTENT OF THE ASSOCIATED SYSTEM(S). SUBMITTALS SHALL INDICATE PRIOR REVIEW AND APPROVAL BY THE RESPONSIBLE CONTRACTOR. SUBMIT FOR REVIEW (6) SETS OF MANUFACTURER'S PRODUCT DATA FOR THE FOLLOWING ITEMS: 1) AIR DISTRIBUTION LAYOUT DRAWINGS AND DETAILS, 2) PIPING DISTRIBUTION LAYOUT DRAWINGS, COMPONENTS, AND DETAILS, 3) ALL EQUIPMENT, 4) CONTROL SCHEMATICS, COMPONENTS, AND SEQUENCES, INCLUDING TIE-IN TO THE EXISTING BUILDING CONTROL OR MANAGEMENT SYSTEM, 5) BALANCING REPORTS, 6) ALL TEST REPORTS, AND 7) ALL CERTIFICATES. ALLOW ENGINEER A MINIMUM OF 10 WORKING DAYS FOR PROCESSING AND REVIEW OF EACH SUBMISSION.
- OPERATION AND MAINTENANCE DATA: SUBMIT (3) SETS OF OPERATING AND MAINTENANCE MANUALS PRIOR TO THE COMPLETION OF THE PROJECT. PROVIDE ON-SITE DEMONSTRATION OF ALL SYSTEMS TO OWNER AFTER SYSTEMS ARE FULLY OPERATIONAL. O&M MANUALS SHALL INCLUDE ALL COMPONENTS (DIFFUSERS, VALVES, ETC.) AS WELL AS SYSTEM DESCRIPTIONS OF ALL SYSTEMS WITH FLOW DIAGRAMS, WIRING DIAGRAMS, WRITTEN WARRANTIES, RECOMMENDED SPARE PARTS AND ROUTINE MAINTENANCE REQUIREMENTS WITH RECOMMENDED INTERVALS FOR ALL MOVING EQUIPMENT AND CONTROLS.
- RECORD DRAWINGS: CAD RECORD DRAWING FILES SHALL BE SUBMITTED AT THE COMPLETION OF THE PROJECT SHOWING THE "AS-BUILT" CONDITION INCLUDING WORK INSTALLED AND ALL MODIFICATIONS OR ADDITIONS TO ORIGINAL DESIGN. OBTAIN THE AUTOCAD FILES FOR PREPARATION OF AS-BUILT DRAWINGS FROM THE ARCHITECT. THE ARCHITECT AND ENGINEER ARE NOT GRANTING ANY OWNERSHIP OR PROPERTY INTEREST IN THE CAD DRAWINGS BY THE DELIVERY OF THE CAD FILES. THE USE OF THE CAD FILES AND DRAWINGS ARE LIMITED FOR THE SOLE PURPOSE OF ASSISTING IN THE CONTRACTOR'S PERFORMANCE IN ITS CONTRACTUAL OBLIGATIONS WITH RESPECT TO THIS PROJECT. ANY REUSE AND/OR OTHER USE BY THE CONTRACTOR WILL BE AT THE CONTRACTOR'S SOLE RISK AND WITHOUT LIABILITY TO THE ARCHITECT AND ENGINEER.
- WARRANTIES: WARRANTY INSTALLATION IN WRITING FOR ONE YEAR FROM DATE OF OWNER'S ACCEPTANCE OF CERTIFICATE OF SUBSTANTIAL COMPLETION, WHERE INDIVIDUAL EQUIPMENT SECTIONS SPECIFY LONGER WARRANTIES, PROVIDE THE LONGER WARRANTY. REPAIR, REPLACE OR PROVIDE TEMPORARY ACCOMMODATIONS FOR DEFECTIVE MATERIALS, EQUIPMENT, WORKMANSHIP AND INSTALLATION THAT DEVELOP WITHIN 24 HOURS OF NOTIFICATION. WARRANTY SHALL INCLUDE A CONTACT PERSON (NAME AND 24 HOUR TELEPHONE NUMBER) FOR SERVICE REQUESTS. CORRECT DAMAGE CAUSED WHILE MAKING NECESSARY REPAIRS AND REPLACEMENTS UNDER WARRANTY PERIOD AT NO ADDITIONAL COST.
- COORDINATION: CONFER WITH ALL OTHER TRADES RELATIVE TO LOCATION OF ALL APPARATUS AND EQUIPMENT TO BE INSTALLED AND SELECT LOCATIONS SO AS NOT TO CONFLICT WITH OR HINDER THE PROGRESS OF THE WORK OF OTHER SECTIONS. WORK INSTALLED THAT CREATES INTERFERENCE OR RESTRICTS ACCESS REQUIRED BY CODE (INCLUDING CLEARANCES TO ELECTRICAL COMPONENTS) OR TO CONDUCT MAINTENANCE AND/OR ADJUSTMENTS SHALL BE MODIFIED AT NO ADDITIONAL COST TO THE OWNER.
- SUPPORTS: INCLUDE ALL STRUCTURAL STEEL SUPPORTS, HANGER BRACKETS, ETC., REQUIRED FOR THE EXECUTION OF THE WORK OF THIS SECTION. THE WELDS AND EDGES OF ALL BRACKETS SHALL BE FILED OR GRIND SMOOTH FOR PAINTING. HANGERS SHALL BE STEEL ANGLE IRON, CHANNEL OR STEEL ROD USED WITH APPROVED CLAMPS, INSERTS, ETC. ALL HANGERS SHALL BE GALVANIZED OR PAINTED WITH TWO COATS OF RUSTOLEUM PAINT BEFORE INSTALLATION. APPLY TOUCH-UP PAINT (ZINC GALVANIZING FOR GALVANIZED STEEL) AFTER INSTALLATION. SUPPORTS INSTALLED IN EXTERIOR LOCATIONS SHALL BE PVC COATED STEEL, GALVANIZED STEEL, OR STAINLESS STEEL WITH STAINLESS STEEL HARDWARE.

- CUTTING AND PATCHING: INCLUDE ALL CORING, CUTTING, PATCHING AND FIREPROOFING NECESSARY FOR THE EXECUTION OF THE WORK OF THIS SECTION. STRUCTURAL ELEMENTS SHALL NOT BE CUT WITHOUT WRITTEN APPROVAL OF THE ARCHITECT. REPAIR AND PATCH AROUND THE WORK SPECIFIED HEREIN TO MATCH THE EXISTING ADJACENT SURFACES TO THE SATISFACTION OF THE ARCHITECT. FILL AND PATCH ALL OPENINGS OR HOLES LEFT IN THE EXISTING STRUCTURES BY THE REMOVAL OF EXISTING EQUIPMENT THAT IS PART OF THIS SECTION OF THE SPECIFICATIONS. PATCH AND SEAL ALL EXISTING OPENINGS IN DUCTWORK AND PIPING NOT UTILIZED FOR NEW LAYOUT. PROVIDE FIRE STOPPING TO MAINTAIN THE FIRE RATING OF THE FIRE RESISTANCE-RATED ASSEMBLY. ALL PENETRATIONS AND ASSOCIATED FIRE STOPPING SHALL BE INSTALLED IN ACCORDANCE WITH THE FIRE STOPPING MANUFACTURER'S LISTED INSTALLATION DETAILS AND BE LISTED BY UL OR FM.
- HOISTING, SCAFFOLDING AND PLANKING: INCLUDE THE FURNISHING, SET-UP AND MAINTENANCE OF ALL HOISTING MACHINERY, CRANES, SCAFFOLDS, STAGING AND PLANKING AS REQUIRED FOR THE EXECUTION OF WORK FOR THIS SECTION.
- SAFETY PRECAUTIONS: LIFE SAFETY AND ACCIDENT PREVENTION SHALL BE A PRIMARY CONSIDERATION, COMPLY WITH ALL OF THE SAFETY REQUIREMENTS OF THE OWNER AND OSHA THROUGHOUT THE ENTIRE CONSTRUCTION PERIOD OF THE PROJECT. FURNISH, PLACE AND MAINTAIN PROPER GUARDS AND ANY OTHER NECESSARY CONSTRUCTION REQUIRED TO SECURE SAFETY OF LIFE AND PROPERTY.
- ACCESSIBILITY: ALL WORK PROVIDED UNDER THIS SECTION OF THE SPECIFICATION SHALL BE INSTALLED SO THAT PARTS REQUIRING PERIODIC INSPECTION, MAINTENANCE AND REPAIR ARE READILY ACCESSIBLE. WORK OF THIS TRADE SHALL NOT INFRINGE UPON CLEARANCES REQUIRED BY EQUIPMENT OF OTHER TRADES.
- PROTECTION OF WORK AND PROPERTY: THIS CONTRACTOR SHALL BE RESPONSIBLE FOR THE CARE AND PROTECTION OF ALL WORK INCLUDED UNDER THIS SECTION UNTIL THE COMPLETION AND FINAL ACCEPTANCE OF THIS PROJECT. PROTECT ALL EQUIPMENT AND MATERIALS FROM DAMAGE FROM ALL CAUSES INCLUDING, BUT NOT LIMITED TO, FIRE, VANDALISM AND THEFT. ALL MATERIALS AND EQUIPMENT DAMAGED OR STOLEN SHALL BE REPAIRED OR REPLACED WITH EQUAL MATERIAL OR EQUIPMENT AT NO ADDITIONAL COST TO THE OWNER. PROTECT ALL EQUIPMENT, OUTLETS AND OPENINGS, AND ROOF PENETRATIONS WITH TEMPORARY PLUGS, CAPS AND COVERS. PROTECT WORK AND MATERIALS OF OTHER TRADES FROM DAMAGE THAT MIGHT BE CAUSED BY WORK OR WORKMEN UNDER THIS SECTION AND MAKE GOOD DAMAGE THUS CAUSED. DAMAGED MATERIALS ARE TO BE REMOVED FROM THE SITE, NO SITE STORAGE OF DAMAGED MATERIALS WILL BE ALLOWED. ANY DAMAGE TO EXISTING SYSTEMS AND EQUIPMENT CAUSED BY THIS CONTRACTOR DURING INSTALLATION SHALL BE REPAIRED AND/OR REPLACED AT THIS CONTRACTOR'S EXPENSE TO THE COMPLETE SATISFACTION OF THE BUILDING OWNER.
- PROJECT CLOSEOUT: A CERTIFICATE OF COMPLETION SHALL BE ISSUED BY THE CONTRACTOR INDICATING THAT THE INSTALLATION IS IN CONFORMANCE WITH THE CONSTRUCTION DOCUMENTS AND ALL APPLICABLE LOCAL, STATE AND FEDERAL STATUTES AND CODES. ALL SUBMITTALS, AS-BUILTS, O&M MANUALS, AND BALANCING REPORTS ARE TO BE PROVIDED, FOR ENGINEER'S REVIEW, PRIOR TO REQUEST FOR COMPLETION CERTIFICATES. IN ADDITION, AND ALSO PRIOR TO REQUEST FOR COMPLETION CERTIFICATES, ALL PUNCH LIST ITEMS MUST BE COMPLETED TO THE SATISFACTION OF THE ENGINEER. THE CONTRACTOR MUST VERIFY THAT ALL SEQUENCES OF OPERATIONS AND CONTROLS HAVE BEEN INCORPORATED AND ALL SYSTEMS AND EQUIPMENT ARE WORKING PER THE SPECIFIED SEQUENCES OF OPERATIONS. A BLANK CONTRACTOR'S CERTIFICATE FORM CAN BE FURNISHED BY RDK ENGINEERS UPON REQUEST. FINAL INSPECTION BY THE ENGINEER SHALL BE CONDUCTED AFTER RECEIPT OF THE CERTIFICATE OF COMPLETION. PREMATURITY REQUESTS FOR FINAL INSPECTIONS THAT REQUIRE REINSPECTION OF DEFICIENT ITEMS WILL RESULT IN BACK CHARGES OF THE COSTS ASSOCIATED WITH THE REINSPECTION.

PART 2 - PRODUCTS




- DUCTWORK: MATERIAL, CONSTRUCTION, AND INSTALLATION SHALL MEET REQUIREMENTS OF MOST RECENT EDITIONS OF SMACNA HVAC DUCT CONSTRUCTION STANDARDS, EXCEPT FOR MORE STRINGENT REQUIREMENTS SPECIFIED OR SHOWN ON DRAWINGS. MEDIUM PRESSURE DUCTWORK BETWEEN FANS AND VOLUME BOXES SHALL BE BUILT TO 4" PRESSURE CLASS WITH SEAL CLASS A. UNLESS SPECIFIED OTHERWISE, ALL OTHER DUCTWORK SHALL BE BUILT TO 2" PRESSURE CLASS WITH SEAL CLASS B. PROVIDE FLEXIBLE CONNECTION ON ALL DUCTS CONNECTING TO FANS AND ROTATING EQUIPMENT. ALL DUCTS SHALL BE GROUNDED ACROSS FLEXIBLE CONNECTION WITH FLEXIBLE COPPER GROUNDING STRIPS. MAXIMUM LENGTH OF FLEXIBLE RUN-OUT TO DIFFUSERS SHALL BE 6 FEET. FOR LONGER RUN-OUTS, ADD RIGID DUCT. DUCTS SHALL BE CONSTRUCTED OF HOT DIPPED GALVANIZED STEEL UNLESS OTHERWISE NOTED.
- FIRE DAMPERS: PROVIDE FIRE DAMPERS THROUGHOUT AIR SYSTEMS FOR ALL DUCTS PENETRATING FIRE RATED WALLS AND AS REQUIRED BY APPLICABLE CODES, STANDARDS, AND AUTHORITIES. PROVIDE ACCESS DOOR FOR EACH FIRE DAMPER OF SUFFICIENT SIZE TO REPAIR INTERNAL LINK. FIRE DAMPERS SHALL BE AS MANUFACTURED BY GREENHECK, RUSKIN, ARROW, NALOR, OR APPROVED EQUAL. DAMPER BLADES SHALL BE OUT OF AIR STREAM (UNLESS SIZE IS LARGER THAN AVAILABLE IN CURTAIN TYPE, THEN BLADE TYPE SHALL BE USED, SIMILAR TO FIRE/SMOKE DAMPERS. IF ACTUATORS ARE REQUIRED, MECHANICAL CONTRACTOR SHALL INCLUDE THE WIRING IN HIS COST.). DAMPERS SHALL BEAR 1-1/2 HOUR MINIMUM UL-RATING FIRE DAMPER LABEL AND BE CONSTRUCTED AND INSTALLED AS REQUIRED BY UL 555.
- VOLUME DAMPERS: PROVIDE MANUAL ADJUSTABLE VOLUME DAMPERS, WITH EXTENDED MOUNT, INDICATING AND LOCKING QUADRANTS ON EACH TAKE-OFF TO REGISTER, GRILLE, OR DIFFUSER (NOT ALL MAY BE SHOWN ON DRAWINGS).
- DIFFUSERS, REGISTERS, AND GRILLES: PROVIDE DIFFUSERS, REGISTERS AND GRILLES FOR SUPPLY, RETURN, AND EXHAUST OUTLETS, OF SIZE, TYPE, AND DESIGN SHOWN ON DRAWINGS. DIFFUSER SIZES SHOWN ARE NECK SIZES; REGISTER AND GRILLE SIZE ARE NOMINAL. ACCEPTABLE MANUFACTURERS: TITUS, ANEMOSTAT, KRUEGER, TUTTLE & BAILEY, PRICE, OR METALAIR. SOUND PRESSURE LEVELS ARE NOT TO EXCEED NC 30.

- DUCT INSULATION (EXTERNAL): INSULATION SHALL BE CERTAIN-TEED, KNAUF, MANVILLE, OR OWENS CORNING. MATERIALS SHALL MEET REQUIREMENTS OF ADHESIVE AND SEALANT COUNCIL STANDARDS AND SMACNA. DUCTWORK THAT IS LINED DOES NOT NEED EXTERNAL INSULATION EXCEPT FOR SUPPLY AND RETURN DUCTWORK LINED WITH ONLY 1" THICK LINING LOCATED IN CONCEALED PLENUMS OR UNCONDITIONED SPACES. TO MEET THE ENERGY CODE R5 REQUIREMENT, ADD A MINIMUM 1/2" THICK EXTERIOR INSULATION TO THESE LINED DUCTS. INSULATE ALL SUPPLY AND FRESH AIR DUCTS AND PLENUMS. INSULATE RETURN DUCTS NOT IN CEILING RETURN AIR PLENUMS. INSULATION SHALL BE AT LEAST 1-1/2" THICK. FOR CONCEALED INSULATION, USE FIBROUS GLASS DUCT WRAP WITH FOIL-KRAFT FLAME RESISTANT VAPOR BARRIER. EXPOSED INSULATION SHALL BE RIGID FIBERGLASS INSULATION WITH ALUMINUM VAPOR BARRIER. DUCTWORK THAT IS RUN OUTDOORS SHALL BE PITCHED FOR DRAINAGE AND INSULATED WITH AT LEAST 2" THICK INSULATION AND ADDITIONALLY COVERED WITH LIGHT COLOR WEATHERPROOF ROOFING MATERIALS.

PART 3 - EXECUTION

- DEMOLITION: THE EXISTING FACILITY WILL CONTINUE TO OPERATE DURING ALL PHASES OF THE DEMOLITION WORK AND SUBSEQUENT CONSTRUCTION. NO INTERRUPTION OF THE SYSTEMS WILL BE PERMITTED WITHOUT PRIOR APPROVAL OF THE OWNER'S REPRESENTATIVE. SUBMIT PROPOSED METHODS AND SEQUENCE OF OPERATIONS FOR THE SELECTIVE DEMOLITION WORK TO THE OWNER'S REPRESENTATIVE FOR REVIEW PRIOR TO THE START OF THE WORK. ANY DEMOLITION SHALL BE COORDINATED WITH OWNER, ARCHITECT, CM/GC, AND ENGINEER. PERFORM ALL DEMOLITION WHILE ENSURING MINIMUM INTERFERENCE WITH ADJACENT OCCUPIED AREAS.
- INSTALLATION OF EQUIPMENT: INSTALL ALL ITEMS SPECIFIED UNDER PART 2 - PRODUCTS, ACCORDING TO THE MANUFACTURER'S REQUIREMENTS, SHOP DRAWINGS, AND DETAILS AS SHOWN ON THE DRAWINGS AND AS SPECIFIED. INSTALL ALL WORK SO THAT PARTS REQUIRING INSPECTION, REPLACEMENT, MAINTENANCE AND REPAIR SHALL BE READILY ACCESSIBLE. MINOR DEVIATIONS FROM THE DRAWINGS MAY BE MADE TO ACCOMPLISH THIS, BUT ANY SUBSTANTIAL CHANGE SHALL NOT BE MADE WITHOUT PRIOR WRITTEN OWNER APPROVAL.
- IDENTIFICATION: ALL EQUIPMENT AND DUCTWORK PROVIDED UNDER THIS SECTION OF THE SPECIFICATIONS SHALL BE MARKED FOR EASE OF IDENTIFICATION PER OWNER'S OR INDUSTRY STANDARDS.
- CLEANING: DUCTS SHALL BE THOROUGHLY CLEANED SO THAT NO DIRT OR DUST SHALL BE DISCHARGED FROM DIFFUSERS, REGISTERS, OR GRILLES WHEN SYSTEM IS OPERATED. AFTER COMPLETION OF PROJECT, CLEAN EXTERIOR SURFACES OF ALL EQUIPMENT INCLUDED IN THIS SECTION, INCLUDING REMOVAL OF CONCRETE RESIDUE. AFTER COMPLETION OF PROJECT, REMOVE ALL CONSTRUCTION DEBRIS, TEMPORARY FACILITIES AND EQUIPMENT FROM WORK AREA. LEAVE WORK AREA TO PERMIT OCCUPATION.
- START UP AND BALANCING: PROVIDE NEBB OR AABC CERTIFIED PERSONNEL, WORK AREA, APPARATUS, AND SERVICES FOR START-UP AND BALANCING OF MECHANICAL SYSTEMS TO PERFORMANCE DATA SHOWN IN SCHEDULES AND ON DRAWINGS, AS SPECIFIED, AND AS REQUIRED BY CODES, STANDARDS, REGULATIONS, AND AUTHORITIES HAVING JURISDICTION INCLUDING CITY INSPECTORS. AIR FLOWS SHALL BE BALANCED TO +/- 10% OF DESIGN. LEAKS, DAMAGE, AND DEFECTS DISCOVERED OR RESULTING FROM START-UP AND BALANCING SHALL BE REPAIRED OR REPLACED TO LIKE-NEW CONDITION WITH ACCEPTABLE MATERIALS. TESTS SHALL BE CONTINUED UNTIL SYSTEM OPERATES WITHOUT ADJUSTMENTS OR REPAIRS. REPORT DATA ON INDUSTRY STANDARD NEBB OR AABC REPORTING FORMS. CONTROL DAMPER AND ROOFTOP UNIT DATA SHALL INCLUDE ALL AIRFLOWS (MAXIMUM, MINIMUM, HEATING, RETURN AIR, OUTSIDE, ETC.). SUBMIT SIX COPIES OF START-UP AND BALANCING REPORTS TO ARCHITECT FOR APPROVAL PRIOR TO THE START OF DEMOLITION. THE TESTING AND BALANCING CONTRACTOR SHALL TAKE CFM AND STATIC PRESSURE READINGS AT AREAS DESIGNATED ON THE CONTRACT DRAWINGS. READINGS SHALL BE SUBMITTED PRIOR TO START OF NEW WORK.

56 NORTHPORT DRIVE
(1361 WASHINGTON AVENUE)
PORTLAND, ME

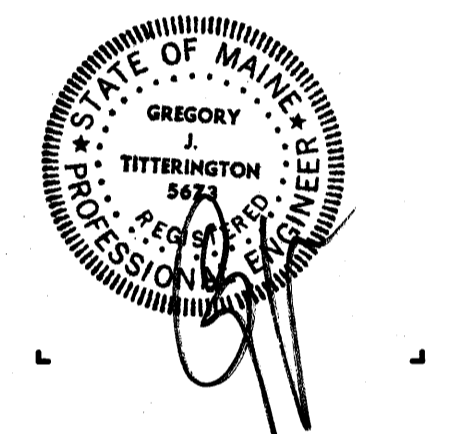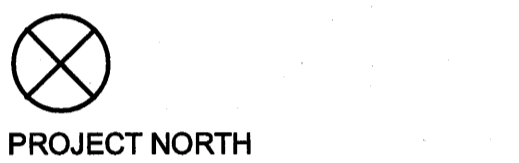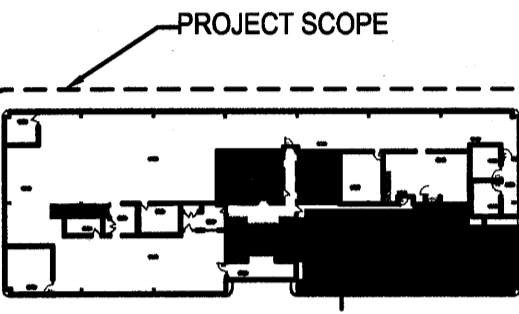

ADD Inc

311 SUMNER STREET BOSTON, MA 02210 617.234.3100

ISSUANCES

No.	Description	Date
1	ISSUED FOR PERMIT	12/23/08

Checked by:

HVAC SPECIFICATIONS, NOTES & SCHEDULES

Drawing Scale: N.T.S.

Job No. 20080729

H-900