




NOTE:
SMOKE ALARMS/CO DETECTORS
 SHALL BE INSTALLED IN THE Reviewed for Code Compliance
Permitting and Inspections Department
 FOLLOWING LOCATIONS: Approved with Conditions
 1: EACH SLEEPING AREA **07/19/2018**
 2: OUTSIDE EACH SEPARATE SLEEPING
 AREA IN THE IMMEDIATE VICINITY
 OF THE BEDROOMS
 3: ALL SMOKE ALARMS SHALL BE
 INTERCONNECTED

SPRINKLER SYSTEM DESIGN PER
 NFPA 13D AND LOCAL CODES.
 SPRINKLER SYSTEM TO BE
 BLAZEMASTER

Elevations are approximated and need to
 be verified on site prior to pouring foundation.



Rough openings to be determined by builder.
 Placement of openings to be determined by builder.

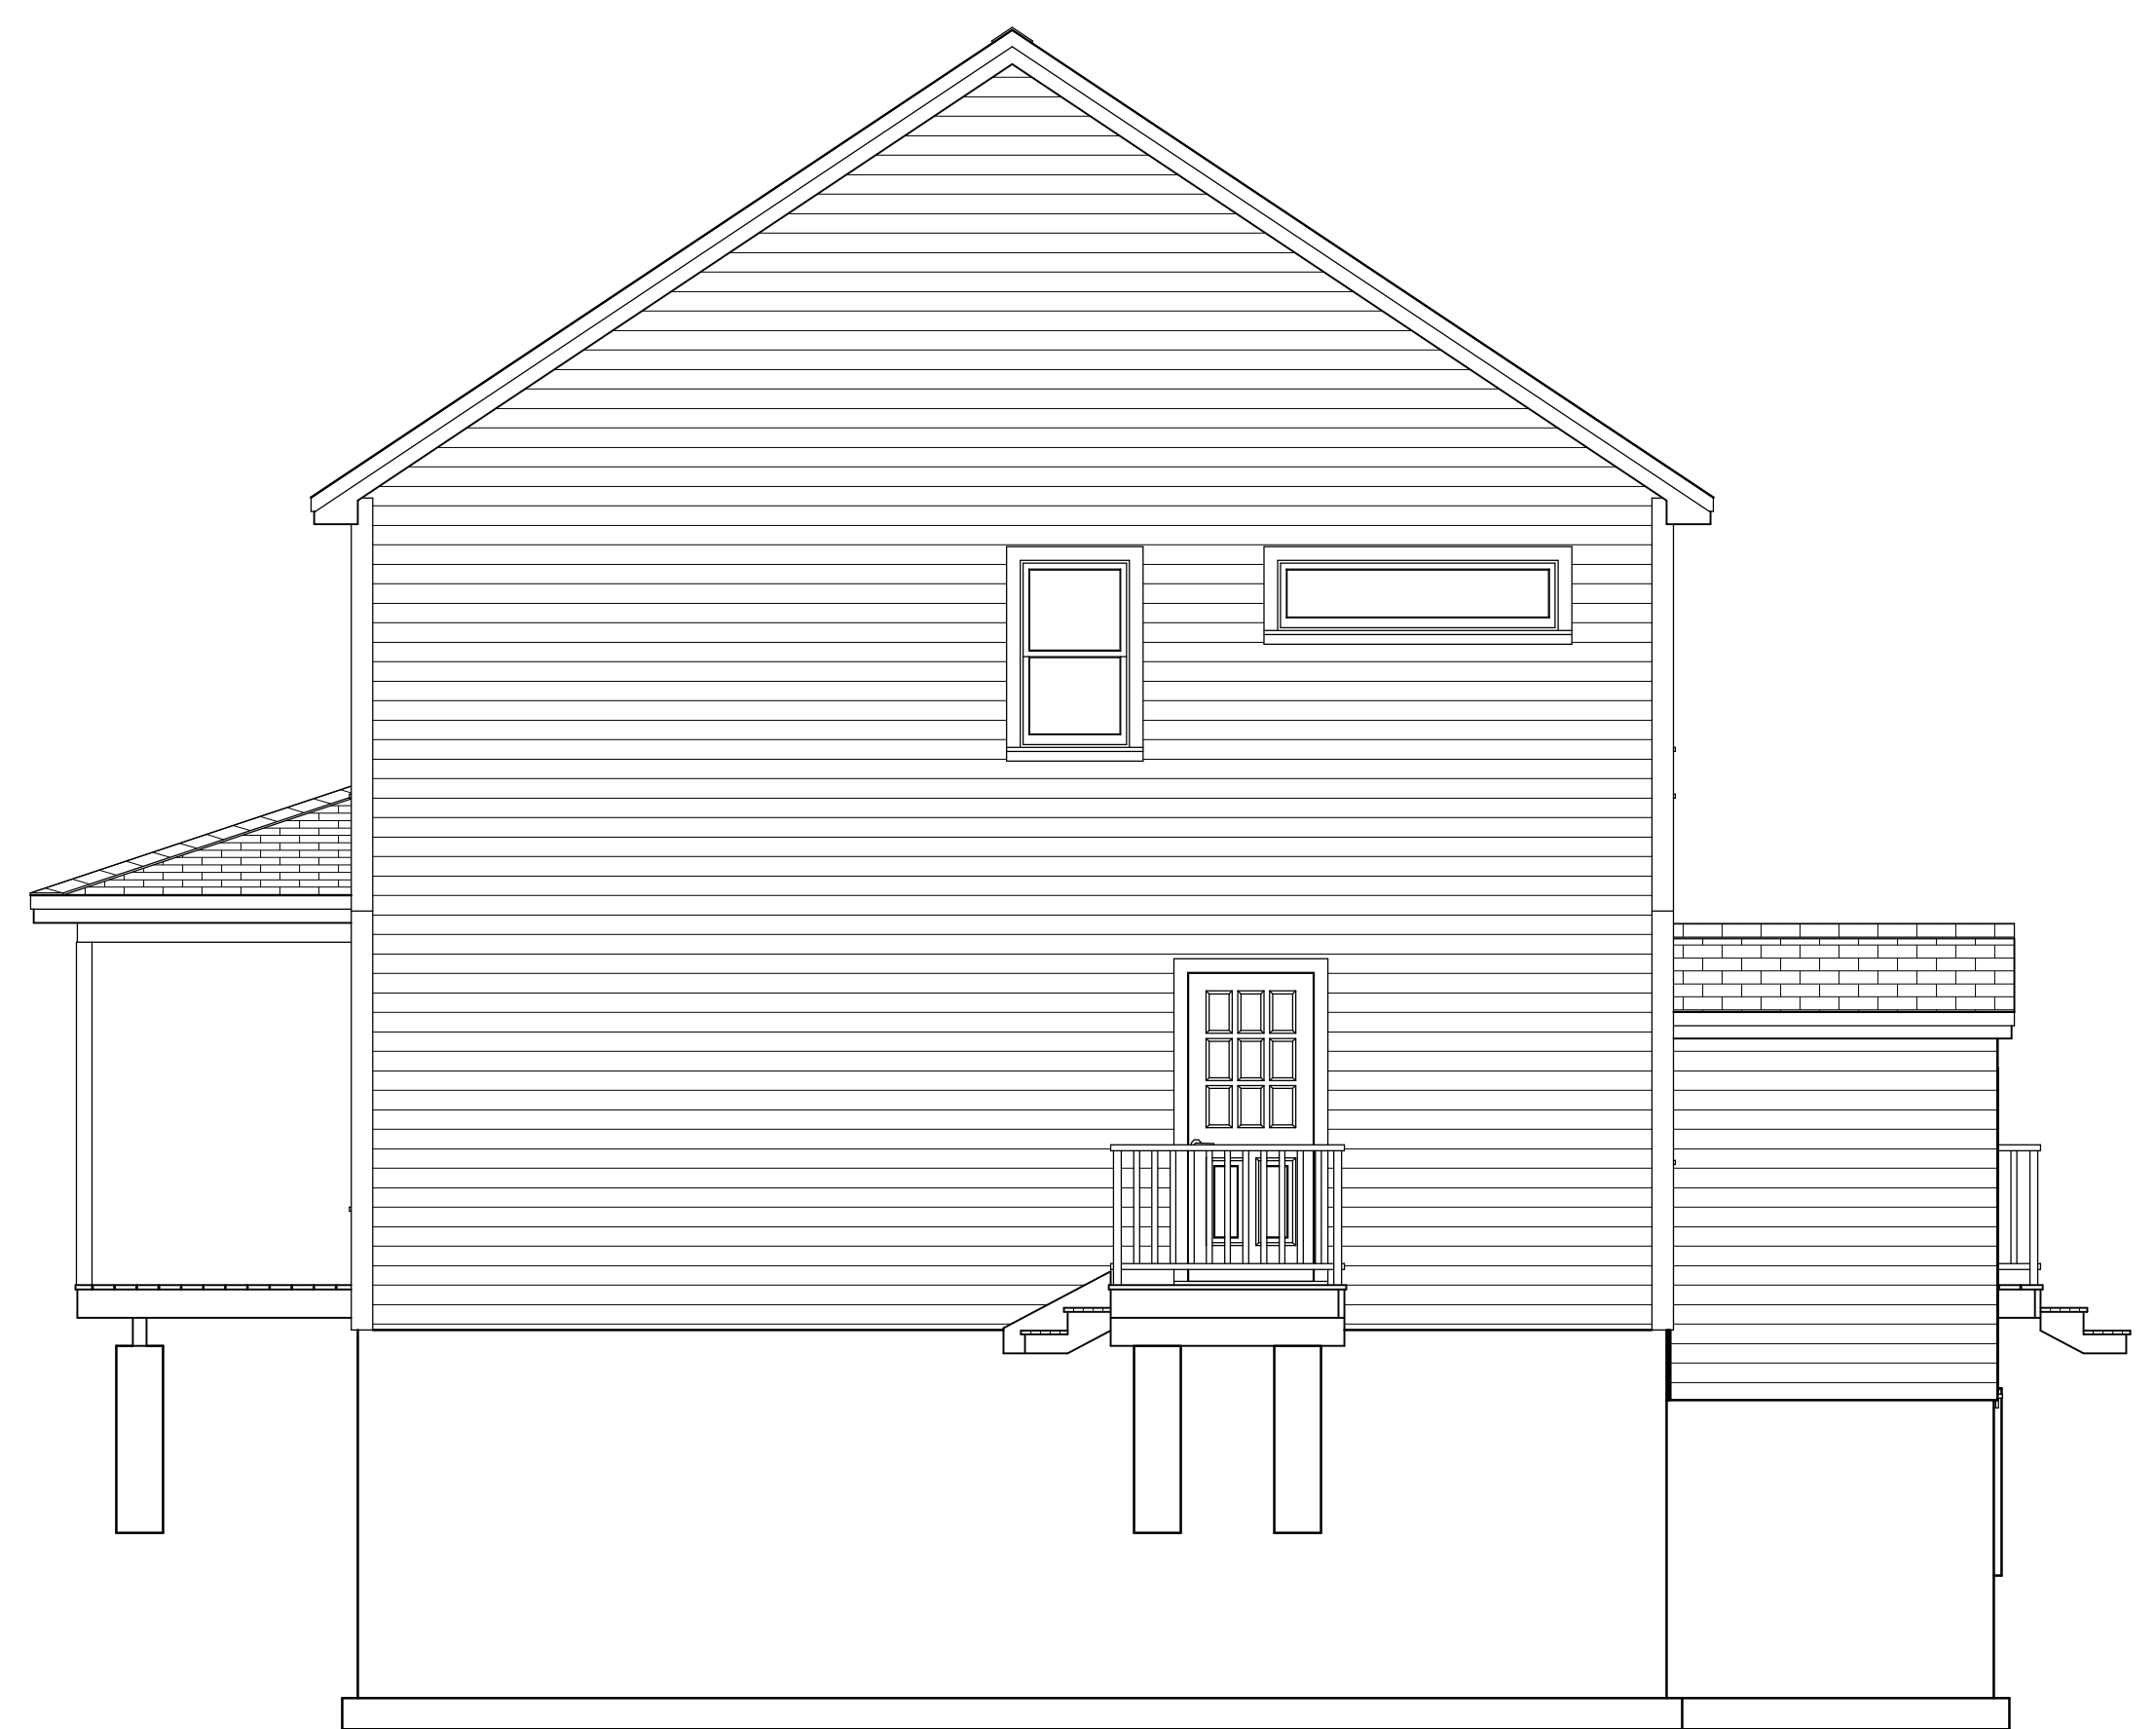

REVISION TABLE	REVISION BY	DESCRIPTION
NUMBER	DATE	

SMOKE ALARMS/CO DETECTORS SHALL BE INSTALLED IN THE FOLLOWING LOCATIONS:

HIGGINS #13

DRAWINGS PROVIDED BY:

DATE:

7/13/2018

SCALE:

AS NOTED


SHEET:

P-1



Elevations are approximated and need to be verified on site prior to pouring foundation.


Rough openings to be determined by builder.
 Placement of openings to be determined by builder.

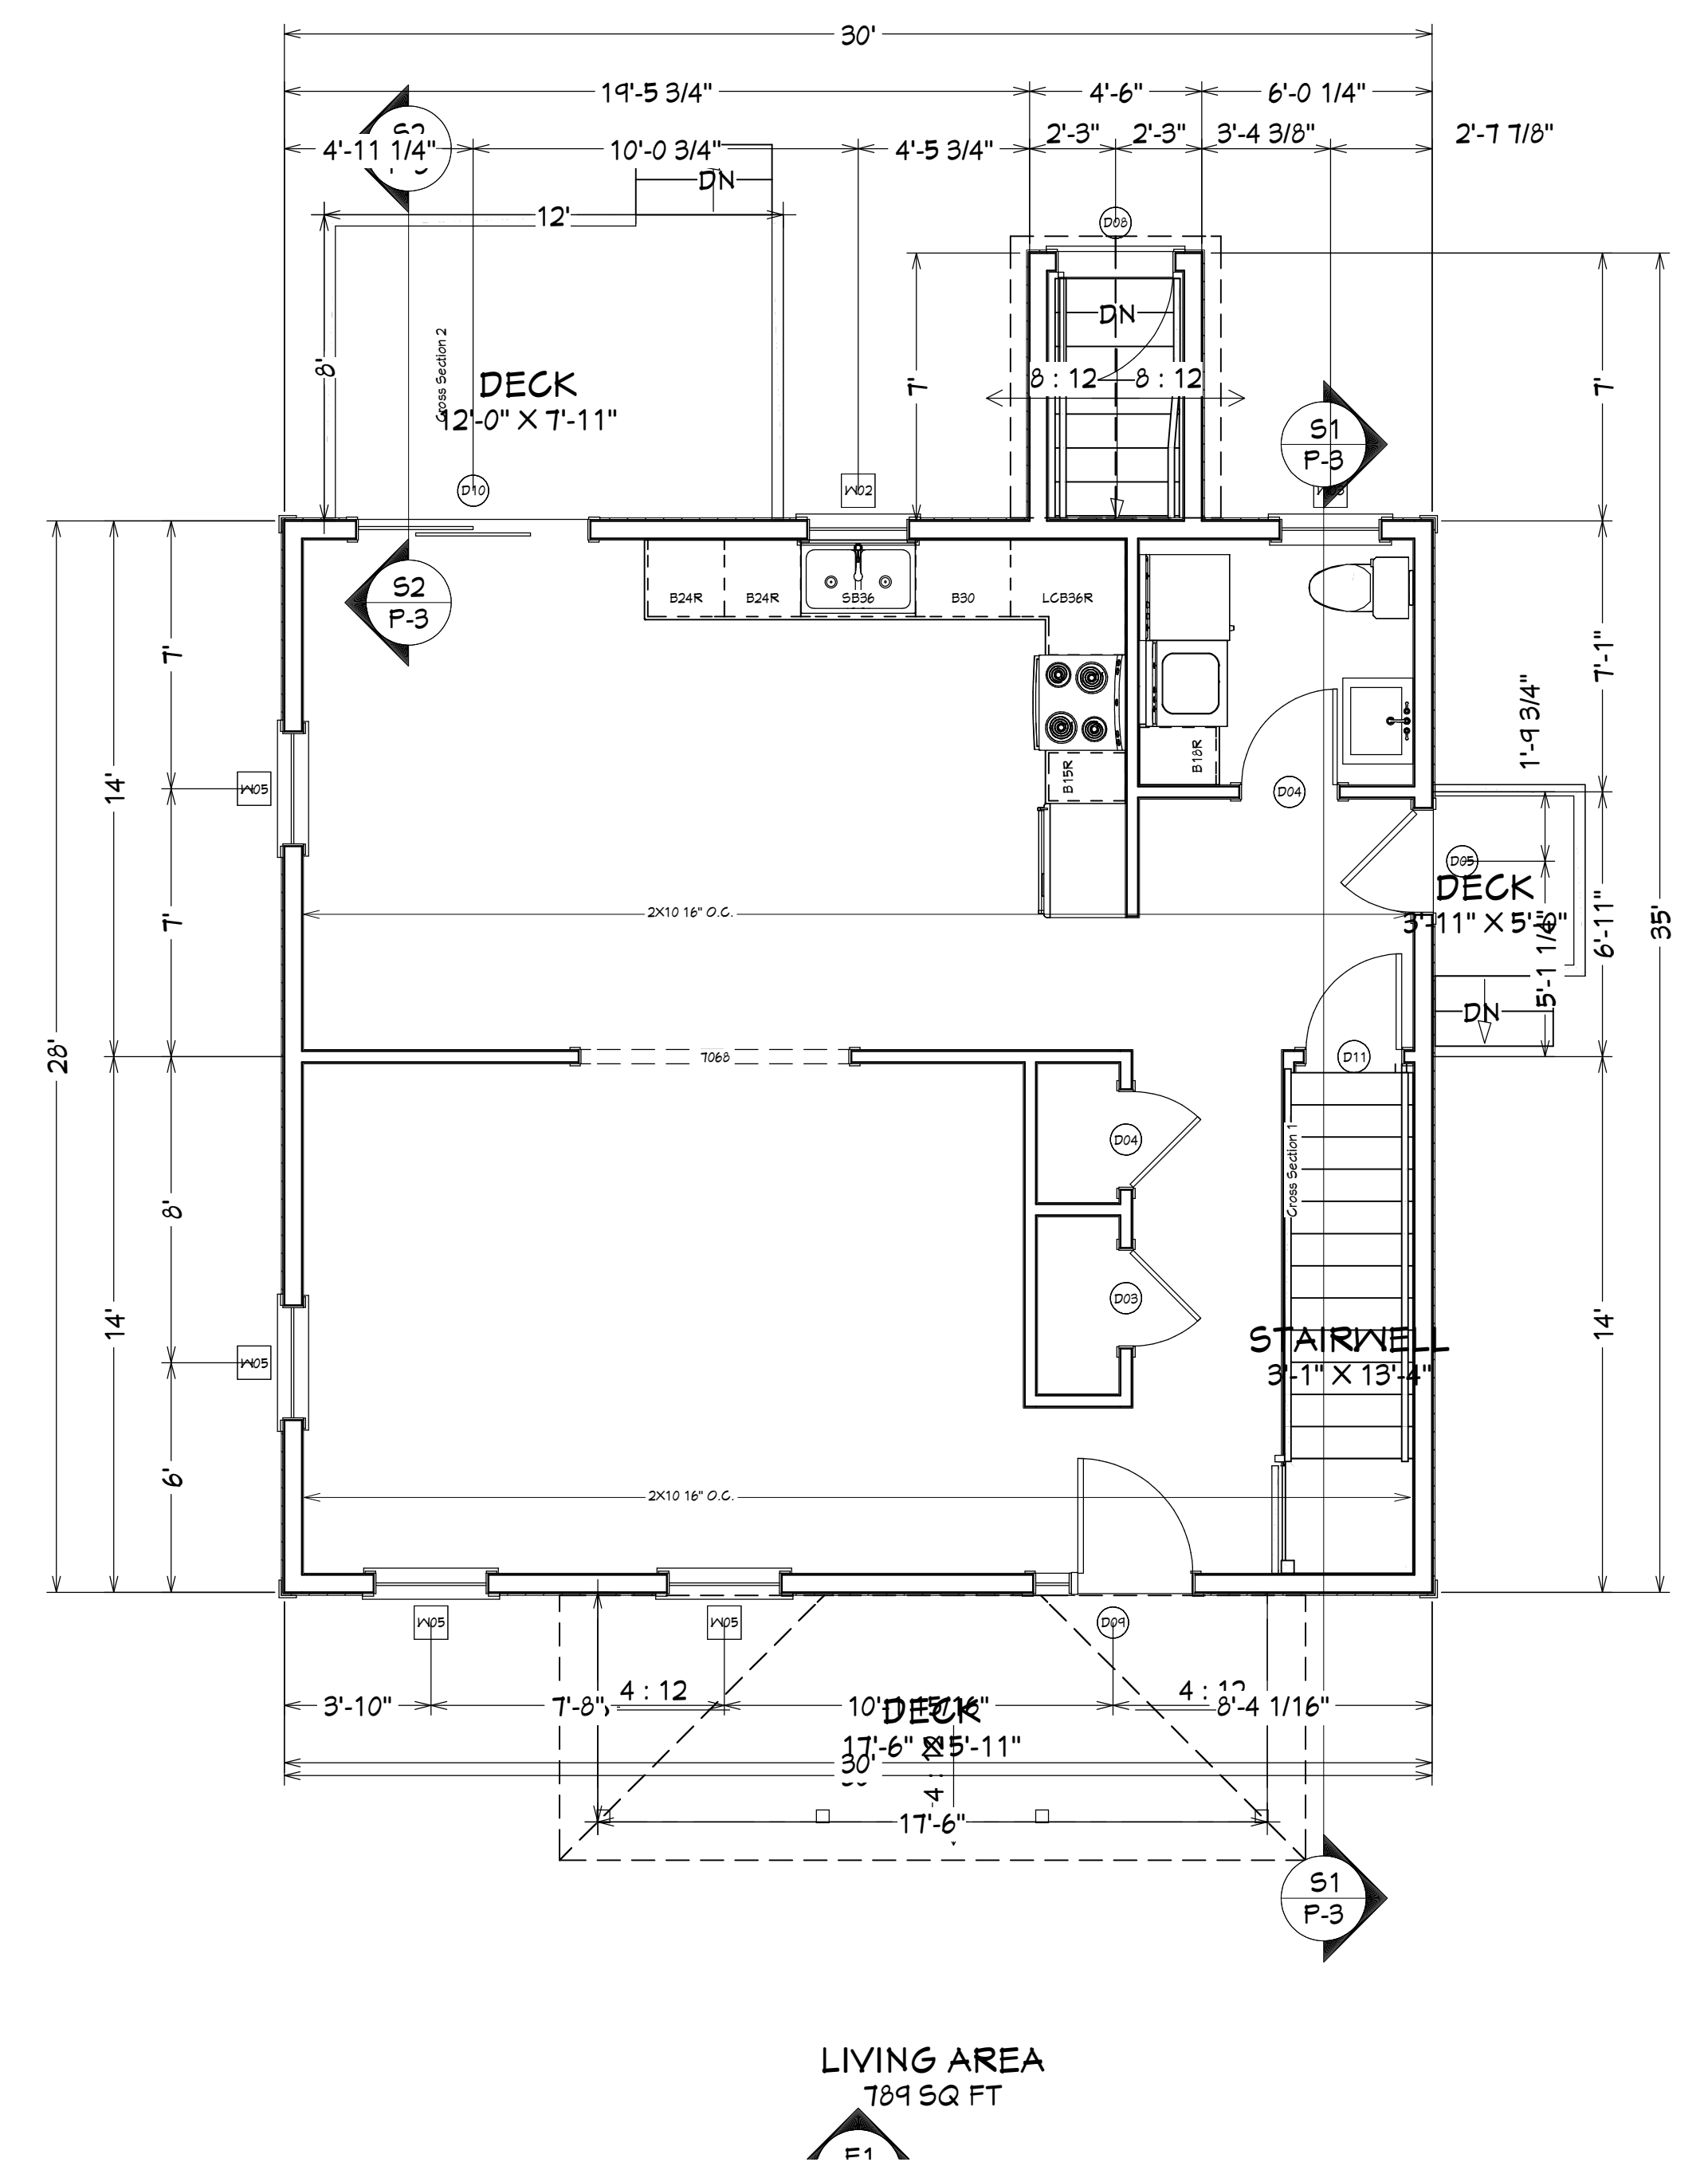

1st Floor 1/4 in = 1 ft

NUMBER	LABEL	QTY	FLOOR	SIZE	WIDTH	HEIGHT	DESCRIPTION	THICKNESS
D01	1868	1	2	1868 L IN	20"	80"	HINGED-DOOR P04	1 3/8"
D02	2068	1	2	2068 L IN	24"	80"	HINGED-DOOR P04	1 3/8"
D03	2668	1	1	2668 L IN	30"	80"	HINGED-DOOR P04	1 3/8"
D04	2668	2	1	2668 R IN	30"	80"	HINGED-DOOR P04	1 3/8"
D05	2868	1	1	2868 R EX	32"	80"	EXT. HINGED-DOOR E06	1 3/4"
D06	2868	2	2	2868 L IN	32"	80"	HINGED-DOOR P04	1 3/8"
D07	2868	3	2	2868 R IN	32"	80"	HINGED-DOOR P04	1 3/8"
D08	3068	1	1	3068 R EX	36"	80"	EXT. HINGED-DOOR E06	1 3/4"
D09	4268MU	1	1	4268	50"	80"	MULLED UNIT	
D10	6068	1	1	6068 R EX	72"	80"	EXT. SLIDER-GLASS PANEL	1 3/4"
D11	2668 STEEL INSUL DOOR W/GASKET	1	1	2668 R IN	30"	80"	HINGED-DOOR P04	1 3/4"
D12	2468	2	2	2468 L IN	28"	80"	HINGED-DOOR P04	1 3/8"

NUMBER	LABEL	QTY	FLOOR	SIZE	WIDTH	HEIGHT	EGRESS	DESCRIPTION	TEMPERED
W01	2440DH	1	2	2440DH	28"	48"		DOUBLE HUNG	
W02	2830DH	1	1	2830DH	32"	35 7/8"		DOUBLE HUNG	
W03	2840DH	1	1	2840DH	32"	48"		DOUBLE HUNG	YES
W04	2840DH	2	2	2840DH	32"	48"		DOUBLE HUNG	YES
W05	3050DH	4	1	3050DH	36"	60"		DOUBLE HUNG	
W06	3050DH	2	2	3050DH	36"	60"		DOUBLE HUNG	
W07	3050DH	3	2	3050DH	36"	60"	YES	DOUBLE HUNG	
W08	6016FX	1	2	6016FX	72"	18"		FIXED GLASS	

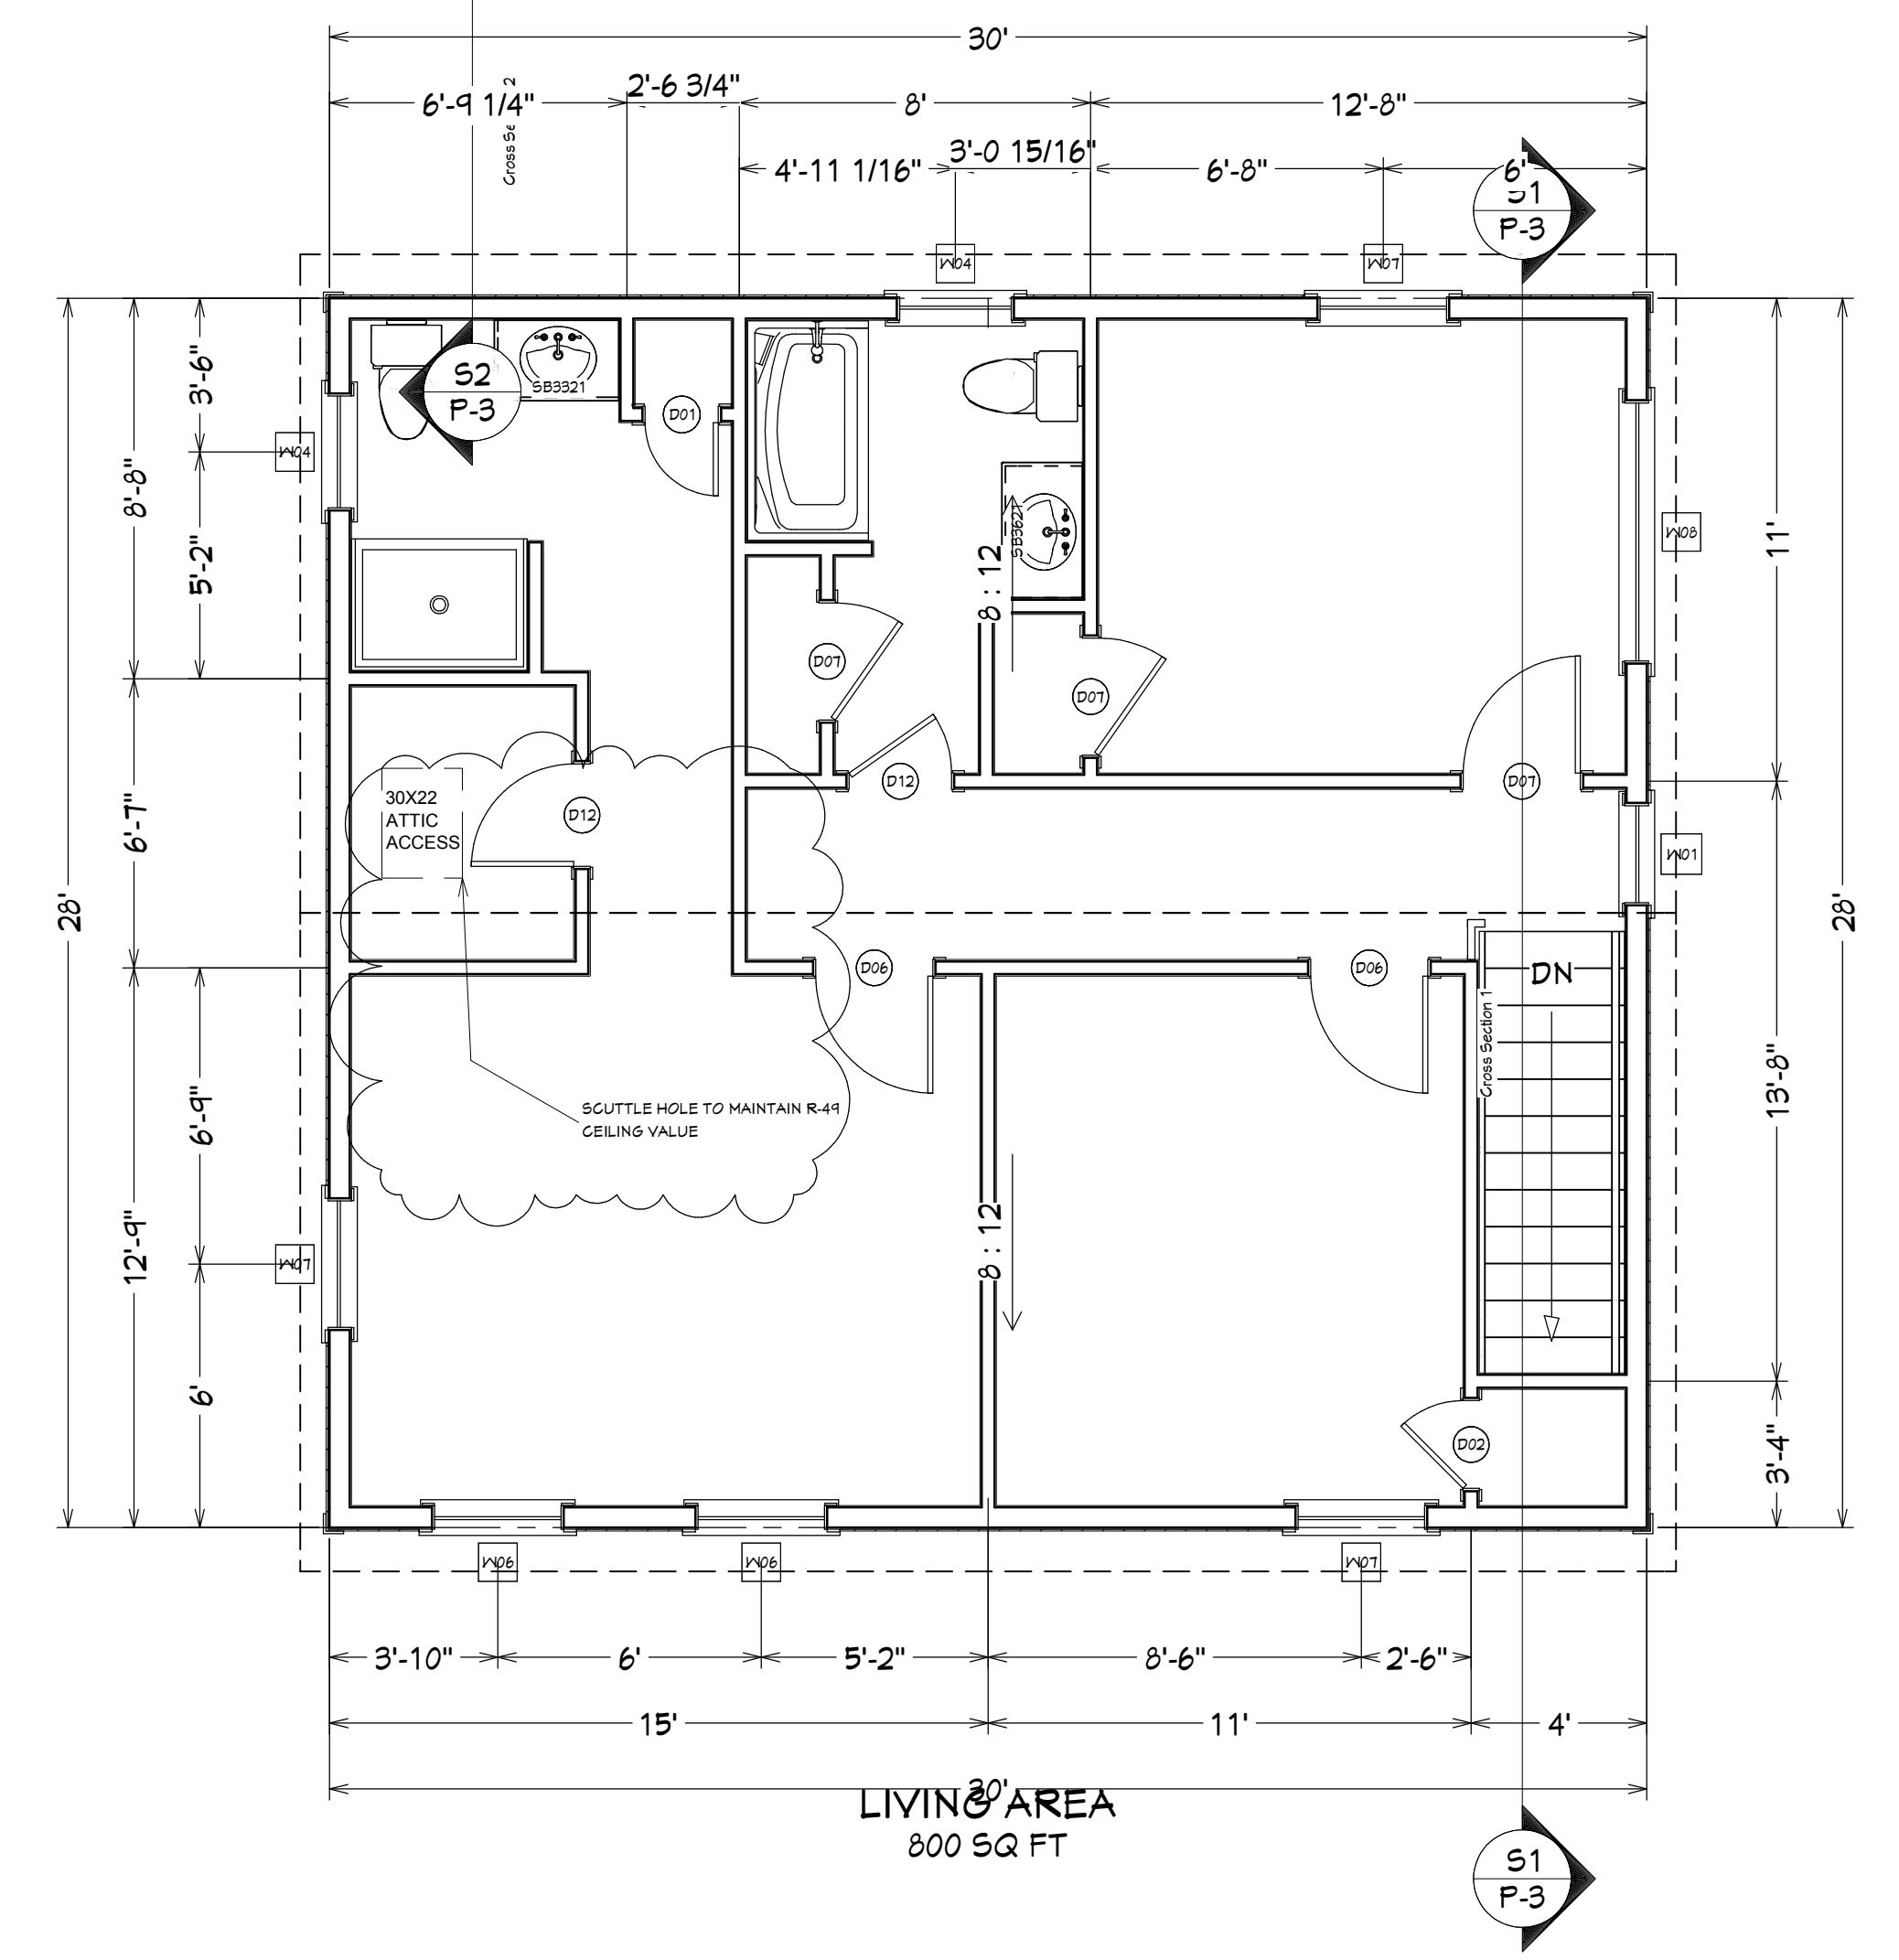

2nd Floor

NOTE:
 SMOKE ALARMS/CO DETECTORS SHALL BE INSTALLED IN THE FOLLOWING LOCATIONS:
 1: EACH SLEEPING AREA
 2: OUTSIDE EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS
 3: ALL SMOKE ALARMS SHALL BE INTERCONNECTED

SPRINKLER SYSTEM DESIGN PER NFPA 13D AND LOCAL CODES.
 SPRINKLER SYSTEM TO BE BLAZEMASTER

NOTE:
 SMOKE ALARMS/CO DETECTORS SHALL BE INSTALLED IN THE FOLLOWING LOCATIONS:
 1: EACH SLEEPING AREA
 2: OUTSIDE EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS
 3: ALL SMOKE ALARMS SHALL BE INTERCONNECTED


REVISION TABLE	REVISION BY	DESCRIPTION
NUMBER	DATE	

DRAWINGS PROVIDED BY:
 HIGGINS #13

DATE:
 7/13/2018

SCALE:
 AS NOTED


SHEET:
 P-2

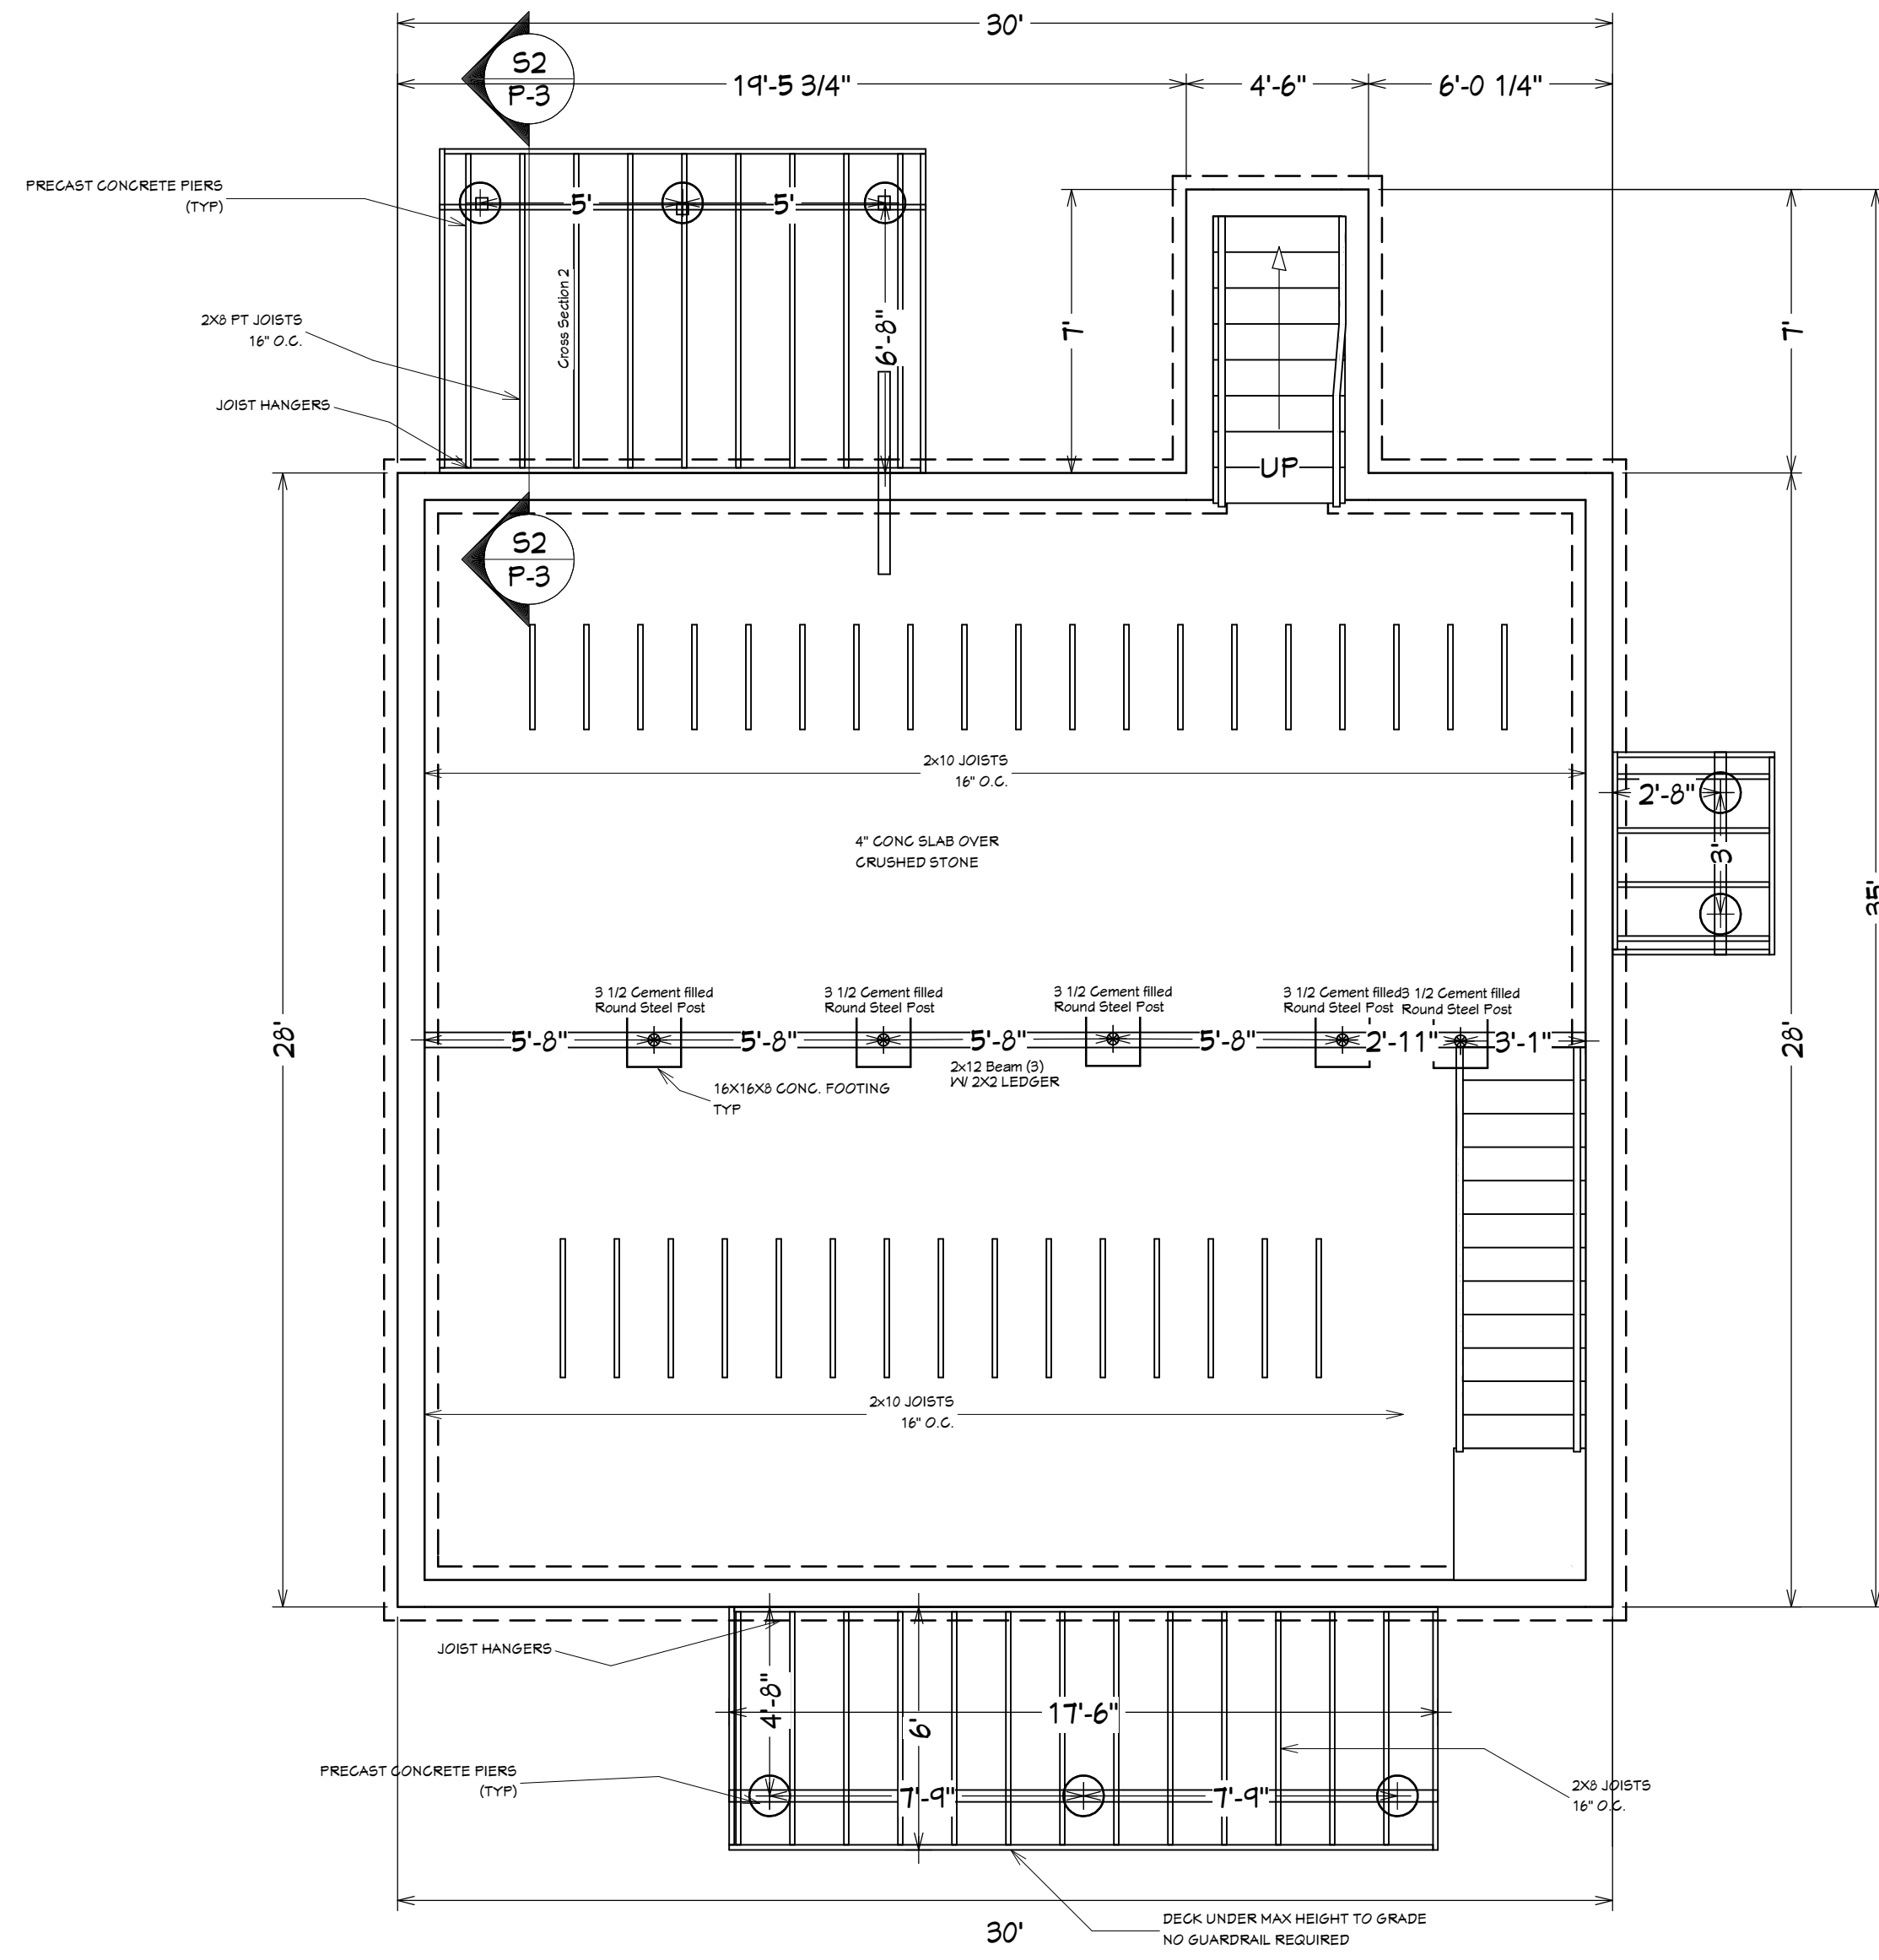

Elevations are approximated and need to be verified on site prior to pouring foundation.

NOTE:
SMOKE ALARMS/CO DETECTORS SHALL BE INSTALLED IN THE FOLLOWING LOCATIONS:
1: EACH SLEEPING AREA
2: OUTSIDE EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS
3: ALL SMOKE ALARMS SHALL BE INTERCONNECTED

SPRINKLER SYSTEM DESIGN PER NFPA 13D AND LOCAL CODES. SPRINKLER SYSTEM TO BE BLAZEMASTER

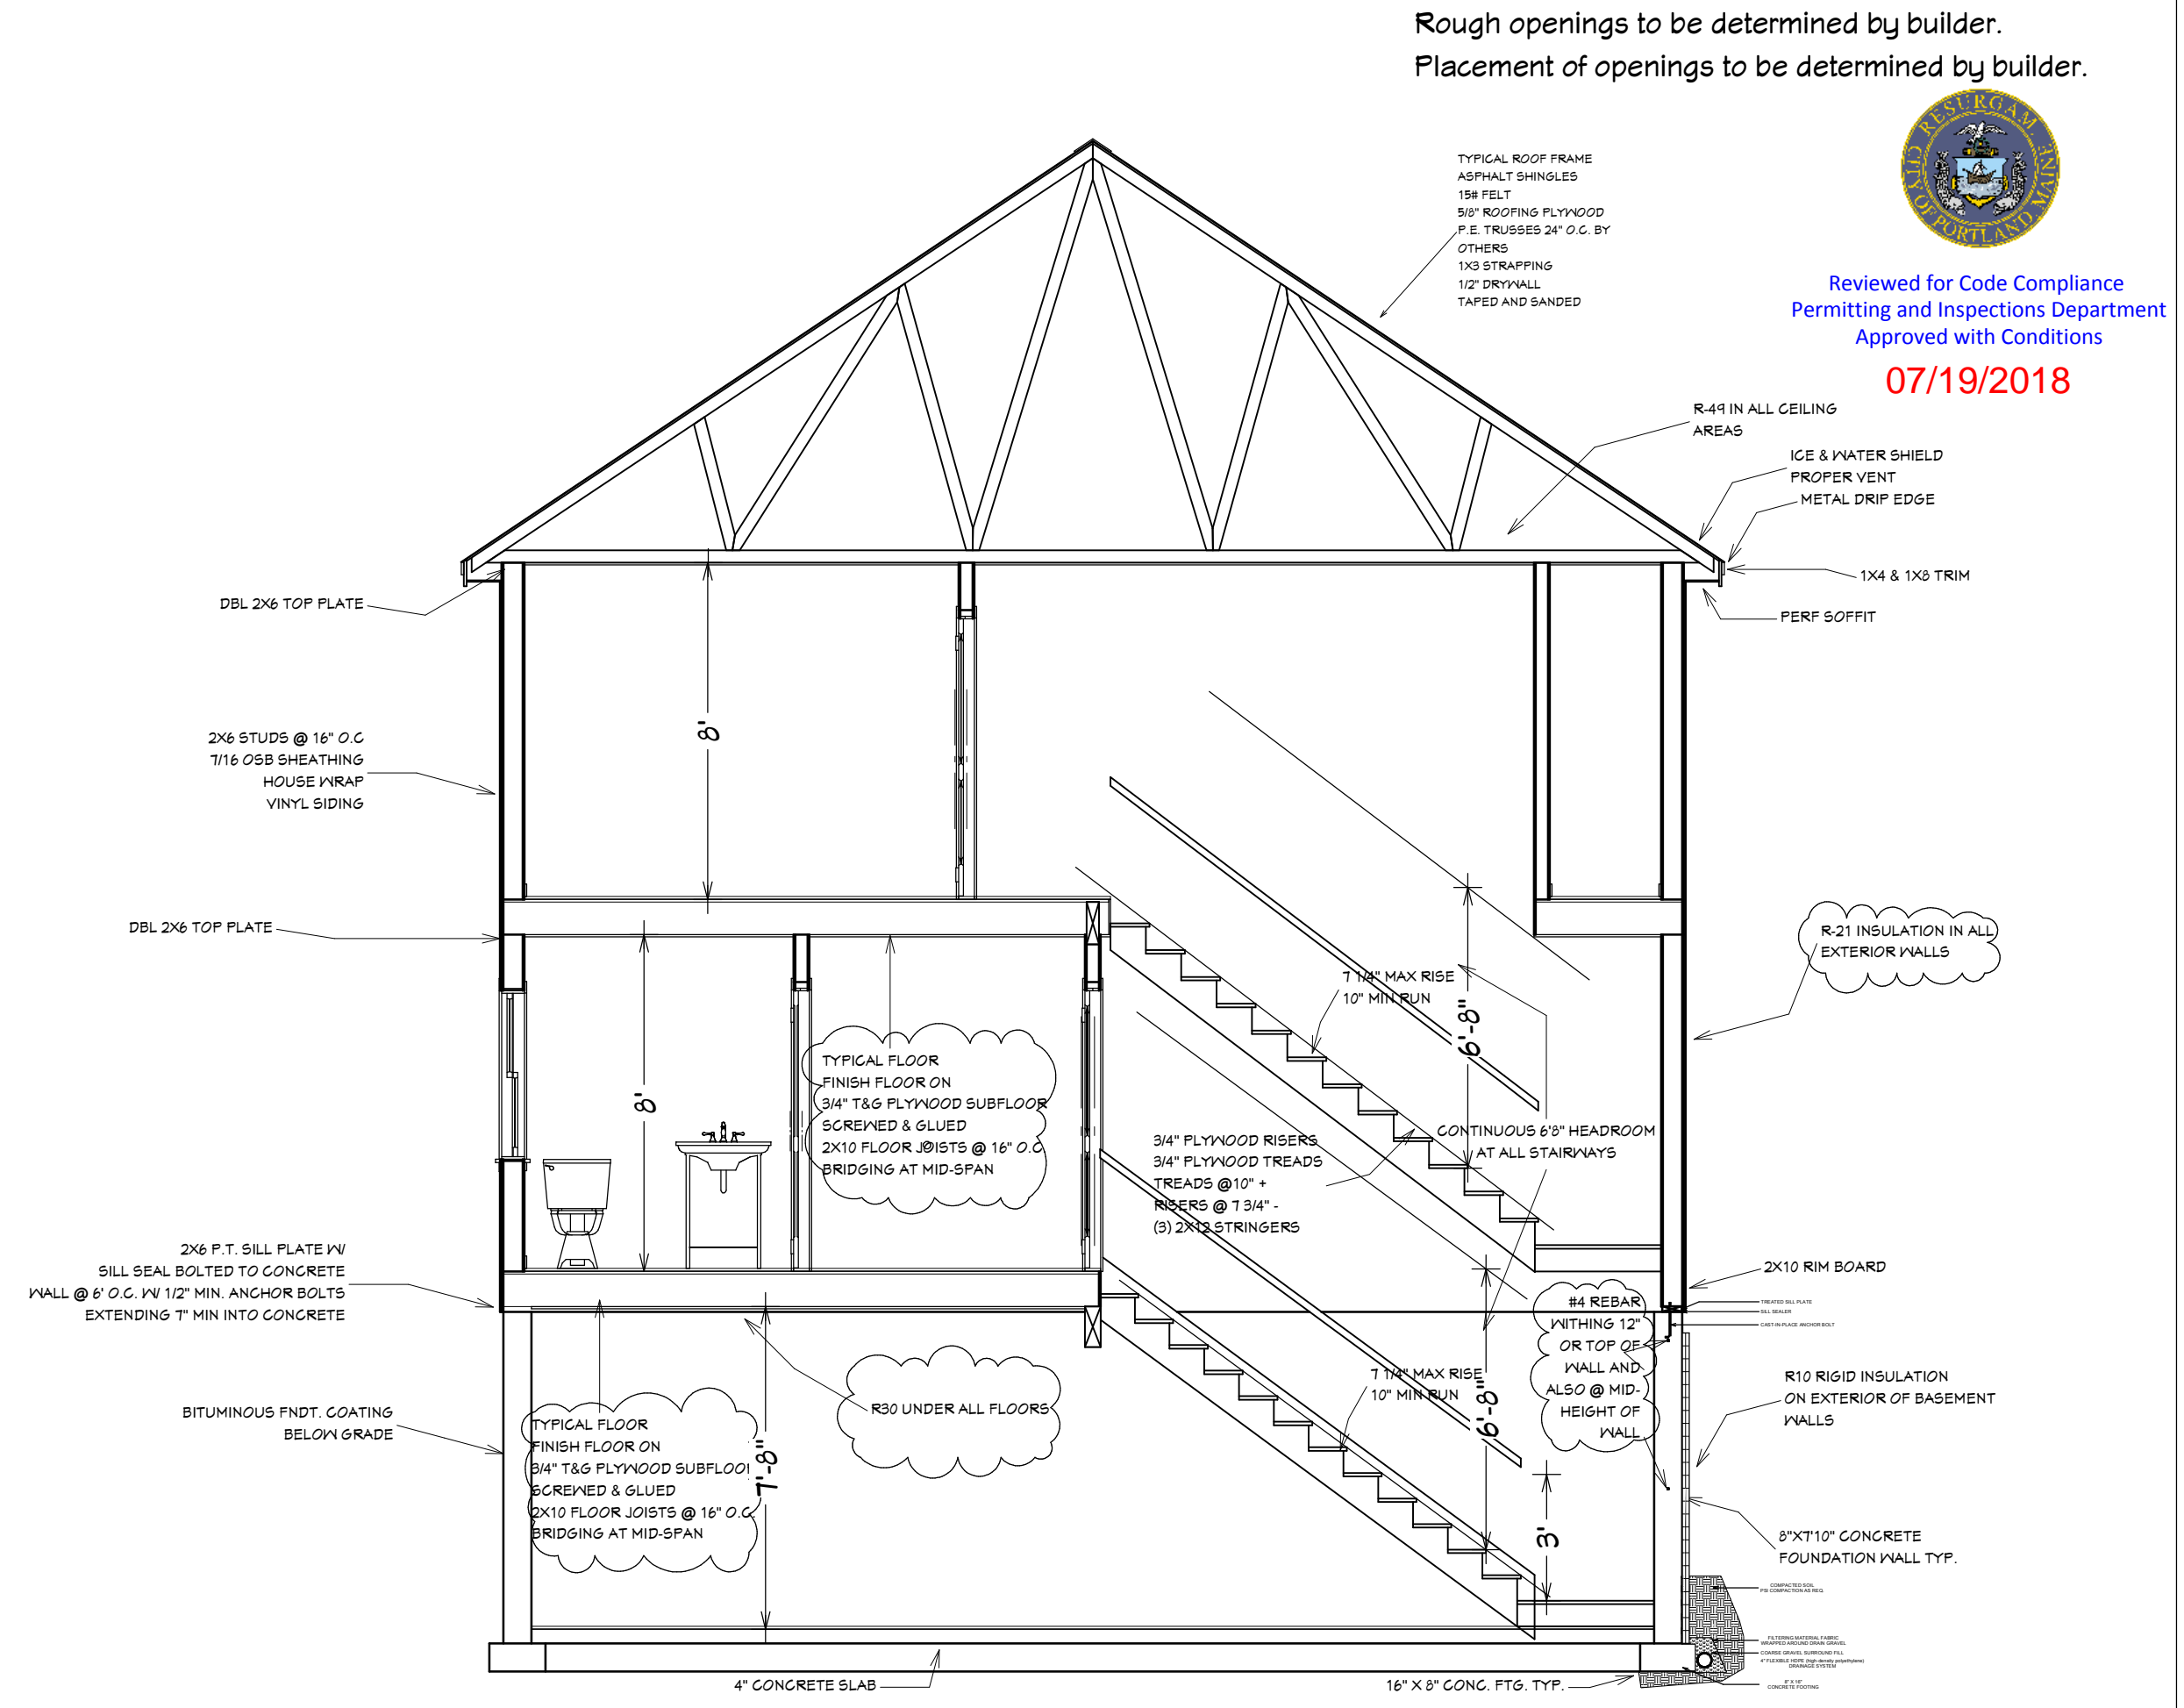

Rough openings to be determined by builder.
Placement of openings to be determined by builder.

Reviewed for Code Compliance
Permitting and Inspections Department
Approved with Conditions
07/19/2018

REVISION TABLE	REVISION BY	DESCRIPTION

Cross Section 1

HEADERS AND GIRDERS SUPPORTING	SIZE	Building Width (feet)		
		20	26	36
One floor only	2-2x4	3-1	2-0	1-2-5
	2-2x6	4-6	3-11	3-6
	2-2x8	5-9	5-0	4-5
	2-2x10	7-0	6-1	5-5
	2-2x12	8-1	7-0	6-3
	3-2x8	7-2	6-3	5-7
	3-2x10	8-9	7-7	6-9
	3-2x12	10-2	8-10	7-10
	4-2x8	5-10	5-1	4-6
	4-2x10	10-1	8-9	7-10
Two floor only	4-2x12	11-9	10-2	9-1
	2-2x4	2-2	1-10	1-7
	2-2x6	3-2	2-9	2-5
	2-2x8	4-1	3-6	3-2
	2-2x10	4-11	4-3	3-10
	2-2x12	5-9	5-0	4-5
	3-2x8	5-1	4-5	3-11
	3-2x10	6-2	5-4	4-10
	3-2x12	7-2	6-3	5-7
	4-2x8	4-2	3-7	3-2
4-2x10	7-2	6-2	5-6	
4-2x12	8-4	7-2	6-5	

DESCRIPTION OF BUILDING MATERIAL	DESCRIPTION OF FASTENER	SPACING OF FASTENERS	
		Edges (inches)	Intermediate support ** (inches)
wood structural panels, subfloor, roof and wall sheathing to framing, and particleboard wall sheathing to framing	5/16" x 12" 6d common nail (subfloor, wall) 6d common nail (roof)	6	12
14932" 1"	6d common nail	6	12
1-1/8" x 1-1/4"	10d common nail or 6d deformed nail	6	12
Other wall sheathing *	1-1/2" galvanized roofing nail 6d common nail staple 16ga., 1-1/2" long	3	6
1/2" regular cellulose fiberboard sheathing	1-1/2" galvanized roofing nail 6d common nail staple 16ga., 1-1/2" long	3	6
1/2" regular cellulose fiberboard sheathing	1-3/4" galvanized roofing nail 6d common nail staple 16ga., 1-3/4" long	3	6
25/32" structural cellulose fiberboard sheathing	1-1/2" galvanized roofing nail 6d common nail, staple galvanized, 1-1/2" long 1-1/4" screws, type PN or S	3	6
1/2" gypsum sheathing	1-1/2" galvanized roofing nail 6d common nail staple 16ga., 1-1/2" long	4	6
5/8" gypsum sheathing	1-1/2" galvanized roofing nail 6d common nail staple 16ga., 1-1/2" long	4	6
wood structural panels, combination subfloor underlayment to framing	3/4" and less 6d deformed nail or 6d common nail	6	12
7/8" 1"	6d common nail or 6d deformed nail	6	12
1-1/8" 1-1/4"	10d common nail or 6d deformed nail	6	12

GIRDERS AND HEADERS SUPPORTING	SIZE	Building Width (feet)		
		20	26	36
Roof and ceiling	2x4	2-1	1-1	1-1
	2x6	3-1	2-1	2-1
	2x8	4-1	3-1	3-1
	2x10	5-1	4-1	4-1
	2x12	6-1	5-1	5-1
	3x8	5-1	4-1	4-1
	3x10	6-1	5-1	5-1
	3x12	7-1	6-1	6-1
	4x8	6-1	5-1	5-1
	4x10	7-1	6-1	6-1
Roof, ceiling and exterior bearing floor	2x4	2-1	1-1	1-1
	2x6	3-1	2-1	2-1
	2x8	4-1	3-1	3-1
	2x10	5-1	4-1	4-1
	2x12	6-1	5-1	5-1
	3x8	5-1	4-1	4-1
	3x10	6-1	5-1	5-1
	3x12	7-1	6-1	6-1
	4x8	6-1	5-1	5-1
	4x10	7-1	6-1	6-1
Roof, ceiling and exterior bearing floor	2x4	2-1	1-1	1-1
	2x6	3-1	2-1	2-1
	2x8	4-1	3-1	3-1
	2x10	5-1	4-1	4-1
	2x12	6-1	5-1	5-1
	3x8	5-1	4-1	4-1
	3x10	6-1	5-1	5-1
	3x12	7-1	6-1	6-1
	4x8	6-1	5-1	5-1
	4x10	7-1	6-1	6-1

For 5/16" x 12" 6d, 1 foot=30.48mm, 1 mile per hour=1.609km/h

a. All nails are smooth common, box or deformed shanks except where otherwise stated. Nails used for framing and sheathing connections shall have minimum average tensile and shear strengths as shown: 50ksi (351 MPa) for shank diameter of 1/2 inch (12.5mm) common nail, 10ksi (68.9 MPa) for shank diameter larger than 1/2 inch but not larger than 1 1/8 inch, and 10ksi (68.9 MPa) for shank diameters of 1/2 inch or less.

b. Staples are 16-gauge wire and have a minimum 1/16-inch on diameter crown width.

c. Nails shall be spaced at not more than 6 inches on center at all supports where spans are 40 inches or greater.

d. Four-foot by 8-foot or 4-foot by 8-foot panels shall be applied vertically.


e. Spacing of fasteners not included in this table shall be based on table R602.5(1).

f. For regions having basic wind speed of 110mph or greater, 6d deformed nails shall be used for attaching plywood and wood structural panel roof.

g. For regions having basic wind speed of 100mph or less, nails for attaching wood structural panel roof sheathing to gable end wall framing shall be spaced 8 inches on center. When basic wind speed is greater than 100mph, nails for attaching panel roof sheathing to intermediate supports shall be spaced 6 inches on center for minimum 48-inch distance from ridges, eaves and gable walls, and 4 inches on center to gable end wall sheathing.

h. Gypsum sheathing shall conform to ASTM C713 and shall be installed in accordance with GA-255. Fiberboard sheathing shall conform to either AIA 194.1 or ASTM C 205.

i. Spacing of fasteners on floor sheathing panel edges applies to panel edges supported by framing members and at all floor perimeter walls. Spacing of fasteners on roof sheathing panel edges applies to panel edges supported by framing members and at all roof perimeter walls. Blocking of roof or floor sheathing panel edges perpendicular to the framing members shall not be required except at intersection of adjacent roof planes. Floor and roof perimeter sheathing panel edges perpendicular to the framing members or solid blocking shall be supported by framing members or solid blocking.

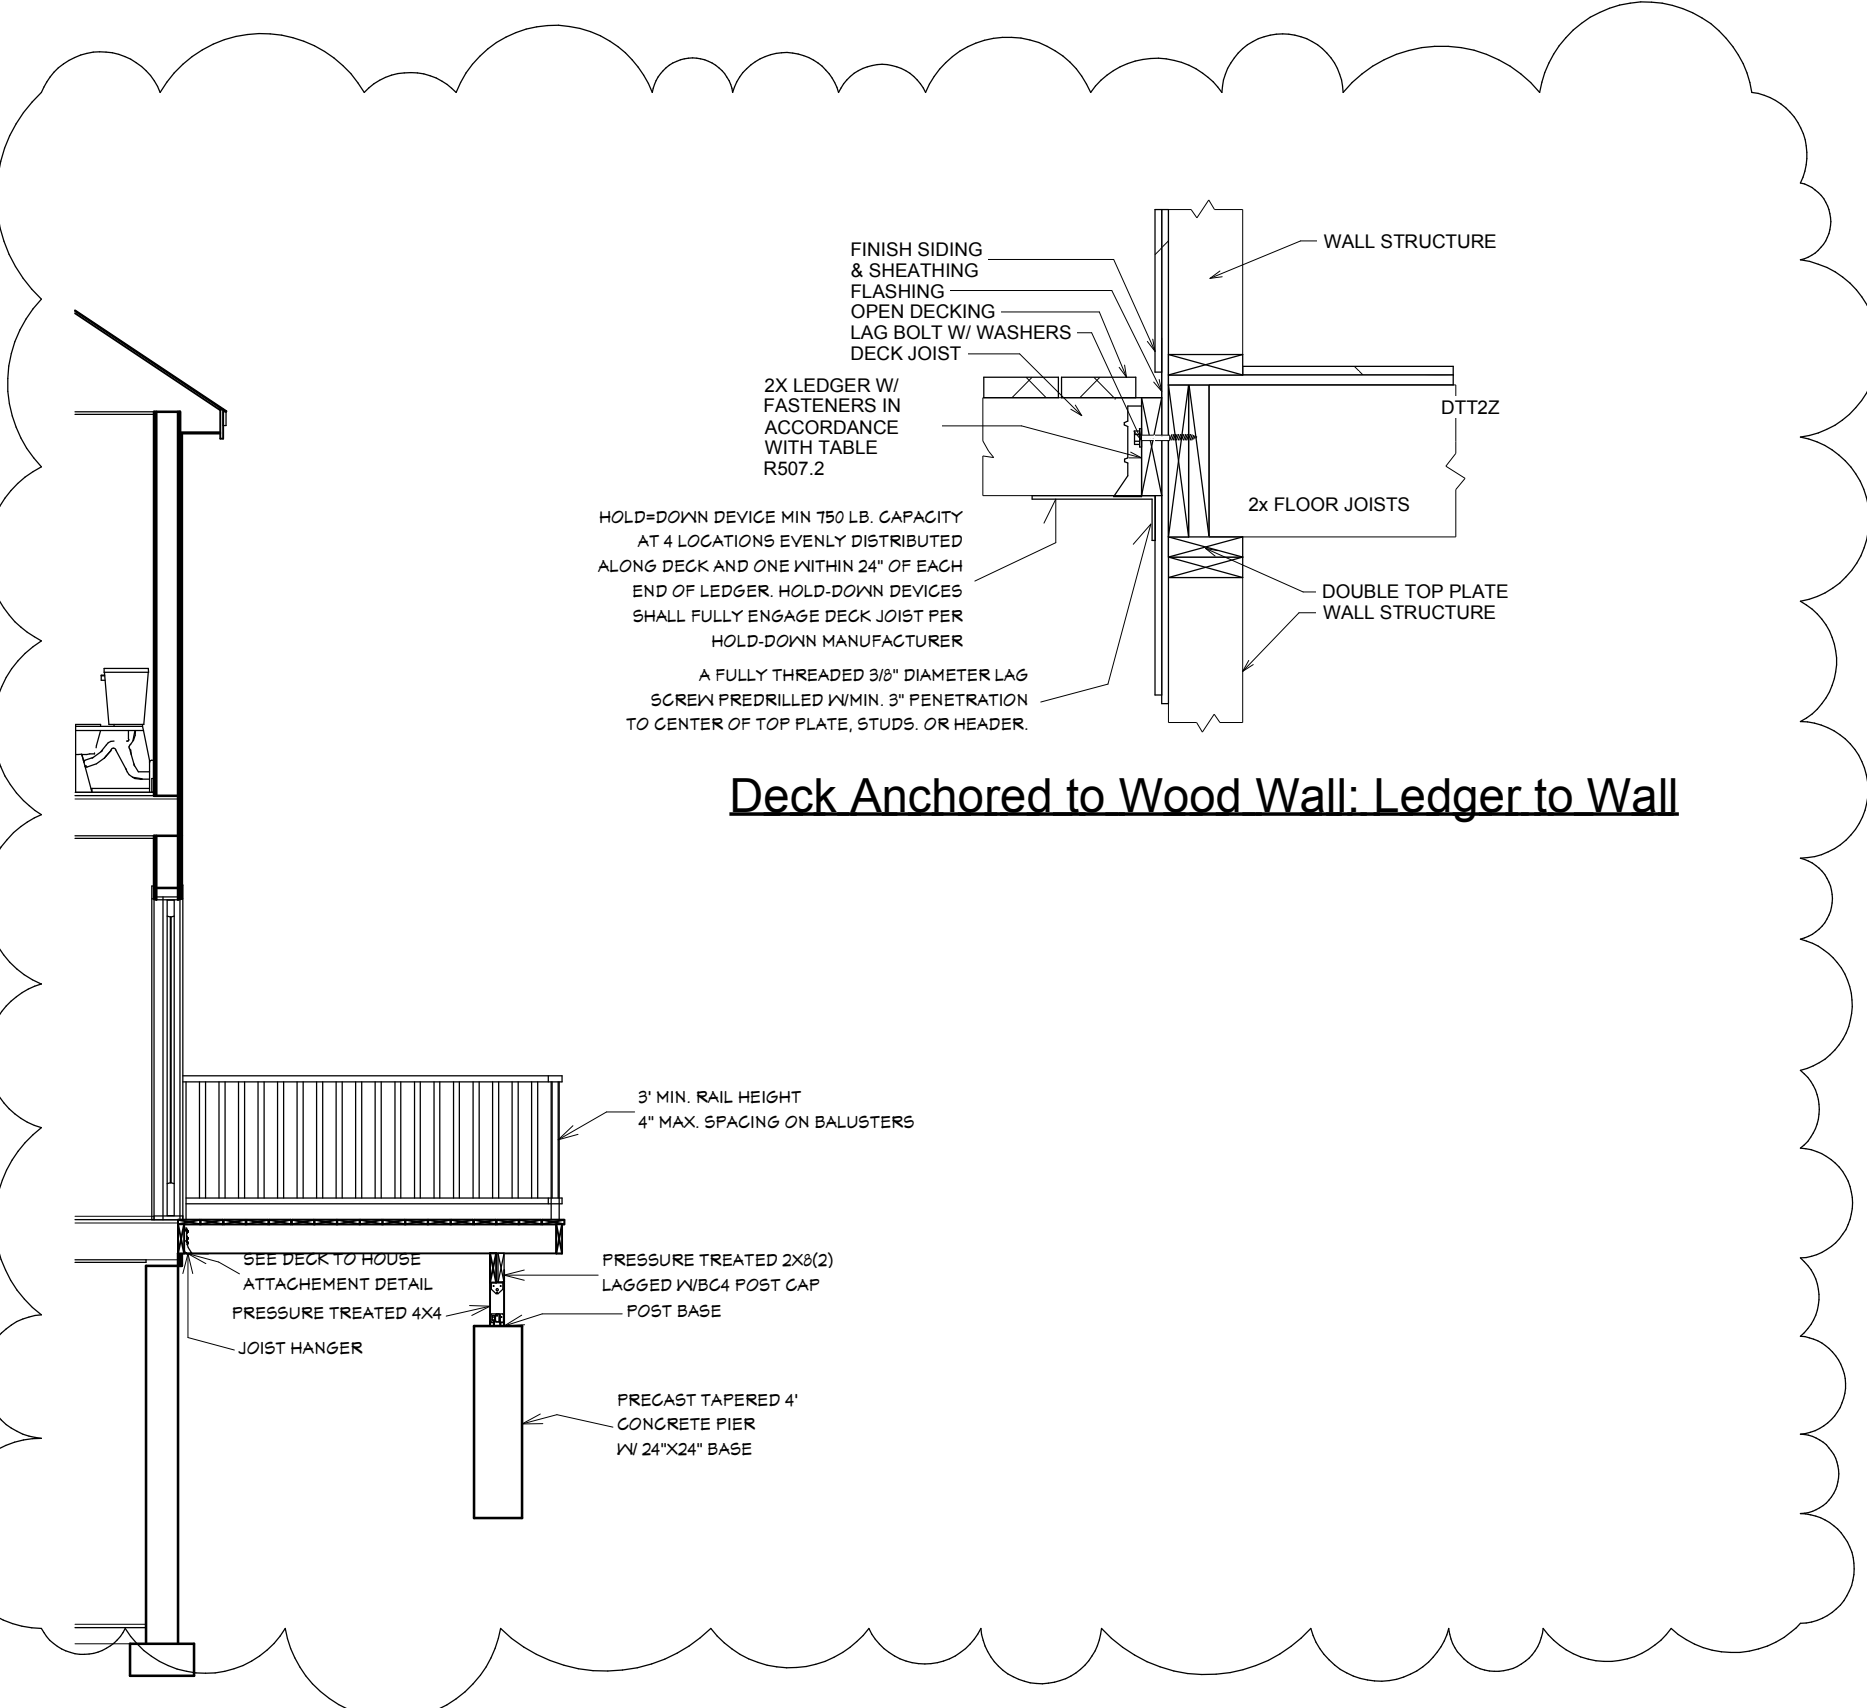

Cross Section 2

HIGGINS #13

DRAWINGS PROVIDED BY:

DATE:
7/13/2018


SCALE:
AS NOTED

SHEET:
P-3



Reviewed for Code Compliance
 Permitting and Inspections Department
 Approved with Conditions


07/19/2018

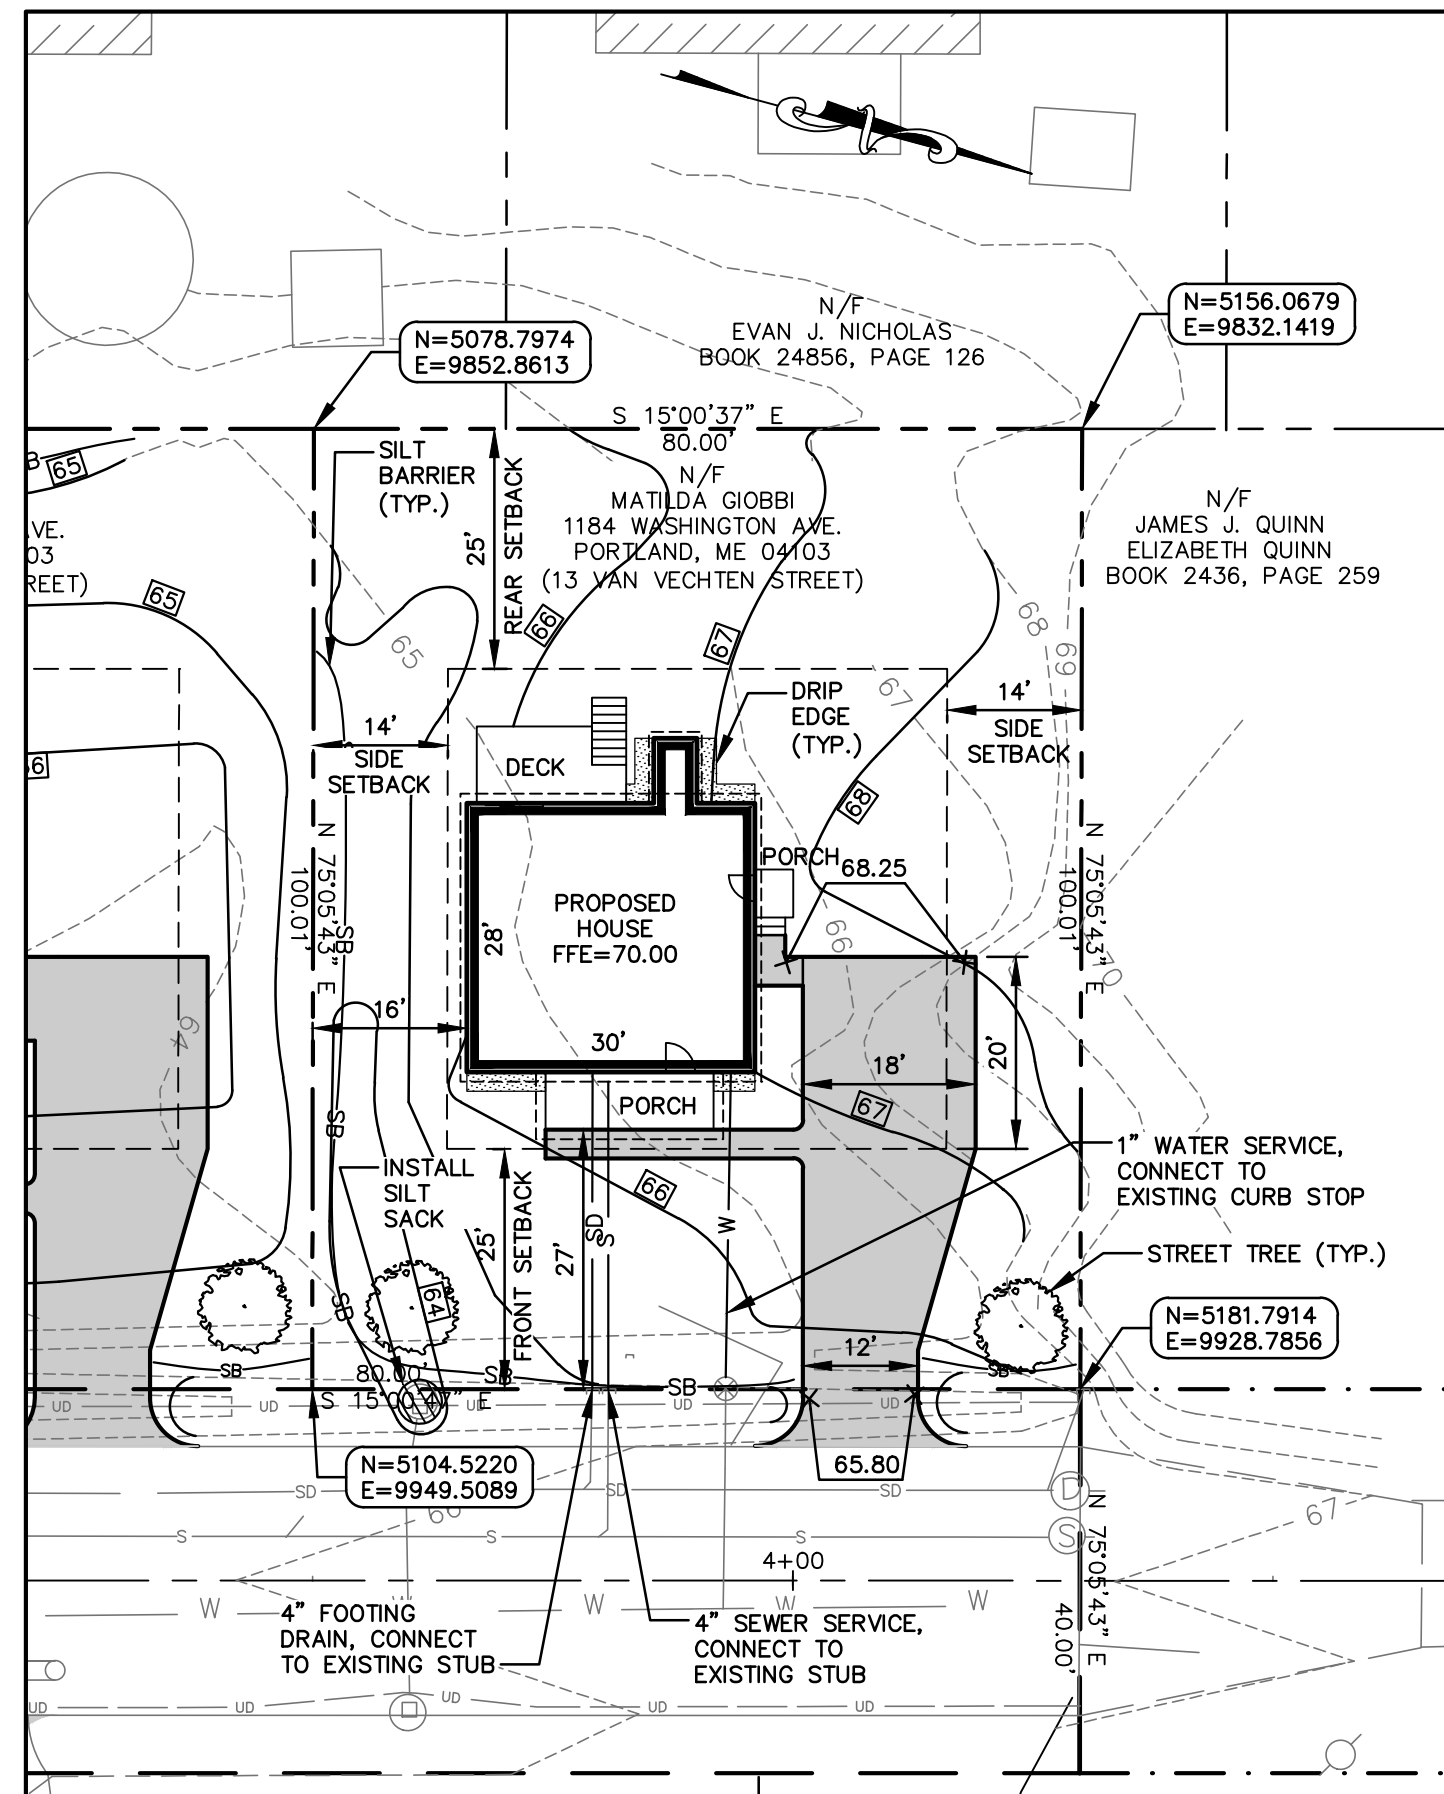

EXISTING	LEGEND	PROPOSED
— — — — —	RIGHT-OF-WAY	— — — — —
— — — — —	PROPERTY LINE	— — — — —
— — — — —	ABUTTER PROPERTY LINE	— — — — —
— — — — —	SETBACK LINE	— — — — —
▨ ▨ ▨ ▨ ▨	BUILDING	▨ ▨ ▨ ▨ ▨
— — — — —	EDGE OF PAVEMENT	— — — — —
— W — — —	WATER LINE	— W — — —
— S — — —	SEWER LINE	— S — — —
— SD — — —	STORM DRAIN	— SD — — —
— UD — — —	UNDERDRAIN	— UD — — —
○	CATCH BASIN	○
○	DRAIN MANHOLE	○
○	SEWER MANHOLE	○
⊗	CURB STOP	⊗
— 65 — — —	CONTOUR	— 65 — — —
— — — — —	STREET TREE	— — — — —
— — — — —	WETLAND	— — — — —
— — — — —	FOUNDATION DRAIN	— — — — —
— — — — —	SILT BARRIER	— — — — —
— — — — —	SILT SACK	— — — — —

NOTES:

- PLAN REFERENCE: "PLAN PROFILE, STREET EXTENSION, VAN VECHTEN STREET, PORTLAND, MAINE" BY DALFONSO ENGINEERING, DATED 10/12/2016, APPROVED PER CITY CODE SECTION 14-403, 11/08/2016.
- RECORD OWNER: MATILDA GIOBBI, 1184 WASHINGTON AVE. PORTLAND, ME 04103, CCRD BOOK 17863, PAGE 069.
- ELEVATIONS: DIMENSIONS REFERENCE CITY DATUM (NGVD 1929).
- TAX MAP REFERENCE: 410-C-30001
- ZONING: R-3
- SOIL TYPE: FROM NRCS SOIL MAP "SN" SCANTIC SILT LOAM.
- PARCEL AREA: 8,001 S.F.
- IMPERVIOUS AREA:
 HOUSE = 870 S.F.
 PORCH = 221 S.F.
 WALKWAY = 103 S.F.
 DRIVEWAY = 805 S.F.

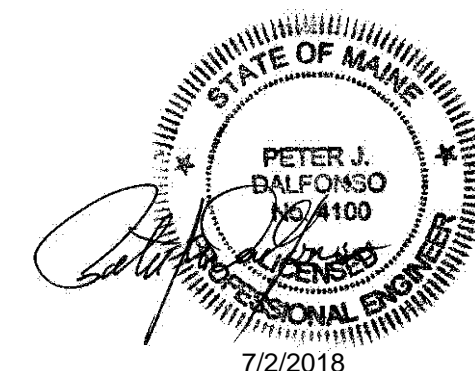

REV.	DATE	REVISION DESCRIPTION	DRAWN	CHK'D
3	6/19/2018	REVISED PER CITY COMMENTS	DB	PJD
2	6/05/2018	REVISED PER CITY COMMENTS	DB	PJD
1	4/05/2018	SUBMITTED FOR BUILDING PERMIT	DB	PJD

SITE PLAN

13 VAN VECHTEN STREET
 PORTLAND, MAINE

Client: **HIGGINS BUILDERS, INC.**
 83 BAY STREET
 PORTLAND, MAINE 04103

Prepared by:	DATE:	3/16/2018
Dalfonso Engineering	PROJ. #:	118
CIVIL ENGINEERING SERVICES 17 Ledge Hill Road Gorham, Maine 04038 Phone: 207-749-4801 Email: pjdal@maine.rr.com	SCALE:	1"=20'
		3 OF 4

