

ELECTRICAL MOUNTING HEIGHTS

ITEM	HEIGHT A.F.F. TO CENTER LINE
THERMOSTATS	48"
DOOR HOLDERS	75" TO CENTER
EMERGENCY CALL	49"
SPEAKERS & PULL STATIONS	42"
WALL LIGHTS IN CORRIDORS	80" TO CENTER LINE
EXTERIOR WALL LIGHTS	96" TO CENTER LINE (I.N.O.)
OUTLETS (COMMON AREAS)	17"
OUTLETS (SUITE AREAS)	24"
LIGHT SWITCH	44"
COUNTER OUTLETS	44" TO BOTTOM
STAIR LIGHTS	2" TO BOTTOM, ABOVE TREAD
ELECTRICAL PANEL	80" TO TOP OF PANEL
BATHROOM WALL VANITY LIGHT	65" TO CENTER (SEE NOTE #1)


NOTES:
 1. CENTER OVER CABINET BASE PROVIDE BACKING IF REQUIRED.
 2. INFORMATION SHOWN FOR REFERENCE. CONFORM TO ARCH, ADA, AND CODE REQUIREMENTS.

GENERAL NOTES:

SEE ELECTRICAL E5.X SHEETS FOR TYPICAL ELECTRICAL IN RESIDENTIAL SUITES. BASEBOARD AND WALL HEATERS TO BE WHITE.
 CONNECT SUITES TO PANELS AS INDICATED ON POWER PLANS.
 CONSULT FINISH SCHEDULE FOR CEILING TYPE IN COMMON AREAS. COORDINATE FIXTURE TYPE AND MOUNTING WITH CEILING TYPE.
 SEE LIGHT FIXTURE PROTECTION DETAIL ON 6/E2.2B AND TYPICAL FOR RECESSED LIGHT FIXTURES AND EXHAUST FANS IN FIRE RATED CEILINGS. MODIFY DETAIL AS NEEDED TO MATCH UNIT INSTALLED.
 PENETRATIONS OF FIRE RATED CONSTRUCTION OR DRAFT STOP CONSTRUCTION TO BE INSTALLED AND PROTECTED AS REQUIRED BY LOCAL CODES AND BUILDING AUTHORITY. SEE ARCH. FOR REQUIREMENTS.
 ELECTRICAL CONTRACTOR RESPONSIBLE FOR DETERMINING NUMBER AND SIZE OF CONDUCTORS, GROUND, AND NEUTRAL WIRES. SEE PANEL SCHEDULES FOR MIN. SIZES.
 COORDINATE MECHANICAL EQUIPMENT ELECTRICAL CONNECTIONS WITH MECHANICAL DRAWINGS AND EQUIPMENT FURNISHED. VERIFY LOCATIONS, CHARACTERISTICS AND LOADS, AND ADJUST WIRE AND BREAKER SIZES AS NEEDED. CONNECT PERIPHERALS AND INTERLOCK WITH OTHER MECHANICAL EQUIPMENT AS SHOWN ON MECHANICAL DRAWINGS OR AS REQUIRED.
 PROVIDE DUCT SMOKE (PHOTO TYPE) DETECTORS AT RETURN OF AIR HANDLING EQUIPMENT IF REQUIRED BY LOCAL CODE.
 CONNECT DUCT SMOKE DETECTORS TO SHUT DOWN AIR HANDLING UNIT AND PROVIDE REMOTE RESET LIGHT/ALARM IN CORRIDOR WALL CLOSEST TO UNIT. CONNECT SMOKE DETECTOR OUTPUT TO FIRE ALARM PANEL.
 CONNECT CORRIDOR NON-EMERGENCY LIGHTING THROUGH AUTOMATIC LIGHTING CONTROLLER LOCATED IN MECHANICAL ROOM.
 PROVIDE LINK SEAL LINK SLEEVE AT BUILDING ELECTRICAL PENETRATIONS IN FOUNDATION OR WHERE EXPOSED TO EARTH/ELEMENTS.
 PROVIDE WARNING SIGN AT DISCONNECTS THAT SERVE EQUIPMENT LOCATIONS WITH MORE THAN ONE DISCONNECT. EQUIPMENT WITH MORE THAN ONE DISCONNECT SHALL HAVE LOCKABLE DISCONNECTS.
 DO NOT USE HAMMERS OR BLUNT FORCE DEVICES TO "KNOCK-OUT" WIREWAYS IN BUILDING MATERIALS MAINTAIN NOT LESS THAN 18" FROM EDGE OF JOISTS. SEE DETAIL #1/E2.2B AND #14/E2.2B FOR ALLOWABLE BORING/NOTCHING OF MEMBERS. SEE ARCH FOR REQUIREMENTS. CIRCUIT "E" DESIGNATED LIGHT AND RECEPTABLES FIXTURES TO EMERGENCY PANEL.


ELECTRICAL KEY NOTES:

- CONNECT 120 VOLT SINGLE PHASE WASHING MACHINE. PROVIDE ONE CIRCUIT FOR EACH MACHINE. (MOUNT 40" A.F.F.)
- CONNECT 120 VOLT SINGLE PHASE GAS CLOTHES DRYER. PROVIDE ONE CIRCUIT FOR EACH MACHINE. RUN 3/4" EMT FROM 1ST FLOOR LAUNDRY ROOM TO ATTIC FOR FUTURE DRYER BOOSTER FAN. (MOUNT 40" A.F.F.)
- ELECTRIC RANGE. PROVIDE NEMA 14-50R 50 AMP 120/208VOLT SINGLE PHASE RANGE RECEPTACLE AT 6" A.F.F.
- ENTRY CANOPY / EXIT LIGHTS. CONNECT TO EXTERIOR LIGHTING CONTROL. SEE DETAIL 3/E2.2b
- NOT USED
- PROVIDE TYPE "V" FIXTURE AND GFI RECEPTACLE IN ELEVATOR PIT. DO NOT CONNECT ON SAME CIRCUIT. MOUNT SWITCH IN PIT. MOUNT FIXTURES TO AVOID CAR.
- PROVIDE 20 AMP ELEVATOR CAB LIGHT FUSED DISCONNECT IN EQUIPMENT ROOM CIRCUITED TO EMERGENCY PANEL. FUSE SIZE PER MANUFACTURER.
- TO EXTERIOR PARKING AREA PATHWAY AND LANDSCAPE LIGHTING. CIRCUIT TO PANEL VIA EXTERIOR LIGHTING CONTROL. SEE SITE PLAN DRAWING(S) FOR LOCATIONS AND QUANTITIES.
- ELECTRICAL MAIN DISTRIBUTION PANEL. SEE ONE-LINE.
- DOMESTIC COLD WATER AND FIRE SPRINKLER SERVICE ENTRANCES FOR GROUNDING. COORDINATE WITH PLUMBING CONTRACTOR.
- EMERGENCY STANDBY ENGINE GENERATOR. SEE SPECIFICATIONS. SEE SITE (E1.0/A.1.1) PLAN FOR LOCATION.
- AUTOMATIC TRANSFER SWITCH FURNISHED AS PART OF ENGINE GENERATOR PACKAGE. SEE SPECIFICATIONS AND ONE-LINE.
- PROVIDE FUSED DISCONNECT ELEVATOR MODULE WITH INTEGRAL SHUNT-TRIP FOR ELEVATOR MACHINE. COORDINATE FUSE REQUIREMENTS WITH ELEVATOR MANUFACTURER. CONNECT TO FIRE ALARM AND REMOTE SHUNT-TRIP SWITCH. COOPER BUSMAN, EATON ELEVATOR CONTROL SWITCH ES SERIES, OR APPROVED.
- TELEPHONE TERMINAL BOARD. SEE TELEPHONE SECTION OF SPECIFICATIONS. PROVIDE DOUBLE DUPLEX RECEPTACLE MOUNTED ON BACKBOARD AND TWO DEDICATED CIRCUITS AND #6 EQUIPMENT GROUND CONNECTED TO GROUND BUS AT MOP.
- IRRIGATION CONTROL PANEL. PROVIDE RECEPTACLE ON DEDICATED CIRCUIT. STUB OUT A 2" PVC CONDUIT TO EXTERIOR OF BUILDING. COORDINATE LOCATION AND REQUIREMENTS WITH IRRIGATION CONTRACTOR.
- POWER DOOR CONNECTED TO ATRium SMOKE CONTROL SYSTEM. SEE DETAIL 15/E2.2b AND SEQUENCE OF OPERATION ON E.1.7. (SEE SPECIFICATION SECTION 16100 FOR ADDITIONAL WIRING REQUIREMENTS.)
- INSTALL RECEPTACLE HORIZONTALLY.
- LOCATE FIXTURES IN ATTIC SPACE FOR EACH WING. MOUNT IN AREAS TO PROVIDE LIGHT FOR MAINTENANCE USE. PROVIDE PILOT LIGHT SWITCH AT EACH ACCESS INSIDE OF STAIR DOOR.
- PROVIDE WEATHERPROOF LIGHT FIXTURE AND WEATHERPROOF GFI RECEPTACLE WITHIN 10 FEET OF MECHANICAL EQUIPMENT. COORDINATE LOCATION WITH MECHANICAL.
- KITCHEN MAKE-UP AIR UNIT. ROUTE FAN POWER CONDUCTORS THROUGH SUPPLY VFD#1 LOCATED IN ENERGY MANAGEMENT SYSTEM (EMS) CONTROL PANEL LOCATED ON THE SIDE OF THE KITCHEN HOOD. PROVIDE ONE 3/4" CONDUIT FOR CONTROL WIRING FROM EMS CONTROL PANEL TO MAKE-UP AIR UNIT. PROVIDE TWO SETS OF 2-WIRE 16 AWG SHIELDED MULTI-CONDUCTOR CABLES BETWEEN MAIN AND EMS PANEL. DO NOT ROUTE CONTROL CABLE ADJACENT TO HIGH POWER WIRING. COORDINATE WITH KITCHEN HOOD VENTILATION CONTROL CONSULTANT DRAWINGS H-3 AND H-4. ACTIVATION OF ANSUL SYSTEM SHALL SHUT DOWN MAKE-UP AIR UNIT.
- THR-U-WALL HVAC UNIT. SEE MECHANICAL SPECIFICATION. FURNISHED BY OWNER. INSTALLED BY MECHANICAL CONTRACTOR. CONNECTED BY ELECTRICAL CONTRACTOR.
- GAS FIRED WATER HEATERS. CIRCUIT ELECTRICAL GAS WATER HEATER CONNECTIONS TO BACK-UP POWER PANEL.
- HOT WATER RECIRCULATING PUMPS. FRACTIONAL HORSEPOWER 120V SINGLE PHASE. CIRCUIT TO BACK-UP POWER PANEL.
- AC-1 PACKAGED ROOFTOP GAS PACK AIR CONDITIONING EQUIPMENT. SEE MECHANICAL EQUIPMENT SCHEDULE. SEE DETAIL 17/E2.2b.
- KITCHEN RANGE HOOD EXHAUST FAN. ROUTE FAN POWER CONDUCTORS THROUGH EXHAUST VENT LOCATED IN ENERGY MANAGEMENT SYSTEM (EMS) CONTROL PANEL LOCATED ON THE SIDE OF THE KITCHEN HOOD. COORDINATE WITH KITCHEN HOOD VENTILATION CONTROL CONSULTANT DRAWINGS H-2 AND H-4. FUSE SIZE PER MANUFACTURER.
- NOT USED
- EP-409. CONNECT TO EMERGENCY PANEL. SEE DETAILS ON M4.2. FUSE PER MANUFACTURER AND NEC. SEE SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS SPECIFIC TO THIS EQUIPMENT. SEE DETAIL 15/E2.2b.
- AC-2 PACKAGED ROOFTOP GASPACK AIR CONDITIONING EQUIPMENT. SEE MECHANICAL EQUIPMENT SCHEDULE. FUSE PER MANUFACTURER. SEE DETAIL 17/E2.2b.
- COORDINATE LIGHTING WITH EQUIPMENT. CHAIR OR SURFACE MOUNT.
- MOUNT LIGHTS, RECEPT., SWITCHES AND TIMERS ON WALL NEXT TO CATWALK.
- 3F-2 SUPPLY FAN FOR COOLING AND HEATING CORRIDORS. SEE MECHANICAL EQUIPMENT SCHEDULE FOR DESCRIPTION. SEE DETAIL 17/E2.2b.
- 11/2 HP ATTIC FAN ON ROOF. PROVIDE INDIVIDUAL DISCONNECTS. MECHANICAL FAN CONTROL 12" BELOW ROOF SHEATHING ON WALL NEXT TO CATWALK. SEE DETAIL 9/E2.2b.
- OMARK MUH-03-81 RATED 3KW AT 208 VOLT 1 PHASE. SUSPENDED FROM CEILING. CONTROLLED BY REMOTE WALL THERMOSTAT.
- 30 AMP 2 POLE CIRCUIT FOR COMBO WASHER & DRYER UNIT.
- PROVIDE POWER FOR GAS FIRE PLACE PER MANUFACTURER REQUIREMENTS. PROVIDE SWITCH FOR FAN AND IGNITOR.
- LOCATION OF FUTURE DOOR (DO NOT CIRCUIT (WIRE) IN THIS LOCATION).
- NOT USED
- AREA OF RESCUE ASSISTANCE ANNUNCIATOR. CORNELL 4200 SERIES. WIRE PER MANUFACTURER REQUIREMENTS. NOT LESS THAN #12 AWG. COPPER FOR POWER. PROVIDE BATTERY BACKUP BY MANUFACTURER AND LOCATE ABOVE CEILING IN OFFICE 151. SEE 1/E5.1. LABEL ANNUNCIATOR PER AHA REQUIREMENTS. SYSTEM PROVIDED BY OWNER.
- AREA OF RESCUE CALL STATION. CORNELL 4200 SERIES. CONNECT TO ANNUNCIATOR PANEL IN FOYER. PER MANUFACTURER REQUIREMENTS. SYSTEM PROVIDED BY OWNER.
- EMERGENCY CALL REMOTE HEAD END. VERIFY LOCATION AND ELECTRICAL REQUIREMENTS WITH GENERAL CONTRACTOR.
- SHUT DOWN KITCHEN EQUIPMENT AND RECEPTACLE POWER UNDER HOOD UPON ACTIVATION OF ANSUL SYSTEM. SEE KITCHEN DRAWINGS.
- GFI RECEPTACLE @ 48 FOR WATER SOFTENER. CONNECT TO DEDICATED 120V CIRCUIT. OWNER SUPPLIED WATER SOFTENER. CONTRACTOR TO INSTALL.
- FRACTIONAL HP FAN MOTOR, 120V. CONNECT TO SWITCHED LEG OF LIGHTING CIRCUIT.
- PROVIDE GFI BREAKER.
- KITCHEN WALK-IN FREEZER & COOLER CONDENSING UNITS. REFER TO KITCHEN PLANS.
- FIRE/SMOKE DAMPER CONNECTION. CIRCUIT TO BACK-UP POWER PANEL. SEE DETAIL 12/E2.2b. DO NOT CONNECT MORE THAN SEVEN FSD'S TO EACH CIRCUIT.
- EMERGENCY CALL SYSTEM BACK BOARD. PROVIDE RECEPTACLE ON DEDICATED CIRCUIT.
- NOT USED
- BROWN MODEL 154 LOW PROFILE CEILING HEATER. 120 VOLT, 1,250 WATTS. WITH MODEL 86W LINE-VOLTAGE THERMOSTAT.
- PROVIDE UN-SWITCHED/UNCONTROLLED HOT TO EXIT SIGNS, TYPICAL.
- WIRE ATTIC LIGHTS TO EMERGENCY CIRCUIT.
- PROVIDE #6 CU GROUND WIRE FOR P.A. SYSTEM TO BUILDING GROUND IN MECHANICAL ROOM.
- ELECTRIC DRYER-VERIFY ELEC. REQUIREMENTS.
- WIRE FOR FUTURE THRU-WALL PTAC UNIT TO REPLACE BASEBOARD IN "C" UNIT BEDROOMS. SEE DETAIL "C" UNIT, TYPICAL. "ON E5.X SERIES. DO NOT CIRCUIT (WIRE) IN THIS LOCATION.
- PROVIDE EMERGENCY POWER SWITCH/DIMMER BYPASS RELAY. SEE DETAIL 5/E2.2b.
- PROVIDE SEPARATE BOX FOR EMERGENCY CIRCUIT.
- CONNECT VIA LIGHTING CONTROLLER. SEE DETAIL 3/E2.2b.
- SINGLE POINT POWER CONNECTION. PROVIDE CONNECTION TO EXTERIOR CONDENSING UNIT. SEE MECHANICAL.
- PROVIDE CONDUCTORS FOR BASEBOARD CONNECTIONS. INCLUDE REMOTE THERMOSTAT WIRING.
- ONLY HEAT AND FAN TO OPERATE WHEN EMERGENCY POWER IS IN OPERATION. PROVIDE DUAL CONNECTION TO UNIT. MECHANICAL UNIT MODIFICATIONS IS NOT ACCEPTABLE. SEE MECHANICAL.
- PROVIDE CF-1 CEILING FAN WITH SEPARATE SWITCH FOR FAN AND LIGHT. SEE E5 SHEETS.

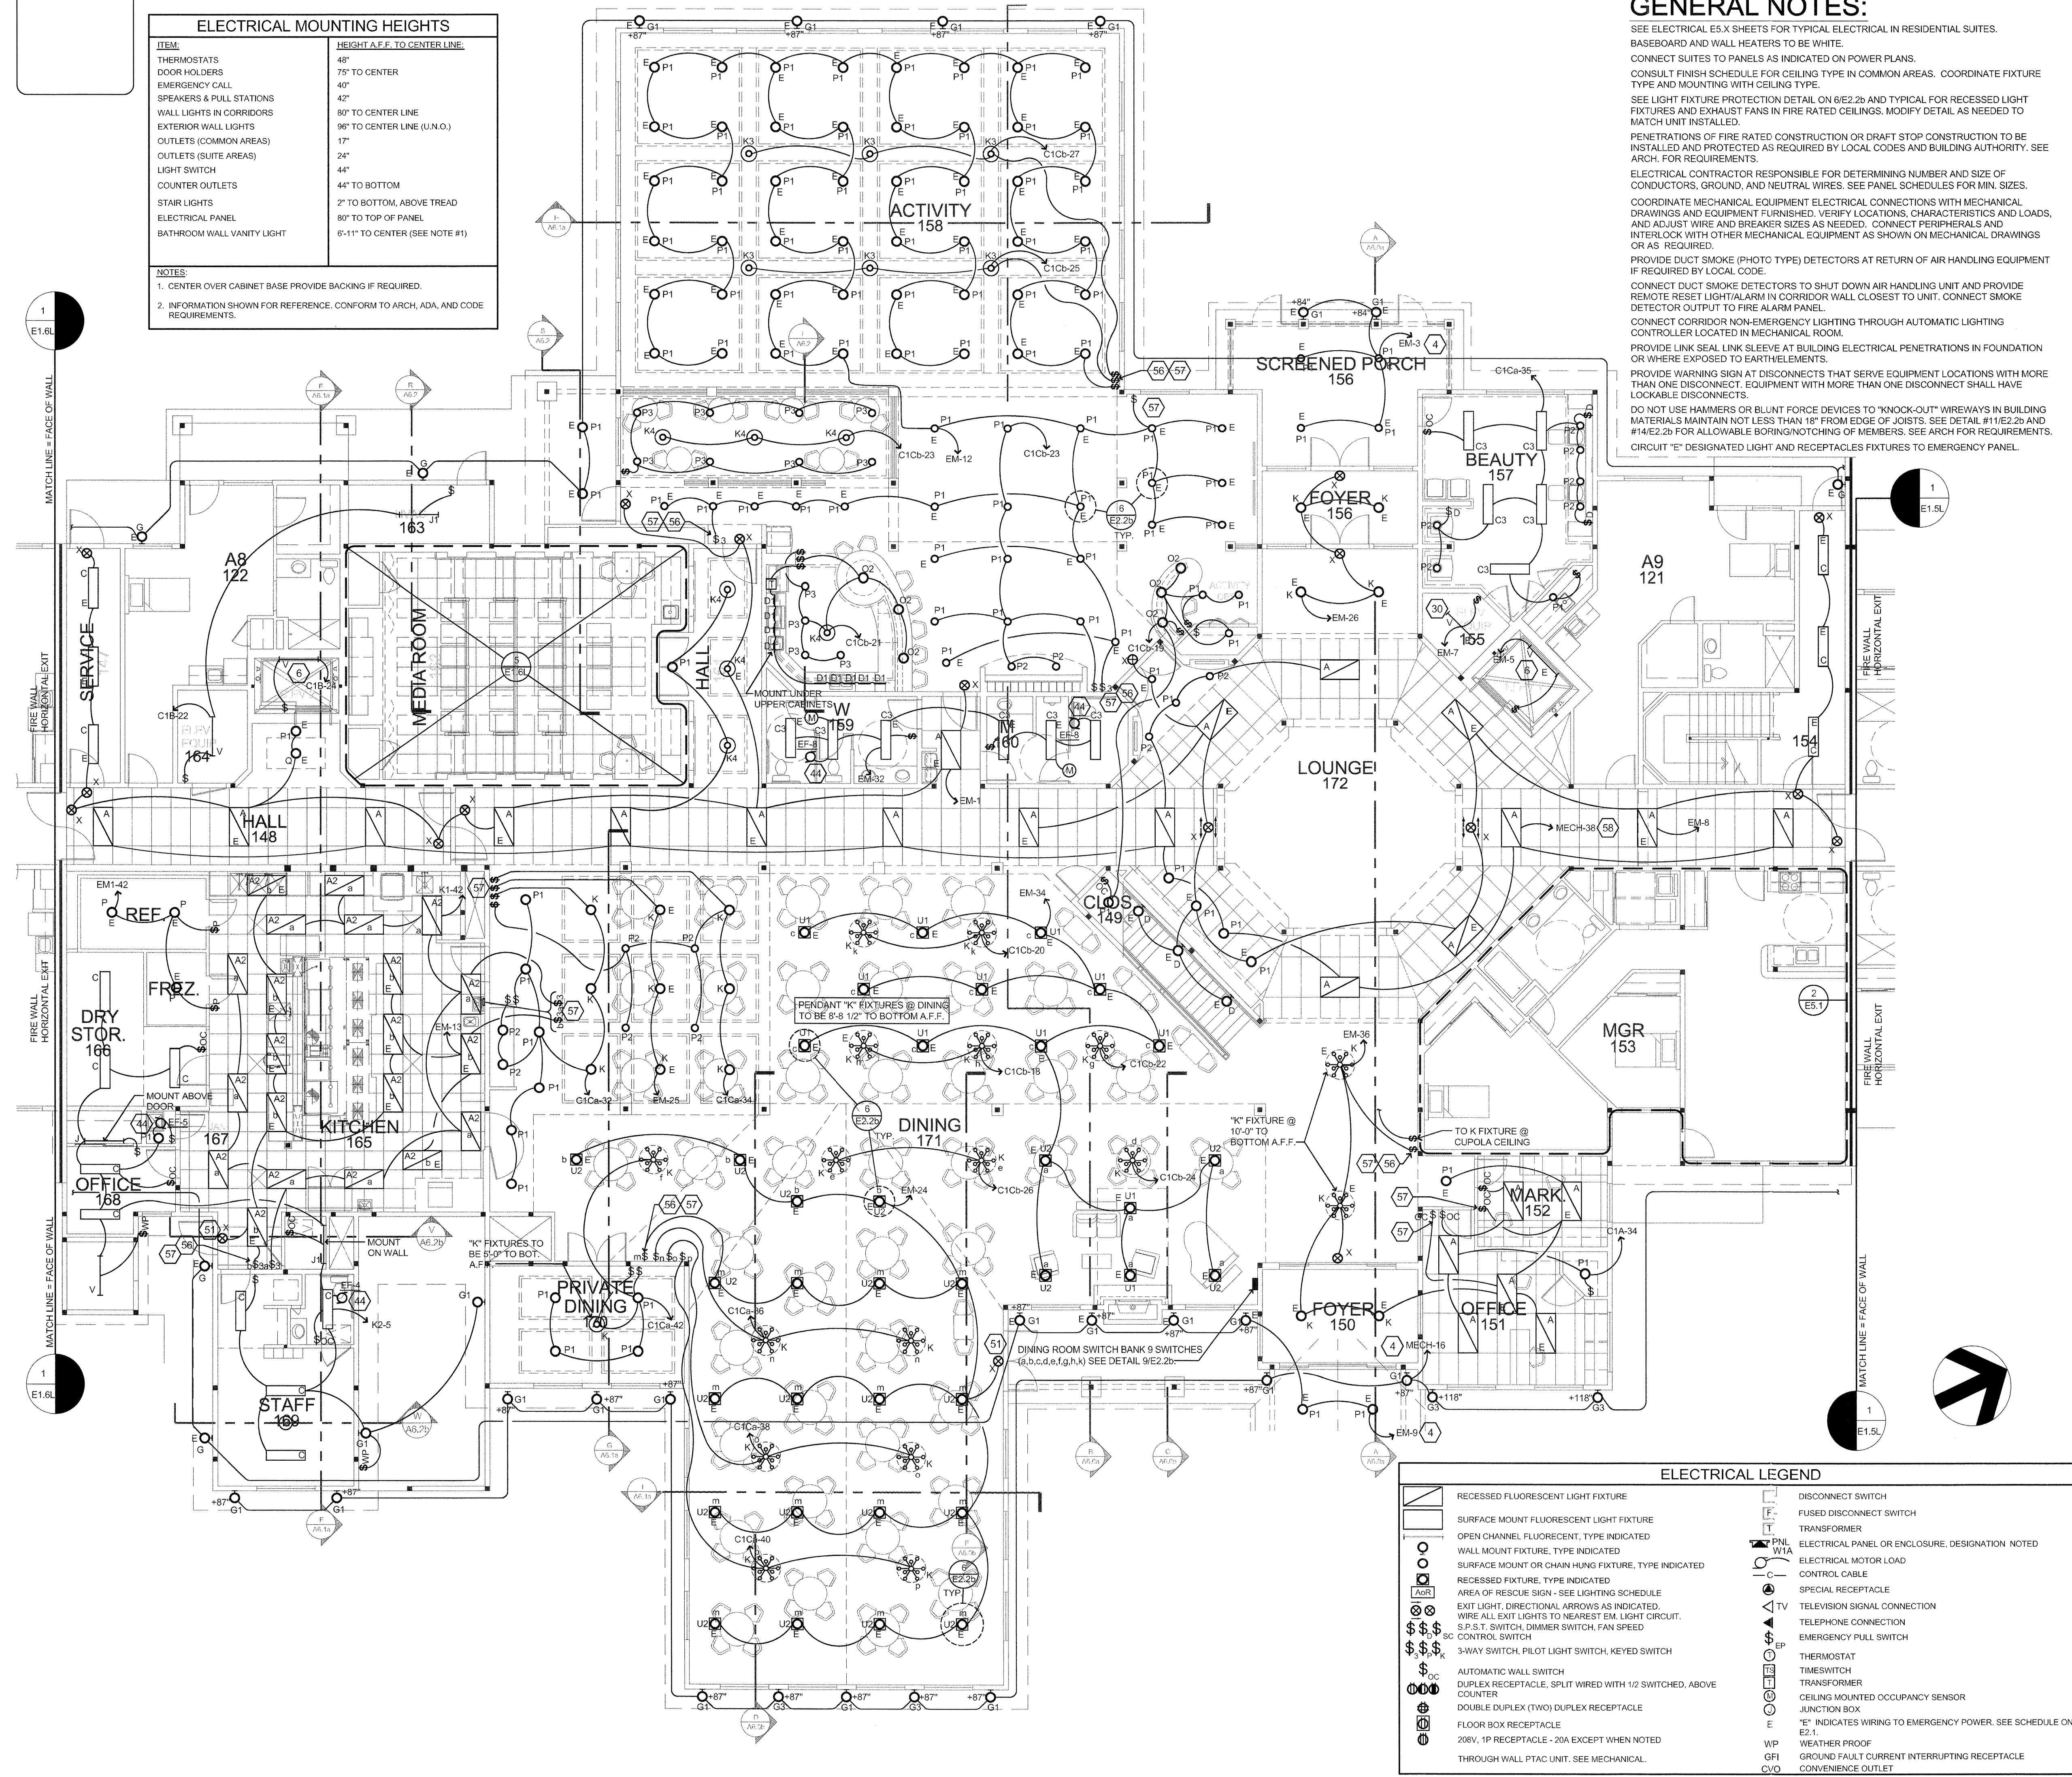

ELECTRICAL LEGEND

(Symbol: Square with diagonal lines)	RECESSED FLUORESCENT LIGHT FIXTURE	(Symbol: Square with 'F')	DISCONNECT SWITCH
(Symbol: Square with horizontal lines)	SURFACE MOUNT FLUORESCENT LIGHT FIXTURE	(Symbol: Square with 'F' and 'T')	FUSED DISCONNECT SWITCH
(Symbol: Square with vertical lines)	OPEN CHANNEL FLUORESCENT, TYPE INDICATED	(Symbol: Square with 'T')	TRANSFORMER
(Symbol: Square with diagonal lines and 'W')	WALL MOUNT FIXTURE, TYPE INDICATED	(Symbol: Square with 'PNL' and 'W/A')	ELECTRICAL PANEL OR ENCLOSURE, DESIGNATION NOTED
(Symbol: Circle with 'S')	SURFACE MOUNT OR CHAIN HUNG FIXTURE, TYPE INDICATED	(Symbol: Square with 'C')	ELECTRICAL MOTOR LOAD
(Symbol: Square with diagonal lines and 'R')	RECESSED FIXTURE, TYPE INDICATED	(Symbol: Square with 'C' and 'R')	ELECTRICAL CABLE
(Symbol: Square with diagonal lines and 'A')	AREA OF RESCUE SIGN - SEE LIGHTING SCHEDULE	(Symbol: Square with 'C' and 'S')	SPECIAL RECEPTACLE
(Symbol: Square with diagonal lines and 'D')	EXIT LIGHT, DIRECTIONAL ARROWS AS INDICATED	(Symbol: Square with 'TV')	TELEVISION SIGNAL CONNECTION
(Symbol: Square with diagonal lines and 'W')	WIRE ALL EXIT LIGHTS TO NEAREST EM. LIGHT CIRCUIT.	(Symbol: Square with 'T')	TELEPHONE CONNECTION
(Symbol: Square with diagonal lines and 'S.P.S.T.')	S.P.S.T. SWITCH, DIMMER SWITCH, FAN SPEED CONTROL SWITCH	(Symbol: Square with 'EP')	EMERGENCY PULL SWITCH
(Symbol: Square with diagonal lines and '3-WAY')	3-WAY SWITCH, PILOT LIGHT SWITCH, KEYED SWITCH	(Symbol: Square with 'T')	THERMOSTAT
(Symbol: Square with diagonal lines and 'A.W.S.')	AUTOMATIC WALL SWITCH	(Symbol: Square with 'TS')	TIMESWITCH
(Symbol: Square with diagonal lines and 'D.R.')	DUPLEX RECEPTACLE, SPLIT WIRED WITH 1/2 SWITCHED, ABOVE COUNTER	(Symbol: Square with 'TR')	TRANSFORMER
(Symbol: Square with diagonal lines and 'D.D.')	DOUBLE DUPLEX (TWO) DUPLEX RECEPTACLE	(Symbol: Square with 'O.S.')	CEILING MOUNTED OCCUPANCY SENSOR
(Symbol: Square with diagonal lines and 'F.R.')	FLOOR BOX RECEPTACLE	(Symbol: Square with 'J.B.')	JUNCTION BOX
(Symbol: Square with diagonal lines and '208V.')	208V, 1P RECEPTACLE - 20A EXCEPT WHEN NOTED	(Symbol: Square with 'E.1.')	"E" INDICATES WIRING TO EMERGENCY POWER. SEE SCHEDULE ON E5.1.
(Symbol: Square with diagonal lines and 'T.W.')	THROUGH WALL PTAC UNIT, SEE MECHANICAL	(Symbol: Square with 'WP')	WEATHER PROOF
		(Symbol: Square with 'GFI')	GROUND FAULT CURRENT INTERRUPTING RECEPTACLE
		(Symbol: Square with 'C.V.O.')	CONVENIENCE OUTLET

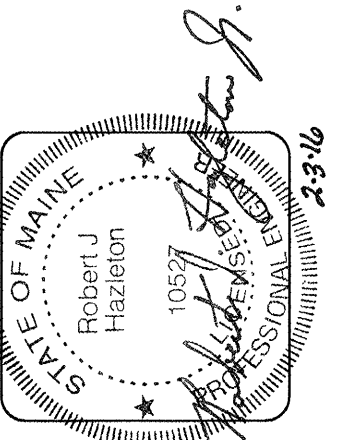

lenity
 architecture

3150 Vette Court SE, Salem, Oregon 97301
 P 503 399 1090 F 503 999 0585 wlenityarchitecture.com

COLSON AND COLSON
 GENERAL CONTRACTOR, INC.

2280 McILCHRIST STREET SE, SUITE 200
 SALEM, OREGON, 97302
 PHONE (503) 566-7401

PORTLAND
 RETIREMENT RESIDENCE

802 OCEAN AVE. PORTLAND, MAINE 04103

FIRST FLOOR
 LIGHTING
 CORE PLAN

DATE
 8/28/2015

REVISED DATE
 9/22/2015

SHEET
 E1.1L

FIRST FLOOR - LIGHTING
 SCALE: 1/8"=1'-0"