


### GENERAL NOTES:

- SEE ELECTRICAL E.S.X SHEETS FOR TYPICAL ELECTRICAL IN RESIDENTIAL SUITES. BASEBOARD AND WALL HEATERS TO BE WHITE.
- CONNECT SUITES TO PANELS AS INDICATED ON POWER PLANS.
- CONSULT FINISH SCHEDULE FOR CEILING TYPE IN COMMON AREAS. COORDINATE FIXTURE TYPE AND MOUNTING WITH CEILING TYPE.
- SEE LIGHT FIXTURE PROTECTION DETAIL ON 6/E2.2b AND TYPICAL FOR RECESSED LIGHT FIXTURES AND EXHAUST FANS IN FIRE RATED CEILINGS. MODIFY DETAIL AS NEEDED TO MATCH UNIT INSTALLED.
- PENETRATIONS OF FIRE RATED CONSTRUCTION OR DRAFT STOP CONSTRUCTION TO BE INSTALLED AND PROTECTED AS REQUIRED BY LOCAL CODES AND BUILDING AUTHORITY. SEE ARCH. FOR REQUIREMENTS.
- ELECTRICAL CONTRACTOR RESPONSIBLE FOR DETERMINING NUMBER AND SIZE OF CONDUCTORS, GROUND, AND NEUTRAL WIRES. SEE PANEL SCHEDULES FOR MIN. SIZES.
- COORDINATE MECHANICAL EQUIPMENT ELECTRICAL CONNECTIONS WITH MECHANICAL DRAWINGS AND EQUIPMENT FURNISHED. VERIFY LOCATIONS, CHARACTERISTICS AND LOADS. AND ADJUST WIRE AND BREAKER SIZES AS NEEDED. CONNECT PERIPHERALS AND INTERLOCK WITH OTHER MECHANICAL EQUIPMENT AS SHOWN ON MECHANICAL DRAWINGS OR AS REQUIRED.
- PROVIDE DUCT SMOKE (PHOTO TYPE) DETECTORS AT RETURN OF AIR HANDLING EQUIPMENT IF REQUIRED BY LOCAL CODE.
- CONNECT DUCT SMOKE DETECTORS TO SHUT DOWN AIR HANDLING UNIT AND PROVIDE REMOTE RESET LIGHT/ALARM IN CORRIDOR WALL CLOSEST TO UNIT. CONNECT SMOKE DETECTOR OUTPUT TO FIRE ALARM PANEL.
- CONNECT CORRIDOR NON-EMERGENCY LIGHTING THROUGH AUTOMATIC LIGHTING CONTROLLER LOCATED IN MECHANICAL ROOM.
- PROVIDE LINK SEAL LINK SLEEVE AT BUILDING ELECTRICAL PENETRATIONS IN FOUNDATION OR WHERE EXPOSED TO EARTHELEMENTS.
- PROVIDE WARNING SIGN AT DISCONNECTS THAT SERVE EQUIPMENT LOCATIONS WITH MORE THAN ONE DISCONNECT. EQUIPMENT WITH MORE THAN ONE DISCONNECT SHALL HAVE LOCKABLE DISCONNECTS.
- DO NOT USE HAMMERS OR BLUNT FORCE DEVICES TO "KNOCK-OUT" WIREWAYS IN BUILDING MATERIALS MAINTAIN NOT LESS THAN 18" FROM EDGE OF JOISTS. SEE DETAIL #11/E2.2b AND #14/E2.2b FOR ALLOWABLE BORING/NOTCHING OF MEMBERS. SEE ARCH FOR REQUIREMENTS.
- CIRCUIT "E" DESIGNATED LIGHT AND RECEPTABLE FIXTURES TO EMERGENCY PANEL.

SEE E1.1L FOR ELECTRICAL KEYED NOTES.

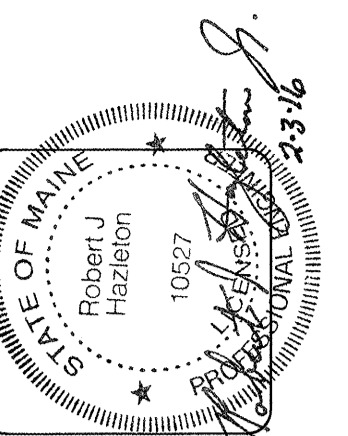

**lenity**  
architecture

3150 Kettle Court SE, Salem, Oregon 97301  
P 503 399 1090 F 503 399 0585 W lenityarchitecture.com

**COLSON AND COLSON**  
GENERAL CONTRACTOR, INC.

2200 McILCHRIST STREET SE, SUITE 200  
SALEM, OREGON, 97302  
PHONE (503) 586-7401

**PORTLAND**  
RETIREMENT RESIDENCE

802 OCEAN AVE. PORTLAND, MAINE 04103

**ATTIC LIGHT/REF. CLG. PLAN**

DATE: 8/28/2015  
REVISED DATE: 9/22/2015

SHEET E1.7L

SEE 3/4A.0 FOR MOUNTING HEIGHT

### 1 ATTIC - LIGHTING

SCALE: 1/16" = 1'-0"

ELECTRICAL MOUNTING HEIGHTS		ELECTRICAL LEGEND	
ITEM:	HEIGHT A.F.F. TO CENTER LINE:		RECESSED FLUORESCENT LIGHT FIXTURE
THERMOSTATS	48"		SURFACE MOUNT FLUORESCENT LIGHT FIXTURE
DOOR HOLDERS	75" TO CENTER		OPEN CHANNEL FLUORESCENT, TYPE INDICATED
EMERGENCY CALL	40"		WALL MOUNT FIXTURE, TYPE INDICATED
SPEAKERS & PULL STATIONS	42"		SURFACE MOUNT OR CHAIN HUNG FIXTURE, TYPE INDICATED
WALL LIGHTS IN CORRIDORS	80" TO CENTER LINE		RECESSED FIXTURE, TYPE INDICATED
EXTERIOR WALL LIGHTS	80" TO CENTER LINE (U.N.O.)		AREA OF RESCUE SIGN - SEE LIGHTING SCHEDULE
OUTLETS (COMMON AREAS)	17"		EXIT LIGHT, DIRECTIONAL ARROWS AS INDICATED.
OUTLETS (SUITE AREAS)	24"		WIRE ALL EXIT LIGHTS TO NEAREST EM. LIGHT CIRCUIT.
LIGHT SWITCH	44"		S.P.S.T. SWITCH, DIMMER SWITCH, FAN SPEED CONTROL SWITCH
COUNTER OUTLETS	44" TO BOTTOM		3-WAY SWITCH, PILOT LIGHT SWITCH, KEYED SWITCH
STAIR LIGHTS	2" TO BOTTOM, ABOVE TREAD		AUTOMATIC WALL SWITCH
ELECTRICAL PANEL	80" TO TOP OF PANEL		DUPLEX RECEPTACLE, SPLIT WIRED WITH 1/2 SWITCHED, ABOVE COUNTER
BATHROOM WALL VANITY LIGHT	6'-11" TO CENTER (SEE NOTE #1)		DOUBLE DUPLEX (TWO) DUPLEX RECEPTACLE
			FLOOR BOX RECEPTACLE
			208V, 1P RECEPTACLE - 20A EXCEPT WHEN NOTED
			THROUGH WALL PTAC UNIT. SEE MECHANICAL.
			DISCONNECT SWITCH
			FUSED DISCONNECT SWITCH
			TRANSFORMER
			ELECTRICAL PANEL OR ENCLOSURE, DESIGNATION NOTED
			ELECTRICAL MOTOR LOAD
			CONTROL CABLE
			SPECIAL RECEPTACLE
			TELEVISION SIGNAL CONNECTION
			TELEPHONE CONNECTION
			EMERGENCY PULL SWITCH
			THERMOSTAT
			TIMESWITCH
			TRANSFORMER
			CEILING MOUNTED OCCUPANCY SENSOR
			JUNCTION BOX
			"E" INDICATES WIRING TO EMERGENCY POWER. SEE SCHEDULE ON E2.1
			WP WEATHER PROOF
			GFI GROUND FAULT CURRENT INTERRUPTING RECEPTACLE
			CVO CONVENIENCE OUTLET

- NOTES:**
- CENTER OVER CABINET BASE PROVIDE BACKING IF REQUIRED.
  - INFORMATION SHOWN FOR REFERENCE. CONFORM TO ARCH, ADA, AND CODE REQUIREMENTS.

