



C2 SCALE: 1/4"=1'-0"

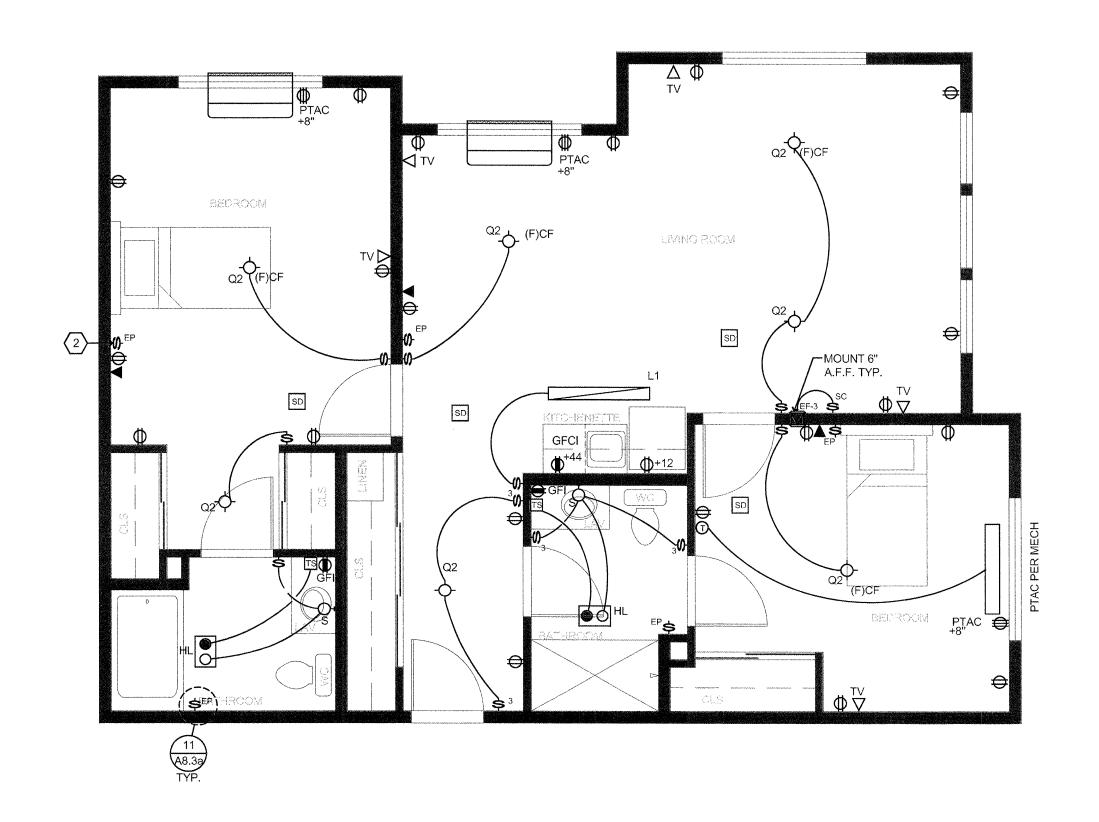

**C**3

SCALE: 1/4"=1'-0"

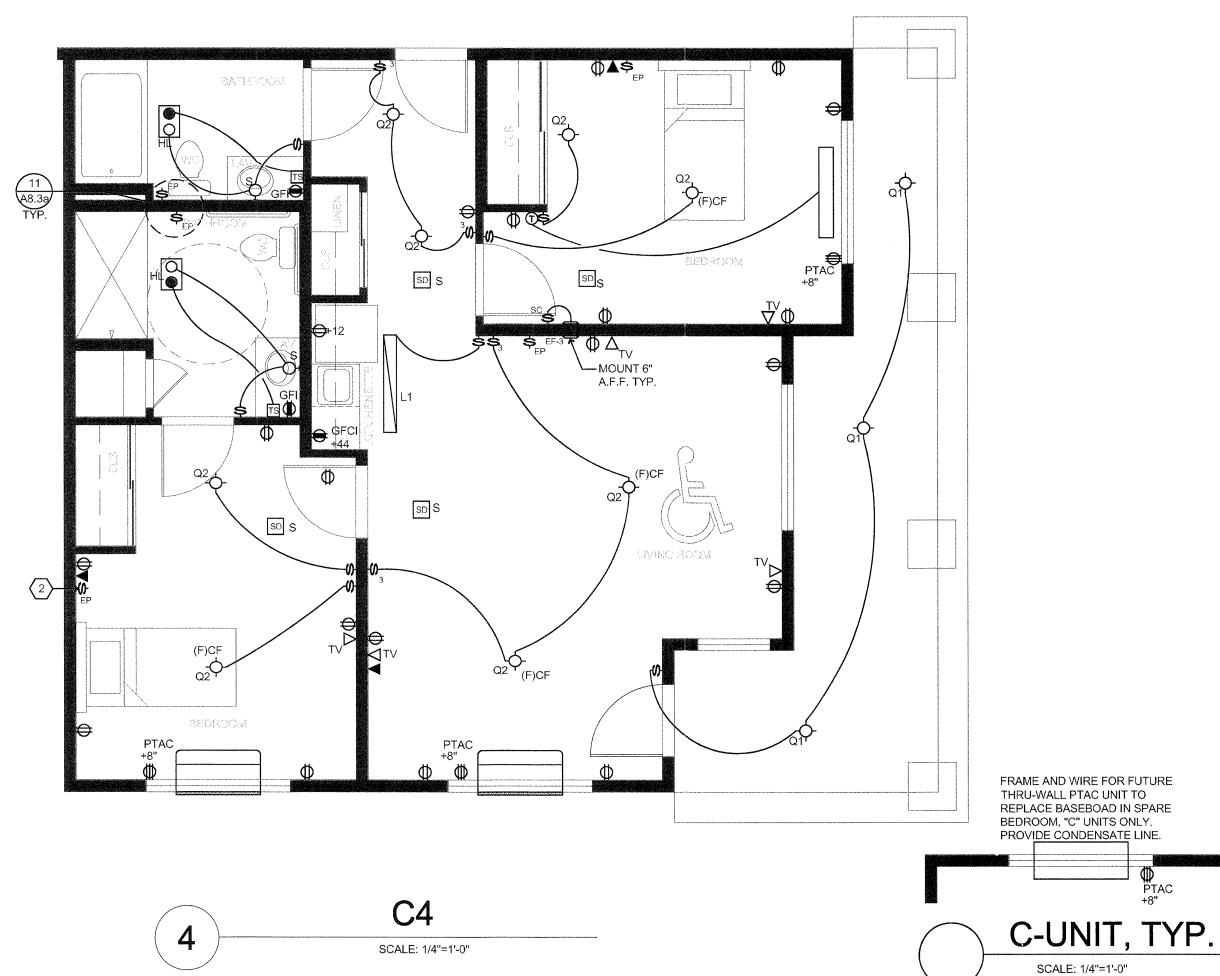

**GENERAL NOTES:** 

- 1. REFER TO 2/A8.3a FOR TYPICAL SUITE BATH LAYOUT. 2. FRAME AND WIRE FOR FUTURE PTAC RECEPTACLE ON
- RIGHT SIDE OF BASEBOARD LOCATION. TO REPLACE BASEBOARD IN "C" UNIT SPARE BEDROOMS.
- 3. REFER TO ELECTRICAL SCHEDULE NOTES /
- SPECIFICATIONS ON SHEET E2.1. 4. REFER TO ELECTRICAL DETAILS ON SHEET E2.2b.
- 5. INSTALL G.F.C.I. RECEPTACLE IN UNIT BATHROOMS AND AT BAR. RECEPTACLES WITHIN 6' OF SINK EDGE SHALL BE G.F.C.I PROTECTED. 6. FOR SUITE CIRCUITING SEE POWER SHEETS AND E2.3
- 7. PHONE JACKS IN OFFICE/MARKETING, MANAGER, CO-MANAGER SHALL BE DUPLEX. SEE SECTION 1.4,
- DWG. E4.1. EACH JACK SHOULD HOME RUN TO PHONE 8. INSTALL PTAC RECEPTACLE ON RIGHT SIDE OF UNIT,
- WITH IN 12" OF SLEEVE. 9. INTERCONNECT SUITE SMOKE DETECTORS. CIRCUIT SUITE SMOKE DETECTORS TO SUITE LIGHTING
- CIRCUIT. 10. SEE ELECTRICAL POWER SHEETS FOR BASEBOARD
- SIZING. 11. PROVIDE BLOCKING AND LISTED OUTLET BOX FOR THE INSTALLATION OF A FUTURE CEILING FAN AT THE LIGHTING LOCATIONS INDICATED WITH A "(F)CF" DESIGNATION.

## ELECTRICAL LEGEND

- \$3 THREE WAY SWITCH
- **\$**OC AUTOMATIC WALL SWITCH \$ EP WIRELESS EMERGENCY PULL SWITCH.
- COORDINATE LOCATION WITH TEL-TRON \$SC FAN SPEED CONTROL SWITCH
- RECEPTACLE
- 208 VOLT RECEPTACLE
- ARC FAULT BREAKER CIRCUIT (AFCI). SPLIT RECEPTACLE C/W 2 CCTS.
- RECEPTACLE AT COUNTER TV
- TELEPHONE THERMOSTAT
- SPECIAL CONNECTION
- CEILING FAN (CF-1) WITH LISTED BOX. SEE E2.1
  - LIGHTING SCHEDULE. INTERCONNECTED 120V COMBINATION SMOKE
- DETECTOR AND CARBON MONOXIDE ALARM INTERCONNECTED 120V COMBINATION SMOKE DETECTOR AND CARBON MONOXIDE ALARM
- "E" INDICATES WIRING TO EMERGENCY POWER.
- SEE MECH. EF-3 ROOM TO ROOM FAN

## PTAC UNIT

- (H) HEAT/ (L) LIGHT UNIT (SEE DETAIL 6/E2.2b, 7/A8.8 FOR FIXTURE PROTECTION)
- LIGHT FIXTURES. SEE LIGHTING SCHEUDLE ON E2.1 LIGHT FIXTURE WITH LISTED BOX FOR FUTURE CEILING FAN. SEE GENERAL NOTE 11.
- "EF-5" BY MECH (SEE M4.2)
- TS TIMER SWITCH (15 MIN. TURN-TYPE TIMER) D DATA PORT
- HEATER

GFCI / GFI GROUND FAULT CIRCUIT INTERRUPTER FLUORESCENT UNDER CABINET LIGHT.

## **KEYED NOTES**

- REPLACE TYPE "Q2" FIXTURE WITH TYPE "CF1" CEILING FA ON UPPER FLOOR VAULTED UNITS. SEE LIGHTING PLANS FOR LOCATION OF VAULTED UNITS. (SEE DETAIL 6,7/E5.1)
- PROVIDE JUNCTION BOX AT 48" A.F.F. FOR EMERGENCY PULL SWITCH AND (1) FPLR-SHEILDED 18-4 CABLE FROM BEDROOM SMOKE DETECTOR. RELAY TO J-BOX AT THIS LOCATION ONLY. ADDITIONAL LOCATIONS WILL BE SURFACE MOUNT.
- COORDINATE WITH MECHANICAL IF SUITE BATHROOM EXHAUST FAN WILL BE PROVIDED. IF NO FAN IS PROVIDED ELIMINATE SWITCH AND ELECTRICAL CONNECTION TO FAI

PORT
RETIREMENT
802 OCEAN AVE. POF

A SE A

DATE

8/28/2015 **REVISED DATE** 

SHEET

E5.10

**SUITE PLANS**