




A2


SCALE: 1/4"=1'-0"

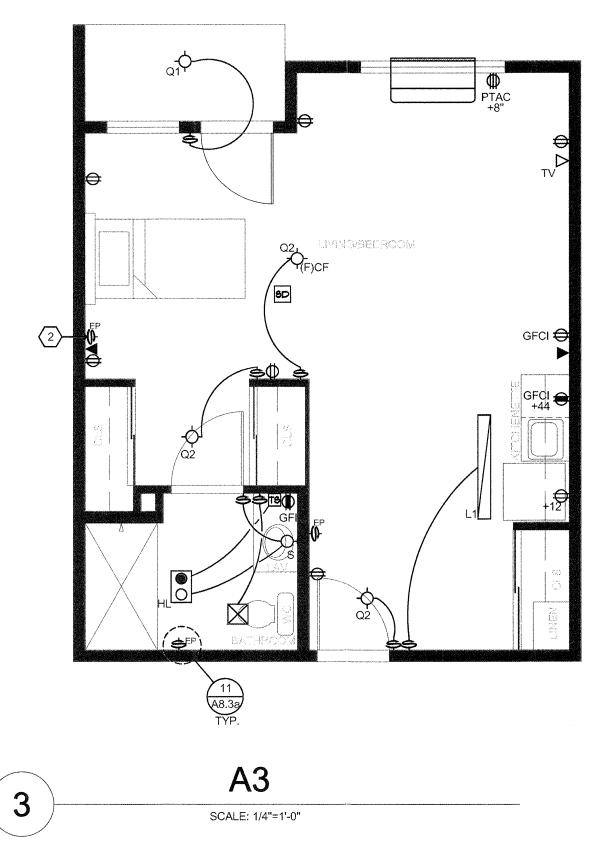

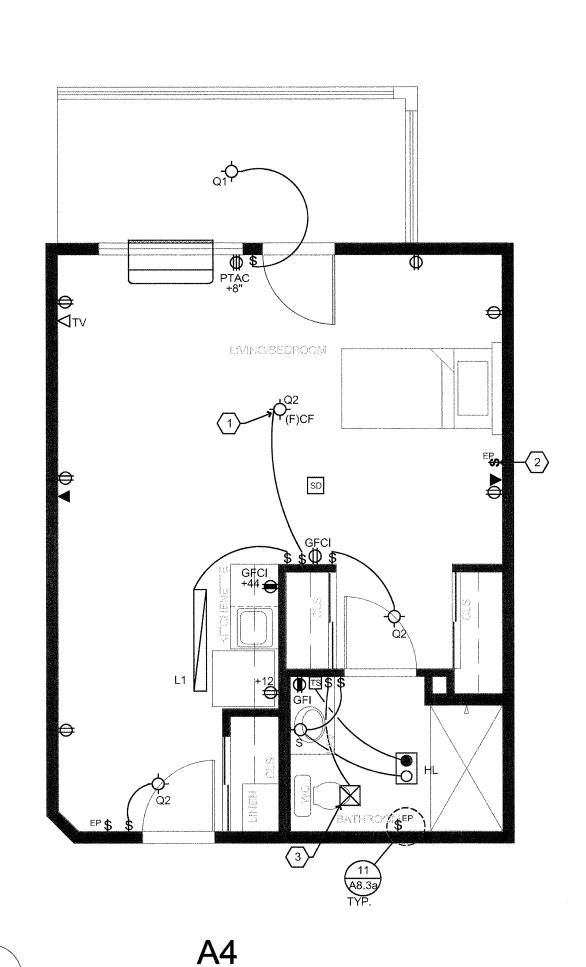


SCALE: 1/4"=1'-0"

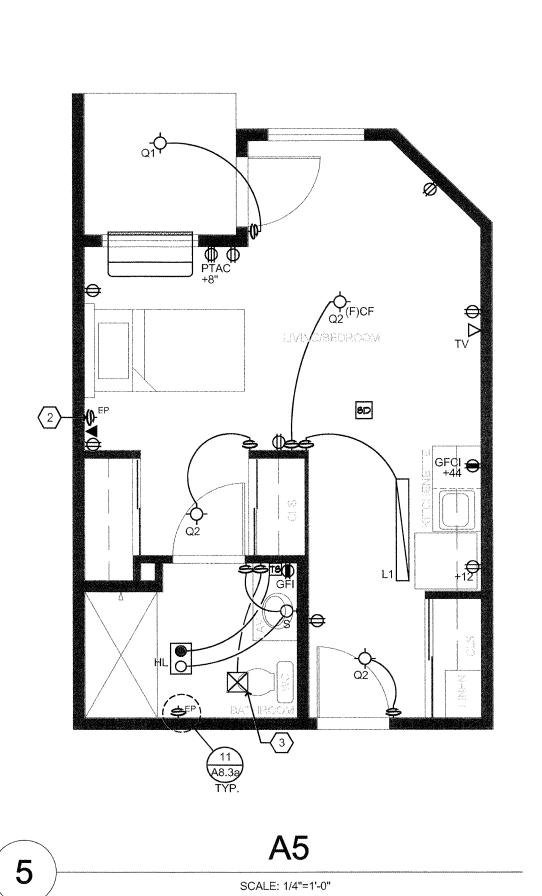

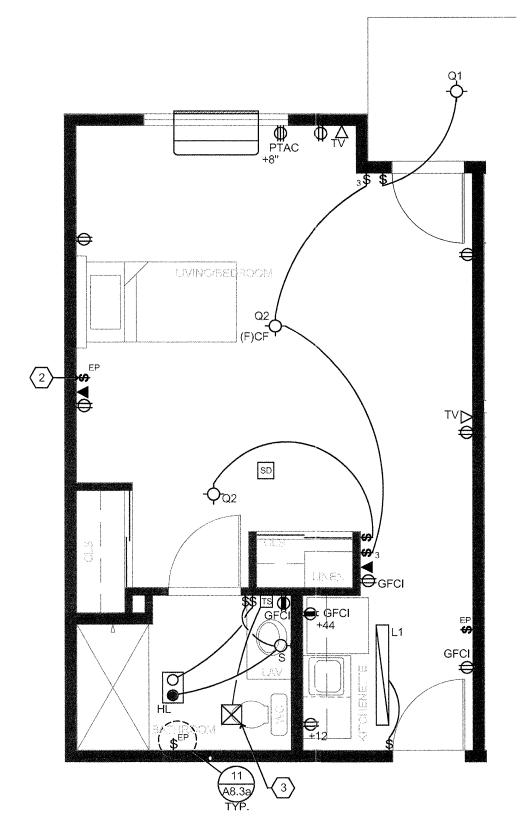

A6

SCALE: 1/4"=1'-0"

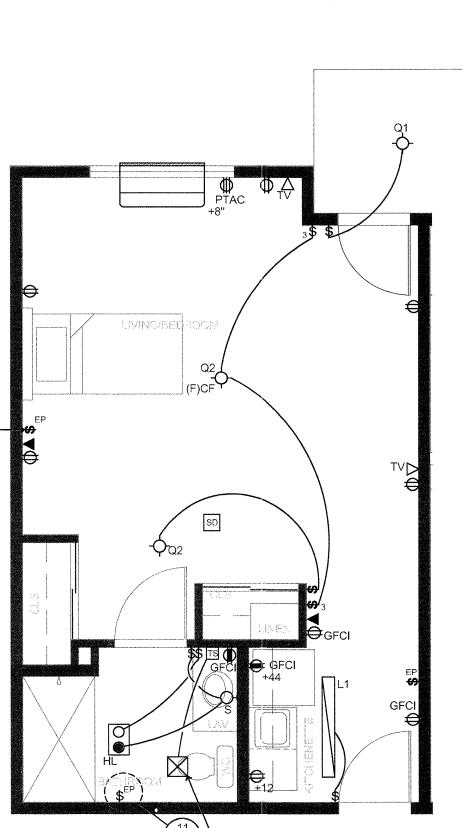

GENERAL NOTES:

- 1. REFER TO 2/A8.3a FOR TYPICAL SUITE BATH LAYOUT. 2. FRAME AND WIRE FOR FUTURE PTAC RECEPTACLE ON RIGHT SIDE OF BASEBOARD LOCATION. TO REPLACE
- BASEBOARD IN "C" UNIT SPARE BEDROOMS. 3. REFER TO ELECTRICAL SCHEDULE NOTES /
- SPECIFICATIONS ON SHEET E2.1. 4. REFER TO ELECTRICAL DETAILS ON SHEET E2.2b.
- 5. INSTALL G.F.C.I. RECEPTACLE IN UNIT BATHROOMS AND AT BAR. RECEPTACLES WITHIN 6' OF SINK EDGE SHALL BE G.F.C.I PROTECTED.
- 6. FOR SUITE CIRCUITING SEE POWER SHEETS AND E2.3
- 7. PHONE JACKS IN OFFICE/MARKETING, MANAGER, CO-MANAGER SHALL BE DUPLEX. SEE SECTION 1.4, DWG. E4.1. EACH JACK SHOULD HOME RUN TO PHONE
- 8. INSTALL PTAC RECEPTACLE ON RIGHT SIDE OF UNIT, WITH IN 12" OF SLEEVE.
- 9. INTERCONNECT SUITE SMOKE DETECTORS. CIRCUIT SUITE SMOKE DETECTORS TO SUITE LIGHTING
- CIRCUIT. 10. SEE ELECTRICAL POWER SHEETS FOR BASEBOARD
- 11. PROVIDE BLOCKING AND LISTED OUTLET BOX FOR THE INSTALLATION OF A FUTURE CEILING FAN AT THE LIGHTING LOCATIONS INDICATED WITH A "(F)CF" DESIGNATION.

ELECTRICAL LEGEND

- \$3 THREE WAY SWITCH
- ♦ OC AUTOMATIC WALL SWITCH \$ EP WIRELESS EMERGENCY PULL SWITCH.
- COORDINATE LOCATION WITH TEL-TRON DRAWINGS. \$ SC FAN SPEED CONTROL SWITCH
- RECEPTACLE 208 VOLT RECEPTACLE
- ARC-FAULT BREAKER CIRCUIT (AFCI). SPLIT RECEPTACLE C/W 2 CCTS.
- RECEPTACLE AT COUNTER TV TELEPHONE
- THERMOSTAT SPECIAL CONNECTION
- CEILING FAN (CF-1) WITH LISTED BOX. SEE E2.1
- LIGHTING SCHEDULE. INTERCONNECTED 120V COMBINATION SMOKE DETECTOR AND CARBON MONOXIDE ALARM
- INTERCONNECTED 120V COMBINATION SMOKE DETECTOR AND CARBON MONOXIDE ALARM
- "E" INDICATES WIRING TO EMERGENCY POWER.
- SEE MECH. EF-3 ROOM TO ROOM FAN
- (H) HEAT/ (L) LIGHT UNIT (SEE DETAIL 6/E2.2b, 7/Á8.8 FOR FIXTURE PROTECTION)
- LIGHT FIXTURES. SEE LIGHTING SCHEUDLE ON E2.1 LIGHT FIXTURE WITH LISTED BOX FOR FUTURE CEILING FAN. SEE GENERAL NOTE 11.
 - "EF-5" BY MECH (SEE M4.2)
 - TS TIMER SWITCH (15 MIN. TURN-TYPE TIMER)
 - D DATA PORT
- GFCI / GFI GROUND FAULT CIRCUIT INTERRUPTER FLUORESCENT UNDER CABINET LIGHT.

KEYED NOTES

_____ HEATER

- REPLACE TYPE "Q2" FIXTURE WITH TYPE "CF1" CEILING FA ON UPPER FLOOR VAULTED UNITS. SEE LIGHTING PLANS FOR LOCATION OF VAULTED UNITS. (SEE DETAIL 6,7/E5.1)
- PROVIDE JUNCTION BOX AT 48" A.F.F. FOR EMERGENCY PULL SWITCH AND (1) FPLR-SHEILDED 18-4 CABLE FROM BEDROOM SMOKE DETECTOR. RELAY TO J-BOX AT THIS LOCATION ONLY. ADDITIONAL LOCATIONS WILL BE SURFACE MOUNT.
- COORDINATE WITH MECHANICAL IF SUITE BATHROOM EXHAUST FAN WILL BE PROVIDED. IF NO FAN IS PROVIDED ELIMINATE SWITCH AND ELECTRICAL CONNECTION TO FAI

8/28/2015

REVISED DATE

SHEET E5.2

SUITE PLANS